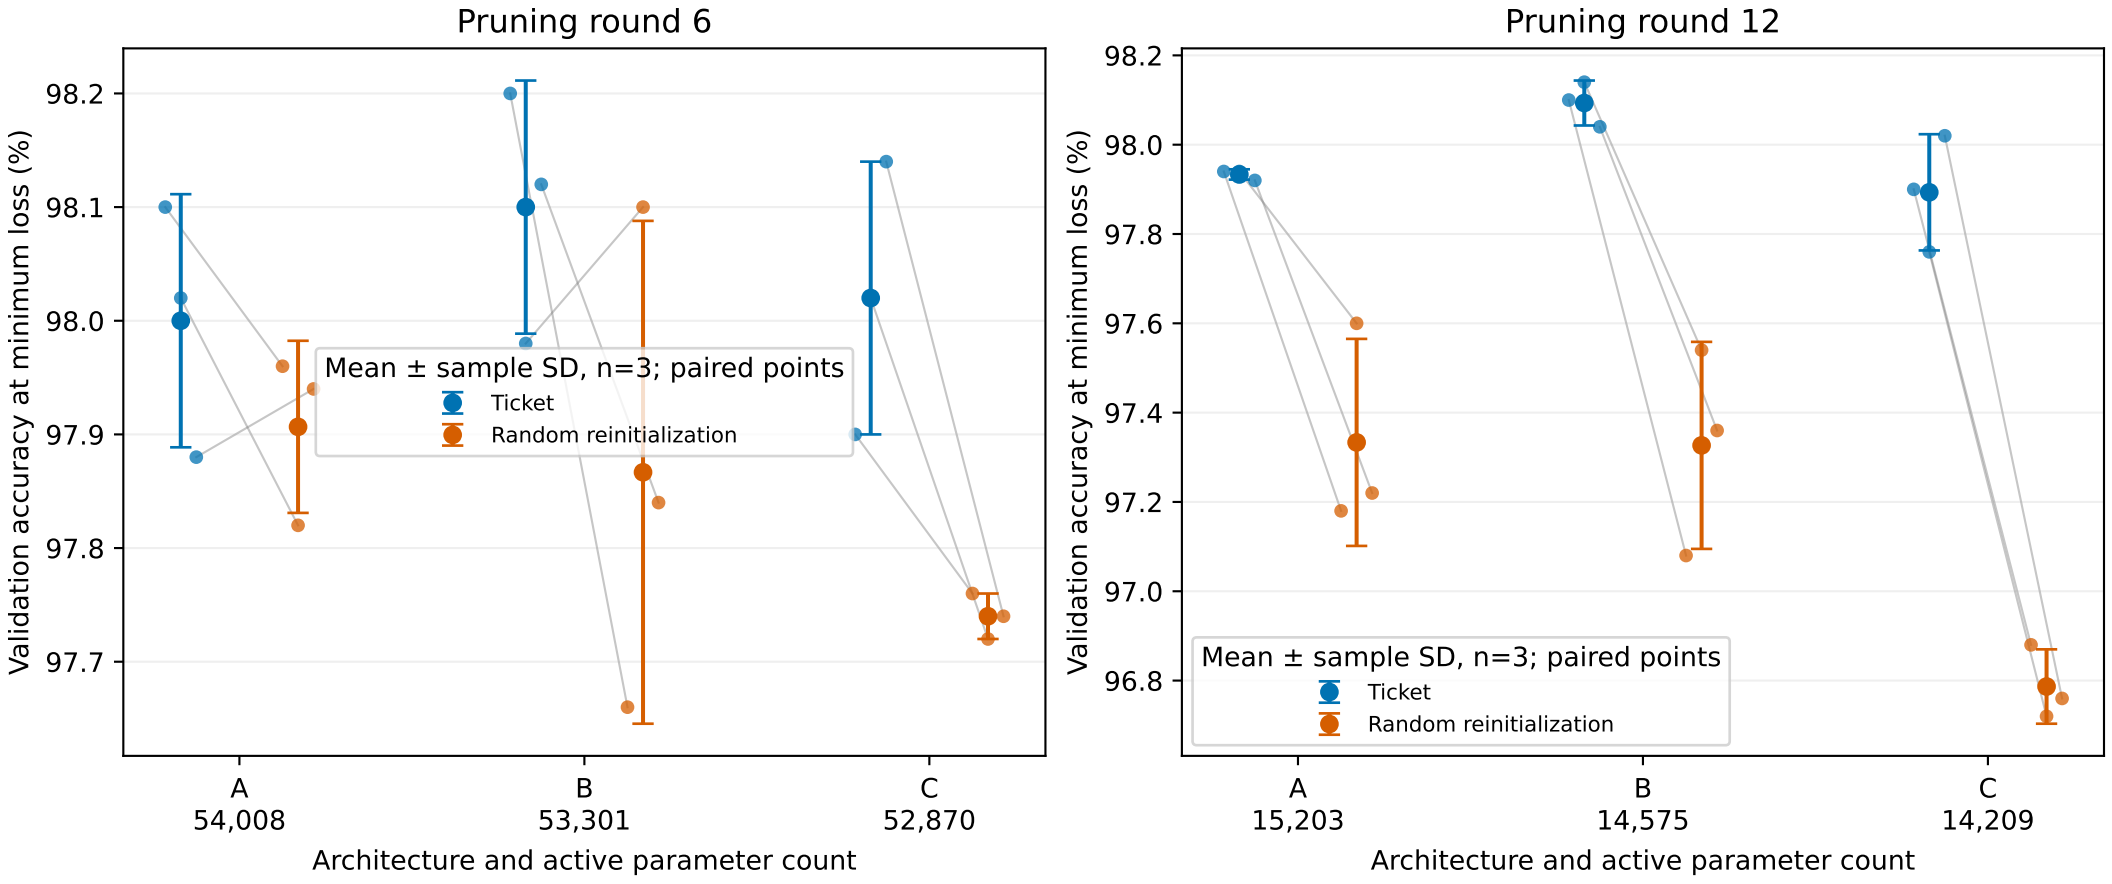
Pruning round 6
Validation accuracy at minimum loss (%)
98.2
98.1
98.0
97.9
97.8
97.7
Mean ± sample SD, n=3; paired points
Ticket
Random reinitialization
A
54,008
B
53,301
C
52,870
Architecture and active parameter count
Pruning round 12
Validation accuracy at minimum loss (%)
98.2
98.0
97.8
97.6
97.4
97.2
97.0
96.8
Mean ± sample SD, n=3; paired points
Ticket
Random reinitialization
A
15,203
B
14,575
C
14,209
Architecture and active parameter count