


APP CRS	Rwy Idg	<b>5700</b>
<b>016°</b>	TDZE	<b>56</b>
	Apt Elev	<b>56</b>

RNAV (RNP) Z RWY 2L  
JOHN WAYNE/ORANGE COUNTY (SNA)

<p><b>T</b> For uncompensated Baro-VNAV systems, procedure NA below 5°C (41°F) or above 54°C (130°F). GPS required.</p>	<p><b>MISSED APPROACH:</b> Climb to 800 then climbing left turn to 2600 direct SLI VORTAC and hold.</p>
---	---

D-ATIS <b>126.0</b>	SOCAL APP CON <b>121.3 263.1</b>	JOHN WAYNE TOWER ★ <b>126.8 (CTAF) 0 343.625</b>	GND CON <b>120.8</b>	CLNC DEL <b>118.0</b>	CPDLC	UNICOM <b>122.95</b>
------------------------	-------------------------------------	---	-------------------------	--------------------------	-------	-------------------------

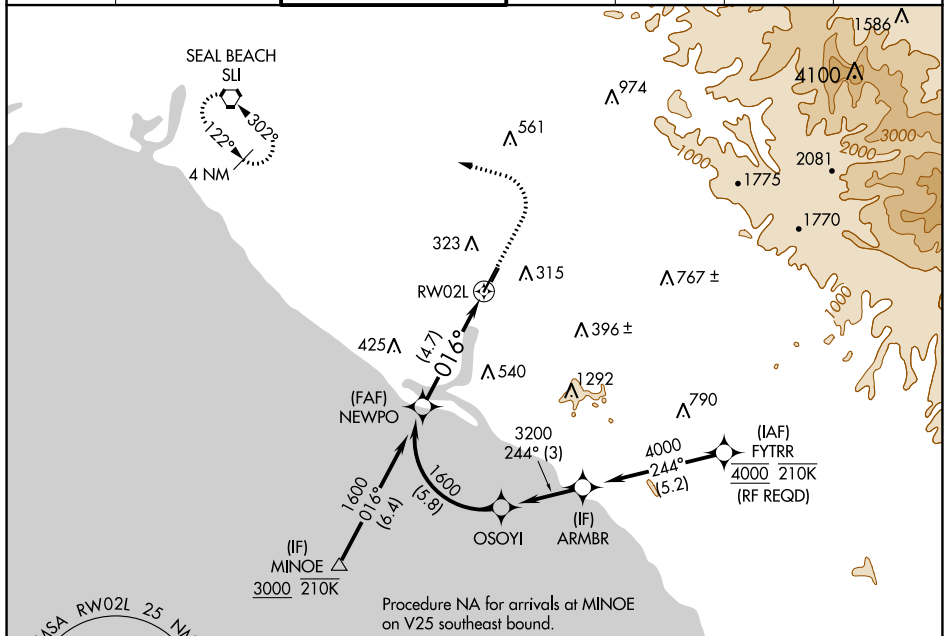

ELEV 56	<b>D</b>	TDZE 56
---------	----------	---------

