

APP CRS

Rwy Idg

11494

TDZE

640

Apt Elev

645

036°

RNAV (RNP) X RWY 4R

DETROIT METRO WAYNE COUNTY (DTW)


RNP AR APCH.

ALSF-2

MISSED APPROACH: Climb to 4000 direct LUPAY and hold.

For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.

D-ATIS	DETROIT APP CON	METRO TOWER	GND CON	CLNC DEL	CPDLC
133.675	124.05 284.0	128.125 317.725	121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)	120.65	

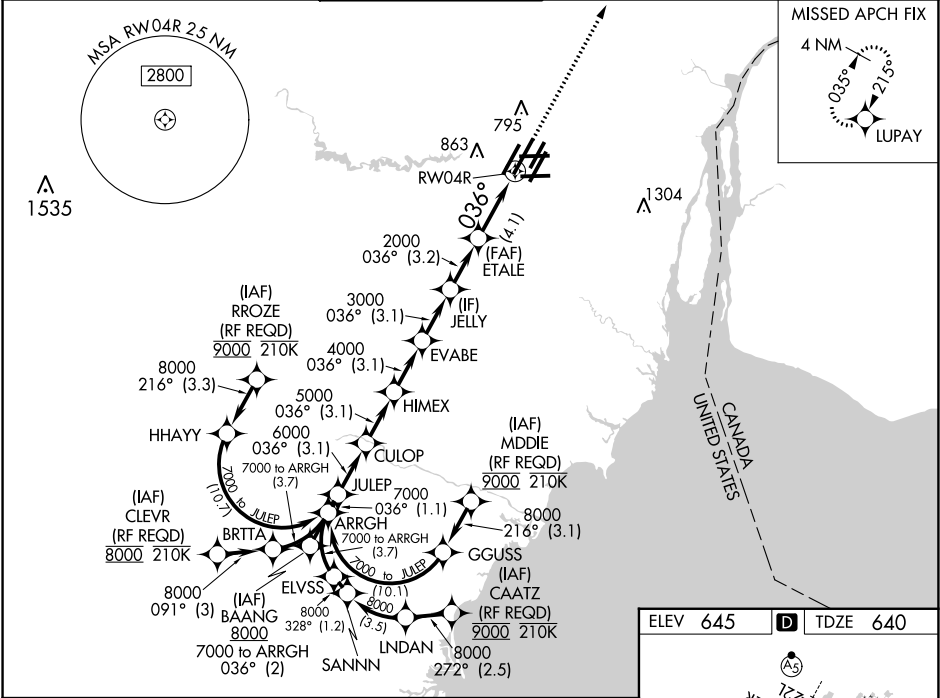

JULEP

7000

036°

CULOP

6000

HIMEX

5000

EVABE

4000

JELLY

3000

ETALE

2000

RW04R

GP 3.00°

TCH 52

3.1 NM

3.1 NM

3.1 NM

3.1 NM

3.2 NM

4.1 NM

CATEGORY

A

B

C

D

RNP 0.30 DA

1031/35

391 (400-5%)

AUTHORIZATION REQUIRED

ELEV 645

TDZE 640

TWR 877

3R

4L

4R

22R

21R

21L

27L

27R

31R

31L

35R

35L

36R

36L

37R

37L

38R

38L

39R

39L

40R

40L

41R

41L

42R

42L

43R

43L

44R

44L

45R

45L

46R

46L

47R

47L

48R

48L

49R

49L

50R

50L

51R

51L

52R

52L

53R

53L

54R

54L

55R

55L

56R

56L

57R

57L

58R

58L

59R

59L

60R

60L

61R

61L

62R

62L

63R

63L

64R

64L

65R

65L

66R

66L

67R

67L

68R

68L

69R

69L

70R

70L

71R

71L

72R

72L

73R

73L

74R

74L

75R

75L

76R

76L

77R

77L

78R

78L

79R

79L

80R

80L

81R

81L

82R

82L

83R

83L

84R

84L

85R

85L

86R

86L

87R

87L

88R

88L

89R

89L

90R

90L

91R

91L

92R

92L

93R

93L

94R

94L

95R

95L

96R

96L

97R

97L

98R

98L

99R

99L

100R

100L