

WAAS  
CH **65744**  
**W23A**

APP CRS  
**233°**

Rwy Idg **7543**  
TDZE **710**  
Apt Elev **716**

# RNAV (GPS) RWY 23

WILLOW RUN (YIP)

RNP APCH - GPS.

▼


▲

For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ¾ SM, LNAV Cats C/D visibility to 1 SM.


MALSR

MISSED APPROACH:  
Climb to 3000 direct  
ZAVEX and hold,  
continue climb-in-hold to 3000.

ATIS <b>127.425</b>	DETROIT APP CON <b>118.95 284.0</b>	WILLOW RUN TOWER <b>125.275 256.9</b>	GND CON <b>119.975</b>
------------------------	--	--	---------------------------

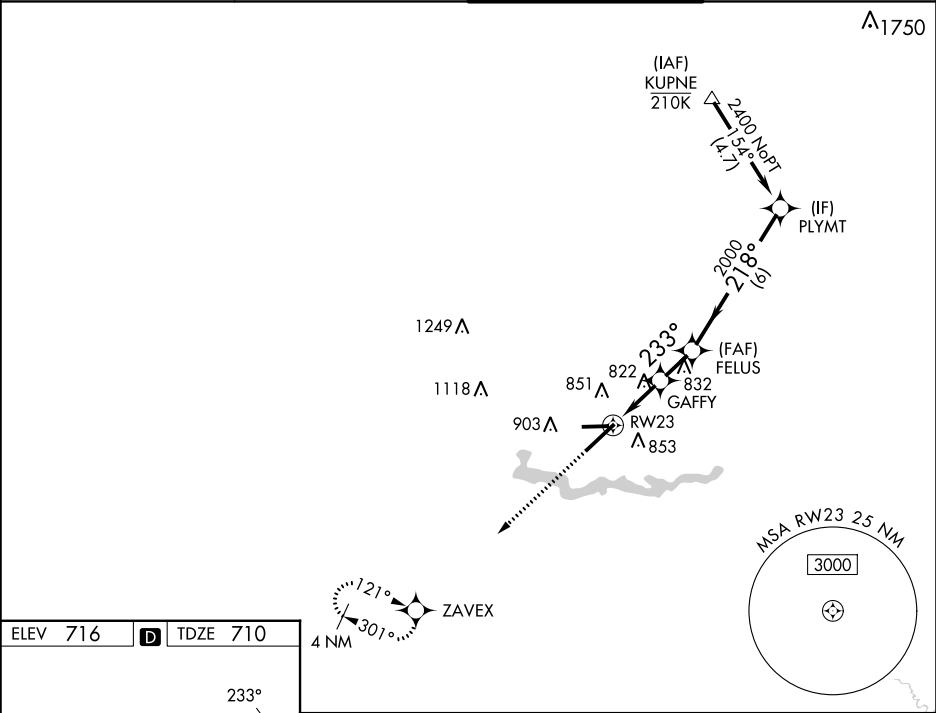

ELEV 716	<b>D</b>	TDZE 710
----------	----------	----------

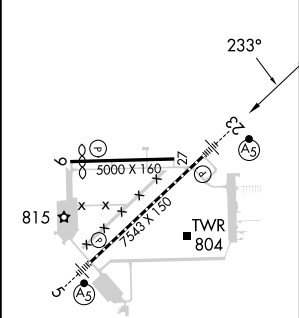

TDZ/CL Rwy 5  
HIRL Rwy 5-23  
MIRL Rwy 9-27

3000 ↑		ZAVEX ✦			
		GAFFY 2000		PLYMT 2400	
1 NM to RW23		FELUS 2000		218°	
RW23		233°		2000	
1 NM		1.3 NM		1.6 NM	
		1500		GP 3.00° TCH 57	
		6 NM			
CATEGORY	A		B	C	D
LPV DA	910-½		200 (200-½)		
LNAV/ VNAV DA	982-½		272 (300-½)		
LNAV MDA	1080-½ 370 (400-½)		1080-⅝ 370 (400-⅝)		
<b>C</b> CIRCLING	1220-1 504 (600-1)		1220-1½ 504 (600-1½)		1400-2¼ 684 (700-2¼)