



OVERVIEW


The purpose of this document is to provide instructions on how to identify and resolve pending acceptance recalls by reviewing related requisitions or purchase orders and completing the required actions to accurately update their status.

Audience

- Recall Managers

Process for Managing Pending Acceptance Recalls

- From Sinai Cloud Landing Page, Click **Supply Chain Execution**.
- Then click **Recall Notices**.

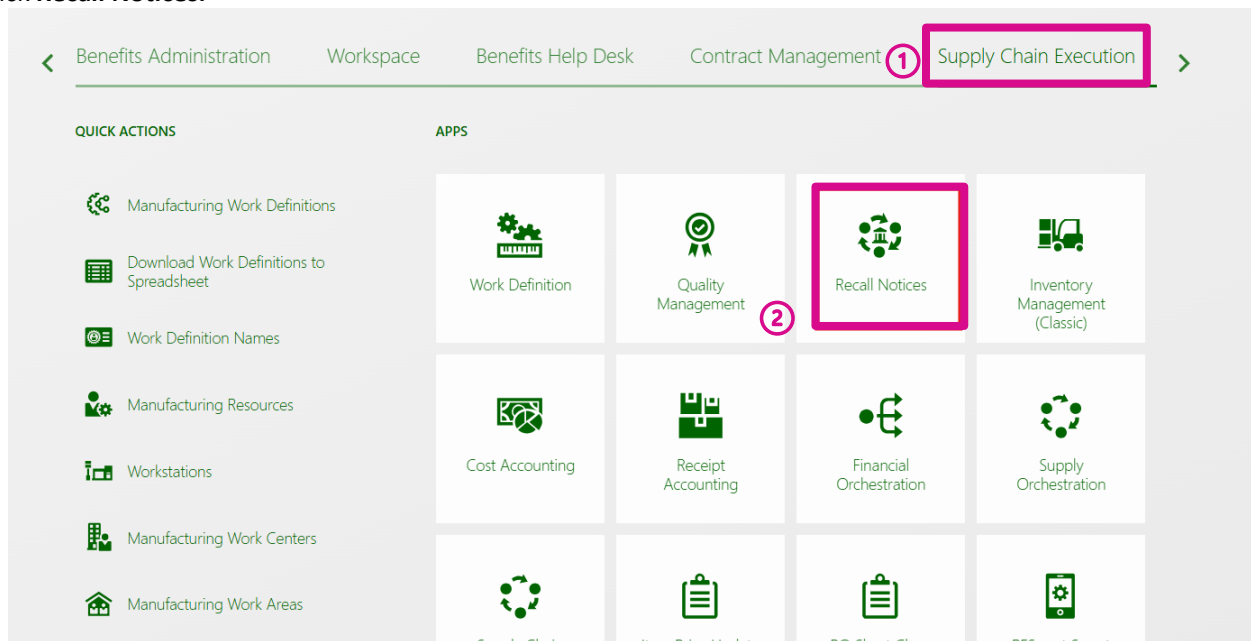

On the recall notices dashboard


On the top of the dashboard, locate the **Pending Acceptance** tab which shows the total number of recall notices currently awaiting action.

- Locate the **Recall Notice**
- In the Recall notice list, find the recall notice you want to work on.
- Use the recall number
- Check the Status
- Verify that the status is Pending Acceptance


- Click the **Review** button

Sinai Cloud


Pending Acceptance Recalls: End-to-End Process

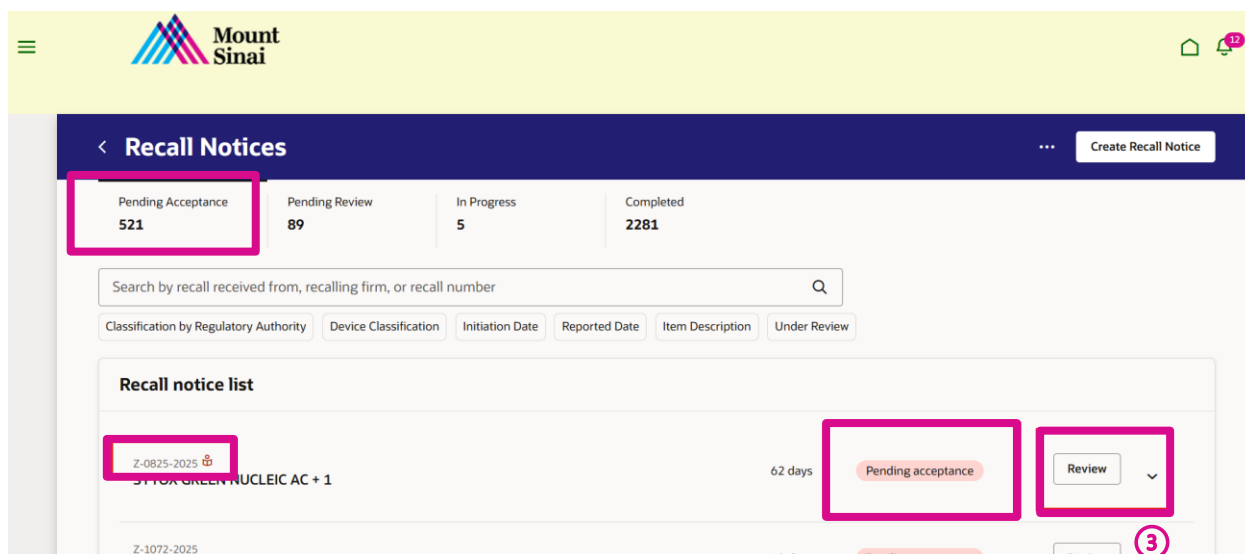

Scroll to the bottom to check whether the system has identified an 'Exact Match', 'Probable Match', or 'No Match'. If it shows an 'Exact Match', also verify whether any inventory transactions, open POs, or related records have been found.

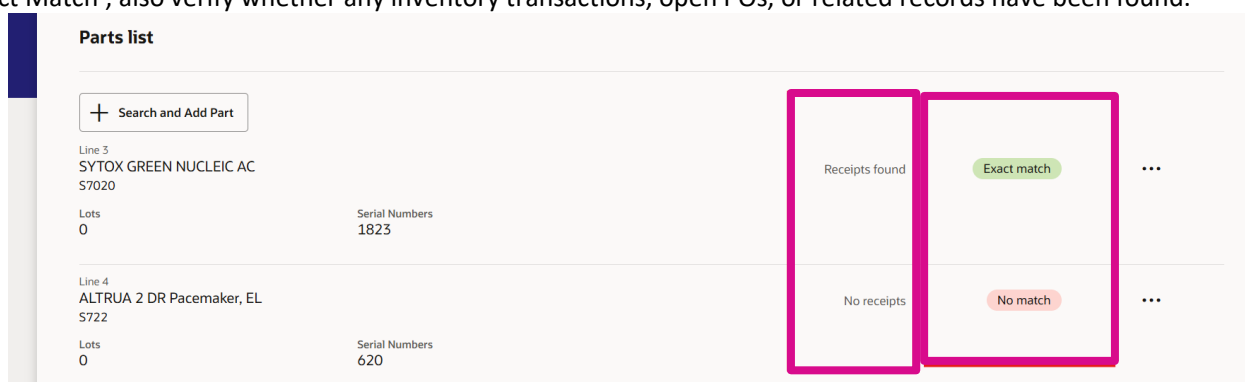

For any lines marked as 'No Match':
The line can either be **withdrawn** or **revalidated**.
4. To proceed, click **3 dots**, then select **Edit Part**.

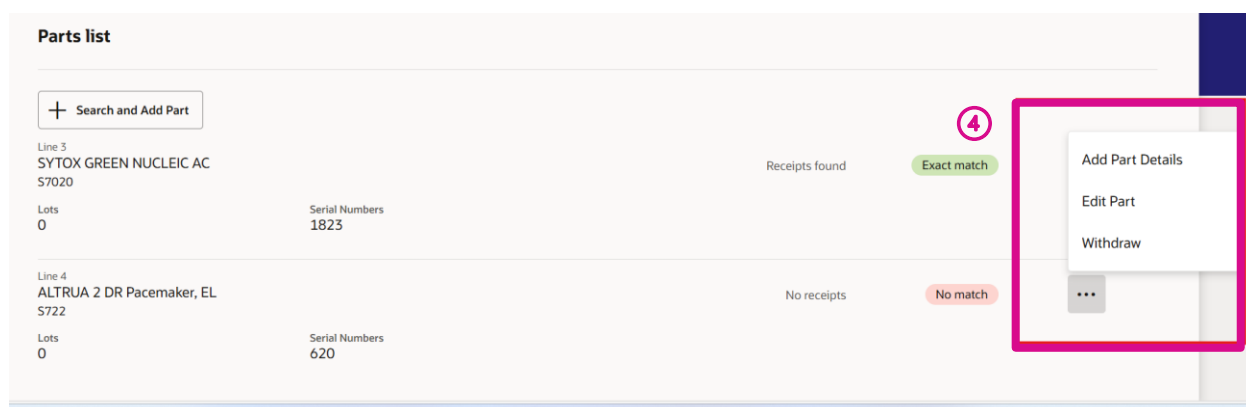

5. Click on **Find Part**



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

S722

Part Number S722	GTIN	Device Identifier 00802526559372, 00802526576515	Model S722
Brand Name ALTRUA 2 DR Pacemaker		Part Description ALTRUA 2 DR Pacemaker, EL	

5 Find Part

Add parts to your recall notice.
Search for parts and add them to the recall notice.

Cancel Update

6. No matches found, click **Cancel** go back to the Part list.

S722

Part Number S722	GTIN	Device Identifier 00802526559372, 00802526576515	Model S722
Brand Name ALTRUA 2 DR Pacemaker		Part Description ALTRUA 2 DR Pacemaker, EL	

Find Part

We couldn't find any matches.
Verify if the attributes in the search criteria are defined as item extensible flex fields and the key item indexes are enabled. Also check if the item relationships are defined and try again.

6 Cancel Update

7. Click the three dots and select **"Withdraw"** to remove the line.



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

Parts list

+ Search and Add Part

Line 3 SYTOX GREEN NUCLEIC AC S7020	Serial Numbers 1823	Receipts found Exact match	6 Add Part Details Edit Part Withdraw ...
Line 4 ALTRUA 2 DR Pacemaker, EL S722	Serial Numbers 620	No receipts No match	

8. Provide a withdrawal reason code and any relevant comments.
9. Click **Withdraw**

Parent page

Recall Notice Z-0825-2025 Pending acceptance

Review and accept the curated recall content

You should assume all results are unvalidated and review the content before accepting. Don't rely on the curation service to make decisions regarding

Product Recall Notice
Curated recall JSON
425.44 KB
Last updated by raviteja.sangaraju@mountsinai.org or

Parts list

+ Search and Add Part

Line 3 SYTOX GREEN NUCLEIC AC S7020	Serial Numbers 1823	Receipts found
Line 4 ALTRUA 2 DR Pacemaker, EL S722	Serial Numbers 620	No receipts

8

Withdraw Line: 4

Reason Code
Item not relevant

Comments

9

Cancel

Withdraw

10. Click **Accept** to accept the Recall Notice.



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

Parent page 10 Accept

Recall Notice Z-0825-2025 Pending acceptance

Review and accept the curated recall content ×

You should assume all results are unvalidated and review the content before accepting. Don't rely on the curation service to make decisions regarding medical care.

Product Recall Notice
Curated recall JSON
425.44 KB

Last updated by raviteja.sangaraju@mountsinai.org on 11/20/2025

Parts list

Line 3	SYTOX GREEN NUCLEIC AC S7020	Receipts found	Exact match	...
Lots	0	Serial Numbers	1823	
Line 4	ALTRUA 2 DR Pacemaker, EL S722	No receipts	Withdrawn	...
Lots	0	Serial Numbers	620	

After clicking “Accept,” the system will publish the notice and automatically check for any duplicates.

Recall Notice Z-0825-2025 Pending acceptance

Review and accept the curated recall content

You should assume all results are unvalidated and review the content before accepting. Don't rely on the curation service to make decisions regarding medical care.

Product Recall Notice
Curated recall JSON
425.44 KB

Last updated by raviteja.sangaraju@mountsinai.org on 11/20/2025

Parts list

Publishing Notice
(

Line 3	SYTOX GREEN NUCLEIC AC S7020	Receipts found	Exact match	...
Lots	0	Serial Numbers	1823	
Line 4	ALTRUA 2 DR Pacemaker, EL S722	No receipts	Withdrawn	...
Lots	0	Serial Numbers	620	

Retain the Notice

After the system checks for duplicates, if no potential duplicates are found, you can choose to retain the current recall notice.

1. Click Retain button.



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

Parent page

Review Duplicates for Z-0825-2025

Initiated On 12/12/2024 Recalling Firm Boston Scientific Corporation 2 Lines

Potential duplicates

We couldn't find any potential duplicates.
Retain the current recall notice.

View Recall Notice Retain

The recall notice will **change its status to "Open."**

Mount Sinai

Notice Z-0825-2025 Open

View Notice Withdraw Notice

Locate the lines for this notice

Specify a date range

Transaction Start Date 12/3/2024

Transaction End Date 1/22/2026

Locate

Boston Scientific Corporation

Recall Reason

A subset of devices from the ACCOLADE Family of Pacemakers and CRT-PS, built before September 2018, have an increased potential to initiate Safety Mode during telemetry or other normal, higher-power operations due to latent high battery impedance.

Creation Date 1/22/2026

Recall Notice Number 4001

Recall Notification Received From U.S. FOOD & DRUG ADMINISTRATION

In the dashboard, the item will be listed under **'In Progress'** recalls.

2. Click on **Locate** after opening the Recall Notice



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

Status	Classification by Regulatory Authority	Device Classification	Initiation Date	Reported Date	Item Description
Pending Acceptance	Pending Review	In Progress	Completed		
520	89	6	2281		

Recall notice list				
Z-0579-2025 DUODENOSCOPE FLEXIBLE 15D BACKWARD COVER DISTAL END FLUSH ADAPTER HIGH FORCE TRA...	35 days	Open	View Progress	
MMS-23-4876-FA CATHETER IV ODS FR L135 CM 2 LUMEN GUIDEWIRE POWERPICC .018 IN POLYURETHANE NITI...	35 days	Draft	Edit Notice	
Z-0827-2025 PACEMAKER VISIONIST X4 CRT P IS-1/IS-4 + 2	17 days	In progress	View Progress	
Z-1067-2025 GENERATOR VNS THERAPY SENTIVA 1000	15 days	In progress	View Progress	
Z-0964-2026 CATHETER GUIDING NONSTERILE LATEX FREE + 1	10 days	In progress	View Progress	
Z-0825-2025 SYTOX GREEN NUCLEIC AC	0 days	Open	Locate	2

You may optionally adjust the time fence to increase or decrease the search period as needed.

3. Click **'Locate'** to initiate the system search for relevant data within the specified time fence.

The system will search for any On-Hand items, Transactions, Open POs, etc., within the last 1,100 days, based on the date range defined by **'Transaction Start Date'** and **'Transaction End Date'**.

< Notice Z-0825-2025 Open View Notice Withdraw Notice

Reported On 1/10/2025 Initiated On 12/12/2024 Class I

▲ Locate the lines for this notice

Specify a date range

Transaction Start Date 12/3/2024 Transaction End Date 1/22/2026 Locate

Boston Scientific Corporation

Recall Reason
A subset of devices from the ACCOLADE Family of Pacemakers and CRT-Ps, built before September 2018, have an increased potential to initiate Safety Mode during telemetry or other normal, higher-power operations due to latent high battery impedance.

Creation Date 1/22/2026 Recall Notice Number 4001 Recall Notification Received From U.S. FOOD & DRUG ADMINISTRATION

Distribution Start Date - Distribution End Date - Mode of Capture Oracle curation service

Lines

4. After a few seconds, click **Refresh** to update and view the results.

< Notice Z-0825-2025

Open

View Notice

Reported On 1/10/2025Initiated On 12/12/2024Class I

Locating items for transaction received between 12/3/2024 - 1/22/2026
This may take some time. Refresh to know if the process is complete.

Refresh

Boston Scientific Corporation

Recall Reason
A subset of devices from the ACCOLADE Family of Pacemakers and CRT-Ps, built before September 2018, have an increased potential to initiate Safety Mode during telemetry or other normal, higher-power operations due to latent high battery impedance.

Creation Date1/22/2026Recall Notice Number4001Recall Notification Received FromU.S. FOOD & DRUG ADMINISTRATION
Distribution Start Date-Distribution End Date-Mode of CaptureOracle curation service

Lines

After the Locate process finishes, the system will automatically generate tasks for the corresponding lines.

Locate complete

Boston Scientific Corporation

Recall Reason
A subset of devices from the ACCOLADE Family of Pacemakers and CRT-Ps, built before September 2018, have an increased potential to initiate Safety Mode during telemetry or other normal, higher-power operations due to latent high battery impedance.

Creation Date1/22/2026Recall Notice Number4001Recall Notification Received FromU.S. FOOD & DRUG ADMINISTRATION
Transaction Start Date12/3/2024Transaction End Date1/22/2026Mode of CaptureOracle curation service

LinesTasksLocations

11-

Lines of 2 foundLine in progressLines complete


Search

LineStatusItemManufacturer Part NumberSupplier Item NumberItem Category

1In progressSYTOX GREEN NUCLEIC AC-57020CHEMICALS - 903010

...

5. Click on the **Tasks** tab to review the created tasks.
In this example, the system generated three separate tasks for a single line.

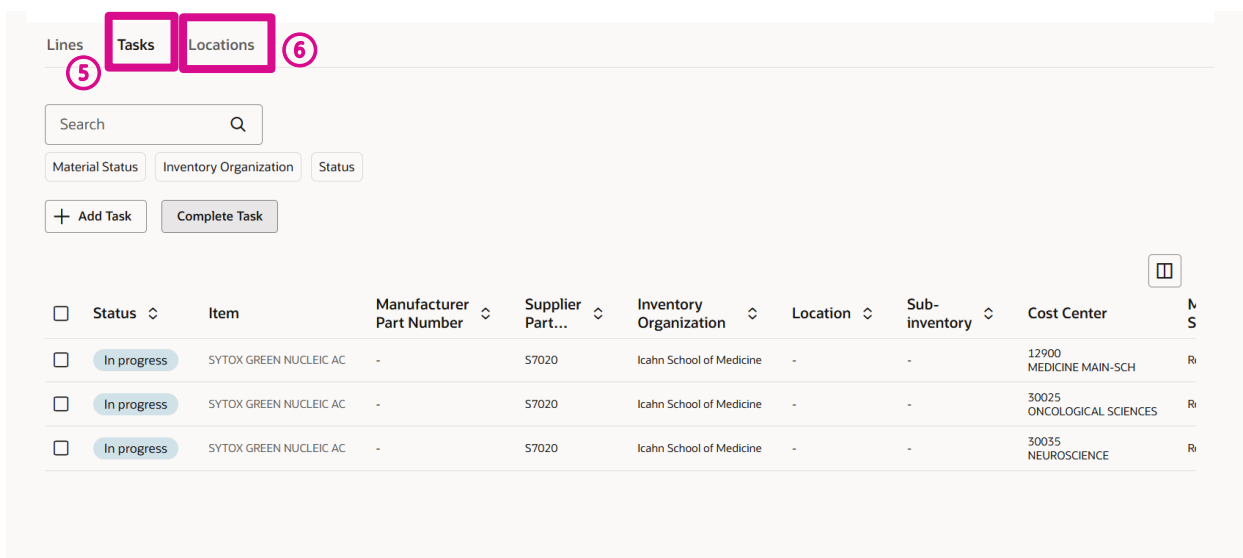

Lines

Tasks Locations 6

5

Search


Material Status Inventory Organization Status

+ Add Task Complete Task

Status	Item	Manufacturer Part Number	Supplier Part...	Inventory Organization	Location	Sub-inventory	Cost Center	M S
In progress	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-	-	12900 MEDICINE MAIN-SCH	Ri
In progress	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-	-	30025 ONCOLOGICAL SCIENCES	Ri
In progress	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-	-	30035 NEUROSCIENCE	Ri

6. Click on the **Locations Tab**

- In this example, **five lines** have been created against the three tasks.
- These lines are based on the **Traceability Status** (Expense in this case).
- Refer to the [Cheat Sheet](#) for details on each status and the expected actions.

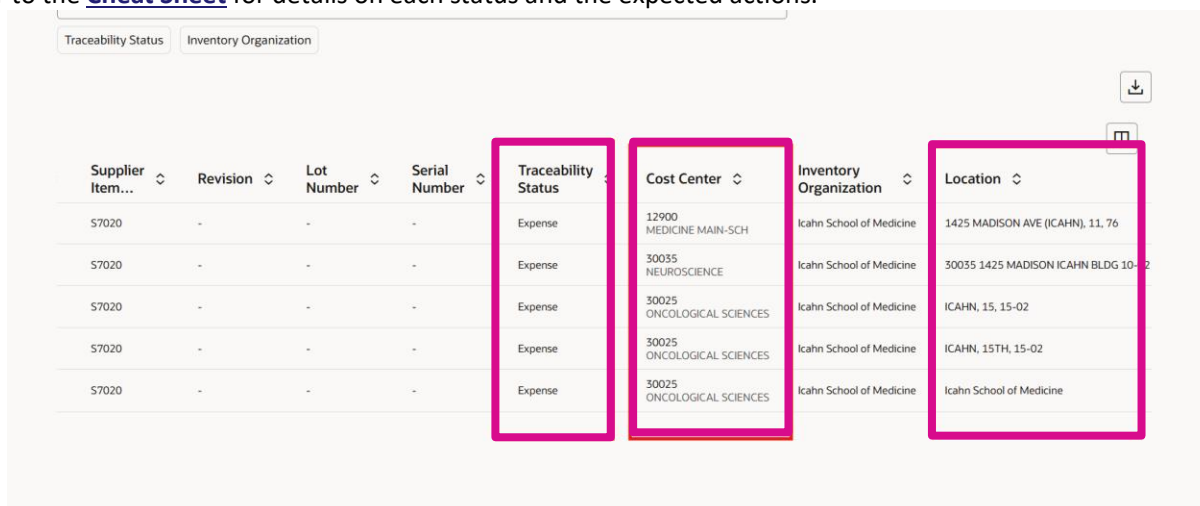

Traceability Status Inventory Organization

Supplier Item...	Revision	Lot Number	Serial Number	Traceability Status	Cost Center	Inventory Organization	Location
S7020	-	-	-	Expense	12900 MEDICINE MAIN-SCH	Icahn School of Medicine	1425 MADISON AVE (ICAHN), 11, 76
S7020	-	-	-	Expense	30035 NEUROSCIENCE	Icahn School of Medicine	30035 1425 MADISON ICAHN BLDG 10-12
S7020	-	-	-	Expense	30025 ONCOLOGICAL SCIENCES	Icahn School of Medicine	ICAHN, 15, 15-02
S7020	-	-	-	Expense	30025 ONCOLOGICAL SCIENCES	Icahn School of Medicine	ICAHN, 15TH, 15-02
S7020	-	-	-	Expense	30025 ONCOLOGICAL SCIENCES	Icahn School of Medicine	Icahn School of Medicine

Once the Track and Trace process is complete, the status of the recall notice updates from 'Open' to 'In Progress'



Z-0825-2025
SYTOX GREEN NUCLEIC AC

0 days

In progress View Progress

7. Upon completion of all tasks, typically performed by department managers, the **Recall Manager** may select all tasks.
8. Click **Complete** to close all tasks at once.



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

1/22/2026 4001 U.S. FOOD
Transaction Start Date 12/3/2024 Transaction End Date 1/22/2026 Mode of Capt Oracle cur

Lines Tasks Locations

Search

Material Status Inventory Organization Status

3 selected + Add Task Complete Task

7

☒	Status	Item	Manufacturer Part Number	Supplier Part...	Inventory Organization	Location
☒	In progress	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-
☒	In progress	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-
☒	In progress	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-

Complete task

Reason Code Destroy

Disposition Quantity

Comments

8

Cancel Complete

After completion of all tasks, the Recall Notice status automatically changes to 'Pending Closure'

< Notice Z-0825-2025 Pending closure View Notice Close Recall Notice

Reported On 1/10/2025 Initiated On 12/22/2024 Class I

Lines Tasks Locations

Search

Material Status Inventory Organization Status

+ Add Task Complete Task

☐	Status	Item	Manufacturer Part Number	Supplier Part...	Inventory Organization	Location	Sub-inventory	Cost Center	N S
☐	Completed	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-	-	12900 MEDICINE MAIN-SCH	Rt
☐	Completed	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-	-	30025 ONCOLOGICAL SCIENCES	Rt
☐	Completed	SYTOX GREEN NUCLEIC AC	-	S7020	Icahn School of Medicine	-	-	30035 NEUROSCIENCE	Rt

Once all tasks are completed, the status of the Recall Notice is updated to 'Pending Closure'.

The Recall Notice will remain in this status for **30 days**. During this period, if any transactions occur for items associated with the Recall Notice, the system will automatically reopen it.

Alternatively, the **Recall Manager** may choose to manually close the Recall Notice at any time.

9. If manually closing, click **Close Recall Notice**.



Sinai Cloud

Pending Acceptance Recalls: End-to-End Process

< Notice Z-0825-2025 Pending closure

View Notice

Close Recall Notice

Reported On 1/10/2025 Initiated On 12/12/2024 Class I

9

Lines Tasks Locations

Search

Material Status Inventory Organization Status