


GFP-29 HSRC maintenance intervals

[siemens-energy.com](https://www.siemens-energy.com)

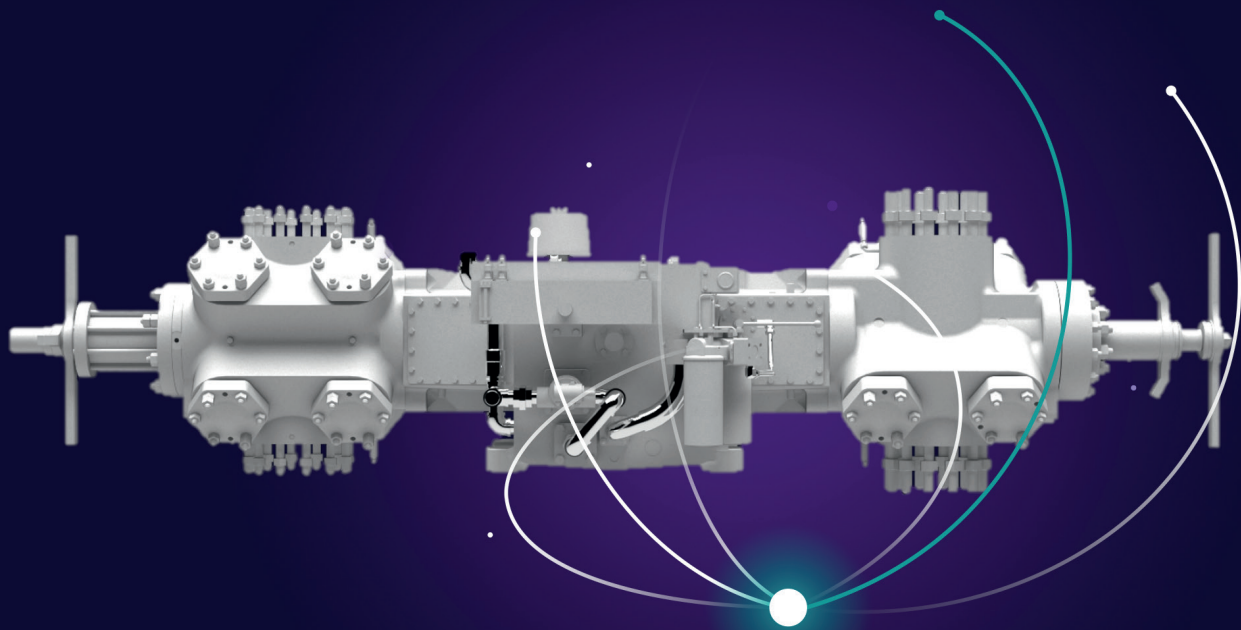

Item	Frequency						
	Daily	1st Week	Monthly	3/9 Months	6 Months	1 Year	4-6 Years
Frame Oil	●	●	●◇	●◇	●◇	●◇	●◇
Cylinder Lubricator Oil	●	●	●	●	●■	●■	●■
Operating Speed	○	○	○	○	○	○	
Gas Temperatures	○	○	○	○	○	○	
Bearing Temperatures	○	○	○	○	○	○	
Compressor Frame Main Oil Pressure	○	○	○	○	○	○	
Compressor Frame Oil Temperature	○	○	○	○	○	○	
Valve Cover Temperatures	○	○	○	○	○	○	
Coolant Temperatures	○	○	○	○	○	○	
Gauge Pressures	○	○	○	○	○	○	
Frame Oil Filter Differential Pressure	○	○	○	○	○	○	
Packing Case Vent Temperature	○	○	○	○	○	○	
Divider Block Cycle Time	●	●	●	●	●		
Separator Levels	●	●	●	●	●		
Distance Piece Vent Leakage	●	●	●	●	●		
Loose Fasteners, Supports, Tubing	⊙	⊙	⊙	⊙	⊙		
Gas/Oil/Coolant Leaks	⊙	⊙	⊙	⊙	⊙		
Gasketed Joint Fastener Torque		●			●		
Cylinder to Frame Fastener Torque		●					
Piston Rod Runout		●			●	●	●
Cylinder Bore Oil Film		●			●	●	●
Loaded Joints During Operation		⊙	⊙	⊙	⊙	⊙	⊙
Pressure and Scraper Packing Leakage		●	●	●	●	●	●
Safety Shutdown Operation			●	●	●	●	●
Loading/Unloading Device Operation				●	●	●	●
VVCP Packing Grease				⊙	⊙	⊙	⊙
Frame Crankcase Breather				⊙	⊙	⊙	⊙
Separator Site Glass				△	△	△	△
Compressor & Driver Foundation Bolt Torque				●	●	●	●
Driver to Compressor Coupling					⊙	⊙◇	⊙◇
Crankshaft Thrust						●	●
Cylinder Lubricator Oil Filter					■	■	■
Inlet Vessel Mesh Screens					⊙	⊙	⊙
Piston Rod and Piston		⊙			⊙	⊙	⊙
Piston Rings					⊙	⊙	⊙
Running Gear Clearances						○	○
Oil Cooler or Heat Exchanger						△	△
Pressure Gauge Accuracy						●	●
Cylinder Bore Condition						⊙	⊙
Safety Valve Accuracy						◆	◆
Separators, Bottles, Dampers						⊙△	⊙△
Packing and Scraper Cases						⊙	⊙□
Cylinder Lubricator Box Internals						⊙	⊙
Cylinder Gas Passages						⊙	⊙
Inlet and Discharge Valves						●△	□
Cylinder Lubricator Pumps						●	●■
Divider Blocks						●	●■
Crosshead Bushing							■
Connecting Rod Bushing							■
Connecting Rod Bearings							■
Main Bearings							■
Frame Oil Pump							□
Seals/Gaskets/Orings							■

Log Data	○	Analyze Properties	◇
Verify/Check Functionality	●	Calibrate	◆
Inspect Condition	⊙	Align	◇
Rebuild Component	□	Clean	△
Replace Component	■		

Siemens Energy Global GmbH & Co. KG
Transformation of Industry
Siemens promenade 9
91058 Erlangen, Germany

For the U.S. published by
Siemens Energy, Inc.
4400 N Alafaya Trail
Orlando, FL 32826, USA

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract. All product designations may be trademarks or product names of Siemens Energy Global GmbH & Co. KG or other companies whose use by third parties for their own purposes could violate the rights of the owner.

Siemens Energy is a trademark licensed by Siemens AG.