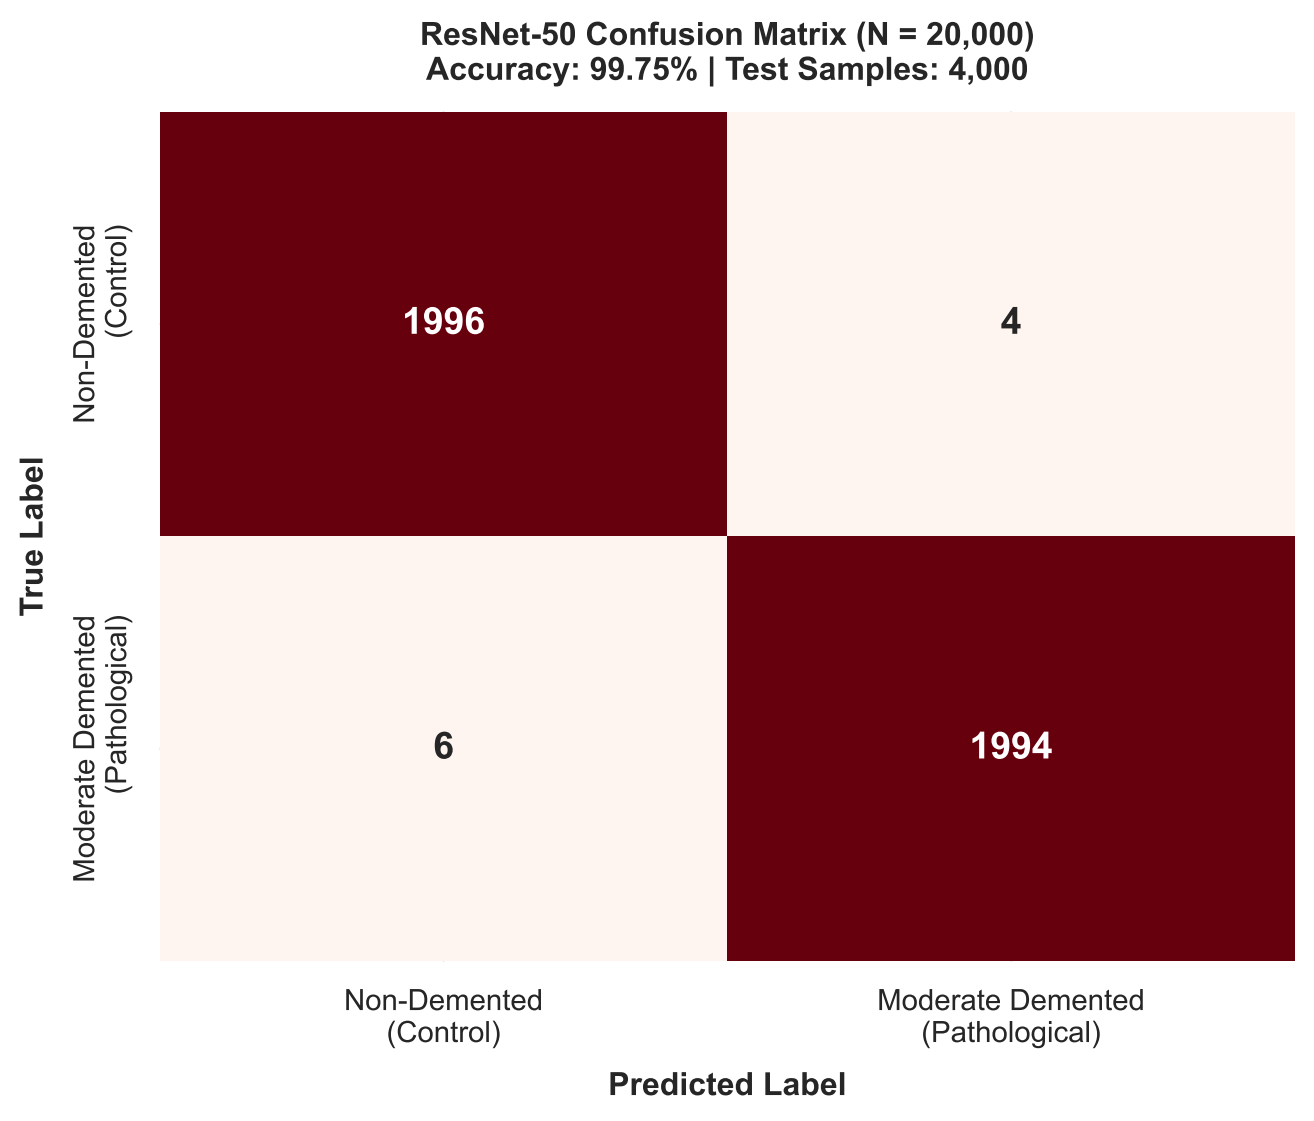
ResNet-50 Confusion Matrix (N = 20,000)
Accuracy: 99.75% | Test Samples: 4,000
True Label
Non-Demented (Control)
Moderate Demented (Pathological)
1996
4
6
1994
Non-Demented (Control)
Moderate Demented (Pathological)
Predicted Label