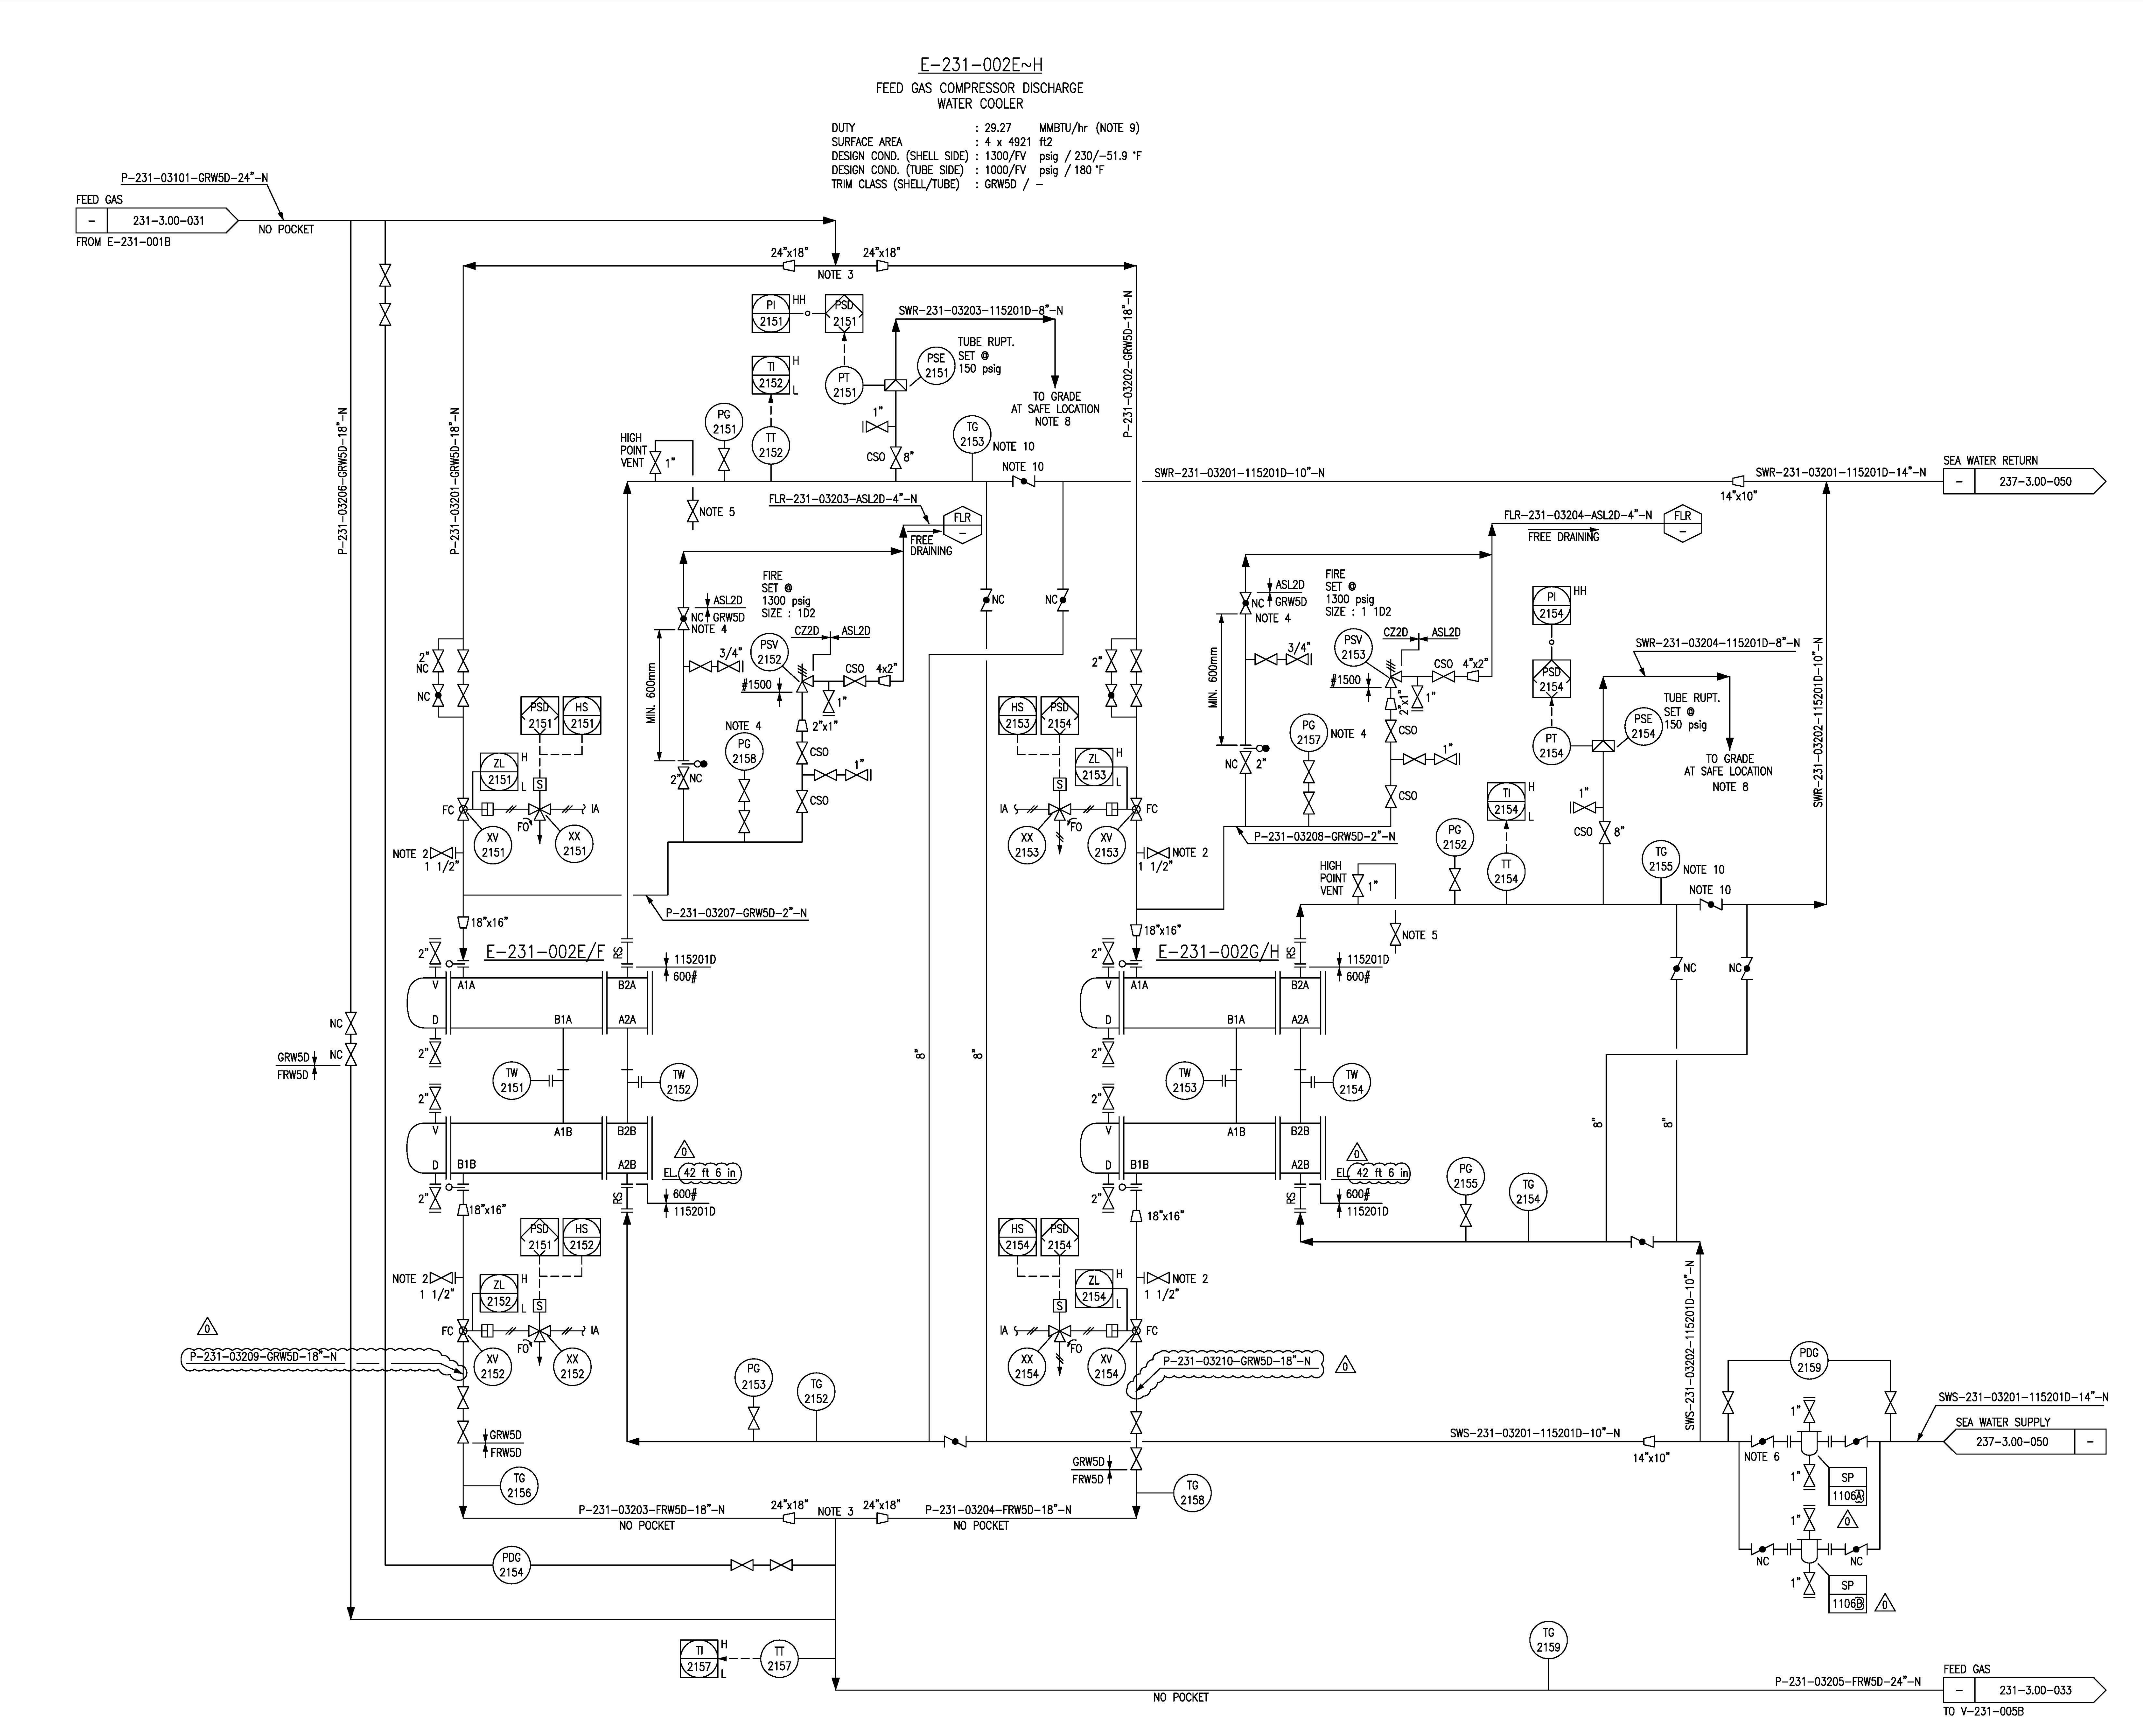
E-231-002E~H
FEED GAS COMPRESSOR DISCHARGE
WATER COOLER
DUTY : 29.27 MMBTU/hr (NOTE 9)
SURFACE AREA : 4 x 4921 ft2
DESIGN COND. (SHELL SIDE) : 1300/FV psig / 230/–51.9 °F
DESIGN COND. (TUBE SIDE) : 1000/FV psig / 180 °F
TRIM CLASS (SHELL/TUBE) : GRW5D / –
FEED GAS
– 231–3.00–031
FROM E–231–001B
P–231–03101–GRW5D–24"–N
NO POCKET
24"x18"
NOTE 3
P–231–03206–GRW5D–18"–N
P–231–03201–GRW5D–18"–N
P–231–03202–GRW5D–18"–N
PI 2151
HH
PSD 2151
TI 2152
H
L
PT 2151
PSE 2151
TUBE RUPT.
SET @
150 psig
SWR–231–03203–115201D–8"–N
TO GRADE
AT SAFE LOCATION
NOTE 8
1"
CSO
8"
TG 2153
NOTE 10
PG 2151
TT 2152
HIGH
POINT
VENT
NOTE 5
FLR–231–03203–ASL2D–4"–N
FLR
FREE
DRAINING
SWR–231–03201–115201D–10"–N
SWR–231–03201–115201D–14"–N
14"x10"
SEA WATER RETURN
– 237–3.00–050
FIRE
SET @
1300 psig
SIZE : 1D2
ASL2D
GRW5D
NC
NOTE 4
MIN. 600mm
3/4"
PSV 2152
CZ2D
#1500
4x2"
2"x1"
PG 2158
2"
PSD 2151
HS 2151
ZL 2151
S
FC
FO
IA
XV 2151
XX 2151
NOTE 2
1 1/2"
P–231–03207–GRW5D–2"–N
18"x16"
E–231–002E/F
RS
115201D
600#
V
D
A1A
B1A
B2A
A2A
TW 2151
TW 2152
A1B
B1B
B2B
A2B
EL. 42 ft 6 in
PSD 2151
HS 2152
ZL 2152
XV 2152
XX 2152
P–231–03209–GRW5D–18"–N
GRW5D
FRW5D
TG 2156
P–231–03203–FRW5D–18"–N
NO POCKET
PDG 2154
PG 2153
TG 2152
TI 2157
TT 2157
8"
FLR–231–03204–ASL2D–4"–N
FREE DRAINING
FIRE
SET @
1300 psig
SIZE : 1 1D2
PSV 2153
4"x2"
PG 2157
HS 2153
PSD 2154
ZL 2153
XX 2153
XV 2153
P–231–03208–GRW5D–2"–N
PI 2154
PSD 2154
PT 2154
PSE 2154
SWR–231–03204–115201D–8"–N
SWR–231–03202–115201D–10"–N
TI 2154
TT 2154
PG 2152
TG 2155
E–231–002G/H
TW 2153
TW 2154
PG 2155
TG 2154
HS 2154
PSD 2154
ZL 2154
XX 2154
XV 2154
P–231–03210–GRW5D–18"–N
TG 2158
P–231–03204–FRW5D–18"–N
SWS–231–03201–115201D–10"–N
SWS–231–03202–115201D–10"–N
PDG 2159
SWS–231–03201–115201D–14"–N
SEA WATER SUPPLY
237–3.00–050 –
NOTE 6
SP 1106A
SP 1106B
0
TG 2159
P–231–03205–FRW5D–24"–N
FEED GAS
– 231–3.00–033
TO V–231–005B

NOTES

1. FOR GENERAL NOTES AND SYMBOLS SEE DWG. NO'S 090768.231–3.00–003~006–A–B.
2. ALL MANUAL VENTS, INSTRUMENTATION VENTS AND DEPRESSURISING LINES IN HYDROCARBON SERVICE TO BE HARD PIPED TO FLARE.
   ALL MANUAL DRAINS AND INSTRUMENTATION DRAINS IN HYDROCARBON SERVICE TO BE HARD PIPED TO CLOSED DRAIN HEADER.
   SEE DETAIL DWG. ON 090768.231–3.00–009–A–B.
3. SYMETRICAL DISTRIBUTION.
4. TG READABLE FROM GLOBE VALVE OF PSV BY–PASS.
5. ACCESSIBLE FROM GROUND.
6. FILTER TO BE LOCATED NEAR TO HEAT EXCHANGER.
7. ALL INSTRUMENT NUMBERS ON THIS DRAWING ARE PREFIXED WITH UNIT NUMBER.
8. HC AND H2S DETECTOR TO BE LOCATED AT DISCHARGE OF PSEs.
9. GOVERNING CASE DUTY FOR SURFACE AREA.
10. TG TO BE READABLE FROM SEA WATER RETURN BLOCK VALVE.

SPADEPLN FILE NAME :
DATE (CUR / OLD) :