


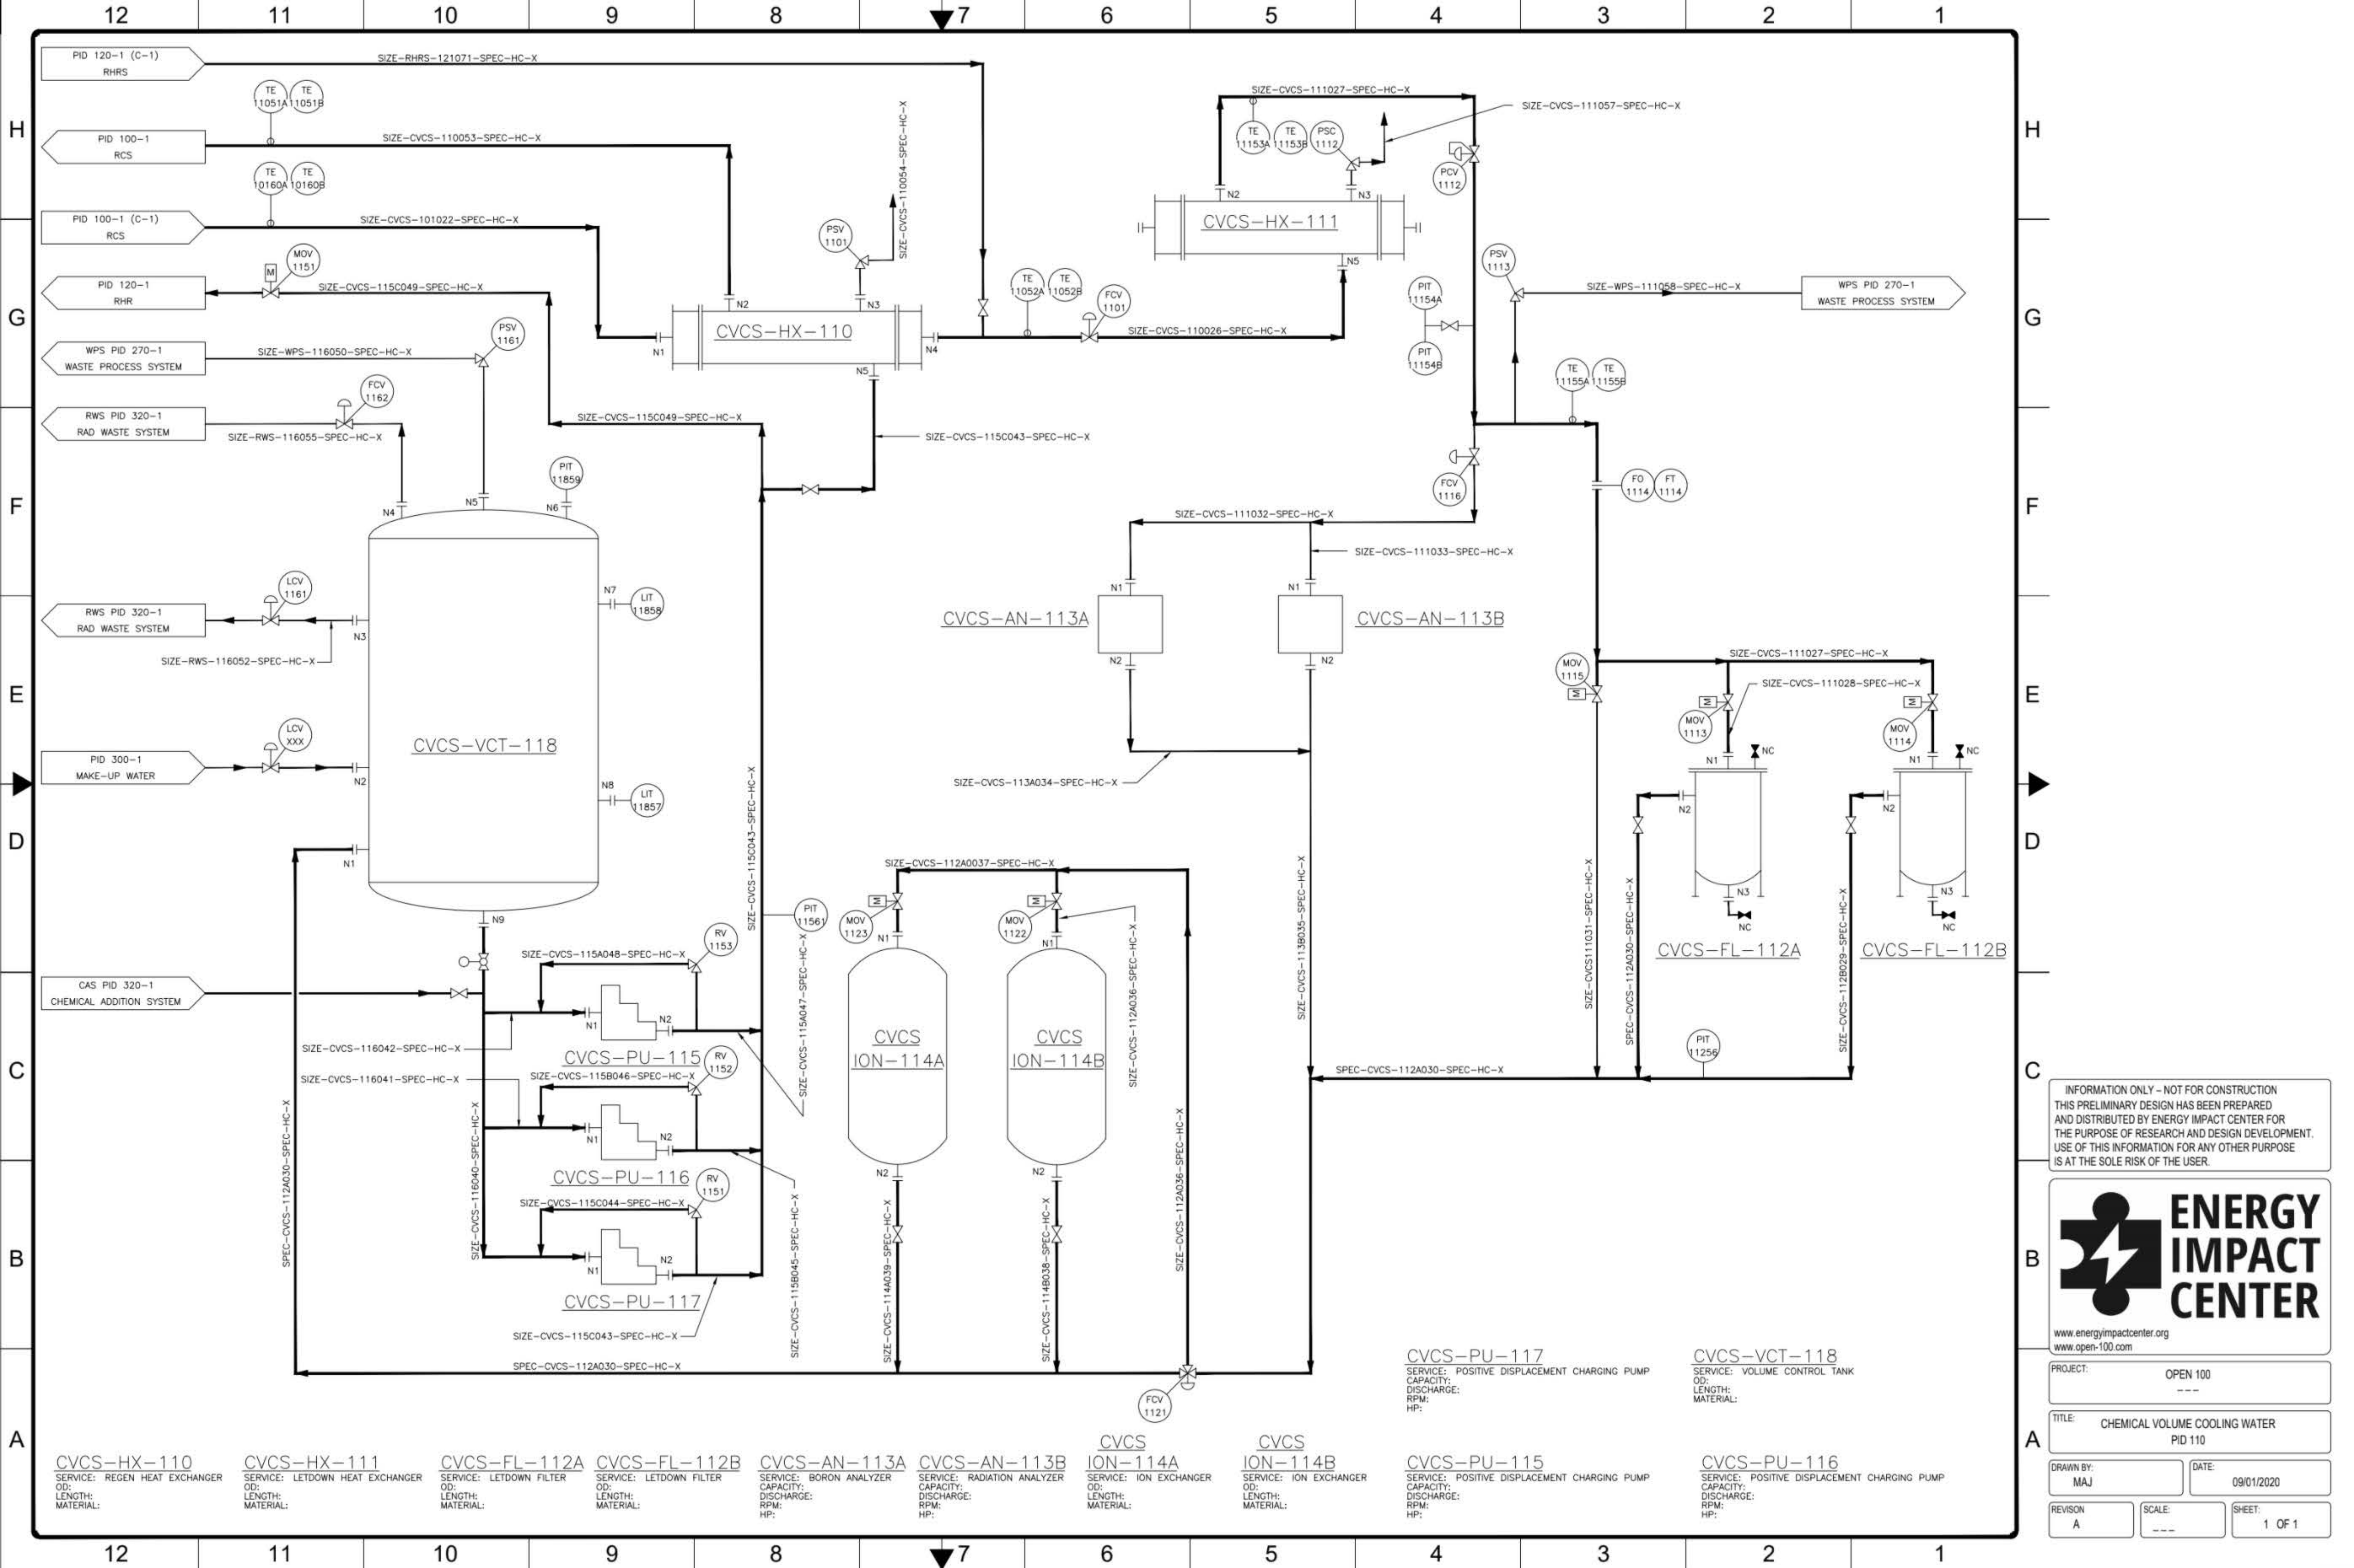

CVCS-HX-110 SERVICE: REGEN HEAT EXCHANGER OD: 12 LENGTH: 12 MATERIAL: 12	CVCS-HX-111 SERVICE: LETDOWN HEAT EXCHANGER OD: 11 LENGTH: 11 MATERIAL: 11	CVCS-FL-112A SERVICE: LETDOWN FILTER OD: 10 LENGTH: 10 MATERIAL: 10	CVCS-FL-112B SERVICE: LETDOWN FILTER OD: 9 LENGTH: 9 MATERIAL: 9	CVCS-AN-113A SERVICE: BORON ANALYZER CAPACITY: 8 DISCHARGE: 8 RPM: 8 HP: 8	CVCS-AN-113B SERVICE: RADIATION ANALYZER CAPACITY: 6 DISCHARGE: 6 RPM: 6 HP: 6	CVCS-ION-114A SERVICE: ION EXCHANGER OD: 6 LENGTH: 6 MATERIAL: 6	CVCS-ION-114B SERVICE: ION EXCHANGER OD: 5 LENGTH: 5 MATERIAL: 5	CVCS-PU-115 SERVICE: POSITIVE DISPLACEMENT CHARGING PUMP CAPACITY: 4 DISCHARGE: 4 RPM: 4 HP: 4	CVCS-PU-116 SERVICE: POSITIVE DISPLACEMENT CHARGING PUMP CAPACITY: 3 DISCHARGE: 3 RPM: 3 HP: 3
---	---	--	---	--	--	---	---	--	--

INFORMATION ONLY - NOT FOR CONSTRUCTION
THIS PRELIMINARY DESIGN HAS BEEN PREPARED
AND DISTRIBUTED BY ENERGY IMPACT CENTER FOR
THE PURPOSE OF RESEARCH AND DESIGN DEVELOPMENT.
USE OF THIS INFORMATION FOR ANY OTHER PURPOSE
IS AT THE SOLE RISK OF THE USER.

**ENERGY
IMPACT
CENTER**

www.energyimpactcenter.org
www.open-100.com

PROJECT:	OPEN 100
TITLE:	CHEMICAL VOLUME COOLING WATER PID 110
DRAWN BY:	MAJ
DATE:	09/01/2020
REVISION	A
SCALE:	---
SHEET:	1 OF 1