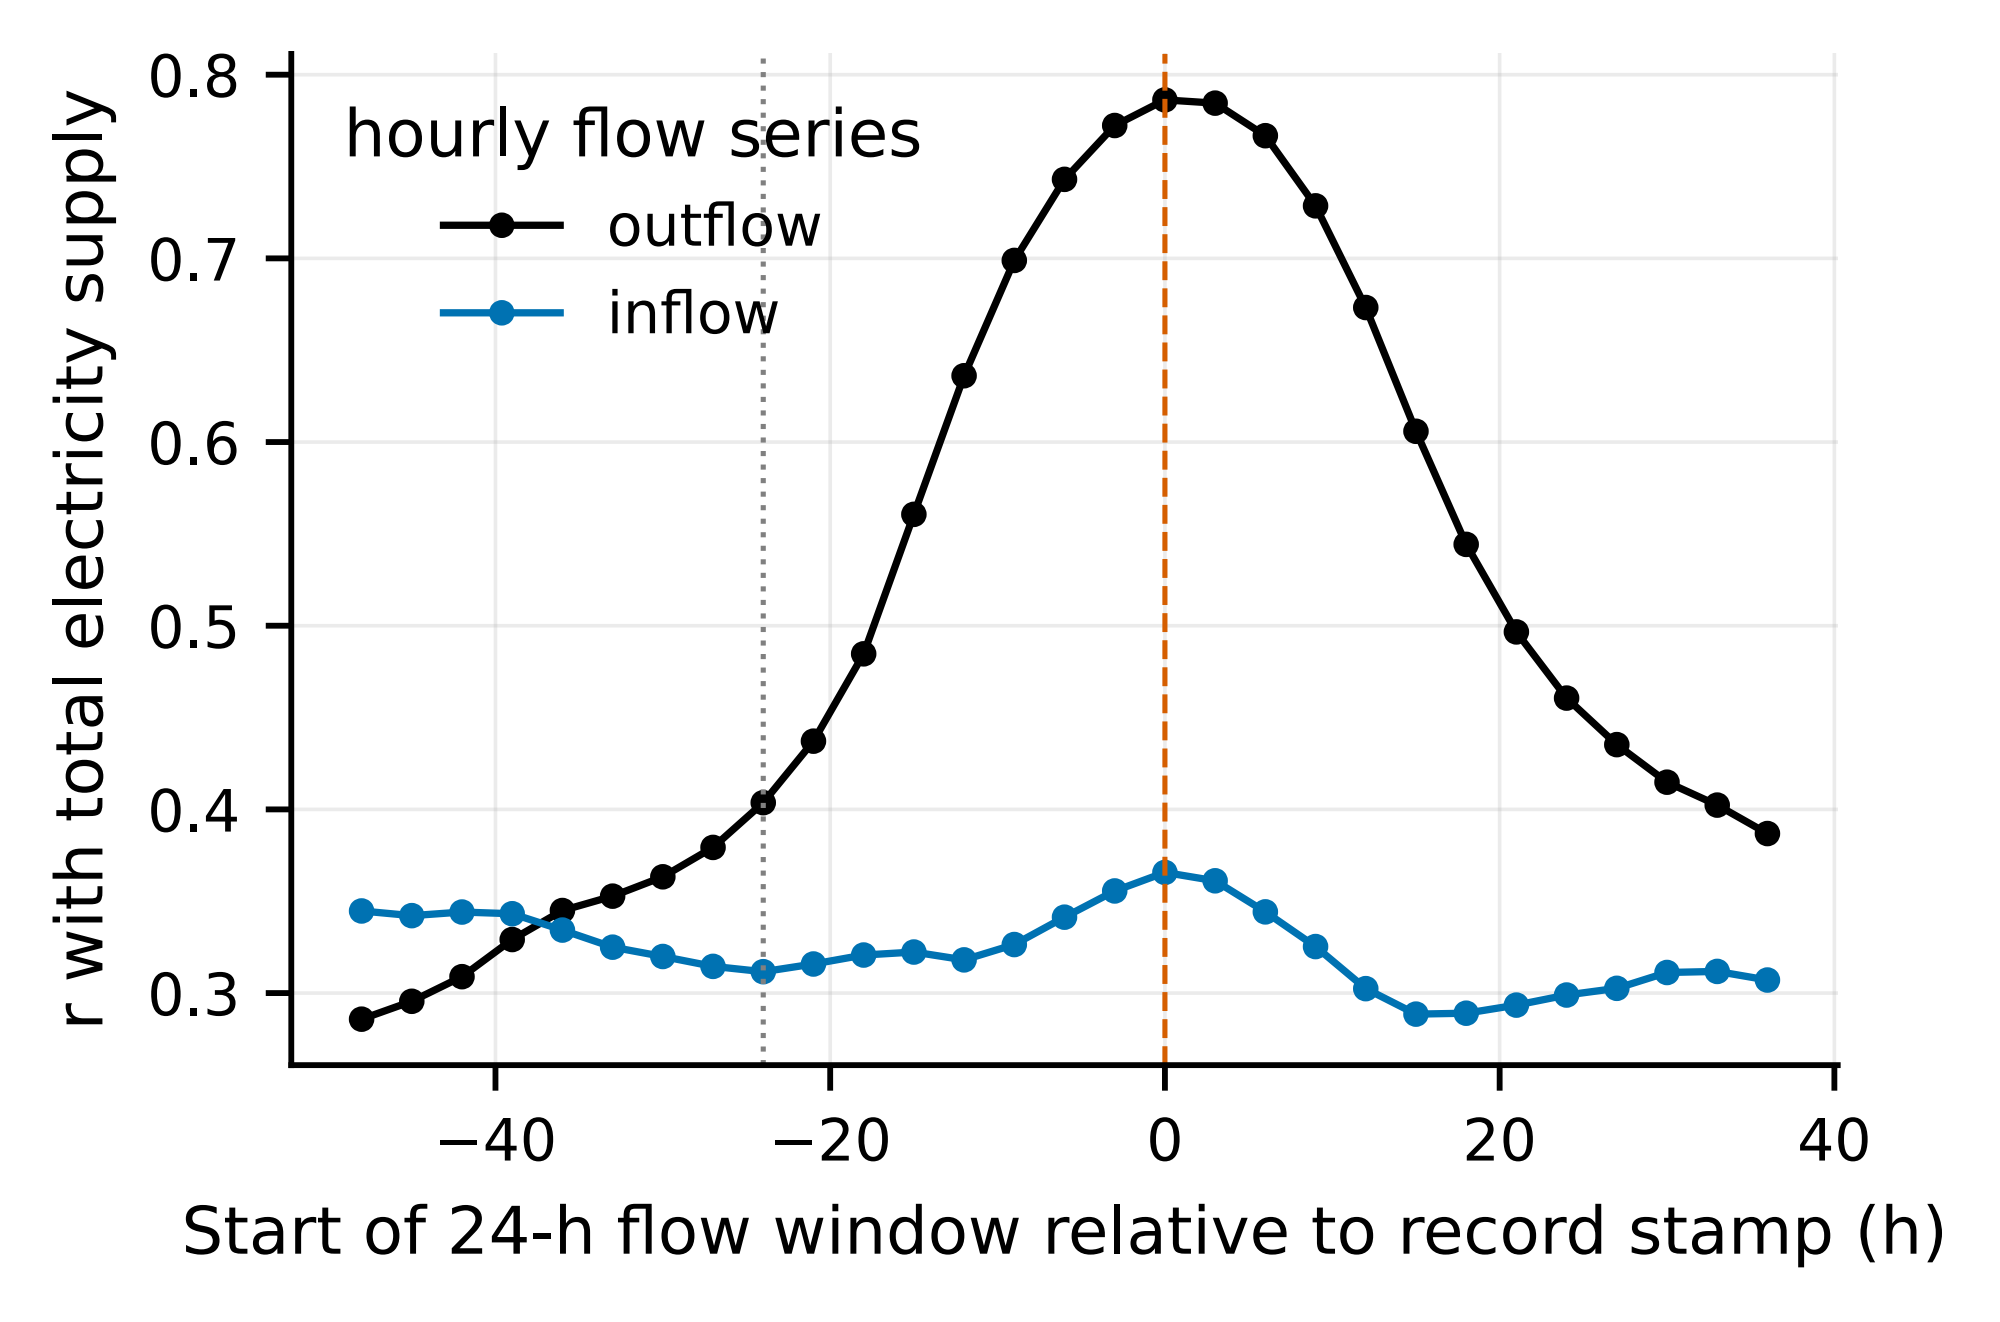
hourly flow series
outflow
inflow
r with total electricity supply
0.8
0.7
0.6
0.5
0.4
0.3
−40
−20
0
20
40
Start of 24-h flow window relative to record stamp (h)