

22 — Solid Track: DCHX Module & Bench Validation

v1.0 — coated-exchanger design, sizing, rig, and the M1-M4 measurement set

Function: Turn the doc 21 sorbent into a working thermal-swing module, and define the bench program that converts sizing-grade assumptions into measured numbers — above all **M2**, the single most economically consequential measurement in the program.

1. Why a desiccant-coated heat exchanger (DCHX)

Coating the sorbent directly onto a finned/plate exchanger lets one element do both halves of the swing: **adsorb with cool fluid** in the channels (sink fluid removes the heat of adsorption — near-isothermal bed at full capacity); **regenerate with hot fluid** (reverse the loop; a sweep airstream carries vapor to the condenser train). DCHX outperforms packed granular beds (~90 vs ~59 kW/m³; 3–5× heat-transfer rate) and is industrially proven in adsorption chillers — though packaged open-cycle DCHX *dehumidifiers* remain build-it-yourself, which is why this project exists. Geometry: flat-panel / stacked parallel plates first; higher-area-density geometries only if a plate stack cannot package.

Key sizing insight: throughput is governed by cycle time and coated area, not sorbent mass. Two (or more) modules alternate on ~10-minute half-cycles; short cycles with generous coated area beat a large slow bed. (Sensible-cycling caveat for the plumbing: doc 20 §4.)

2. Coating

Binder route (the only DIY-able route): sorbent + PVA slurry, sprayed (preferred over dip) at ~0.1–0.5 mm onto a prepared aluminum surface (acid-etched or boehmite-treated), ~0.18 kg sorbent/m² planform.

Binder rules (hard requirements):

- **PVA must be fully hydrolyzed (98–99%).** Partially hydrolyzed grades redissolve in humid service.
- **Even fully hydrolyzed PVA remains water-swellable near saturation unless heat-annealed.** The 120–150 °C activation **doubles as the mandatory anneal** — a re-coat must never skip it.
- Binder fraction low (~10 wt% nominal, locked by test).

Expected failure mode is **mechanical** (delamination / mass loss), not chemical — AlFu's framework is effectively bulletproof over 10³–10⁴ cycles. Durability testing targets the coating (M4).

3. Chloride exposure — finding F5 and the imported materials law

The DCHX is aluminum in a chloride-bearing environment (marine intake air; the liquid track's brine elsewhere on the platform; coastal land sites). Design responses, decided on paper:

- **Sealed/filtered intake path** — salt-aerosol filtration ahead of the coated face; in X8 closed-loop mode (doc 20 §8) the working path ingests no ambient aerosol at all, which is F5's primary mitigation.
- **No dissimilar-metal fittings** in the air path or fluid loop (extends the §5 bench rule to the installed module); no brass anywhere near the anodic plate.
- The sorbent + PVA coating is treated as a **barrier layer whose edge and defect behavior in salt air is inside M4's scope.**
- Imported from the liquid track's materials law (doc 11 §1): the **nylon/polyamide ban** near any CaCl₂ service, the **brazed-plate-HX prohibition** on chloride-wetted duty, drip-loop and containment discipline on any shared bulkheads, and the "pool/aquaculture parts, not plumbing parts" sourcing heuristic.

Corrosion *rate* is empirical and lands in M4; the responses above are not.

4. Sizing (annotated — do not use unannotated)


Baseline at 10-min half-cycles, two alternating modules, ~0.18 kg/m²:

Basis	Duty	Δq basis	Sorbent inventory	Coated HX area
Envelope-only (naive; retained as the cautionary row)	~2–3 kg/h	0.2–0.3 g/g	~3–4 kg	~10–13 m²
Self-consistent peak (doc 20 §5, PENDING T2)	~9–11 kg/h	0.2–0.3 g/g	~3–5× the above	scales accordingly
+ F3 compounded (PENDING M2)	~9–11 kg/h	effective ~0.15–0.2 g/g	+25–50% again	"

The correction path — faster cycling vs more coated area vs architecture revision (warmer supply setpoint uses the ~15-point RH comfort headroom; hybrid brine pre-stage per doc 40 X-register) — is **open** and is exactly what the full T2 model decides. Any independent rebuild should treat T2 as the first modeling task, before hardware; the doc 00 §4 steady state is the interim basis.


5. Bench test rig — single-coupon fluid loop

The coupon is a flat aluminum water-cooling block, AlFu-coated on the external face, temperature-controlled fluid in the channels. Switching the fluid source between hot and cold reservoirs is the whole trick; the fluid-side ΔT yields regeneration energy.

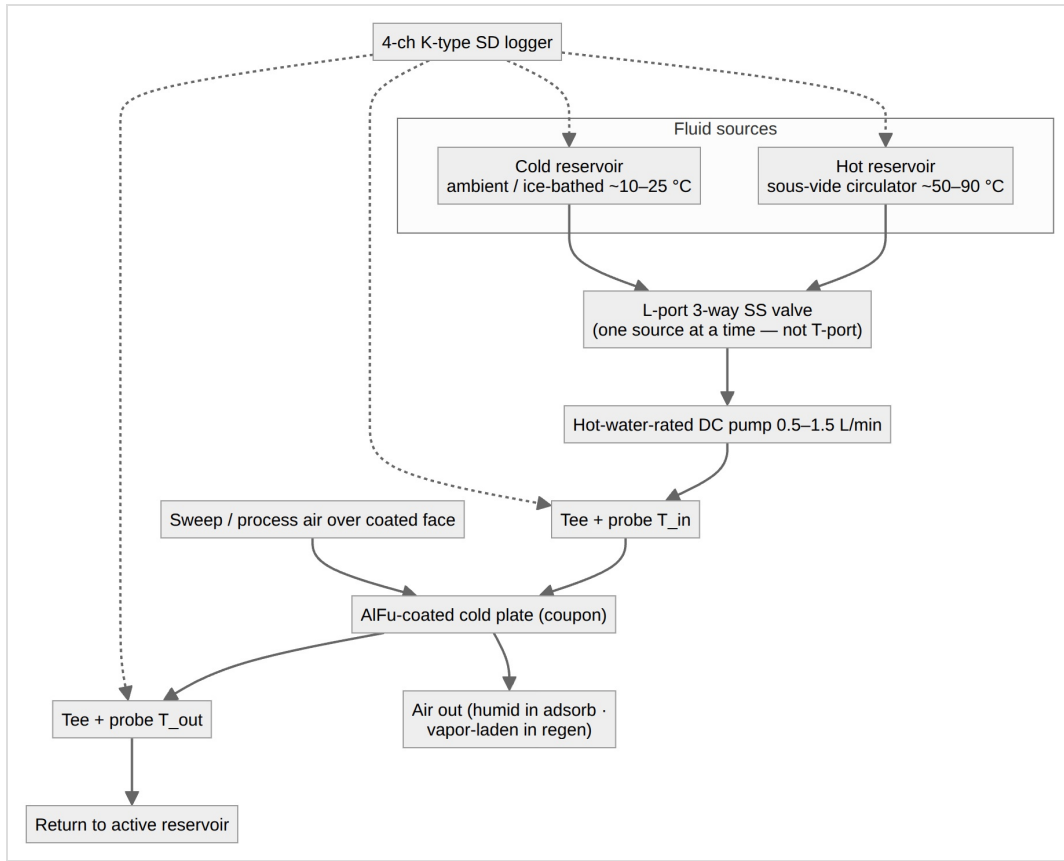

Loop rules: all-aluminum + stainless wetted path, distilled water (avoid brass — galvanic couple with the anodic Al plate); silicone tubing on the hot loop (PVC softens >60 °C); restrictive fittings on the pump *discharge* side; sous-vide circulator as the precision hot reservoir.

Duty cycle:

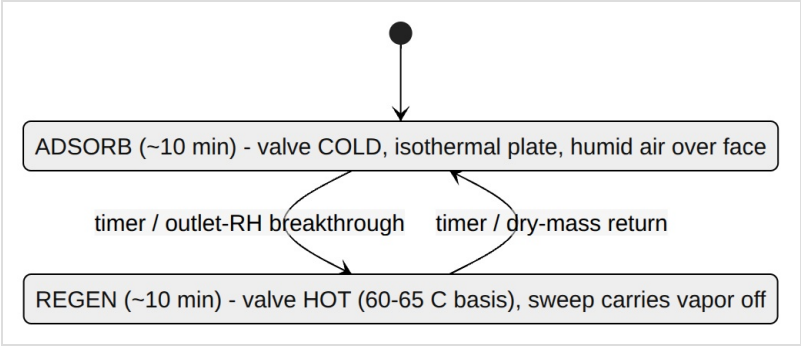

First characterization runs the phases *separately* (saturate for capacity, then clear for regeneration); cycling is for durability (M4).

6. The M1-M4 measurement set

ID	Measures	Method	Pass/insight
M1	Adsorption working capacity (g/g) + coated-face ΔP	weigh activated-dry coupon → saturate isothermally at defined inlet RH → reweigh; U-tube manometer across the coated face at design face velocity	single-point capacity; ΔP gates the doc 20 fan-power line (0.6–1.0 kW claim)
M2	Regeneration vs representative humid purge	from saturated coupon, step hot setpoint across runs — one 45–50 °C confirmation (expected marginal per F2), then completeness and kinetics at 60/65/70 °C against a logged ~24 g/kg purge, RH and ω recorded	(a) desorption completeness/rate within the 10-min half-cycle at 60–65 °C; (b) effective Δq under realistic purge (the F3 number). Gates the heat-source decision
M3	Specific regeneration energy	fluid-side balance $Q = \int \dot{m} \cdot c_p \cdot (T_{in} - T_{out}) dt$; dry/activated blank first (sensible + loss baseline, incl. the doc 20 §4 plumbing overhead), then wet; $(Q_{wet} - Q_{blank})/m_{water}$; condensate cross-check by weighing	vs ~0.67 kWh/L latent floor and ~0.8–1.0 kWh/L total
M4	Cycling durability + salt-air edge behavior	repeat swing 10^2 – 10^3 cycles; periodic M1 + dry-mass weigh + visual; coating edge/defect inspection under salt-aerosol exposure (F5)	capacity fade and coating mass loss/delamination — the failure mode that matters

M2 is run against representative humid purge, never dry lab air. A dry-purge M2 reproduces the literature's ~50 °C claim and tells you nothing about the design point (doc 20 §6).

7. Instrumentation

Fluid side: 4-channel K-type SD logger; four sealed SS 1/8"-NPT probes in inline tees — T1 plate inlet, T2 plate outlet (the ΔT pair), T3 hot, T4 cold. **Offset-calibrate the T1/T2 pair** (isothermal bath): an uncalibrated ±1 °C bias swamps a 3–5 °C signal in the M3 integral.


Air-side humidity — on the critical path, not optional:

Regime	Sensor	Why
--------	--------	-----

Cool, sub-saturated nodes (post-desiccant)	digital capacitive RH/T (SHT85/SHT45 class)	accurate, fast; doubles as air-node thermometer
Near-saturated (>80% RH) and hot regen/purge (50–65 °C+) — the M2 nodes	wet-bulb/dry-bulb psychrometry (dry K-type + wicked aspirated wet K-type)	capacitive sensors are spec'd to ~60 °C / 20–80% RH, drift ~+3% RH in sustained saturation — exactly the regime that matters. This is also the instrument set tests D/G/H (doc 12) reuse

Wet/dry-bulb costs two K-type channels per air node; with the fluid loop consuming all four logger channels, plan the channel budget before M2 (second logger, or a unified ESP32 + MAX31856/SHT node with one timestamped CSV — the same ESP32 stack that runs the platform interlocks). Plus: a flow figure for the M3 integral (timed volumetric catch suffices) and a gravimetric balance. Oven setpoints independently verified by thermocouple — never trust a consumer oven dial for the activation/anneal step.

8. Staged validation pipeline

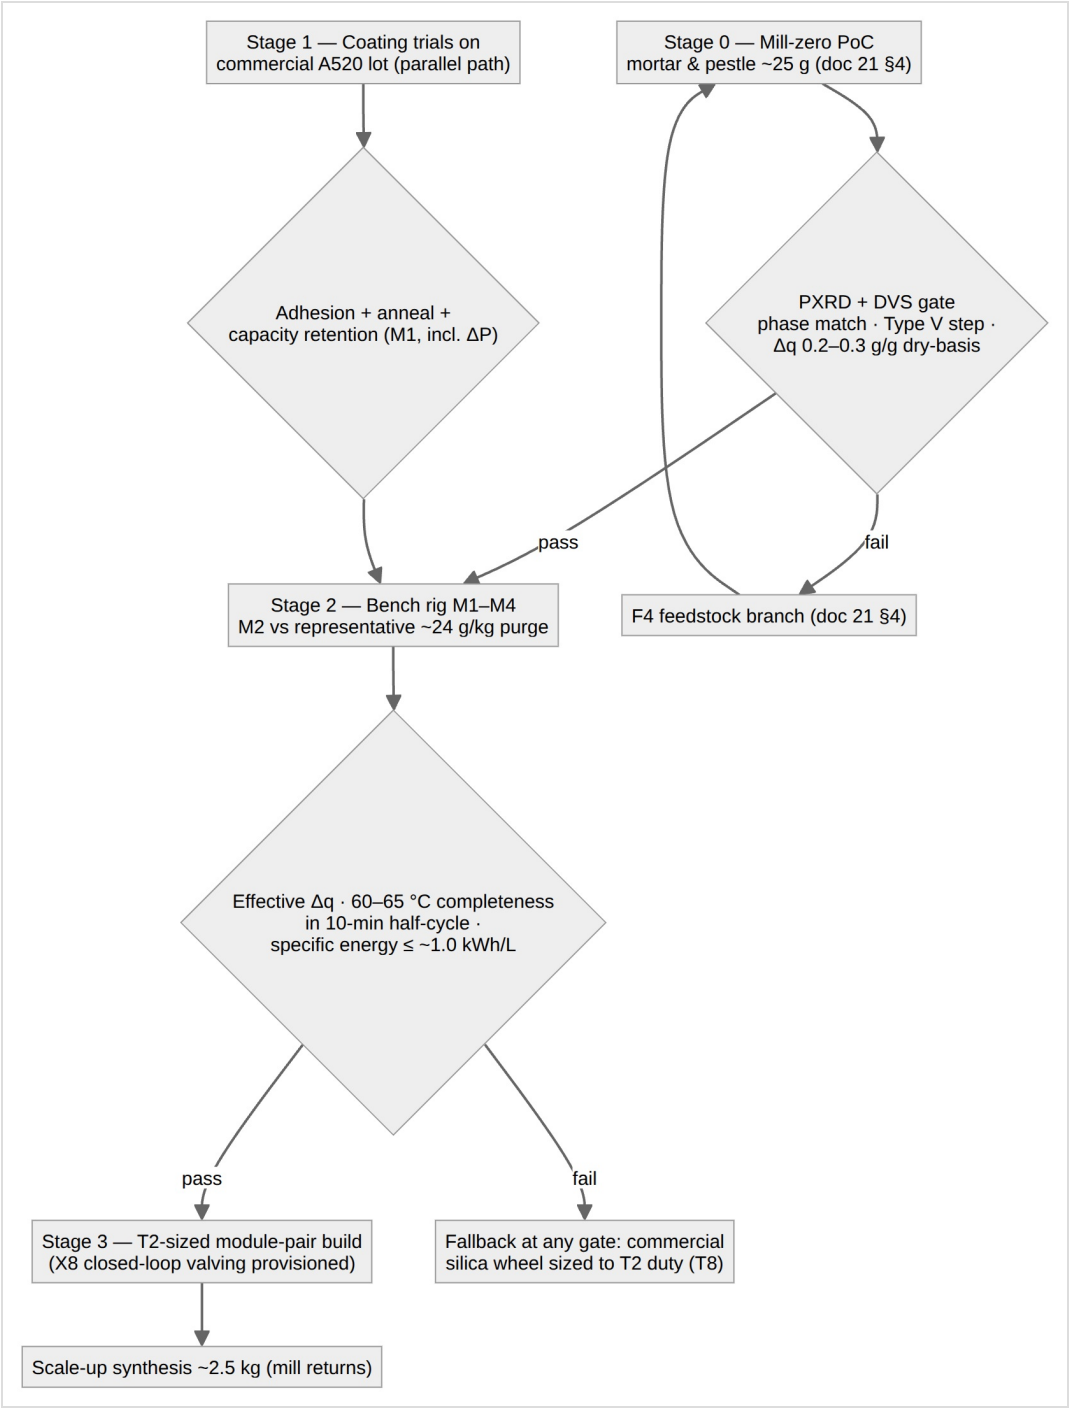

Part of an open defensive-publication release: hardware CERN-OHL-P v2, text CC-BY-4.0. No patents sought or held. Unbuilt paper design — see LICENSE.

Version history

- **v1.0** — New lineage from archived 03: F5 chloride-exposure section and imported materials law added (§3); ΔP measurement added to M1; salt-air edge behavior added to M4; sizing table restated to the self-consistent duty; X8 valving provisioned at Stage 3.