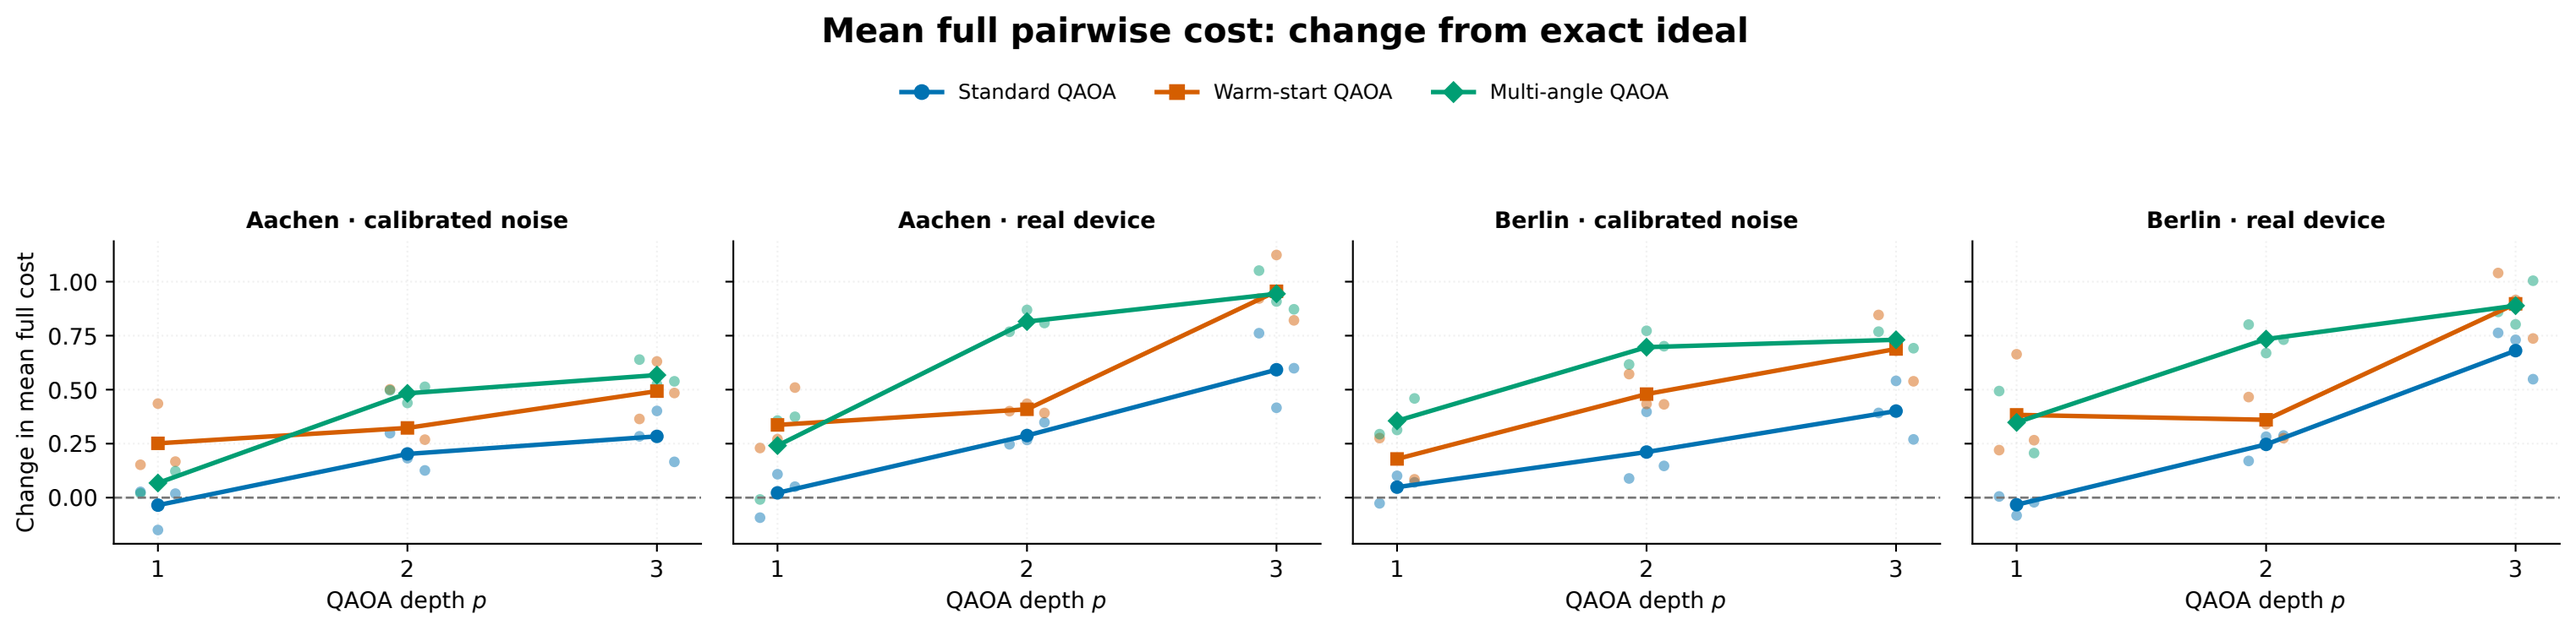

Mean full pairwise cost: change from exact ideal
Standard QAOA
Warm-start QAOA
Multi-angle QAOA
Aachen · calibrated noise
Aachen · real device
Berlin · calibrated noise
Berlin · real device
Change in mean full cost
1.00
0.75
0.50
0.25
0.00
1
2
3
QAOA depth p
Sampled minus exact ideal; differences include shot variation. Lines: repeat means; small dots: repeats.