

Totally Integrated Automation Portal

Safety Administration

Safety summary

General information

F-signatures		
Collective F-Signature	D6B83718	
Collective F-SW-Signature	D4625169	
Collective F-HW-Signature	0255E5AF	
F-Communication Address Signature	----	
Current compilation		
Safety program state	The offline safety program is consistent, but no password has been assigned.	
Compilation time	5/22/2026 2:48:57 PM (UTC +2:00)	
Used versions		
STEP 7	STEP 7 Professional V19 Update 3	
Safety	STEP 7 Safety V19 Update 1	
Access protection		
Safety-related project data	The safety program is protected by UMAC	
F-CPU	Full access with fail-safe (no protection)	
Important Note	Be aware, that the settings regarding the access protection reflect only the current settings while creating this safety summary. They can be changed later without any effect to the signature or compilation time stamp. Refer to the device configuration for current valid access protection on the F-CPU.	

Notes

Location	Note	Additional info
General information	The response time of your safety function also depends on the cycle time of the F-OB and the runtime of the F-runtime group. When using distributed F-I/O modules, the response time also depends on the PROFINET/PROFIBUS parameter assignment. The configuration and parameter assignment of the standard system also has an effect on the response time of your safety function. Note that the configuration and parameter assignment of the standard system is not subject to the access protection of the safety program and does not change the Collective F-Signature.	Note the warning "S085" in the manual and in the STEP 7 Safety online help.

Safety program settings

Safety mode can be disabled	No
Assignment of F-system block numbers	F-system managed
Safety system version	V2.6
Variable F-communication IDs enabled	No

System library elements used in safety program

Instructions (STEP 7 Safety)	
Name	Used version
ACK_GL	V1.3
ESTOP1	V1.6
SFDOOR	V1.3
TON	V1.4

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Totally Integrated Automation Portal		
Information on F-runtime group		
RTG1		
Fail-safe organization block		
Name	FOB_REWINDER CONTROL DESK 000CD1 [OB123]	
Event class	Cyclic interrupt	
Cycle time	100000 µs	
Phase shift	0 µs	
Priority	12	
Main safety block		
Name	REWINDER CONTROL DESK 000CD1 [FB1]	
I-DB for main safety block	Main_Safety_RTG1_DB [DB1]	
F-runtime group parameters		
Name	F-runtime group 1	
Warn cycle time of the F-runtime group	110000 µs	
Maximum cycle time of the F-runtime group	120000 µs	
DB for F-runtime group communication	--	
F-runtime group information DB	RTG1SysInfo	
Pre/Post processing		
FC for pre processing	--	
FC for post processing	--	
Safety information: D6B83718 Consistent; STEP 7 Safety V19;		

Totally Integrated Automation Portal			
F-blocks in safety program			
Block name [Block number]	Function in safety program	Used and compiled in F-RTG	Signature
▼ Safety			00078E88
FOB_REWINDER CONTROL DESK 000CD1 [OB123]	F-OB [system-protected]	RTG1	7DAE2E5A
2 HANDS SELECTORS [FC27]	F-FC	RTG1	E8FA9681
gate requests manage [FC4]	F-FC	RTG1	437319A8
gestione ingressi feedback [FC32]	F-FC	RTG1	A7DFCB9A
sblocco tutte le porte + emergenza [FC28]	F-FC	RTG1	D5BC5FD5
REWINDER CONTROL DESK 000CD1 [FB1]	F-FB	RTG1	4B5AED55
LDrvSafe_SinaGTlg30Status_DB [DB7]	F-I-DB [user-protected]	RTG1	51C9C37E
LDrvSafe_SinaGTlg30Control_DB [DB6]	F-I-DB [user-protected]	RTG1	CCE3C360
Main_Safety_RTG1_DB [DB1]	F-IDB	RTG1	10BAB1EE
▼ S7-1500F			85EB05FB
▼ PROFI-safe Control			85EB05FB
▼ Control Word			8A5D2CA4
▼ Telegram 30			8A5D2CA4
LDrvSafe_SinaGTlg30Control [FB29000]	F-FB [user-protected]	RTG1	8F333427
▼ Status Word			AB7A53D1
▼ Telegram 30			AB7A53D1
LDrvSafe_SinaGTlg30Status [FB29010]	F-FB [user-protected]	RTG1	27131F87
Know-how protected F-blocks in the safety program			
LDrvSafe_SinaGTlg30Control [FB29000]			
Property		Value	
Signature		8F333427	
Safety system version		V2.3	
STEP 7 Safety version		STEP 7 Safety V16	
STEP 7 version		STEP 7 Professional V16 Update 4	
The know-how protected F-block does not contain versioned instructions.			
The know-how protected F-block does not include calls of F-blocks.			
The know-how protected F-block does not include any PLC/DB tags.			
PLC data types used			
Name		Type of UDT	
LDrvSafe_typeSinaGTlg30Control		Fail-safe compliant	
LDrvSafe_SinaGTlg30Status [FB29010]			
Property		Value	
Signature		27131F87	
Safety system version		V2.3	
STEP 7 Safety version		STEP 7 Safety V16	
STEP 7 version		STEP 7 Professional V16 Update 4	
The know-how protected F-block does not contain versioned instructions.			
The know-how protected F-block does not include calls of F-blocks.			
The know-how protected F-block does not include any PLC/DB tags.			
PLC data types used			
Name		Type of UDT	
LDrvSafe_typeSinaGTlg30Status		Fail-safe compliant	
F-compliant PLC data types in the safety program			
PLC data type name, PLC data type number	Used in the safety program	Time stamp	
▼ S7-1500F			
▼ PROFI-safe Control			
▼ Control Word			
▼ Telegram 30			
LDrvSafe_typeSinaGTlg30Control [UDT20]	Yes	6/13/2025 9:22:59 AM (UTC +2:00)	
▼ Status Word			
▼ Telegram 30			
LDrvSafe_typeSinaGTlg30Status [UDT5]	Yes	6/13/2025 9:22:59 AM (UTC +2:00)	
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal		
Data from the standard user program		
Absolute address	Symbolic operand	F-runtime group Block name [Block number] Network
M1.3	"AlwaysFALSE"	RTG1REWINDER CONTROL DESK 000CD1 [FB1]2
M1111.2	"reset safety drive"	RTG1REWINDER CONTROL DESK 000CD1 [FB1]7
M1005.1	"reset speed control device"	RTG1REWINDER CONTROL DESK 000CD1 [FB1]9
M1005.5	"G6 gate open"	RTG1gate requests manage [FC4]1
M1005.6	"G8 gate open"	RTG1gate requests manage [FC4]2
M1006.0	"G9 gate open"	RTG1gate requests manage [FC4]3
M1009.1	"G2 MU101 gate open"	RTG1gate requests manage [FC4]4
M1009.3	"G2 MU011 gate open"	RTG1gate requests manage [FC4]5
M1005.3	"Safety cut enable SOA01"	RTG1gate requests manage [FC4]6
M1009.5	"Safety cut enable SOA03"	RTG1gate requests manage [FC4]6
M1005.3	"Safety cut enable SOA01"	RTG1gate requests manage [FC4]7
M1009.5	"Safety cut enable SOA03"	RTG1gate requests manage [FC4]7
M1006.1	"Safety cut enable SOA02"	RTG1gate requests manage [FC4]9
%DB18.DBX0.7	"DBTEST"."Rider roll down request"	RTG1gate requests manage [FC4]12
%DB14.DBX0.5	"DB_PUT"."SOA1 ZONE ACTIVE"	RTG1gate requests manage [FC4]12
%DB14.DBX0.3	"DB_PUT"."SOA2 ZONE ACTIVE"	RTG1gate requests manage [FC4]12
%DB14.DBX0.6	"DB_PUT"."SOA3 ZONE ACTIVE"	RTG1gate requests manage [FC4]12
%DB18.DBX1.0	"DBTEST"."Access request in slow speed"	RTG1sblocco tutte le porte + emergenza [FC28]1
MD64	"real db speed"	RTG1sblocco tutte le porte + emergenza [FC28]1
%DB14.DBX1.7	"DB_PUT"."ZONE 1 REQUEST"	RTG1sblocco tutte le porte + emergenza [FC28]1
%DB14.DBX2.0	"DB_PUT"."ZONE 2 REQUEST"	RTG1sblocco tutte le porte + emergenza [FC28]1
%DB14.DBX2.1	"DB_PUT"."ZONE 3 REQUEST"	RTG1sblocco tutte le porte + emergenza [FC28]1
Parameters for safety-related CPU-CPU communications via RCVDP, SENDDP		
No safety-related CPU-CPU communication via RCVDP, SENDDP is configured.		
Safety information: D6B83718 Consistent; STEP 7 Safety V19;		

Totally Integrated Automation Portal		
Communications via Flexible F-Link No communications via Flexible F-Link are defined for the F-Program.		
Safety information: D6B83718 Consistent; STEP 7 Safety V19;		

Totally Integrated Automation Portal		
--------------------------------------	--	--

Hardware configuration of F-I/O

F-CPU information

Short designation	CPU 1512SP F-1 PN
Article number	6ES7 512-1SM03-0AB0
Firmware version	V3.0
Central F-source address	1
F-destination address range (PROFIsafe address type 1)	51 .. 51
F-destination address range (PROFIsafe address type 2)	65524 .. 65534

Central periphery

Rail - Slot	Module	Start address	F-destination address	F-monitoring time	Parameter signature (w/o addresses)
Telaio di montaggio_0-7	6ES7 136-6BA01-0CA0 KF6	420	65534	400 ms	0xC5CB (50635)
Telaio di montaggio_0-8	6ES7 136-6BA01-0CA0 KF7	427	65533	400 ms	0x9F3A (40762)
Telaio di montaggio_0-9	6ES7 136-6BA01-0CA0 KF8	434	65532	400 ms	0x9EE8 (40680)
Telaio di montaggio_0-10	6ES7 136-6BA01-0CA0 KF9	441	65531	400 ms	0x13B3 (5043)
Telaio di montaggio_0-11	6ES7 136-6BA01-0CA0 KF10	448	65530	400 ms	0x1540 (5440)
Telaio di montaggio_0-12	6ES7 136-6DB00-0CA0 KF11	250	65529	400 ms	0x2AF1 (10993)
Telaio di montaggio_0-13	6ES7 136-6DB00-0CA0 KF12	455	65528	400 ms	0x2B68 (11112)
Telaio di montaggio_0-14	6ES7 136-6DB00-0CA0 KF13	460	65527	400 ms	0x2AF1 (10993)
Telaio di montaggio_0-15	6ES7 136-6DB00-0CA0 KF14	465	65526	400 ms	0x2AF1 (10993)
Telaio di montaggio_0-18	6ES7 136-6BA01-0CA0 KF17	516	65525	400 ms	0x5944 (22852)
Telaio di montaggio_0-19	6ES7 136-6DB00-0CA0 KF18	486	65524	400 ms	0x2AF1 (10993)

G120C_PN

Rail - Slot	Module	Start address	F-destination address	F-monitoring time	Parameter signature (w/o addresses)
0	Telegramma_PROFIsafe_30	12	51	400 ms	0xAA61 (43617)

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

--	--	--

Totally Integrated Automation Portal					
KF6 : Central I/O Telaio di montaggio_0, Slot 7					
General parameters			Specific Parameters		
Hardware			Sensor supply 0		
Name	KF6		Short-circuit test	No	
Slot	7		Time for short-circuit test	4.2 ms	
Short designation	F-DI 8x24VDC HF		Startup time of sensor after short-circuit test	4.2 ms	
Article number	6ES7 136-6BA01-0CA0		Sensor supply 1		
Start address input	420		Short-circuit test	No	
Start address output	420		Time for short-circuit test	4.2 ms	
Hardware identifier	273		Startup time of sensor after short-circuit test	4.2 ms	
F-monitoring time	400 ms		Sensor supply 2		
F-source address	1		Short-circuit test	No	
F-destination address	65534		Time for short-circuit test	4.2 ms	
F-parameter signature (without addresses)	0xC5CB (50635)		Startup time of sensor after short-circuit test	4.2 ms	
F-parameter signature (with addresses)	0xA6A8 (42664)		Sensor supply 3		
Behavior after channel fault	Passivate channel		Short-circuit test	No	
RIOforFA-Safety	Yes		Time for short-circuit test	4.2 ms	
PROFIsafe mode	V2 mode		Startup time of sensor after short-circuit test	4.2 ms	
PROFIsafe protocol version	Expanded protocol (XP)		Sensor supply 4		
Firmware version	V2.0		Short-circuit test	No	
Software			Time for short-circuit test	4.2 ms	
F-I/O DB number	30009		Startup time of sensor after short-circuit test	4.2 ms	
F I/O DB name	F00420_KF6		Sensor supply 5		
Used in F-runtime group	RTG1		Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 6		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 7		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Channel 0, 4		
			Sensor evaluation	1oo2 evaluation, equivalent	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 0		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 4		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 1, 5		
			Sensor evaluation	1oo2 evaluation, equivalent	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 1		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	Sensor supply 1	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 5		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	Sensor supply 5	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
Safety information: D6B83718 Consistent; STEP 7 Safety V19;					

Totally Integrated Automation Portal		
General parameters	Specific Parameters	
	Channel 2, 6	
	Sensor evaluation	1oo2 evaluation, equivalent
	Discrepancy behavior	Supply value 0
	Discrepancy time	400 ms
	Reintegration after discrepancy error	Test 0-Signal not necessary
	Channel 2	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
	Channel 6	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
	Channel 3, 7	
	Sensor evaluation	1oo2 evaluation, equivalent
	Discrepancy behavior	Supply value 0
	Discrepancy time	400 ms
	Reintegration after discrepancy error	Test 0-Signal not necessary
	Channel 3	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
	Channel 7	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
Safety information: D6B83718 Consistent; STEP 7 Safety V19;		

Totally Integrated Automation Portal				
KF7 : Central I/O Telaio di montaggio_0, Slot 8				
General parameters		Specific Parameters		
Hardware		Sensor supply 0		
Name	KF7	Short-circuit test	No	
Slot	8	Time for short-circuit test	4.2 ms	
Short designation	F-DI 8x24VDC HF	Startup time of sensor after short-circuit test	4.2 ms	
Article number	6ES7 136-6BA01-0CA0	Sensor supply 1		
Start address input	427	Short-circuit test	No	
Start address output	427	Time for short-circuit test	4.2 ms	
Hardware identifier	274	Startup time of sensor after short-circuit test	4.2 ms	
F-monitoring time	400 ms	Sensor supply 2		
F-source address	1	Short-circuit test	No	
F-destination address	65533	Time for short-circuit test	4.2 ms	
F-parameter signature (without addresses)	0x9F3A (40762)	Startup time of sensor after short-circuit test	4.2 ms	
F-parameter signature (with addresses)	0xD874 (55412)	Sensor supply 3		
Behavior after channel fault	Passivate channel	Short-circuit test	No	
RIOforFA-Safety	Yes	Time for short-circuit test	4.2 ms	
PROFIsafe mode	V2 mode	Startup time of sensor after short-circuit test	4.2 ms	
PROFIsafe protocol version	Expanded protocol (XP)	Sensor supply 4		
Firmware version	V2.0	Short-circuit test	No	
Software		Time for short-circuit test	4.2 ms	
F-I/O DB number	30010	Startup time of sensor after short-circuit test	4.2 ms	
F I/O DB name	F00427_KF7	Sensor supply 5		
Used in F-runtime group	RTG1	Short-circuit test	No	
		Time for short-circuit test	4.2 ms	
		Startup time of sensor after short-circuit test	4.2 ms	
		Sensor supply 6		
		Short-circuit test	No	
		Time for short-circuit test	4.2 ms	
		Startup time of sensor after short-circuit test	4.2 ms	
		Sensor supply 7		
		Short-circuit test	No	
		Time for short-circuit test	4.2 ms	
		Startup time of sensor after short-circuit test	4.2 ms	
		Channel 0, 4		
		Sensor evaluation	1oo2 evaluation, equivalent	
		Discrepancy behavior	Supply value 0	
		Discrepancy time	400 ms	
		Reintegration after discrepancy error	Test 0-Signal not necessary	
		Channel 0		
		Activated	Yes	
		Channel failure acknowledge	Automatic	
		Sensor supply	External sensor supply	
		Input delay	3,2 ms	
		Chatter monitoring	No	
		Number of signal changes	5	
		Monitoring window	2 sec	
		Channel 4		
		Activated	Yes	
		Channel failure acknowledge	Automatic	
		Sensor supply	External sensor supply	
		Input delay	3,2 ms	
		Chatter monitoring	No	
		Number of signal changes	5	
		Monitoring window	2 sec	
		Channel 1, 5		
		Sensor evaluation	1oo2 evaluation, equivalent	
		Discrepancy behavior	Supply value 0	
		Discrepancy time	400 ms	
		Reintegration after discrepancy error	Test 0-Signal not necessary	
		Channel 1		
		Activated	Yes	
		Channel failure acknowledge	Automatic	
		Sensor supply	External sensor supply	
Input delay	3,2 ms			
Chatter monitoring	No			
Number of signal changes	5			
Monitoring window	2 sec			
Channel 5				
Activated	Yes			
Channel failure acknowledge	Automatic			
Sensor supply	External sensor supply			
Input delay	3,2 ms			
Chatter monitoring	No			
Number of signal changes	5			
Monitoring window	2 sec			
Safety information: D6B83718 Consistent; STEP 7 Safety V19;				

Totally Integrated Automation Portal			
General parameters	Specific Parameters		
	Channel 2, 6		
	Sensor evaluation	1oo1 evaluation	
	Discrepancy behavior	Supply value 0	
	Discrepancy time	400 ms	
	Reintegration after discrepancy error	Test 0-Signal not necessary	
	Channel 2		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	3,2 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
	Monitoring window	2 sec	
	Channel 6		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	3,2 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
	Monitoring window	2 sec	
	Channel 3, 7		
	Sensor evaluation	1oo1 evaluation	
	Discrepancy behavior	Supply value 0	
	Discrepancy time	400 ms	
	Reintegration after discrepancy error	Test 0-Signal not necessary	
	Channel 3		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	3,2 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
	Monitoring window	2 sec	
	Channel 7		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	3,2 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
Monitoring window	2 sec		
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal					
KF8 : Central I/O Telaio di montaggio_0, Slot 9					
General parameters			Specific Parameters		
Hardware			Sensor supply 0		
Name	KF8		Short-circuit test	No	
Slot	9		Time for short-circuit test	4.2 ms	
Short designation	F-DI 8x24VDC HF		Startup time of sensor after short-circuit test	4.2 ms	
Article number	6ES7 136-6BA01-OCA0		Sensor supply 1		
Start address input	434		Short-circuit test	No	
Start address output	434		Time for short-circuit test	4.2 ms	
Hardware identifier	275		Startup time of sensor after short-circuit test	4.2 ms	
F-monitoring time	400 ms		Sensor supply 2		
F-source address	1		Short-circuit test	No	
F-destination address	65532		Time for short-circuit test	4.2 ms	
F-parameter signature (without addresses)	0x9EE8 (40680)		Startup time of sensor after short-circuit test	4.2 ms	
F-parameter signature (with addresses)	0x990C (39180)		Sensor supply 3		
Behavior after channel fault	Passivate channel		Short-circuit test	No	
RIOforFA-Safety	Yes		Time for short-circuit test	4.2 ms	
PROFIsafe mode	V2 mode		Startup time of sensor after short-circuit test	4.2 ms	
PROFIsafe protocol version	Expanded protocol (XP)		Sensor supply 4		
Firmware version	V2.0		Short-circuit test	No	
Software			Time for short-circuit test	4.2 ms	
F-I/O DB number	30011		Startup time of sensor after short-circuit test	4.2 ms	
F I/O DB name	F00434_KF8		Sensor supply 5		
Used in F-runtime group	RTG1		Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 6		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 7		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Channel 0, 4		
			Sensor evaluation	1oo2 evaluation, equivalent	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 0		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 4		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 1, 5		
			Sensor evaluation	1oo1 evaluation	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 1		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 5		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
Safety information: D6B83718 Consistent; STEP 7 Safety V19;					

Totally Integrated Automation Portal			
General parameters	Specific Parameters		
	Channel 2, 6		
	Sensor evaluation	1oo1 evaluation	
	Discrepancy behavior	Supply value 0	
	Discrepancy time	400 ms	
	Reintegration after discrepancy error	Test 0-Signal not necessary	
	Channel 2		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	6,4 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
	Monitoring window	2 sec	
	Channel 6		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	6,4 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
	Monitoring window	2 sec	
	Channel 3, 7		
	Sensor evaluation	1oo1 evaluation	
	Discrepancy behavior	Supply value 0	
	Discrepancy time	400 ms	
	Reintegration after discrepancy error	Test 0-Signal not necessary	
	Channel 3		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	3,2 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
	Monitoring window	2 sec	
	Channel 7		
	Activated	Yes	
	Channel failure acknowledge	Automatic	
	Sensor supply	External sensor supply	
	Input delay	3,2 ms	
	Chatter monitoring	No	
	Number of signal changes	5	
Monitoring window	2 sec		
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal					
KF9 : Central I/O Telaio di montaggio_0, Slot 10					
General parameters			Specific Parameters		
Hardware			Sensor supply 0		
Name	KF9		Short-circuit test	No	
Slot	10		Time for short-circuit test	4.2 ms	
Short designation	F-DI 8x24VDC HF		Startup time of sensor after short-circuit test	4.2 ms	
Article number	6ES7 136-6BA01-0CA0		Sensor supply 1		
Start address input	441		Short-circuit test	No	
Start address output	441		Time for short-circuit test	4.2 ms	
Hardware identifier	276		Startup time of sensor after short-circuit test	4.2 ms	
F-monitoring time	400 ms		Sensor supply 2		
F-source address	1		Short-circuit test	No	
F-destination address	65531		Time for short-circuit test	4.2 ms	
F-parameter signature (without addresses)	0x13B3 (5043)		Startup time of sensor after short-circuit test	4.2 ms	
F-parameter signature (with addresses)	0x6CBB (27835)		Sensor supply 3		
Behavior after channel fault	Passivate channel		Short-circuit test	No	
RIOforFA-Safety	Yes		Time for short-circuit test	4.2 ms	
PROFIsafe mode	V2 mode		Startup time of sensor after short-circuit test	4.2 ms	
PROFIsafe protocol version	Expanded protocol (XP)		Sensor supply 4		
Firmware version	V2.0		Short-circuit test	No	
Software			Time for short-circuit test	4.2 ms	
F-I/O DB number	30012		Startup time of sensor after short-circuit test	4.2 ms	
F I/O DB name	F00441_KF9		Sensor supply 5		
Used in F-runtime group	RTG1		Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 6		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 7		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Channel 0, 4		
			Sensor evaluation	1oo1 evaluation	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 0		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 4		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 1, 5		
			Sensor evaluation	1oo1 evaluation	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 1		
			Activated	Yes	
			Channel failure acknowledge	Automatic	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 5		
			Activated	No	
			Channel failure acknowledge	Manual	
			Sensor supply	External sensor supply	
			Input delay	3,2 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
Safety information: D6B83718 Consistent; STEP 7 Safety V19;					

Totally Integrated Automation Portal		
General parameters	Specific Parameters	
	Channel 2, 6	
	Sensor evaluation	1oo1 evaluation
	Discrepancy behavior	Supply value 0
	Discrepancy time	400 ms
	Reintegration after discrepancy error	Test 0-Signal not necessary
	Channel 2	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
	Channel 6	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	Sensor supply 6
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
	Channel 3, 7	
	Sensor evaluation	1oo1 evaluation
	Discrepancy behavior	Supply value 0
	Discrepancy time	400 ms
	Reintegration after discrepancy error	Test 0-Signal not necessary
	Channel 3	
	Activated	Yes
	Channel failure acknowledge	Automatic
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
	Channel 7	
	Activated	No
	Channel failure acknowledge	Manual
	Sensor supply	External sensor supply
	Input delay	3,2 ms
	Chatter monitoring	No
	Number of signal changes	5
	Monitoring window	2 sec
Safety information: D6B83718 Consistent; STEP 7 Safety V19;		

Totally Integrated Automation Portal					
KF10 : Central I/O Telaio di montaggio_0, Slot 11					
General parameters			Specific Parameters		
Hardware			Sensor supply 0		
Name	KF10		Short-circuit test	No	
Slot	11		Time for short-circuit test	4.2 ms	
Short designation	F-DI 8x24VDC HF		Startup time of sensor after short-circuit test	4.2 ms	
Article number	6ES7 136-6BA01-OCA0		Sensor supply 1		
Start address input	448		Short-circuit test	No	
Start address output	448		Time for short-circuit test	4.2 ms	
Hardware identifier	277		Startup time of sensor after short-circuit test	4.2 ms	
F-monitoring time	400 ms		Sensor supply 2		
F-source address	1		Short-circuit test	No	
F-destination address	65530		Time for short-circuit test	4.2 ms	
F-parameter signature (without addresses)	0x1540 (5440)		Startup time of sensor after short-circuit test	4.2 ms	
F-parameter signature (with addresses)	0x7B85 (31621)		Sensor supply 3		
Behavior after channel fault	Passivate channel		Short-circuit test	No	
RIOforFA-Safety	Yes		Time for short-circuit test	4.2 ms	
PROFIsafe mode	V2 mode		Startup time of sensor after short-circuit test	4.2 ms	
PROFIsafe protocol version	Expanded protocol (XP)		Sensor supply 4		
Firmware version	V2.0		Short-circuit test	No	
Software			Time for short-circuit test	4.2 ms	
F-I/O DB number	30013		Startup time of sensor after short-circuit test	4.2 ms	
F I/O DB name	F00448_KF10		Sensor supply 5		
Used in F-runtime group	RTG1		Short-circuit test	No	
		Time for short-circuit test	4.2 ms		
		Startup time of sensor after short-circuit test	4.2 ms		
		Sensor supply 6			
		Short-circuit test	No		
		Time for short-circuit test	4.2 ms		
		Startup time of sensor after short-circuit test	4.2 ms		
		Sensor supply 7			
		Short-circuit test	No		
		Time for short-circuit test	4.2 ms		
		Startup time of sensor after short-circuit test	4.2 ms		
		Channel 0, 4			
		Sensor evaluation	1oo1 evaluation		
		Discrepancy behavior	Supply value 0		
		Discrepancy time	400 ms		
		Reintegration after discrepancy error	Test 0-Signal not necessary		
		Channel 0			
		Activated	Yes		
		Channel failure acknowledge	Automatic		
		Sensor supply	External sensor supply		
		Input delay	3,2 ms		
		Chatter monitoring	No		
		Number of signal changes	5		
		Monitoring window	2 sec		
		Channel 4			
		Activated	Yes		
		Channel failure acknowledge	Automatic		
		Sensor supply	External sensor supply		
		Input delay	3,2 ms		
		Chatter monitoring	No		
		Number of signal changes	5		
		Monitoring window	2 sec		
		Channel 1, 5			
		Sensor evaluation	1oo1 evaluation		
		Discrepancy behavior	Supply value 0		
		Discrepancy time	400 ms		
		Reintegration after discrepancy error	Test 0-Signal not necessary		
		Channel 1			
		Activated	No		
		Channel failure acknowledge	Manual		
		Sensor supply	External sensor supply		
		Input delay	3,2 ms		
		Chatter monitoring	No		
		Number of signal changes	5		
		Monitoring window	2 sec		
		Channel 5			
		Activated	Yes		
		Channel failure acknowledge	Automatic		
		Sensor supply	Sensor supply 5		
		Input delay	3,2 ms		
		Chatter monitoring	No		
		Number of signal changes	5		
		Monitoring window	2 sec		
Safety information: D6B83718 Consistent; STEP 7 Safety V19;					

Totally Integrated Automation Portal			
General parameters		Specific Parameters	
		Channel 2, 6	
		Sensor evaluation	1oo2 evaluation, equivalent
		Discrepancy behavior	Supply value 0
		Discrepancy time	400 ms
		Reintegration after discrepancy error	Test 0-Signal not necessary
		Channel 2	
		Activated	Yes
		Channel failure acknowledge	Automatic
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
		Channel 6	
		Activated	Yes
		Channel failure acknowledge	Automatic
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
		Channel 3, 7	
		Sensor evaluation	1oo1 evaluation
		Discrepancy behavior	Supply value 0
		Discrepancy time	400 ms
		Reintegration after discrepancy error	Test 0-Signal not necessary
		Channel 3	
		Activated	Yes
		Channel failure acknowledge	Automatic
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
		Channel 7	
		Activated	Yes
		Channel failure acknowledge	Automatic
		Sensor supply	Sensor supply 7
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
KF11 : Central I/O Telaio di montaggio_0, Slot 12			
General parameters		Specific Parameters	
Hardware		Maximum test period	
Name	KF11		1000 sec
Slot	12	Disable Dark Test (max. SIL2, CAT3, PLd)	No
Short designation	F-DQ 4x24VDC/2A PM HF	Channel 0	
Article number	6ES7 136-6DB00-0CA0	Activated	Yes
Start address input	250	Max. readback time, dark test and switch-off test	1.0 ms
Start address output	250	Max. readback time switch on test	0.6 ms
Hardware identifier	278	Activated light test	No
F-monitoring time	400 ms	Diagnosis: Wire break	No
F-source address	1	Channel 1	
F-destination address	65529	Activated	Yes
F-parameter signature (without addresses)	0x2AF1 (10993)	Max. readback time, dark test and switch-off test	1.0 ms
F-parameter signature (with addresses)	0x9439 (37945)	Max. readback time switch on test	0.6 ms
Behavior after channel fault	Passivate channel	Activated light test	No
RIOforFA-Safety	No	Diagnosis: Wire break	No
PROFIsafe mode	V2 mode	Channel 2	
PROFIsafe protocol version	Loop-back extension (LP)	Activated	Yes
Firmware version	V2.0	Max. readback time, dark test and switch-off test	1.0 ms
Software		Max. readback time switch on test	0.6 ms
F-I/O DB number	30014	Activated light test	No
F I/O DB name	F00250_KF11	Diagnosis: Wire break	No
Used in F-runtime group	RTG1	Channel 3	
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
		Channel 3	
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal			
KF12 : Central I/O Telaio di montaggio_0, Slot 13			
General parameters		Specific Parameters	
Hardware		Maximum test period	1000 sec
Name	KF12	Disable Dark Test (max. SIL2, CAT3, PLd)	Yes
Slot	13	Channel 0	
Short designation	F-DQ 4x24VDC/2A PM HF	Activated	Yes
Article number	6ES7 136-6DB00-OCA0	Max. readback time, dark test and switch-off test	1.0 ms
Start address input	455	Max. readback time switch on test	0.6 ms
Start address output	455	Activated light test	Yes
Hardware identifier	279	Diagnosis: Wire break	No
F-monitoring time	400 ms	Channel 1	
F-source address	1	Activated	Yes
F-destination address	65528	Max. readback time, dark test and switch-off test	1.0 ms
F-parameter signature (without addresses)	0x2B68 (11112)	Max. readback time switch on test	0.6 ms
F-parameter signature (with addresses)	0x8D3A (36154)	Activated light test	Yes
Behavior after channel fault	Passivate channel	Diagnosis: Wire break	No
RIOforFA-Safety	No	Channel 2	
PROFIsafe mode	V2 mode	Activated	Yes
PROFIsafe protocol version	Loop-back extension (LP)	Max. readback time, dark test and switch-off test	1.0 ms
Firmware version	V2.0	Max. readback time switch on test	0.6 ms
Software		Activated light test	Yes
F-I/O DB number	30015	Diagnosis: Wire break	No
F I/O DB name	F00455_KF12	Channel 3	
Used in F-runtime group	RTG1	Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	Yes
		Diagnosis: Wire break	No
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	Yes
		Diagnosis: Wire break	No
KF13 : Central I/O Telaio di montaggio_0, Slot 14			
General parameters		Specific Parameters	
Hardware		Maximum test period	1000 sec
Name	KF13	Disable Dark Test (max. SIL2, CAT3, PLd)	No
Slot	14	Channel 0	
Short designation	F-DQ 4x24VDC/2A PM HF	Activated	Yes
Article number	6ES7 136-6DB00-OCA0	Max. readback time, dark test and switch-off test	1.0 ms
Start address input	460	Max. readback time switch on test	0.6 ms
Start address output	460	Activated light test	No
Hardware identifier	280	Diagnosis: Wire break	No
F-monitoring time	400 ms	Channel 1	
F-source address	1	Activated	Yes
F-destination address	65527	Max. readback time, dark test and switch-off test	1.0 ms
F-parameter signature (without addresses)	0x2AF1 (10993)	Max. readback time switch on test	0.6 ms
F-parameter signature (with addresses)	0x6BC6 (27590)	Activated light test	No
Behavior after channel fault	Passivate channel	Diagnosis: Wire break	No
RIOforFA-Safety	No	Channel 2	
PROFIsafe mode	V2 mode	Activated	Yes
PROFIsafe protocol version	Loop-back extension (LP)	Max. readback time, dark test and switch-off test	1.0 ms
Firmware version	V2.0	Max. readback time switch on test	0.6 ms
Software		Activated light test	No
F-I/O DB number	30016	Diagnosis: Wire break	No
F I/O DB name	F00460_KF13	Channel 3	
Used in F-runtime group	RTG1	Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal			
KF14 : Central I/O Telaio di montaggio_0, Slot 15			
General parameters		Specific Parameters	
Hardware		Maximum test period	1000 sec
Name	KF14	Disable Dark Test (max. SIL2, CAT3, PLd)	No
Slot	15		
Short designation	F-DQ 4x24VDC/2A PM HF	Channel 0	
Article number	6ES7 136-6DB00-0CA0	Activated	Yes
Start address input	465	Max. readback time, dark test and switch-off test	1.0 ms
Start address output	465	Max. readback time switch on test	0.6 ms
Hardware identifier	283	Activated light test	No
F-monitoring time	400 ms	Diagnosis: Wire break	No
F-source address	1	Channel 1	
F-destination address	65526	Activated	Yes
F-parameter signature (without addresses)	0x2AF1 (10993)	Max. readback time, dark test and switch-off test	1.0 ms
F-parameter signature (with addresses)	0x1480 (5248)	Max. readback time switch on test	0.6 ms
Behavior after channel fault	Passivate channel	Activated light test	No
RIOforFA-Safety	No	Diagnosis: Wire break	No
PROFIsafe mode	V2 mode	Channel 2	
PROFIsafe protocol version	Loop-back extension (LP)	Activated	Yes
Firmware version	V2.0	Max. readback time, dark test and switch-off test	1.0 ms
Software		Max. readback time switch on test	0.6 ms
F-I/O DB number	30026	Activated light test	No
F I/O DB name	F00465_KF14	Diagnosis: Wire break	No
Used in F-runtime group	RTG1	Channel 3	
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal					
KF17 : Central I/O Telaio di montaggio_0, Slot 18					
General parameters			Specific Parameters		
Hardware			Sensor supply 0		
Name	KF17		Short-circuit test	No	
Slot	18		Time for short-circuit test	4.2 ms	
Short designation	F-DI 8x24VDC HF		Startup time of sensor after short-circuit test	4.2 ms	
Article number	6ES7 136-6BA01-0CA0		Sensor supply 1		
Start address input	516		Short-circuit test	No	
Start address output	516		Time for short-circuit test	4.2 ms	
Hardware identifier	372		Startup time of sensor after short-circuit test	4.2 ms	
F-monitoring time	400 ms		Sensor supply 2		
F-source address	1		Short-circuit test	No	
F-destination address	65525		Time for short-circuit test	4.2 ms	
F-parameter signature (without addresses)	0x5944 (22852)		Startup time of sensor after short-circuit test	4.2 ms	
F-parameter signature (with addresses)	0xD6F3 (55027)		Sensor supply 3		
Behavior after channel fault	Passivate channel		Short-circuit test	No	
RIOforFA-Safety	Yes		Time for short-circuit test	4.2 ms	
PROFIsafe mode	V2 mode		Startup time of sensor after short-circuit test	4.2 ms	
PROFIsafe protocol version	Expanded protocol (XP)		Sensor supply 4		
Firmware version	V2.0		Short-circuit test	No	
Software			Time for short-circuit test	4.2 ms	
F-I/O DB number	30028		Startup time of sensor after short-circuit test	4.2 ms	
F I/O DB name	F00516_KF17		Sensor supply 5		
Used in F-runtime group	RTG1		Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 6		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Sensor supply 7		
			Short-circuit test	No	
			Time for short-circuit test	4.2 ms	
			Startup time of sensor after short-circuit test	4.2 ms	
			Channel 0, 4		
			Sensor evaluation	1oo1 evaluation	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 0		
			Activated	Yes	
			Channel failure acknowledge	Manual	
			Sensor supply	External sensor supply	
			Input delay	0,4 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 4		
			Activated	Yes	
			Channel failure acknowledge	Manual	
			Sensor supply	External sensor supply	
			Input delay	0,4 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 1, 5		
			Sensor evaluation	1oo1 evaluation	
			Discrepancy behavior	Supply value 0	
			Discrepancy time	400 ms	
			Reintegration after discrepancy error	Test 0-Signal not necessary	
			Channel 1		
			Activated	Yes	
			Channel failure acknowledge	Manual	
			Sensor supply	External sensor supply	
			Input delay	0,4 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
			Channel 5		
			Activated	Yes	
			Channel failure acknowledge	Manual	
			Sensor supply	External sensor supply	
			Input delay	0,4 ms	
			Chatter monitoring	No	
			Number of signal changes	5	
			Monitoring window	2 sec	
Safety information: D6B83718 Consistent; STEP 7 Safety V19;					

Totally Integrated Automation Portal			
General parameters		Specific Parameters	
		Channel 2, 6	
		Sensor evaluation	1oo2 evaluation, equivalent
		Discrepancy behavior	Supply last valid value
		Discrepancy time	400 ms
		Reintegration after discrepancy error	Test 0-Signal not necessary
		Channel 2	
		Activated	Yes
		Channel failure acknowledge	Manual
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
		Channel 6	
		Activated	Yes
		Channel failure acknowledge	Manual
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
		Channel 3, 7	
		Sensor evaluation	1oo1 evaluation
		Discrepancy behavior	Supply value 0
		Discrepancy time	400 ms
		Reintegration after discrepancy error	Test 0-Signal not necessary
		Channel 3	
		Activated	Yes
		Channel failure acknowledge	Manual
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
		Channel 7	
		Activated	Yes
		Channel failure acknowledge	Manual
		Sensor supply	External sensor supply
		Input delay	3,2 ms
		Chatter monitoring	No
		Number of signal changes	5
		Monitoring window	2 sec
KF18 : Central I/O Telaio di montaggio_0, Slot 19			
General parameters		Specific Parameters	
Hardware		Maximum test period	
Name	KF18		1000 sec
Slot	19	Disable Dark Test (max. SIL2, CAT3, PLd)	No
Short designation	F-DQ 4x24VDC/2A PM HF	Channel 0	
Article number	6ES7 136-6DB00-0CA0	Activated	Yes
Start address input	486	Max. readback time, dark test and switch-off test	1.0 ms
Start address output	486	Max. readback time switch on test	0.6 ms
Hardware identifier	373	Activated light test	No
F-monitoring time	400 ms	Diagnosis: Wire break	No
F-source address	1	Channel 1	
F-destination address	65524	Activated	Yes
F-parameter signature (without addresses)	0x2AF1 (10993)	Max. readback time, dark test and switch-off test	1.0 ms
F-parameter signature (with addresses)	0x7624 (30244)	Max. readback time switch on test	0.6 ms
Behavior after channel fault	Passivate channel	Activated light test	No
RIOforFA-Safety	No	Diagnosis: Wire break	No
PROFIsafe mode	V2 mode	Channel 2	
PROFIsafe protocol version	Loop-back extension (LP)	Activated	Yes
Firmware version	V2.0	Max. readback time, dark test and switch-off test	1.0 ms
Software		Max. readback time switch on test	0.6 ms
F-I/O DB number	30029	Activated light test	No
F I/O DB name	F00486_KF18	Diagnosis: Wire break	No
Used in F-runtime group	RTG1	Channel 3	
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
		Channel 3	
		Activated	Yes
		Max. readback time, dark test and switch-off test	1.0 ms
		Max. readback time switch on test	0.6 ms
		Activated light test	No
		Diagnosis: Wire break	No
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Totally Integrated Automation Portal			
Telegramma_PROFIsafe_30 : G120C_PN, PositionNumber 0			
General parameters		Specific Parameters	
Hardware		F_SIL	SIL2
Name	Telegramma_PROFIsafe_30	F_Source_Add	1
PositionNumber	0	F_iPar_CRC	0
Short designation	Telegramma PROFIsafe 30	F_Check_iPar	NoCheck
--	--	F_Block_ID	0
Start address input	12	F_CRC_Length	3-Byte-CRC
Start address output	12	Receive direction, S_STW1	
Laddr	362	Bit 0	Not supported
F_WD_Time	400 ms	Bit 1	Not supported
F_Dest_Add	51	Bit 2	Not supported
F_Par_CRC_WithoutAddresses	0xAA61 (43617)	Bit 3	Not supported
F_Par_CRC	0xF8F1 (63729)	Bit 4	Not supported
Behavior after channel fault	Passivate the entire module	Bit 5	Not supported
RIOforFA-Safety	No	Bit 6	Not supported
F_Par_Version	V2-mode	Bit 7	Not supported
PROFIsafe protocol version	Loop-back extension (LP)	Bit 8	Not supported
Software		Bit 9	Not supported
F-I/O DB number	30032	Bit 10	Not supported
F I/O DB name	F00012_Telegramma_PROFIsafe_30	Bit 11	Not supported
Used in F-runtime group	RTG1	Bit 12	Not supported
		Bit 13	Not supported
		Bit 14	Not supported
		Bit 15	Not supported
		Send direction, S_ZSW1	
		Bit 0	Not supported
		Bit 1	Not supported
		Bit 2	Not supported
		Bit 3	Not supported
		Bit 4	Not supported
		Bit 5	Not supported
		Bit 6	Not supported
		Bit 7	Not supported
		Bit 8	Not supported
		Bit 9	Not supported
		Bit 10	Not supported
		Bit 11	Not supported
		Bit 12	Not supported
Bit 13	Not supported		
Bit 14	Not supported		
Bit 15	Not supported		
Supplementary information			
Safety summary created on	6/3/2026 4:50:08 PM (UTC +2:00)	Page numbers for safety summary	From 1 - 1 to 1 - 21
Safety information: D6B83718 Consistent; STEP 7 Safety V19;			

Safety Administration / Fail-safe user blocks

LDrvSafe_SinaGTlg30Control

LDrvSafe_SinaGTlg30Control Properties							
General							
Name	LDrvSafe_SinaGTlg30Control	Number	29000	Type	FB	Language	FBD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	LDrvSafe
Version	2.1	User-defined ID					

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
▼ Input											
STO	Bool	true	Non-retain	True	False	True	False				
SS1	Bool	true	Non-retain	True	False	True	False				
SLS	Bool	true	Non-retain	True	False	True	False				
selectSLSbit0	Bool	false	Non-retain	True	False	True	False				
selectSLSbit1	Bool	false	Non-retain	True	False	True	False				
SDIpositive	Bool	true	Non-retain	True	False	True	False				
SDInegative	Bool	true	Non-retain	True	False	True	False				
ackSafetyFaults	Bool	false	Non-retain	True	False	True	False				
▼ Output											
▼ SinaGTlg30Control	"LDrvSafe_type-SinaGTlg30Control"		Non-retain	True	False	True	False				
STO	Bool	false	Non-retain	True	False	True	False				
SS1	Bool	false	Non-retain	True	False	True	False				
reserved1	Bool	false	Non-retain	True	False	True	False				
reserved2	Bool	false	Non-retain	True	False	True	False				
SLS	Bool	false	Non-retain	True	False	True	False				
reserved3	Bool	false	Non-retain	True	False	True	False				
reserved4	Bool	false	Non-retain	True	False	True	False				
internalEventAcknowledge	Bool	false	Non-retain	True	False	True	False				
reserved5	Bool	false	Non-retain	True	False	True	False				
selectSLSbit0	Bool	false	Non-retain	True	False	True	False				
selectSLSbit1	Bool	false	Non-retain	True	False	True	False				
reserved6	Bool	false	Non-retain	True	False	True	False				
SDIpositive	Bool	false	Non-retain	True	False	True	False				
SDInegative	Bool	false	Non-retain	True	False	True	False				
reserved7	Bool	false	Non-retain	True	False	True	False				
reserved8	Bool	false	Non-retain	True	False	True	False				
InOut											
Static											

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

LDrvSafe_SinaGTlg30Status

LDrvSafe_SinaGTlg30Status Properties

General

Name	LDrvSafe_SinaGTlg30Status	Number	29010	Type	FB	Language	FBD
Numbering	Automatic						

Information

Title		Author		Comment		Family	LDrvSafe
Version	2.1	User-defined ID					

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion				Comment
▼ Input												
▼ SinaGTlg30Status	"LDrvSafe_type-SinaGTlg30Sta-tus"		Non-retain	True	False	True	False					
STOactive	Bool	false	Non-retain	True	False	True	False					
SS1active	Bool	false	Non-retain	True	False	True	False					
reserved1	Bool	false	Non-retain	True	False	True	False					
reserved2	Bool	false	Non-retain	True	False	True	False					
SLSactive	Bool	false	Non-retain	True	False	True	False					
reserved3	Bool	false	Non-retain	True	False	True	False					
reserved4	Bool	false	Non-retain	True	False	True	False					
internalEvent	Bool	false	Non-retain	True	False	True	False					
reserved5	Bool	false	Non-retain	True	False	True	False					
SLSbit0Active	Bool	false	Non-retain	True	False	True	False					
SLSbit1Active	Bool	false	Non-retain	True	False	True	False					
reserved6	Bool	false	Non-retain	True	False	True	False					
SDIpositiveActive	Bool	false	Non-retain	True	False	True	False					
SDInegativeActive	Bool	false	Non-retain	True	False	True	False					
reserved7	Bool	false	Non-retain	True	False	True	False					
SSMactive	Bool	false	Non-retain	True	False	True	False					
▼ Output												
safetyFaultActive	Bool	false	Non-retain	True	False	True	False					
STOactive	Bool	false	Non-retain	True	False	True	False					
SS1active	Bool	false	Non-retain	True	False	True	False					
SLSactive	Bool	false	Non-retain	True	False	True	False					
SLSbit0Active	Bool	false	Non-retain	True	False	True	False					
SLSbit1Active	Bool	false	Non-retain	True	False	True	False					
SDIpositiveActive	Bool	false	Non-retain	True	False	True	False					
SDInegativeActive	Bool	false	Non-retain	True	False	True	False					
SSMactive	Bool	false	Non-retain	True	False	True	False					
InOut												
Static												

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

REWINDER CONTROL DESK 000CD1

REWINDER CONTROL DESK 000CD1 Properties

General

Name	REWINDER CONTROL DESK 000CD1	Number	1	Type	FB	Language	LAD
Numbering	Manual						

Information


Title	EMERGENCY	Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
Input									
Output									
InOut									
▼ Static									
▼ Display PushButton S1	ESTOP1			True	True	True	False		
▼ Input									
E_STOP	Bool	false	Non-retain	True	True	True	False		Emergency STOP
ACK_NEC	Bool	true	Non-retain	True	True	True	False		1=Acknowledgment neces-sary
ACK	Bool	false	Non-retain	True	True	True	False		1=Acknowledgment
TIME_DEL	Time	0	Non-retain	True	True	True	False		Time delay
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		1=Enable
Q_DELAY	Bool	false	Non-retain	True	True	True	False		Enable is OFF delayed
ACK_REQ	Bool	false	Non-retain	True	True	True	False		1=acknowledgment request
DIAG	Byte	B#16#00	Non-retain	True	True	True	False		Service information
InOut									
Static									
Emergency_ok	Bool	false	Non-retain	True	True	True	False		
▼ F_IEC_Timer_Instance	TON			True	True	True	False		
▼ Input									
IN	Bool	false	Non-retain	True	True	True	False		Start input
PT	Time	T#0ms	Non-retain	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False		Current time value
InOut									
Static									
▼ Pulse up	TON			True	True	True	False		
▼ Input									
IN	Bool	false	Non-retain	True	True	True	False		Start input
PT	Time	T#0ms	Non-retain	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False		Current time value
InOut									
Static									
▼ Pulse Down	TON			True	True	True	False		
▼ Input									
IN	Bool	false	Non-retain	True	True	True	False		Start input
PT	Time	T#0ms	Non-retain	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False		Current time value
InOut									
Static									
▼ SFDOOR_Instance	SFDOOR			True	True	True	False		
▼ Input									
IN1	Bool	false	Non-retain	True	True	True	False		Input 1
IN2	Bool	false	Non-retain	True	True	True	False		Input 2


Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
QBAD_IN1	Bool	false	Non-retain	True	True	True	False				QBAD signal of FI/O/channel of input IN1
QBAD_IN2	Bool	false	Non-retain	True	True	True	False				QBAD signal of FI/O/channel of input IN2
OPEN_NEC	Bool	true	Non-retain	True	True	True	False				1=open necessary at startup
ACK_NEC	Bool	true	Non-retain	True	True	True	False				1=acknowledgment neces-sary
ACK	Bool	false	Non-retain	True	True	True	False				Acknowledgment
▼ Output											
Q	Bool	false	Non-retain	True	True	True	False				1=Enable, safety door closed
ACK_REQ	Bool	false	Non-retain	True	True	True	False				1=acknowledgement re-quest
DIAG	Byte	B#16#00	Non-retain	True	True	True	False				Service information
InOut											
Static											
feedback ok RR	Bool	false	Non-retain	True	True	True	False				
Feedback ok Chucks	Bool	false	Non-retain	True	True	True	False				
Temp											
Constant											

Network 1: ack global

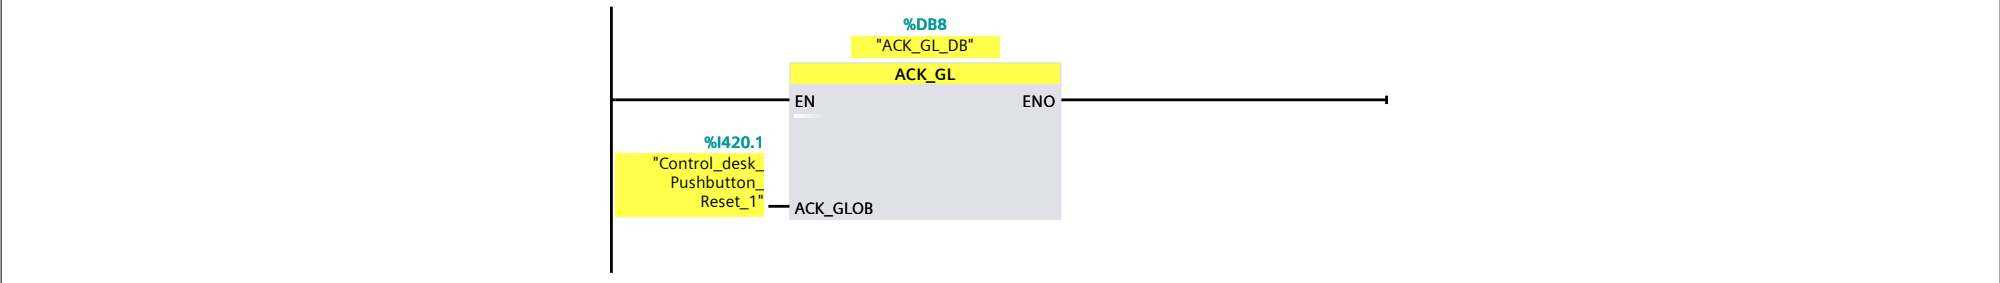


Network 2: EMERGENCY BUTTON S1

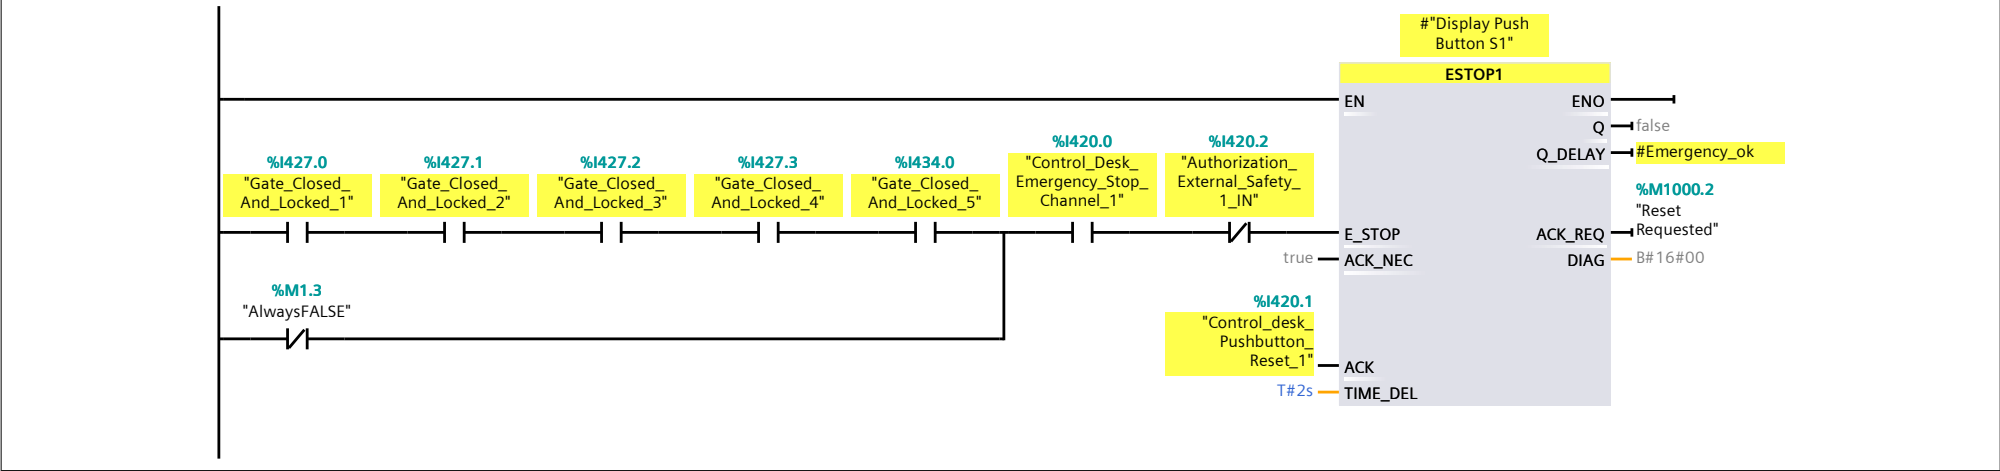

Network 3: Power Supply Cutoff K1/K2




Network 4: EMERGENCY ON

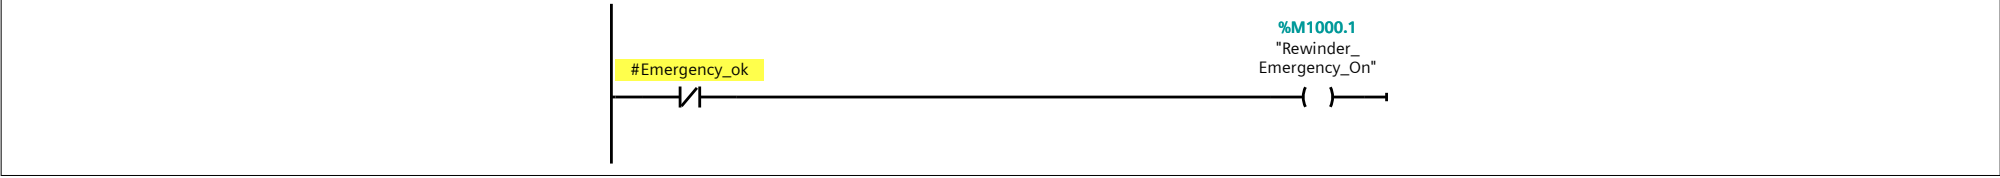


Network 5: FEEDBACK LINE CONTACTORS




Network 6: MACHINE IN EMERGENCY STATUS

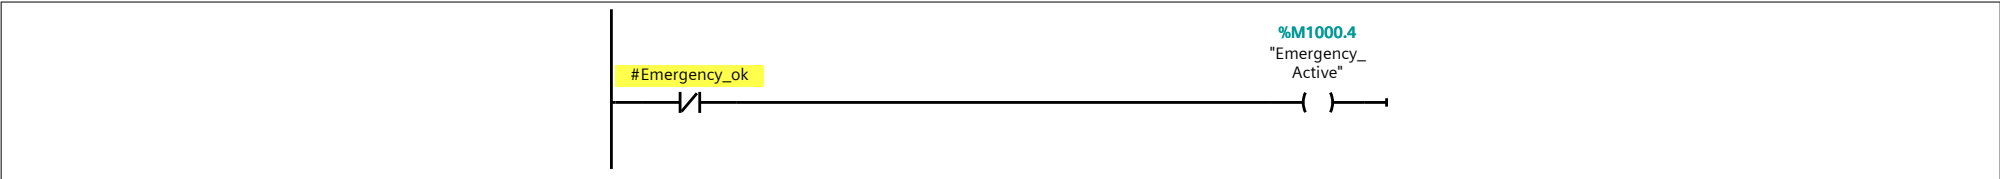


Network 7: PROFISAFE CONTROL

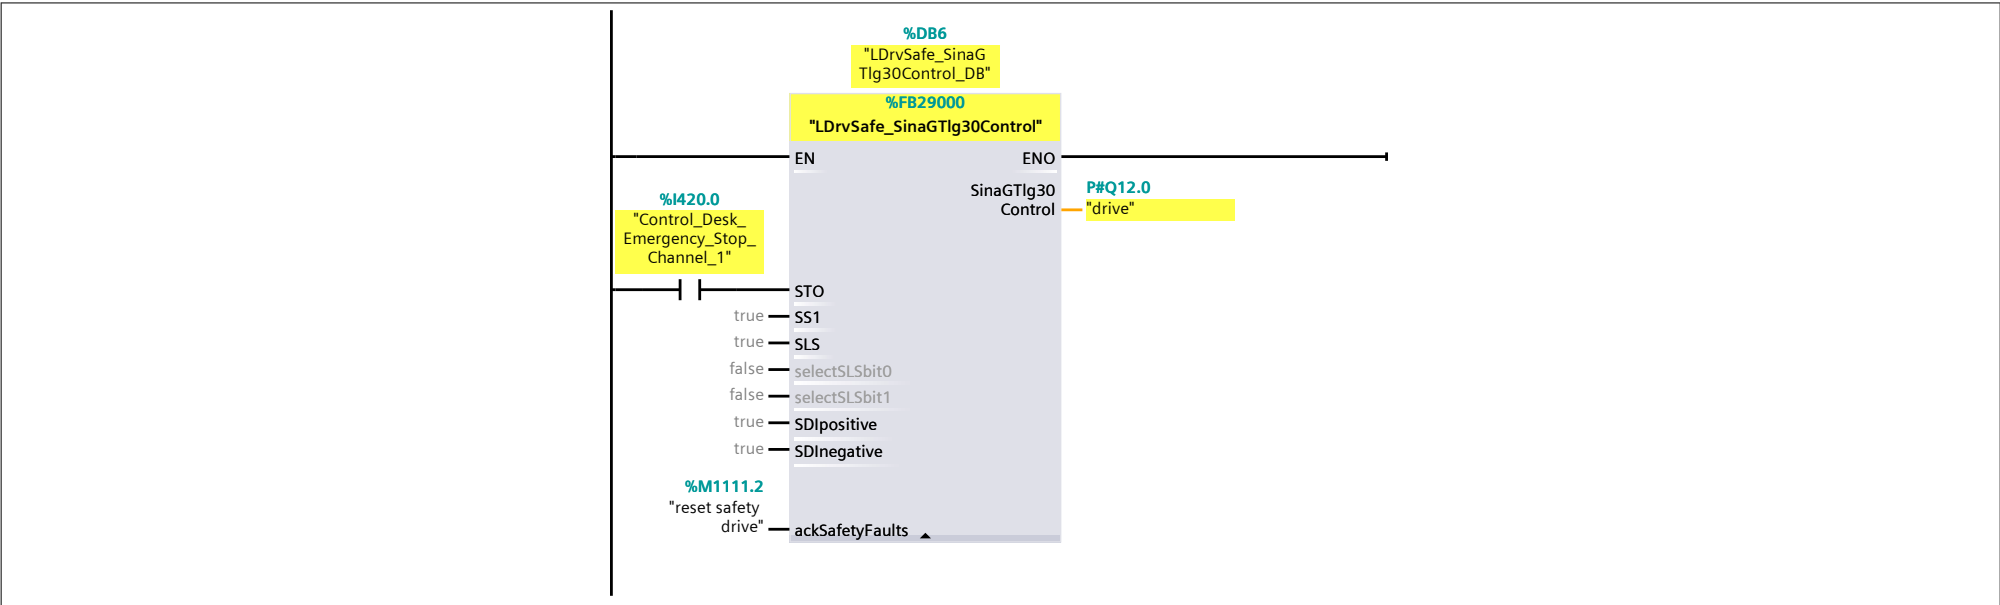


Network 8: PROFISAFE STATUS

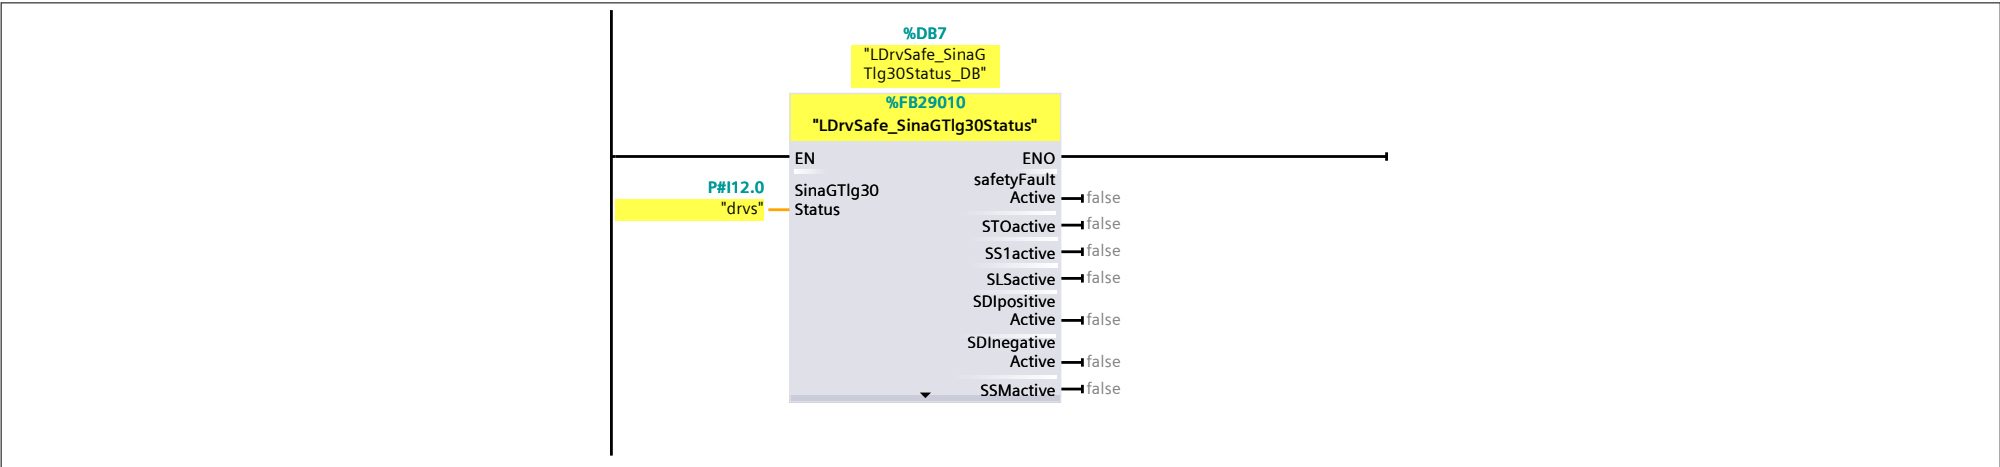

Network 9: speed control feedback

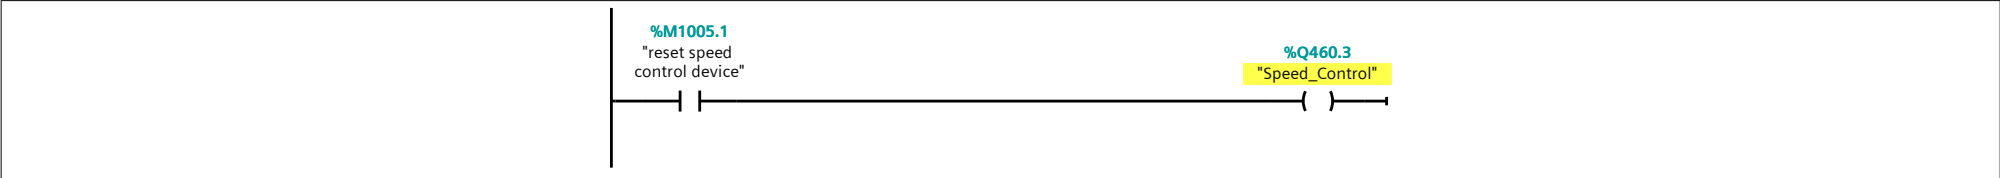


Network 10: speed control feedback

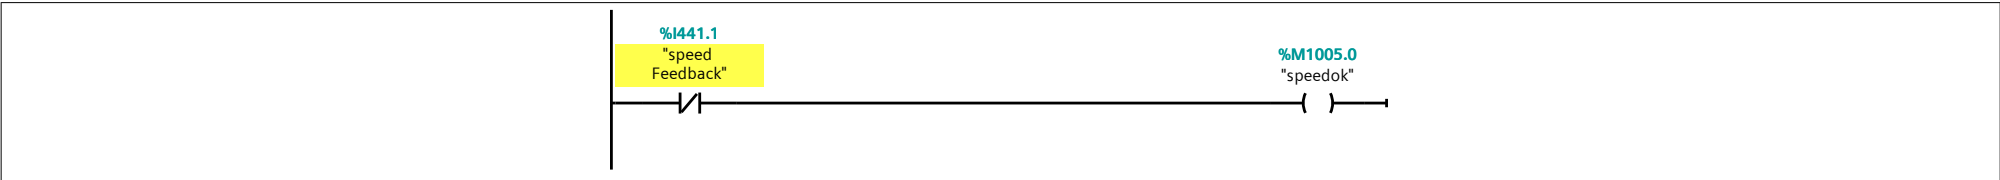


Network 11:




Network 12:

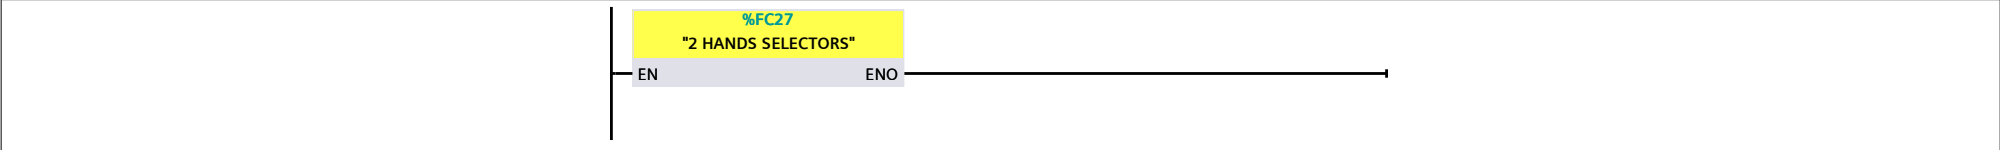

Network 13:

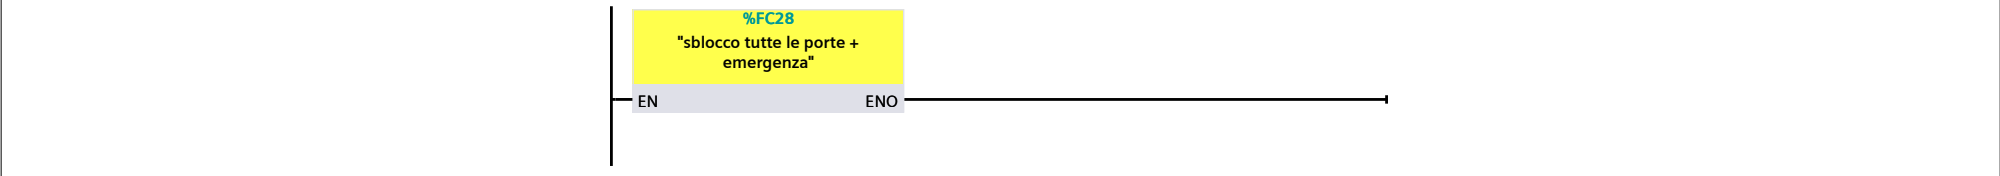

Network 14:

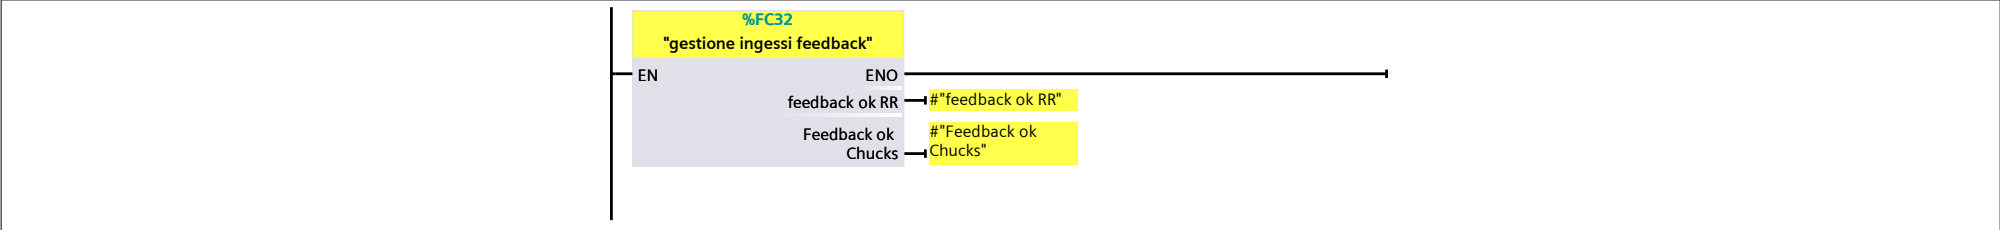

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

gate requests manage

gate requests manage Properties

General

Name	gate requests manage	Number	4	Type	FC	Language	LAD
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Default value	Comment
Input			
Output			
InOut			
Temp			
Constant			
▼ Return			
gate requests manage	Void		

Network 1: Gate G6 MU011

%M1005.5
"G6 gate open"

%Q250.3
"Gate_Lock_Unlock_3"

Network 2: Gate G8 MU011

%M1005.6
"G8 gate open"

%Q455.0
"Gate_Lock_Unlock_4"

Network 3: Gate G9 MU011

%M1006.0
"G9 gate open"

%Q455.1
"Gate_Lock_Unlock_5"

Network 4: Gate G2 MU101

%M1009.1
"G2 MU101 gate open"

%Q250.1
"Gate_Lock_Unlock_1"

Network 5: Gate G2 MU011


%M1009.3
"G2 MU011 gate open"

%Q250.2
"Gate_Lock_Unlock_2"


Network 6: Safety cut and block manage SOA01

if "safety cut enable" then armo le uscite per i blocchi di sicurezza"

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

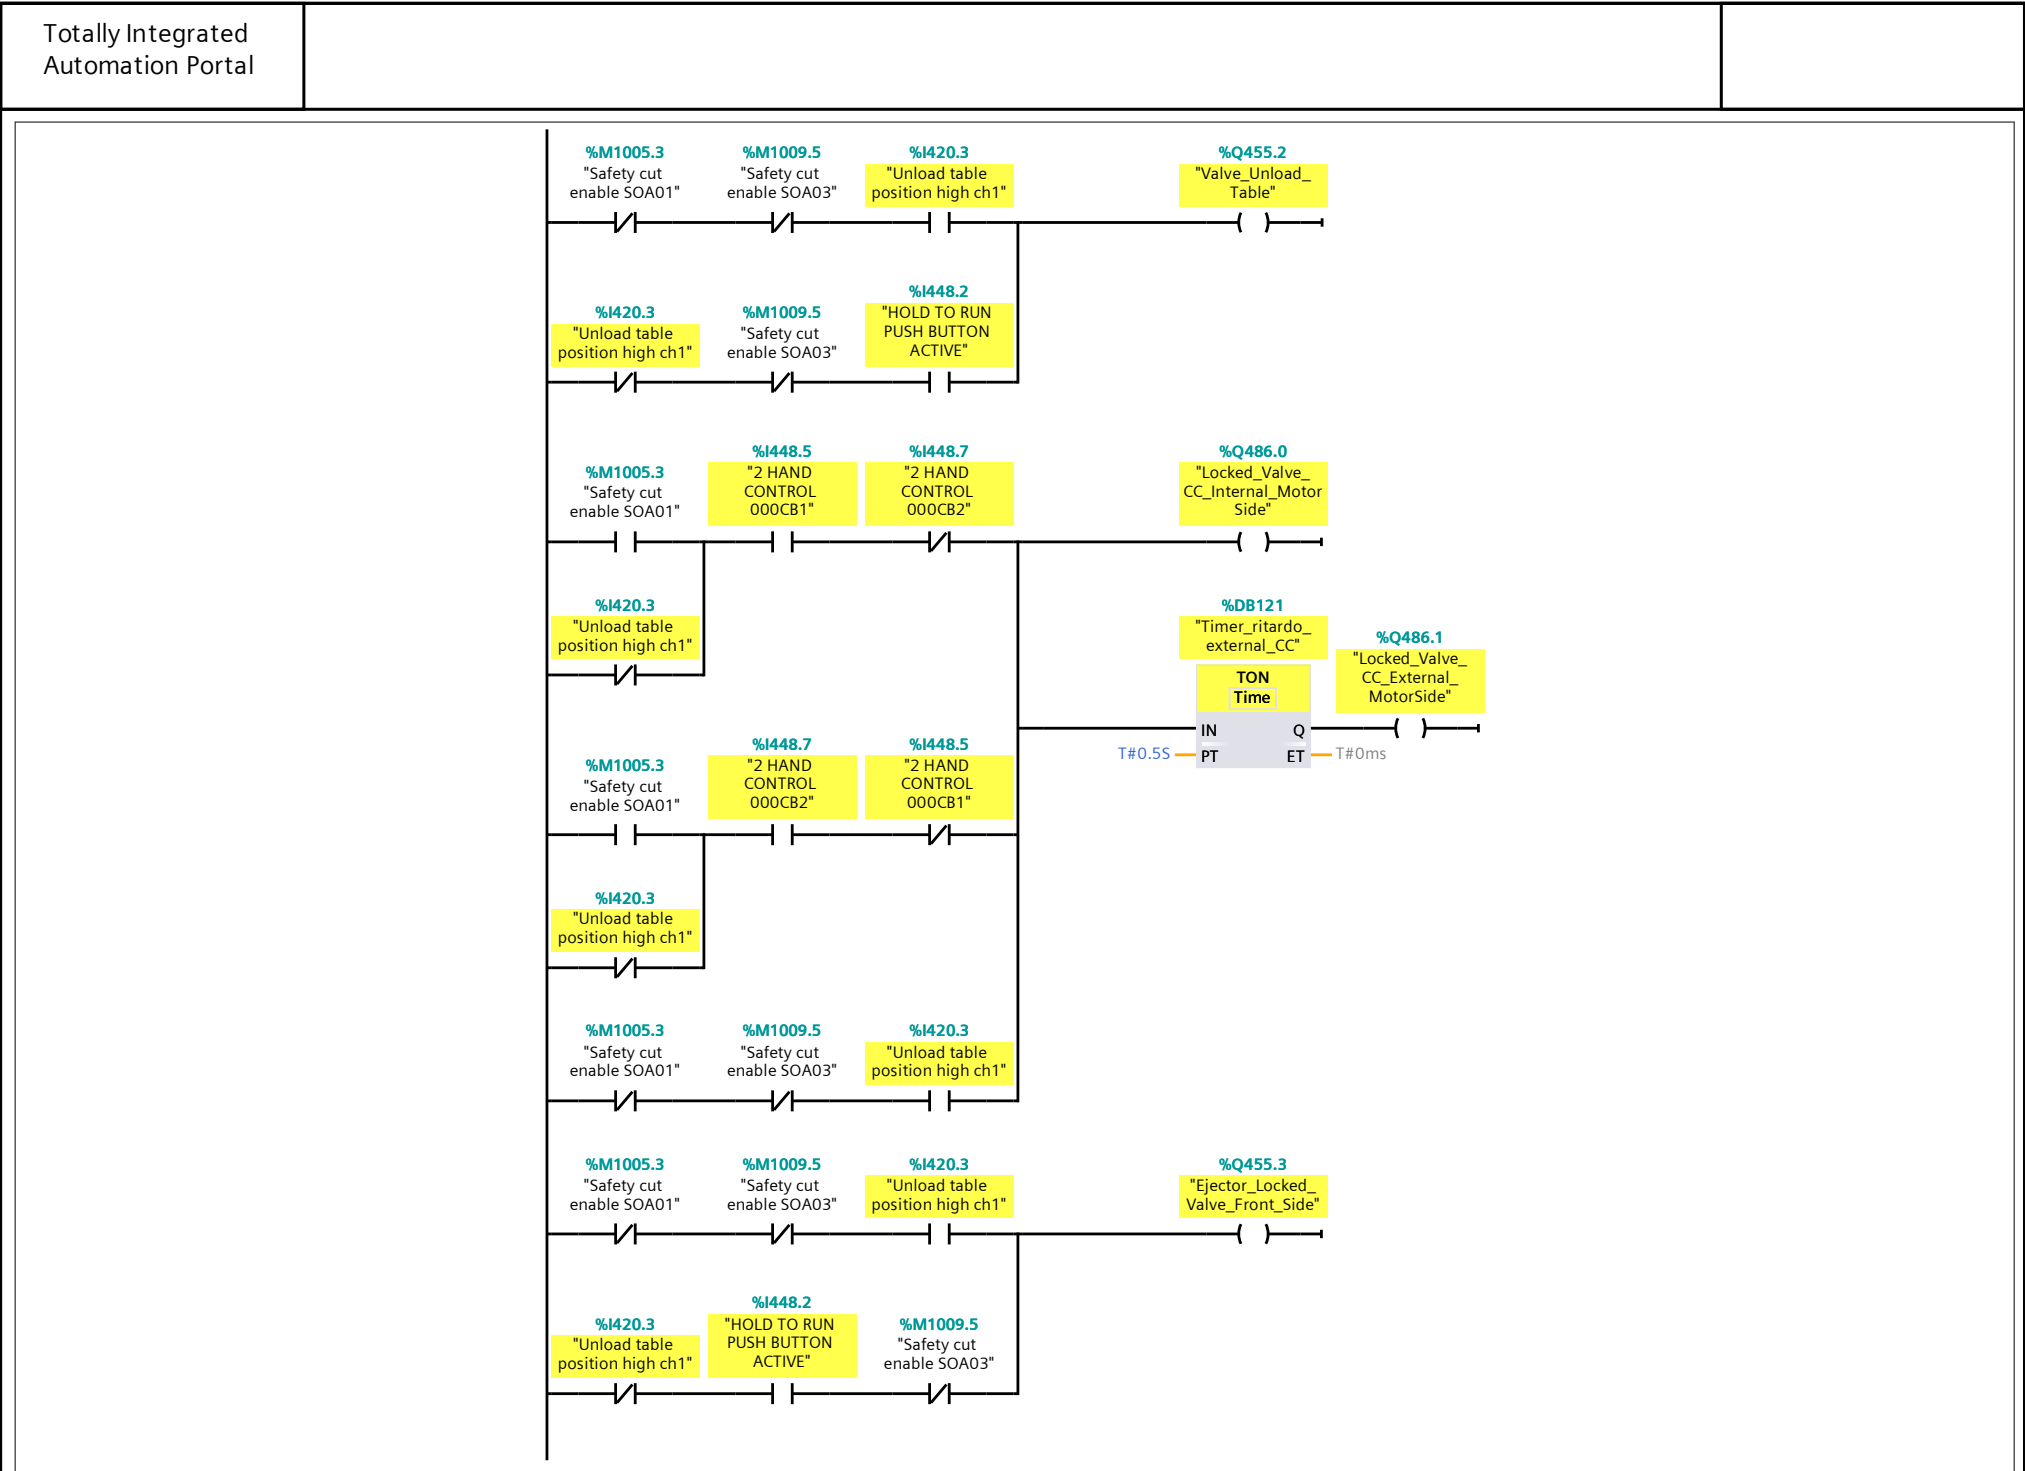


Network 7: Gestione blocco rullo cavaliere con nuovo push button

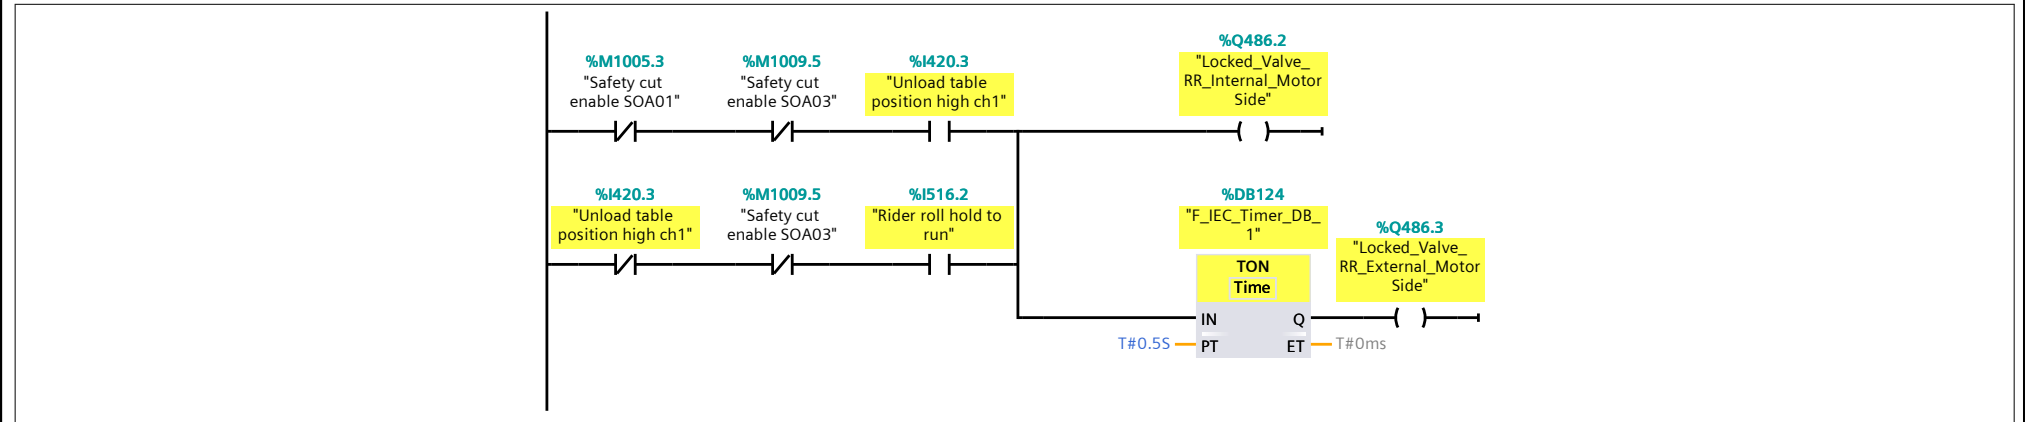

Network 8: SOA01 signalling open close


if G8 OR G9 gate are opened then segnale al cliente che i cancelli sono aperti e blocco il movimento dello spreader device

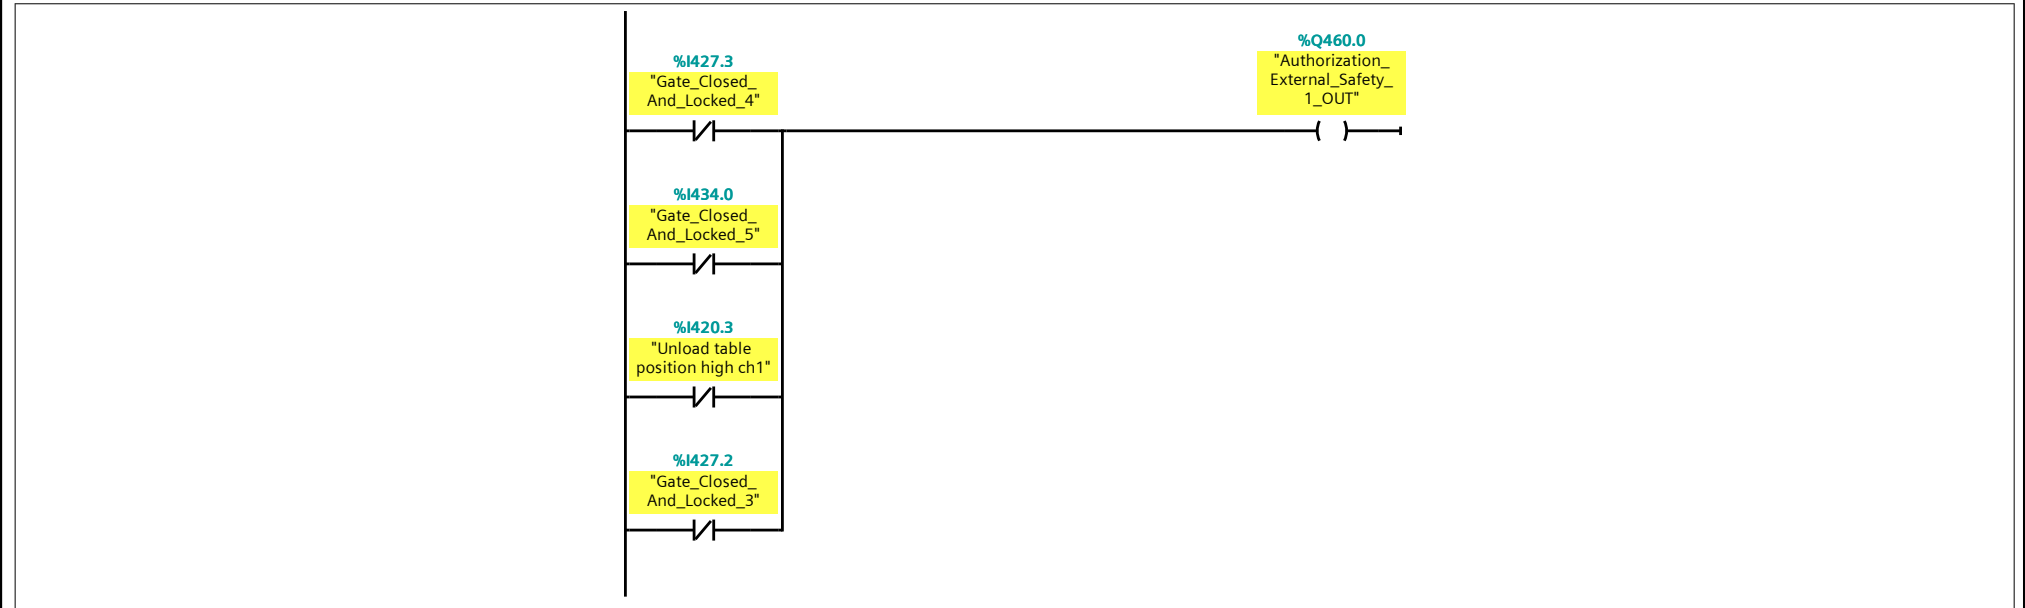

Network 9: Safety cut and block manage SOA02




Network 10: SOA02 signalling open close

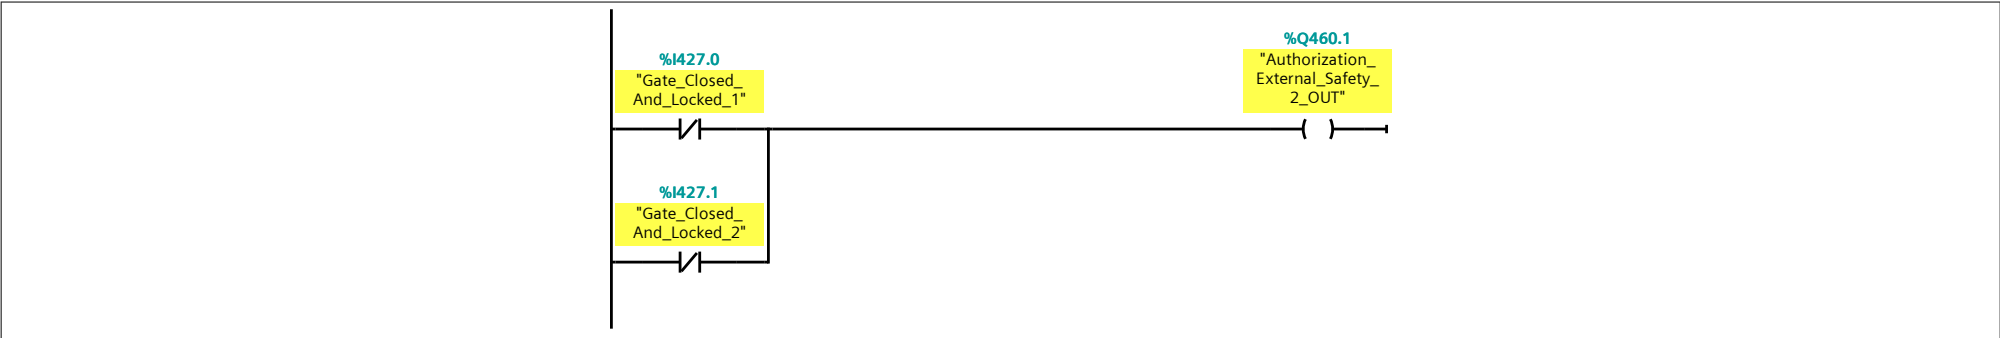


Network 11: SOA03 signalling open close

la zona 3 abilita le stesse componenti della zona 1 e 2 quindi porto il contatto SAO3 alle uscite 1 e 2

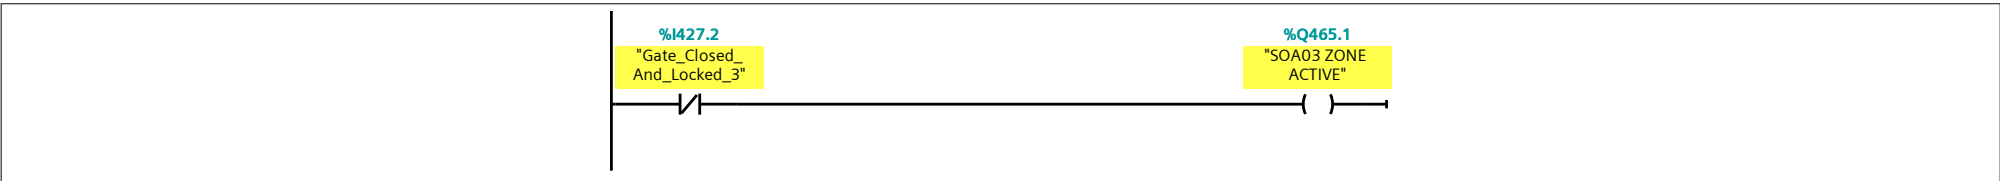


Network 12: sblocco pistoni rullo cavaliere

sblocco i ganci rullo cavaliere con richiesta da europic ,

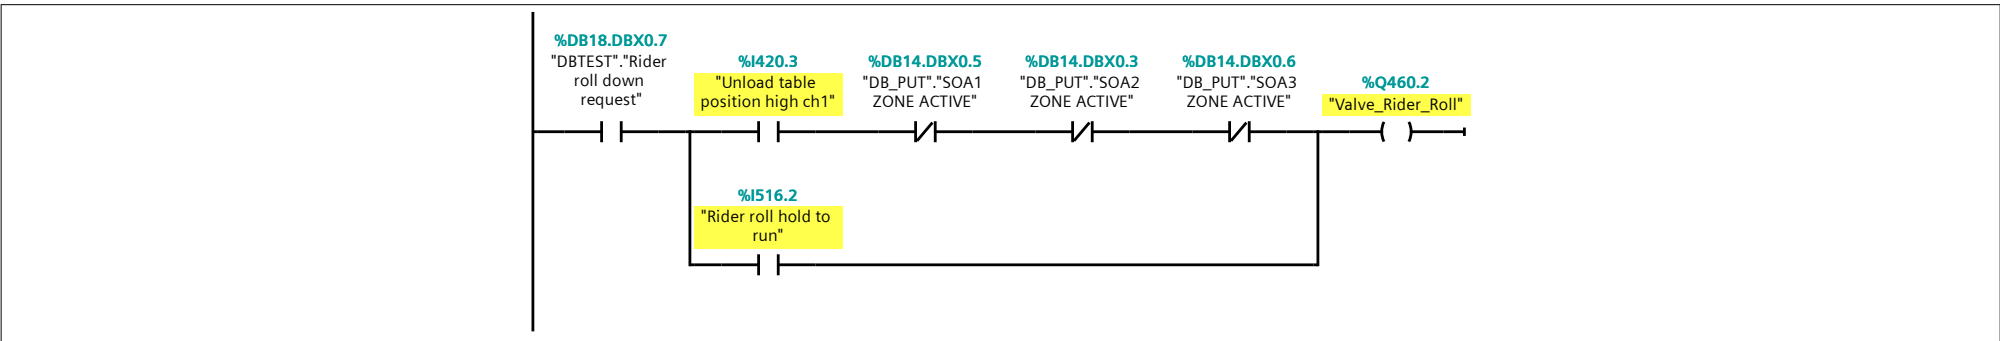

Network 13: quando i ganci sono disingaggiati gli passo l ok per scendere

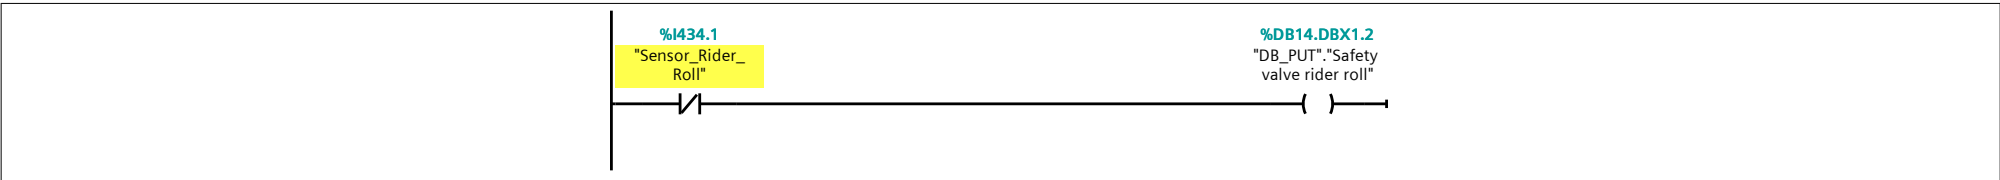


Safety Administration / Fail-safe user blocks

2 HANDS SELECTORS

2 HANDS SELECTORS Properties							
General							
Name	2 HANDS SELECTORS	Number	27	Type	FC	Language	LAD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					
Name		Data type	Default value		Comment		
Input							
Output							
InOut							
Temp							
Constant							
▼ Return							
2 HANDS SELECTORS		Void					

Network 1:

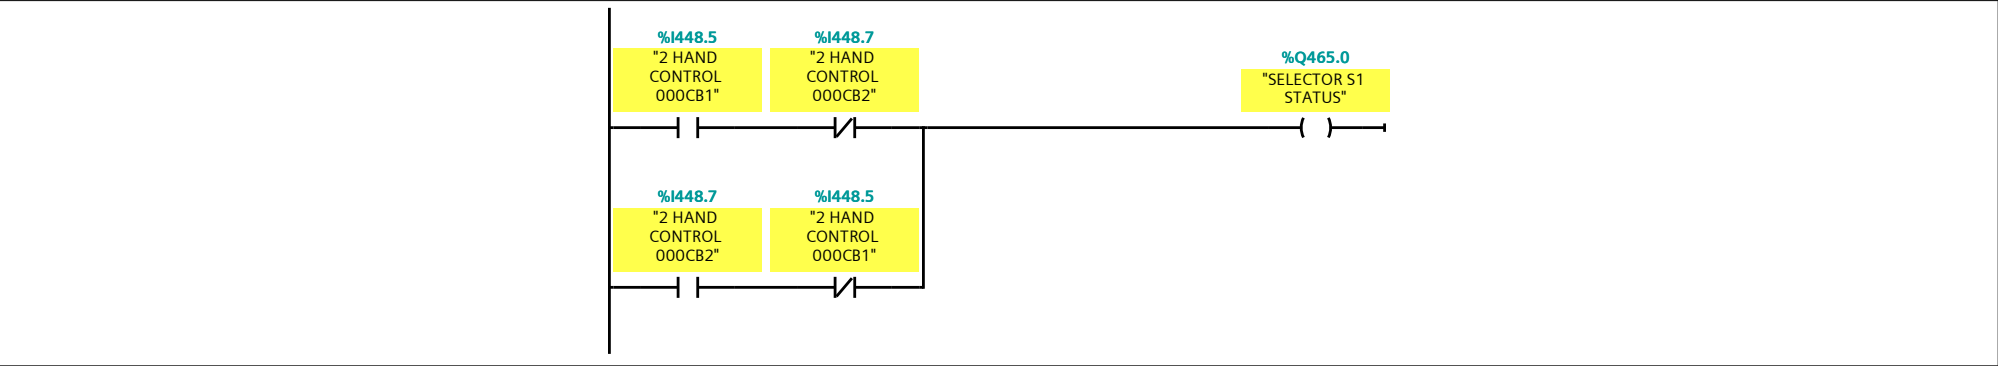


Safety Administration / Fail-safe user blocks

sblocco tutte le porte + emergenza

sblocco tutte le porte + emergenza Properties							
General							
Name	sblocco tutte le porte + emergenza	Number	28	Type	FC	Language	LAD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Default value	Comment
Input			
Output			
InOut			
▼ Temp			
speed0	DInt		
Constant			
▼ Return			
sblocco tutte le porte + emergenza	Void		

Network 1: se ho la macchina a velocità zero e richiedo l'apertura di una zona , allora sblocco tutte le porte e mando la macchina in emergenza .

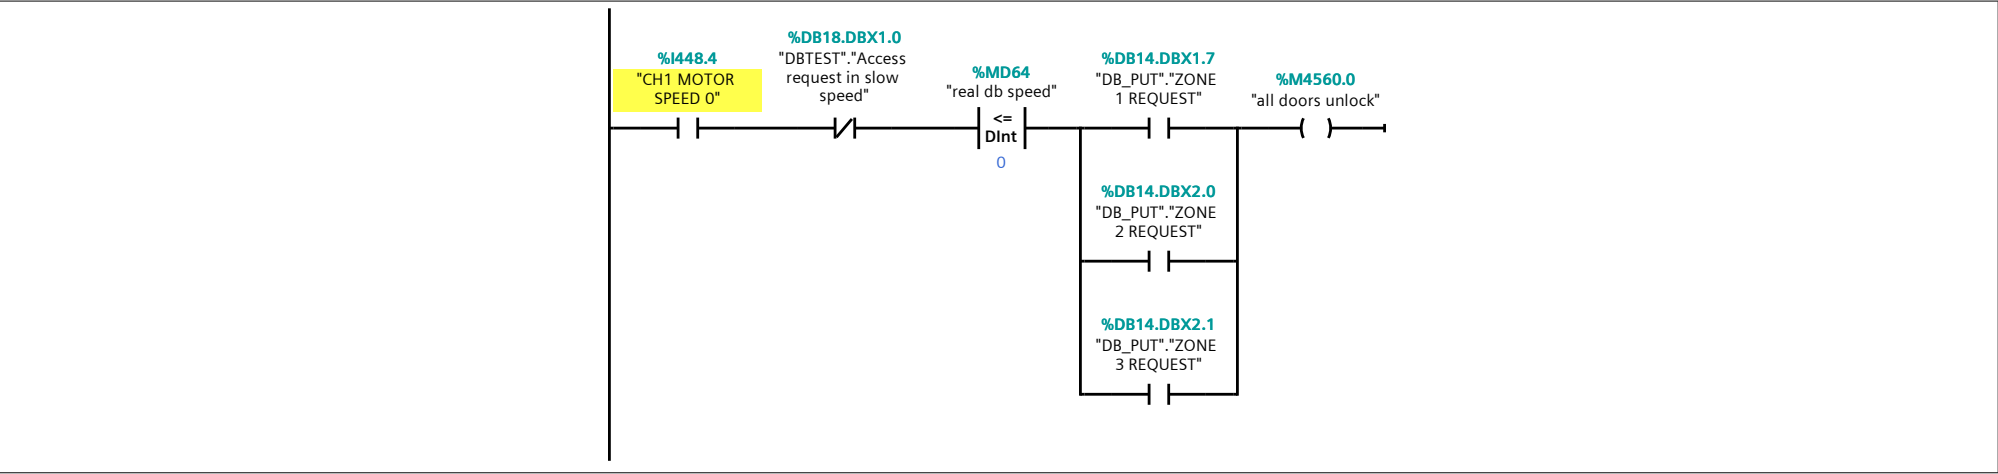

Network 2:




Safety Administration / Fail-safe user blocks

gestione ingressi feedback


gestione ingressi feedback Properties							
General							
Name	gestione ingressi feedback	Number	32	Type	FC	Language	FBD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Default value	Comment
Input			
▼ Output			
feedback ok RR	Bool		
Feedback ok Chucks	Bool		
InOut			
Temp			
Constant			
▼ Return			
gestione ingressi feedback	Void		

Network 1: Safety feedback Rider Roll

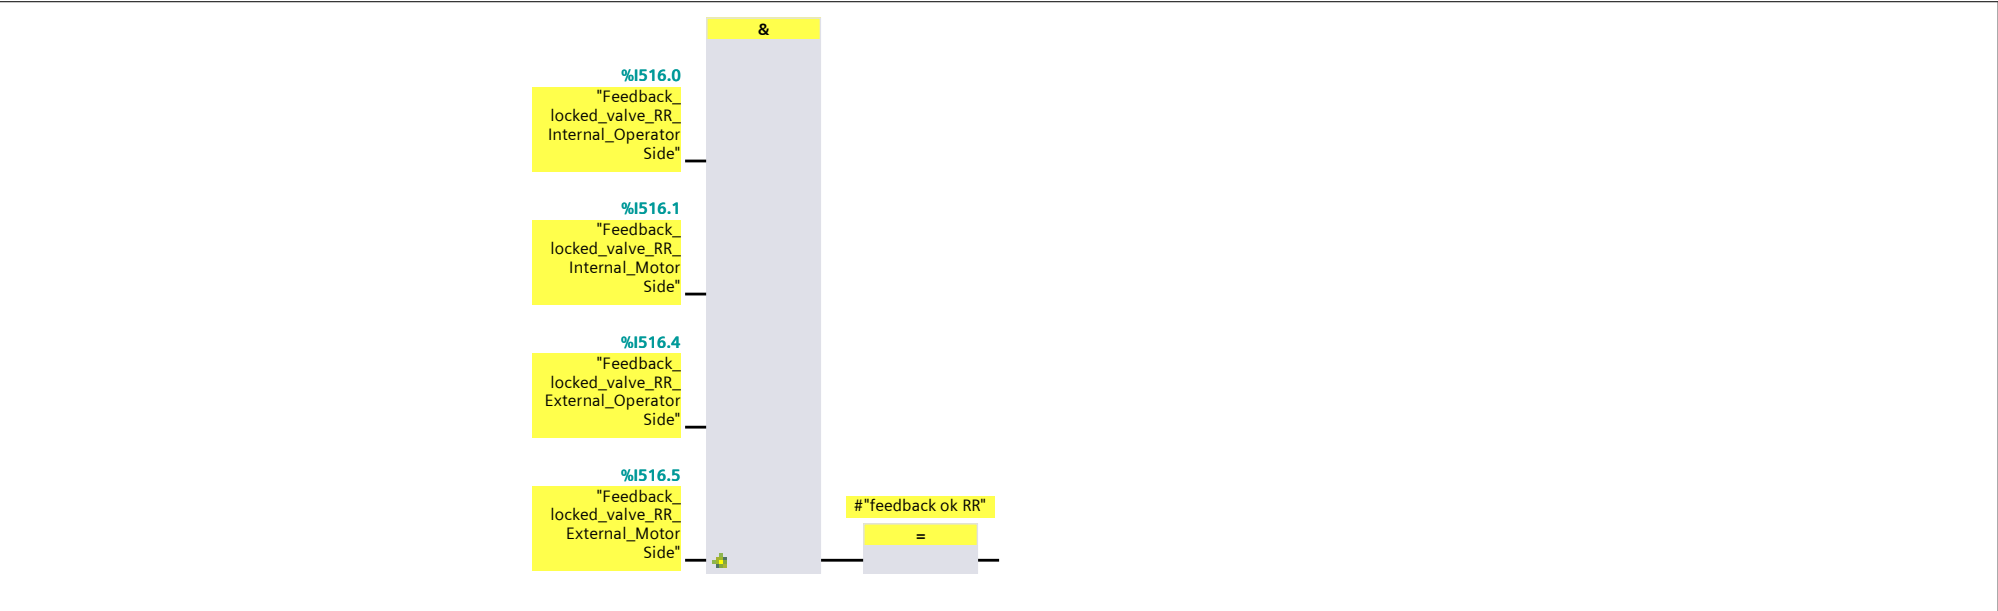

Network 2: Safety feedback chucks

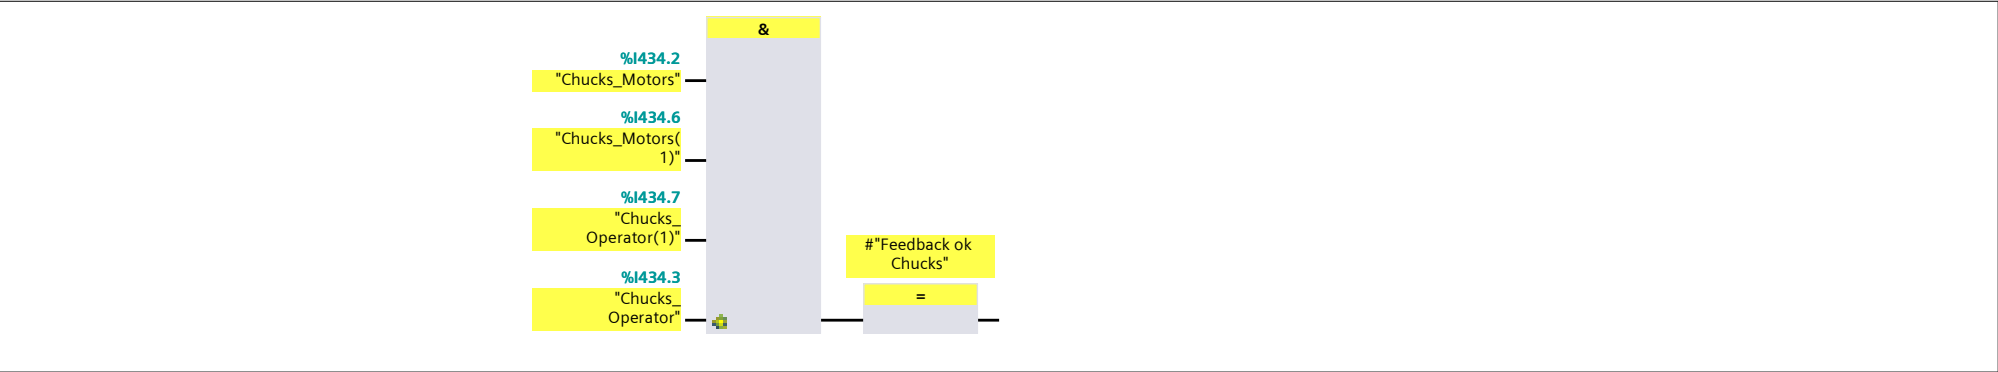

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

LDrvSafe_SinaGTlg30Control_DB

LDrvSafe_SinaGTlg30Control_DB Properties

General

Name	LDrvSafe_SinaGTlg30Control_DB	Number	6	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	LDrvSafe
Version	2.1	User-defined ID					

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
▼ Input									
STO	Bool	true	False	True	False	True	False		
SS1	Bool	true	False	True	False	True	False		
SLS	Bool	true	False	True	False	True	False		
selectSLSbit0	Bool	false	False	True	False	True	False		
selectSLSbit1	Bool	false	False	True	False	True	False		
SDIpositive	Bool	true	False	True	False	True	False		
SDInegative	Bool	true	False	True	False	True	False		
ackSafetyFaults	Bool	false	False	True	False	True	False		
▼ Output									
▼ SinaGTlg30Control	"LDrvSafe_type-SinaGTlg30Control"		False	True	False	True	False		
STO	Bool	false	False	True	False	True	False		
SS1	Bool	false	False	True	False	True	False		
reserved1	Bool	false	False	True	False	True	False		
reserved2	Bool	false	False	True	False	True	False		
SLS	Bool	false	False	True	False	True	False		
reserved3	Bool	false	False	True	False	True	False		
reserved4	Bool	false	False	True	False	True	False		
internalEventAcknowledge	Bool	false	False	True	False	True	False		
reserved5	Bool	false	False	True	False	True	False		
selectSLSbit0	Bool	false	False	True	False	True	False		
selectSLSbit1	Bool	false	False	True	False	True	False		
reserved6	Bool	false	False	True	False	True	False		
SDIpositive	Bool	false	False	True	False	True	False		
SDInegative	Bool	false	False	True	False	True	False		
reserved7	Bool	false	False	True	False	True	False		
reserved8	Bool	false	False	True	False	True	False		
InOut									
Static									

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Safety Administration / Fail-safe user blocks

LDrvSafe_SinaGTlg30Status_DB

LDrvSafe_SinaGTlg30Status_DB Properties												
General												
Name	LDrvSafe_SinaGTlg30Sta-tus_DB		Number	7		Type	DB			Language	DB	
Numbering	Automatic											
Information												
Title			Author			Comment				Family	LDrvSafe	
Version	2.1		User-defined ID									
Name		Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
▼ Input												
▼ SinaGTlg30Status		"LDrvSafe_type-SinaGTlg30Sta-tus"		False	True	False	True	False				
STOactive		Bool	false	False	True	False	True	False				
SS1active		Bool	false	False	True	False	True	False				
reserved1		Bool	false	False	True	False	True	False				
reserved2		Bool	false	False	True	False	True	False				
SLSactive		Bool	false	False	True	False	True	False				
reserved3		Bool	false	False	True	False	True	False				
reserved4		Bool	false	False	True	False	True	False				
internalEvent		Bool	false	False	True	False	True	False				
reserved5		Bool	false	False	True	False	True	False				
SLSbit0Active		Bool	false	False	True	False	True	False				
SLSbit1Active		Bool	false	False	True	False	True	False				
reserved6		Bool	false	False	True	False	True	False				
SDIpositiveActive		Bool	false	False	True	False	True	False				
SDInegativeActive		Bool	false	False	True	False	True	False				
reserved7		Bool	false	False	True	False	True	False				
SSMactive		Bool	false	False	True	False	True	False				
▼ Output												
safetyFaultActive		Bool	false	False	True	False	True	False				
STOactive		Bool	false	False	True	False	True	False				
SS1active		Bool	false	False	True	False	True	False				
SLSactive		Bool	false	False	True	False	True	False				
SLSbit0Active		Bool	false	False	True	False	True	False				
SLSbit1Active		Bool	false	False	True	False	True	False				
SDIpositiveActive		Bool	false	False	True	False	True	False				
SDInegativeActive		Bool	false	False	True	False	True	False				
SSMactive		Bool	false	False	True	False	True	False				
InOut												
Static												

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

ACK_GL_DB

ACK_GL_DB Properties

General

Name	ACK_GL_DB	Number	8	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author	Safety	Comment		Family	F_FUNC
Version	1.0	User-defined ID	F_ACK_GL				

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
▼ Input									
ACK_GLOB	Bool	false	False	True	True	True	False		1=acknowledgment for reintegration
Output									
InOut									
Static									

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

Main_Safety_RTG1_DB

Main_Safety_RTG1_DB Properties

General

Name

Main_Safety_RTG1_DB

Number

1

Type

DB

Language

DB

Numbering

Automatic

Information

Title

Author

Comment

Family

Version

0.1

User-defined ID

FUSI

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
Input									
Output									
InOut									
▼ Static									
▼ Display PushButton S1	ESTOP1		False	True	True	True	False		
▼ Input									
E_STOP	Bool	false	False	True	True	True	False		Emergency STOP
ACK_NEC	Bool	true	False	True	True	True	False		1=Acknowledgment necessary
ACK	Bool	false	False	True	True	True	False		1=Acknowledgment
TIME_DEL	Time	0	False	True	True	True	False		Time delay
▼ Output									
Q	Bool	false	False	True	True	True	False		1=Enable
Q_DELAY	Bool	false	False	True	True	True	False		Enable is OFF delayed
ACK_REQ	Bool	false	False	True	True	True	False		1=acknowledgment request
DIAG	Byte	B#16#00	False	True	True	True	False		Service information
InOut									
Static									
Emergency_ok	Bool	false	False	True	True	True	False		
▼ F_IEC_Timer_Instance	TON		False	True	True	True	False		
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
▼ Pulse up	TON		False	True	True	True	False		
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
▼ Pulse Down	TON		False	True	True	True	False		
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
▼ SFDOOR_Instance	SFDOOR		False	True	True	True	False		
▼ Input									
IN1	Bool	false	False	True	True	True	False		Input 1
IN2	Bool	false	False	True	True	True	False		Input 2
QBAD_IN1	Bool	false	False	True	True	True	False		QBAD signal of FI/O/channel of input IN1

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Totally Integrated Automation Portal												
Name		Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
QBAD_IN2		Bool	false	False	True	True	True	False				QBAD signal of FI/O/channel of input IN2
OPEN_NEC		Bool	true	False	True	True	True	False				1=open necessary at startup
ACK_NEC		Bool	true	False	True	True	True	False				1=acknowledgment necessary
ACK		Bool	false	False	True	True	True	False				Acknowledgment
▼ Output												
Q		Bool	false	False	True	True	True	False				1=Enable, safety door closed
ACK_REQ		Bool	false	False	True	True	True	False				1=acknowledgement request
DIAG		Byte	B#16#00	False	True	True	True	False				Service information
InOut												
Static												
feedback ok RR		Bool	false	False	True	True	True	False				
Feedback ok Chucks		Bool	false	False	True	True	True	False				
Safety information: D6B83718 Consistent; STEP 7 Safety V19;												

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

Timer_ritardo_external_CC

Timer_ritardo_external_CC Properties

General

Name	Timer_ritardo_external_CC	Number	121	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author	Safety	Comment		Family	IEC_TC
Version	1.1	User-defined ID	F_TON				

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

F_IEC_Timer_DB_1

F_IEC_Timer_DB_1 Properties

General

Name	F_IEC_Timer_DB_1	Number	124	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author	Safety	Comment		Family	IEC_TC
Version	1.1	User-defined ID	F_TON				

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									

Safety information: D6B83718 Consistent; STEP 7 Safety V19;

Safety Administration / Fail-safe UDTs

LDrvSafe_typeSinaGTlg30Control

LDrvSafe_typeSinaGTlg30Control Properties										
General										
Name	LDrvSafe_typeSinaGTlg30Control	Number	20		Type	UDT			Language	
Numbering Information										
Title		Author		Comment				Family		
Version		User-defined ID								
Name	Data type	Default value	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
STO	Bool	false	True	False	True	False				
SS1	Bool	false	True	False	True	False				
reserved1	Bool	false	True	False	True	False				
reserved2	Bool	false	True	False	True	False				
SLS	Bool	false	True	False	True	False				
reserved3	Bool	false	True	False	True	False				
reserved4	Bool	false	True	False	True	False				
internalEventAcknowledge	Bool	false	True	False	True	False				
reserved5	Bool	false	True	False	True	False				
selectSLSbit0	Bool	false	True	False	True	False				
selectSLSbit1	Bool	false	True	False	True	False				
reserved6	Bool	false	True	False	True	False				
SDIpositive	Bool	false	True	False	True	False				
SDInegative	Bool	false	True	False	True	False				
reserved7	Bool	false	True	False	True	False				
reserved8	Bool	false	True	False	True	False				

Safety Administration / Fail-safe UDTs

LDrvSafe_typeSinaGTlg30Status

LDrvSafe_typeSinaGTlg30Status Properties										
General										
Name	LDrvSafe_typeSinaGTlg30Status	Number	5		Type	UDT			Language	
Numbering										
Information										
Title		Author			Comment				Family	
Version		User-defined ID								
Name	Data type	Default value	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
STOactive	Bool	false	True	False	True	False				
SS1active	Bool	false	True	False	True	False				
reserved1	Bool	false	True	False	True	False				
reserved2	Bool	false	True	False	True	False				
SLSactive	Bool	false	True	False	True	False				
reserved3	Bool	false	True	False	True	False				
reserved4	Bool	false	True	False	True	False				
internalEvent	Bool	false	True	False	True	False				
reserved5	Bool	false	True	False	True	False				
SLSbit0Active	Bool	false	True	False	True	False				
SLSbit1Active	Bool	false	True	False	True	False				
reserved6	Bool	false	True	False	True	False				
SDIpositiveActive	Bool	false	True	False	True	False				
SDInegativeActive	Bool	false	True	False	True	False				
reserved7	Bool	false	True	False	True	False				
SSMactive	Bool	false	True	False	True	False				