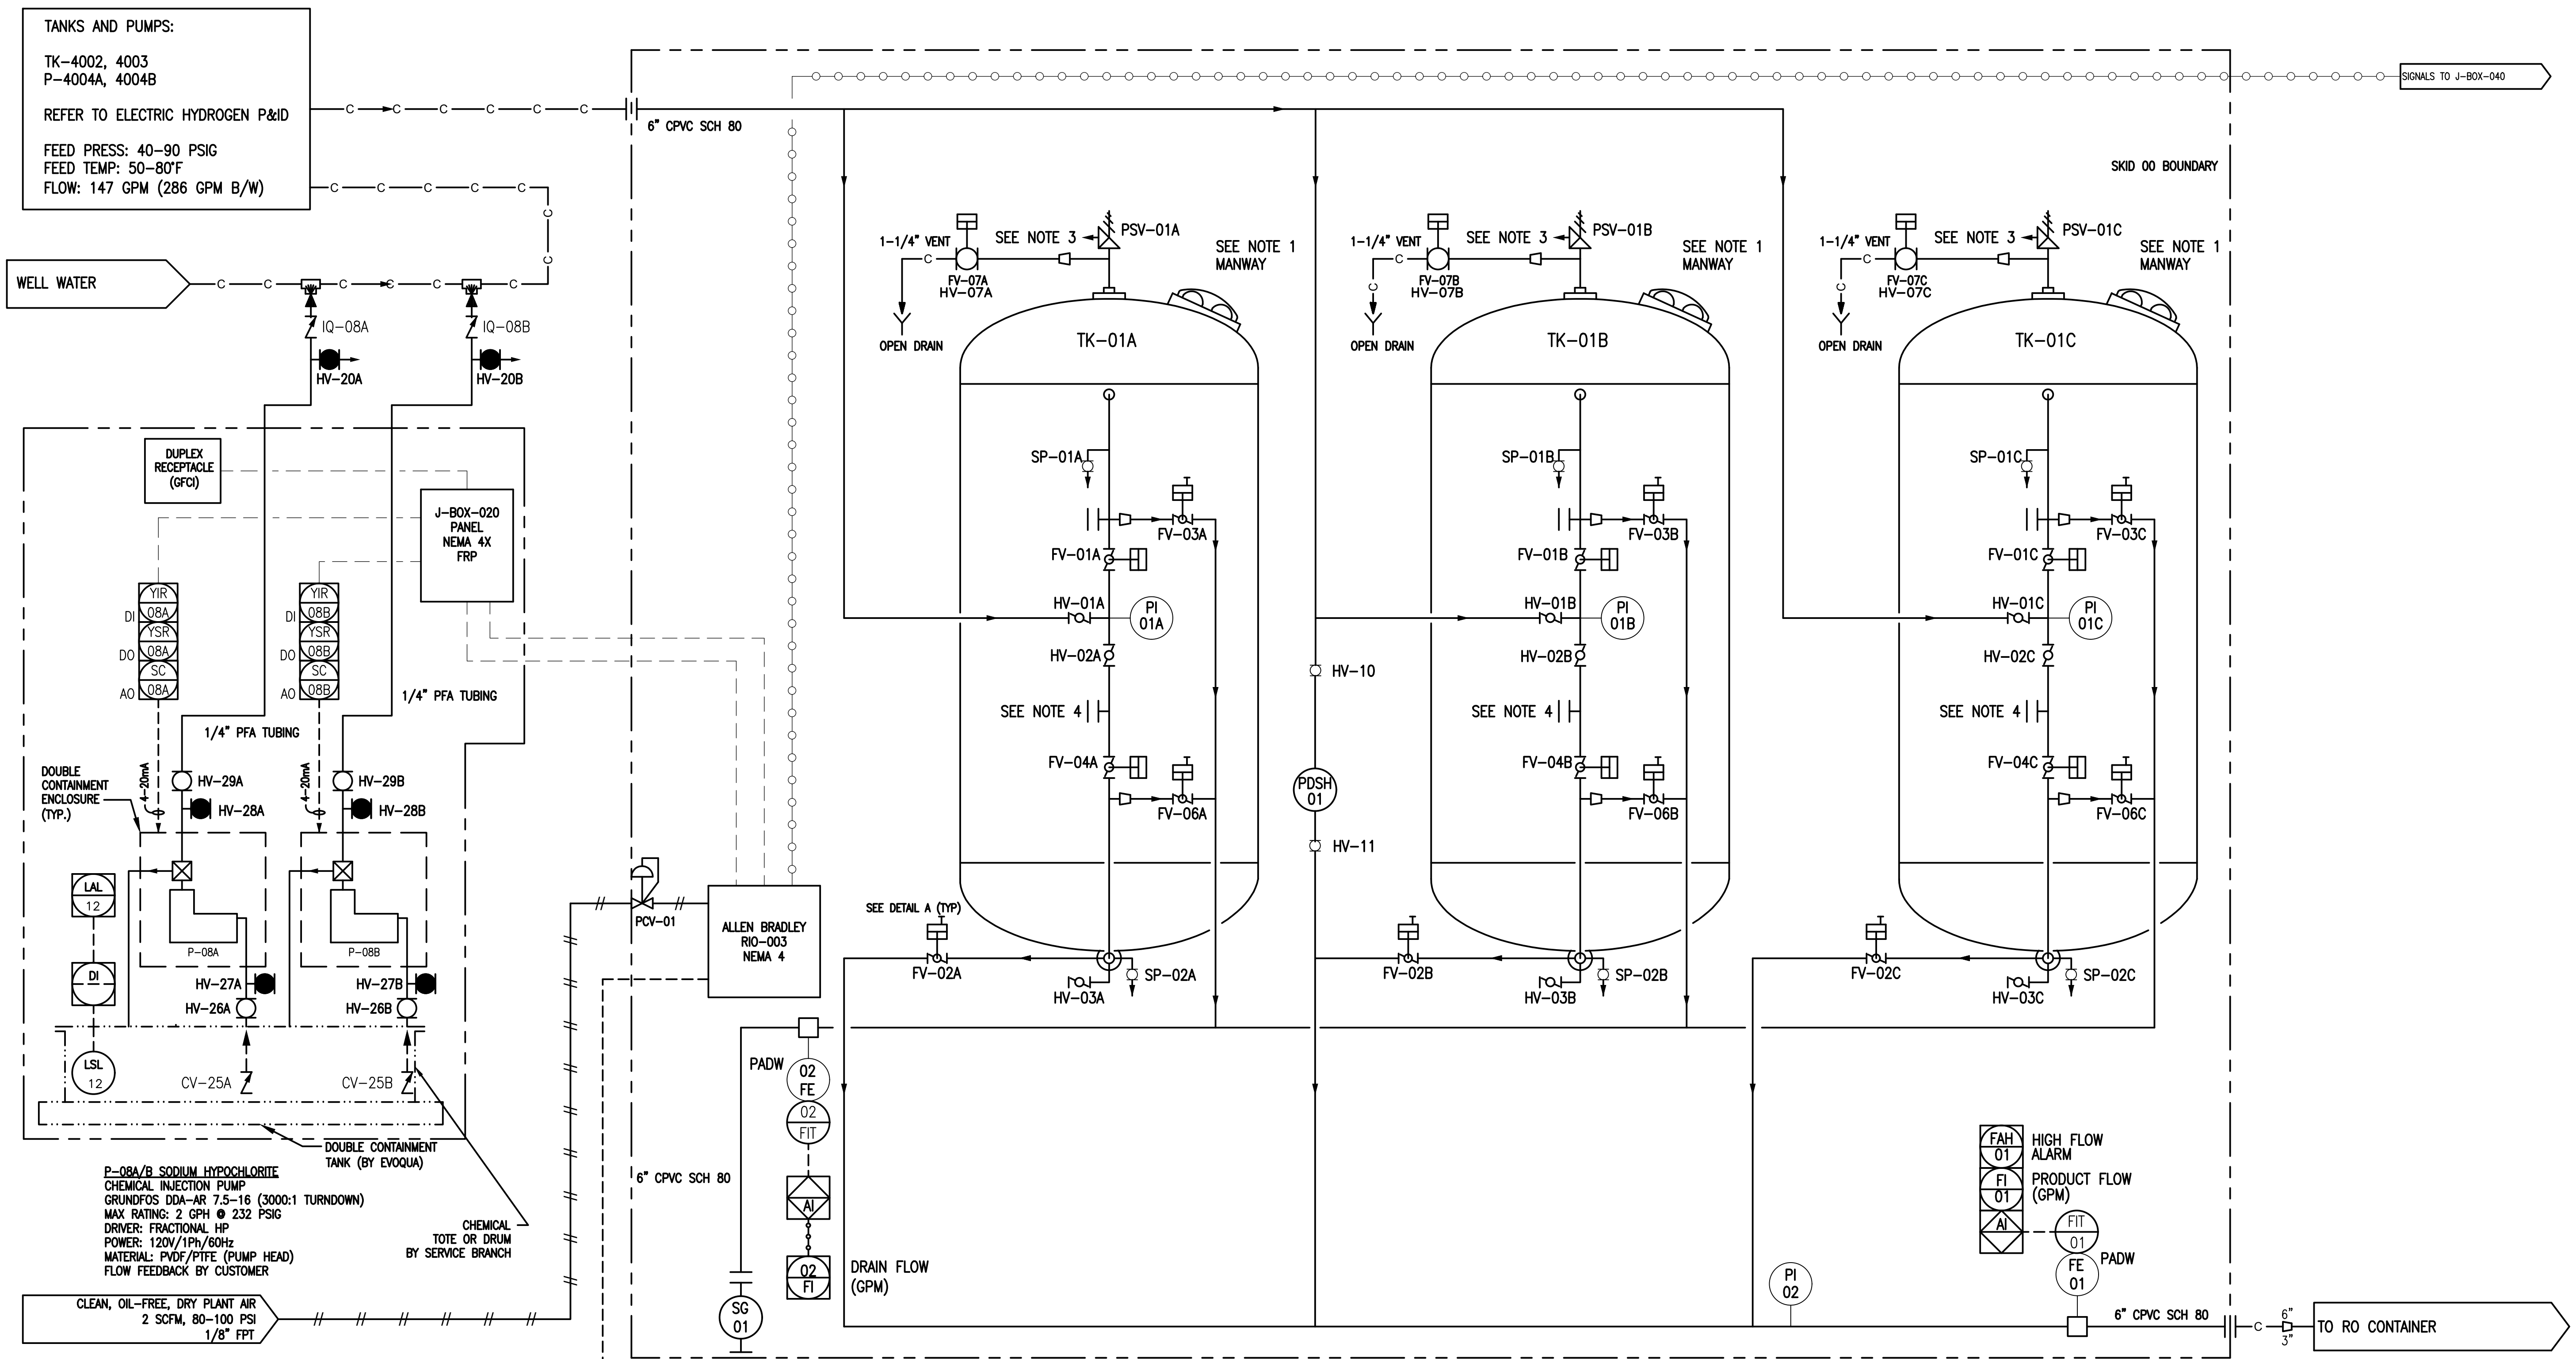

TRIPLEX MMF MODEL PTIXTA54X72A
SPECIFICATION #: S5111-020 (MMF)
PRESSURE: 100 PSIG ASME SECT. VIII CODE STAMP
MEDIA (EACH):
DEPTH 18" ANTHRACITE (0.85-0.95MM)
DEPTH 8" FILTERSAND-QUARTZ #20 (0.45-0.55MM)
DEPTH 4" GARNET #30-40 (0.37MM)

NOTES:
1. ONE 12 X 16 MANWAY PROVIDED.
2. DRAIN LINE NOT TO EXCEED 24" ABOVE DRAIN LINE EXIT.
ATMOSPHERIC DRAIN LINE TO BE ONE SIZE LARGER THAN WASTE PIPING.
3. PRESSURE RELIEF VALVE IS SIZED FOR THERMAL RELIEF ONLY.
4. MANUAL OPERATED VALVE ON PLUS PACKAGES.
5. —C— CUSTOMER FIELD PIPING.
6. PDSH-01 IS AT 15PSI

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	4 OF 12	7

STD-22x34_D v4.1 BAR = 1" AT PLOT SCALE

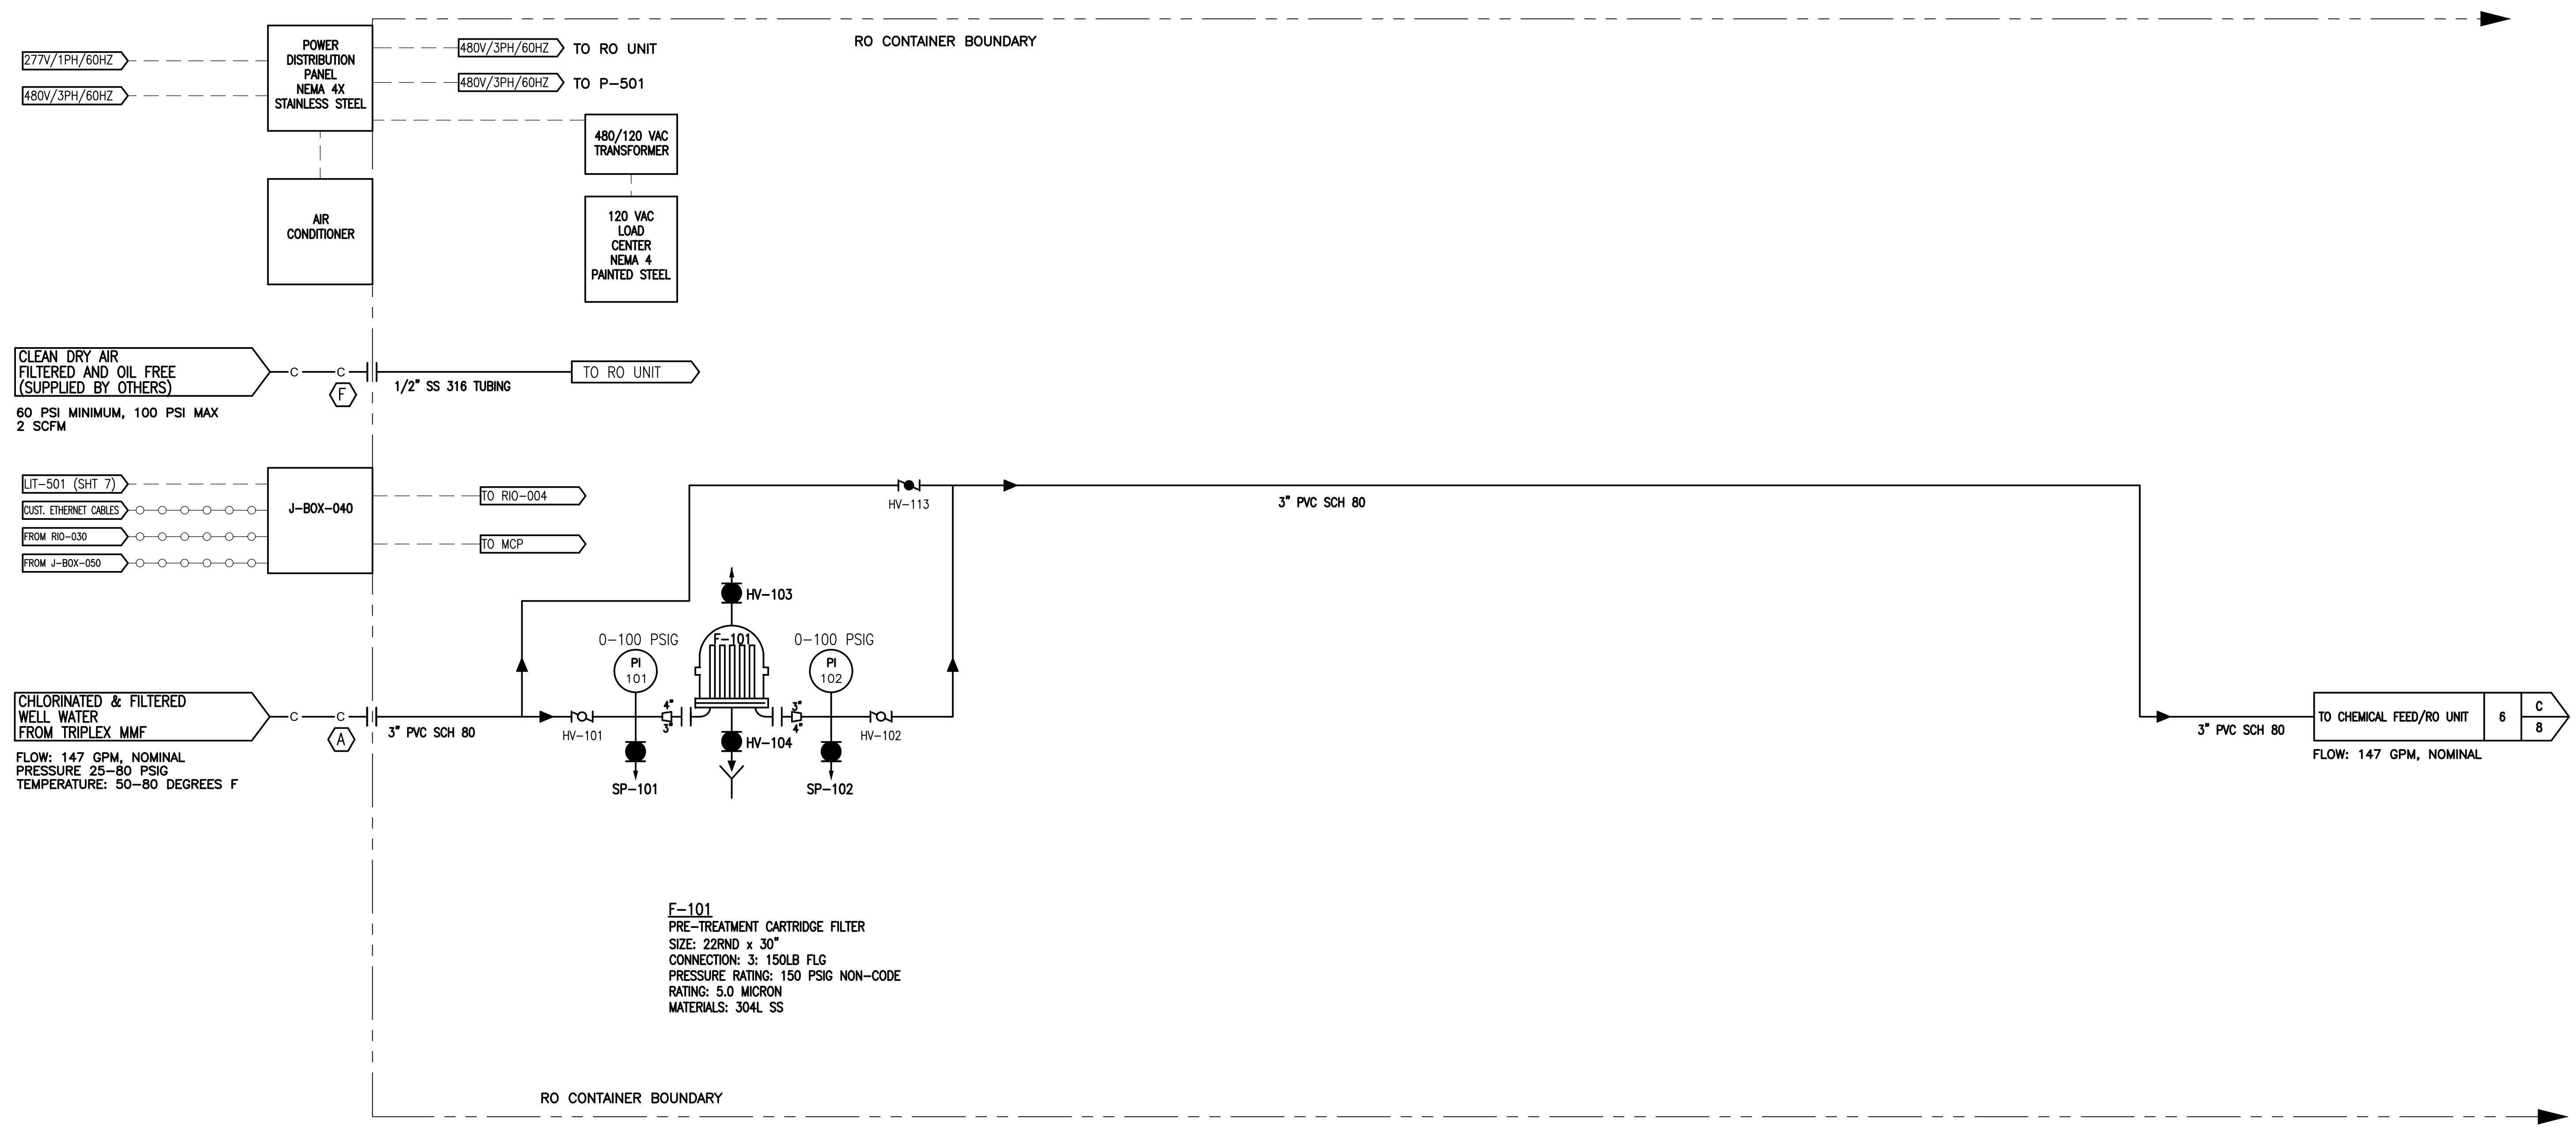

F-101
PRE-TREATMENT CARTRIDGE FILTER
SIZE: 22RND x 30"
CONNECTION: 3: 150LB FLG
PRESSURE RATING: 150 PSIG NON-CODE
RATING: 5.0 MICRON
MATERIALS: 304L SS

TP	RO CONTAINER CONNECTION TABLE	SIZE	TYPE
A	CITY FEEDWATER INLET	3"	FLANGE RF PVC80 150LB
B	RO PRODUCT TO STORAGE TANK T-501	3"	FLANGE RF NATURAL PP 150LB
C	CDI PRODUCT FROM CDI CONTAINER	3"	FLANGE RF NATURAL PP 150LB
D	COMMON CONTAINER DRAIN	3"	FLANGE RF PVC80 150LB
E	DEIONIZED PRODUCT WATER OUTLET	3"	FLANGE RF NATURAL PP 150LB
F	CLEAN DRY AIR INLET	1/2"	FLANGE RF SS316 150LB
G	RO RECIRCULATION TO TANK	3"	FLANGE RF NATURAL PP 150LB
H	CDI PRODUCT FROM CDI CONTAINER	3"	FLANGE RF NATURAL PP 150LB

NOTES, UNLESS OTHERWISE STATED:
1. ALL HARDWARE TO BE GRADE 5 CARBON STEEL, ZINC PLATED
2. ALL CONDUIT TO BE EMT (ELECTRICAL METALLIC TUBING)
3. ALL EQUIPMENT TO BE INSTALLED INSIDE CONTAINER EXCEPT FRP STORAGE TANK AND APPURTENANCES, BY EVOQUA
4. ALL PNEUMATIC TUBING TO BE POLYETHYLENE ASTM D-1693
5. ——C—— CUSTOMER FIELD PIPING

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	EVOQUA WATER TECHNOLOGIES
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	5 OF 12	7

STD:22x34_D v4.1 BAR = 1" AT PLOT SCALE

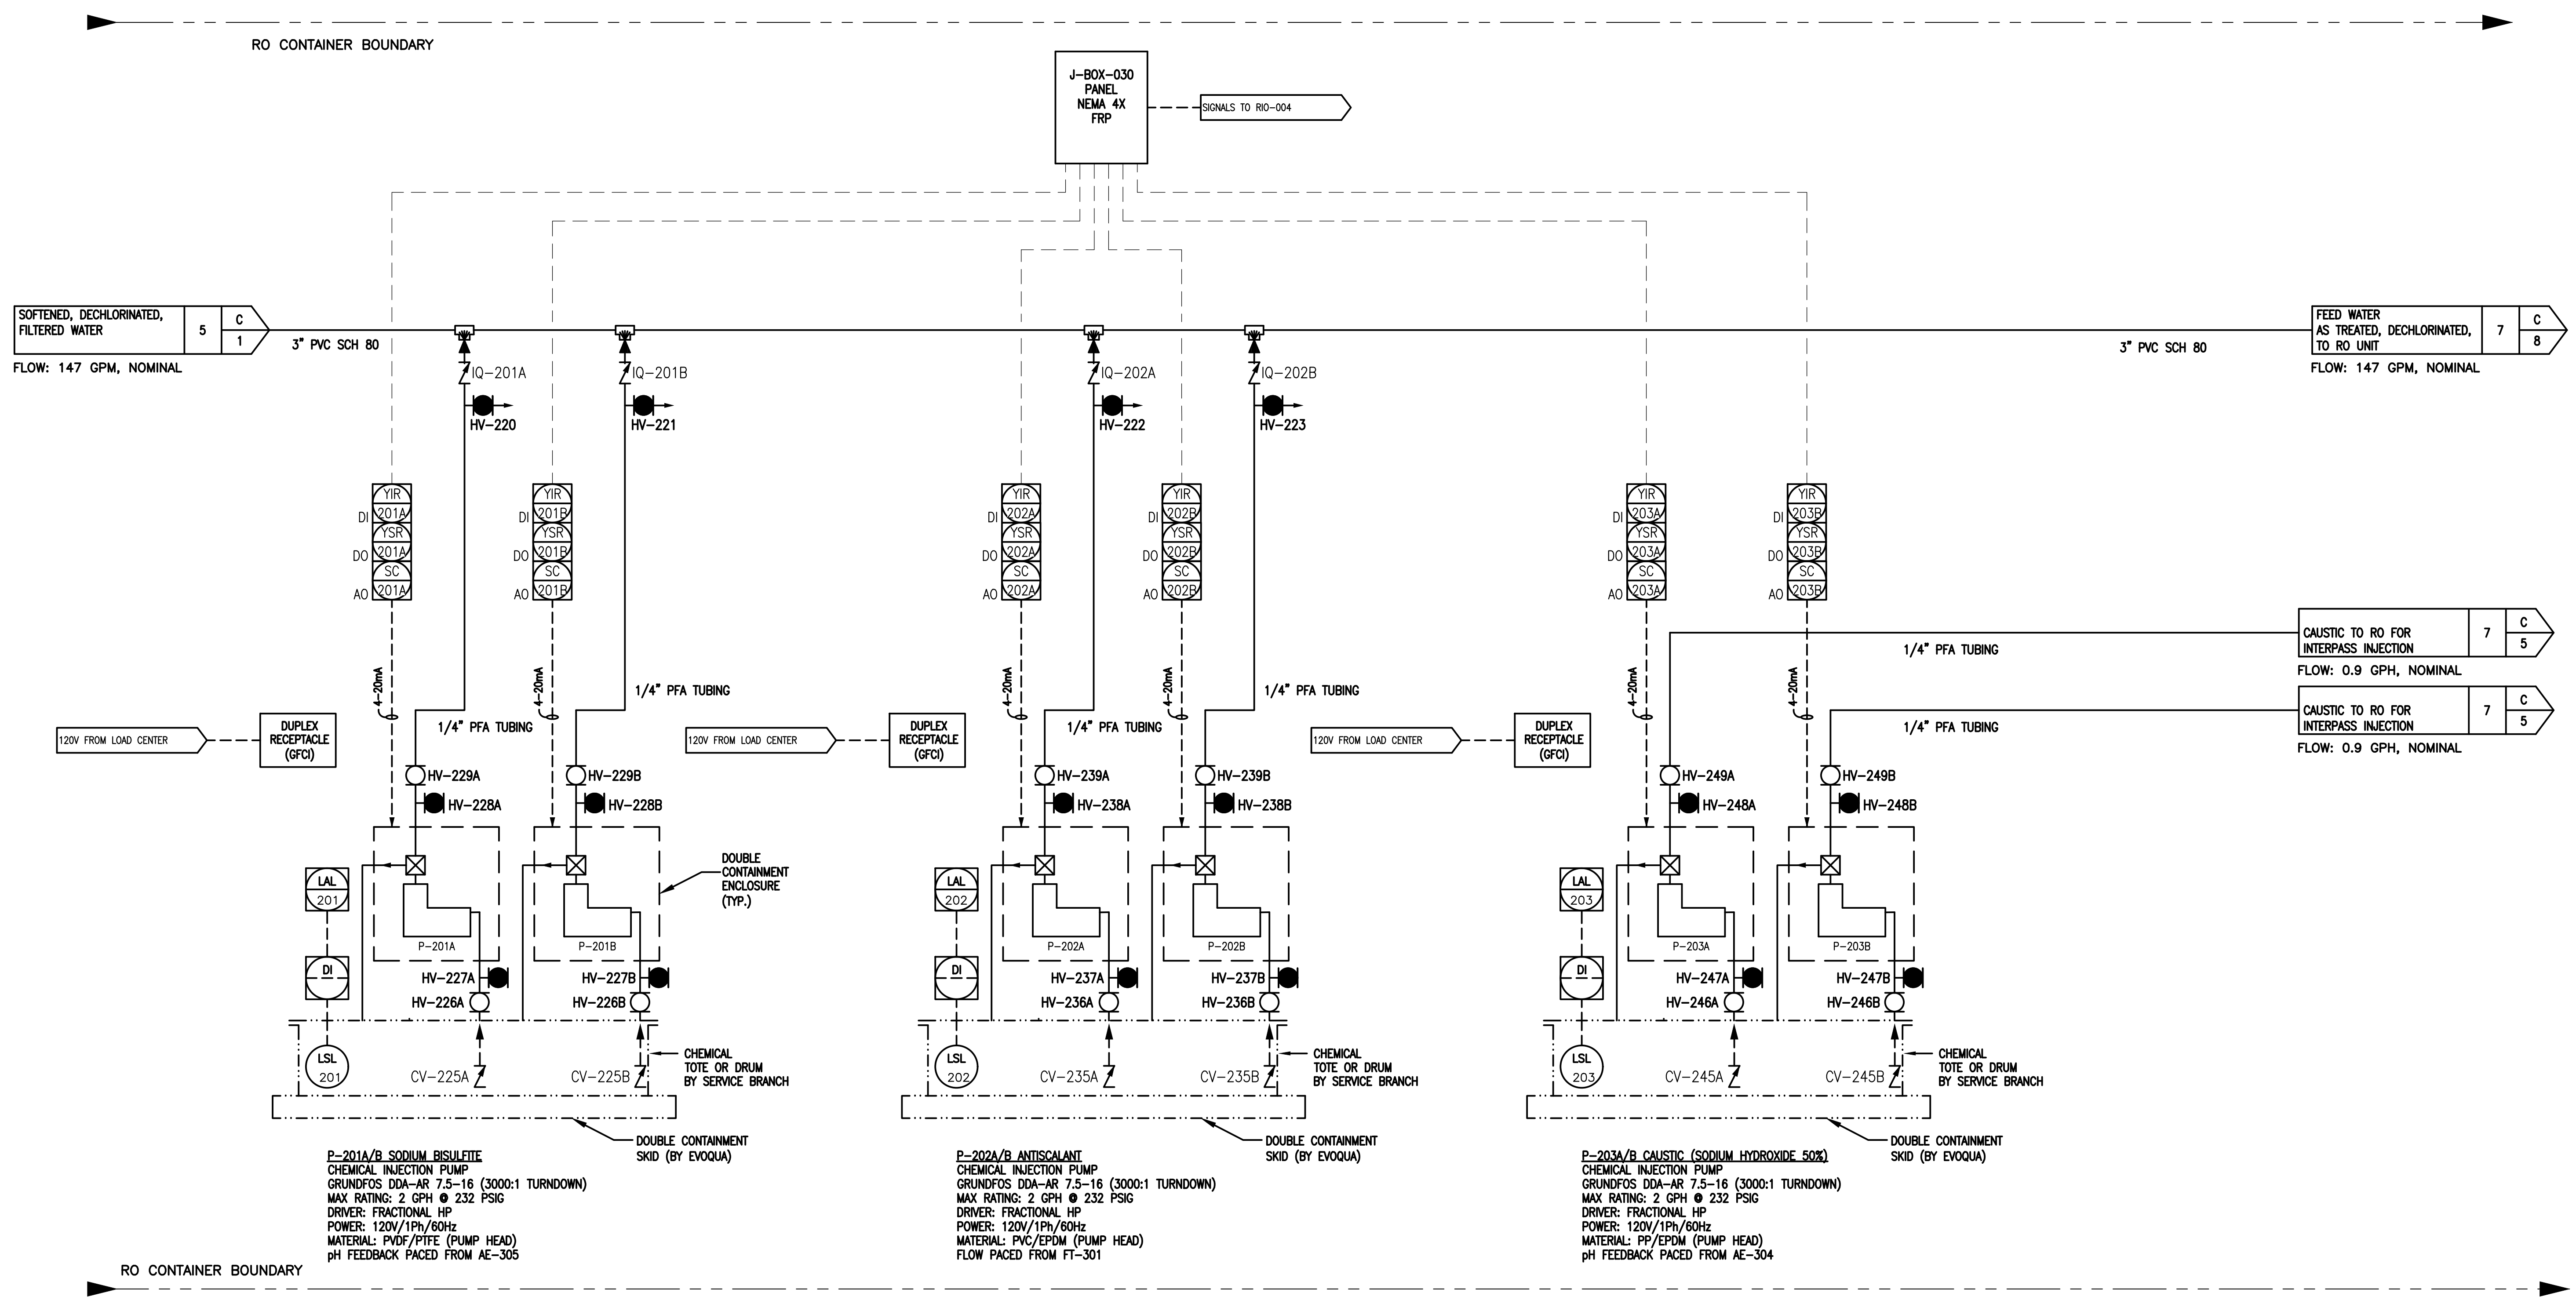

STD 22x34_D v4.1 BAR = 1" AT PLOT SCALE

NOTES, UNLESS OTHERWISE STATED:
1. ——C—— CUSTOMER FIELD PIPING
2. CHEMICALS PROVIDED BY OTHERS

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	6 OF 12	7

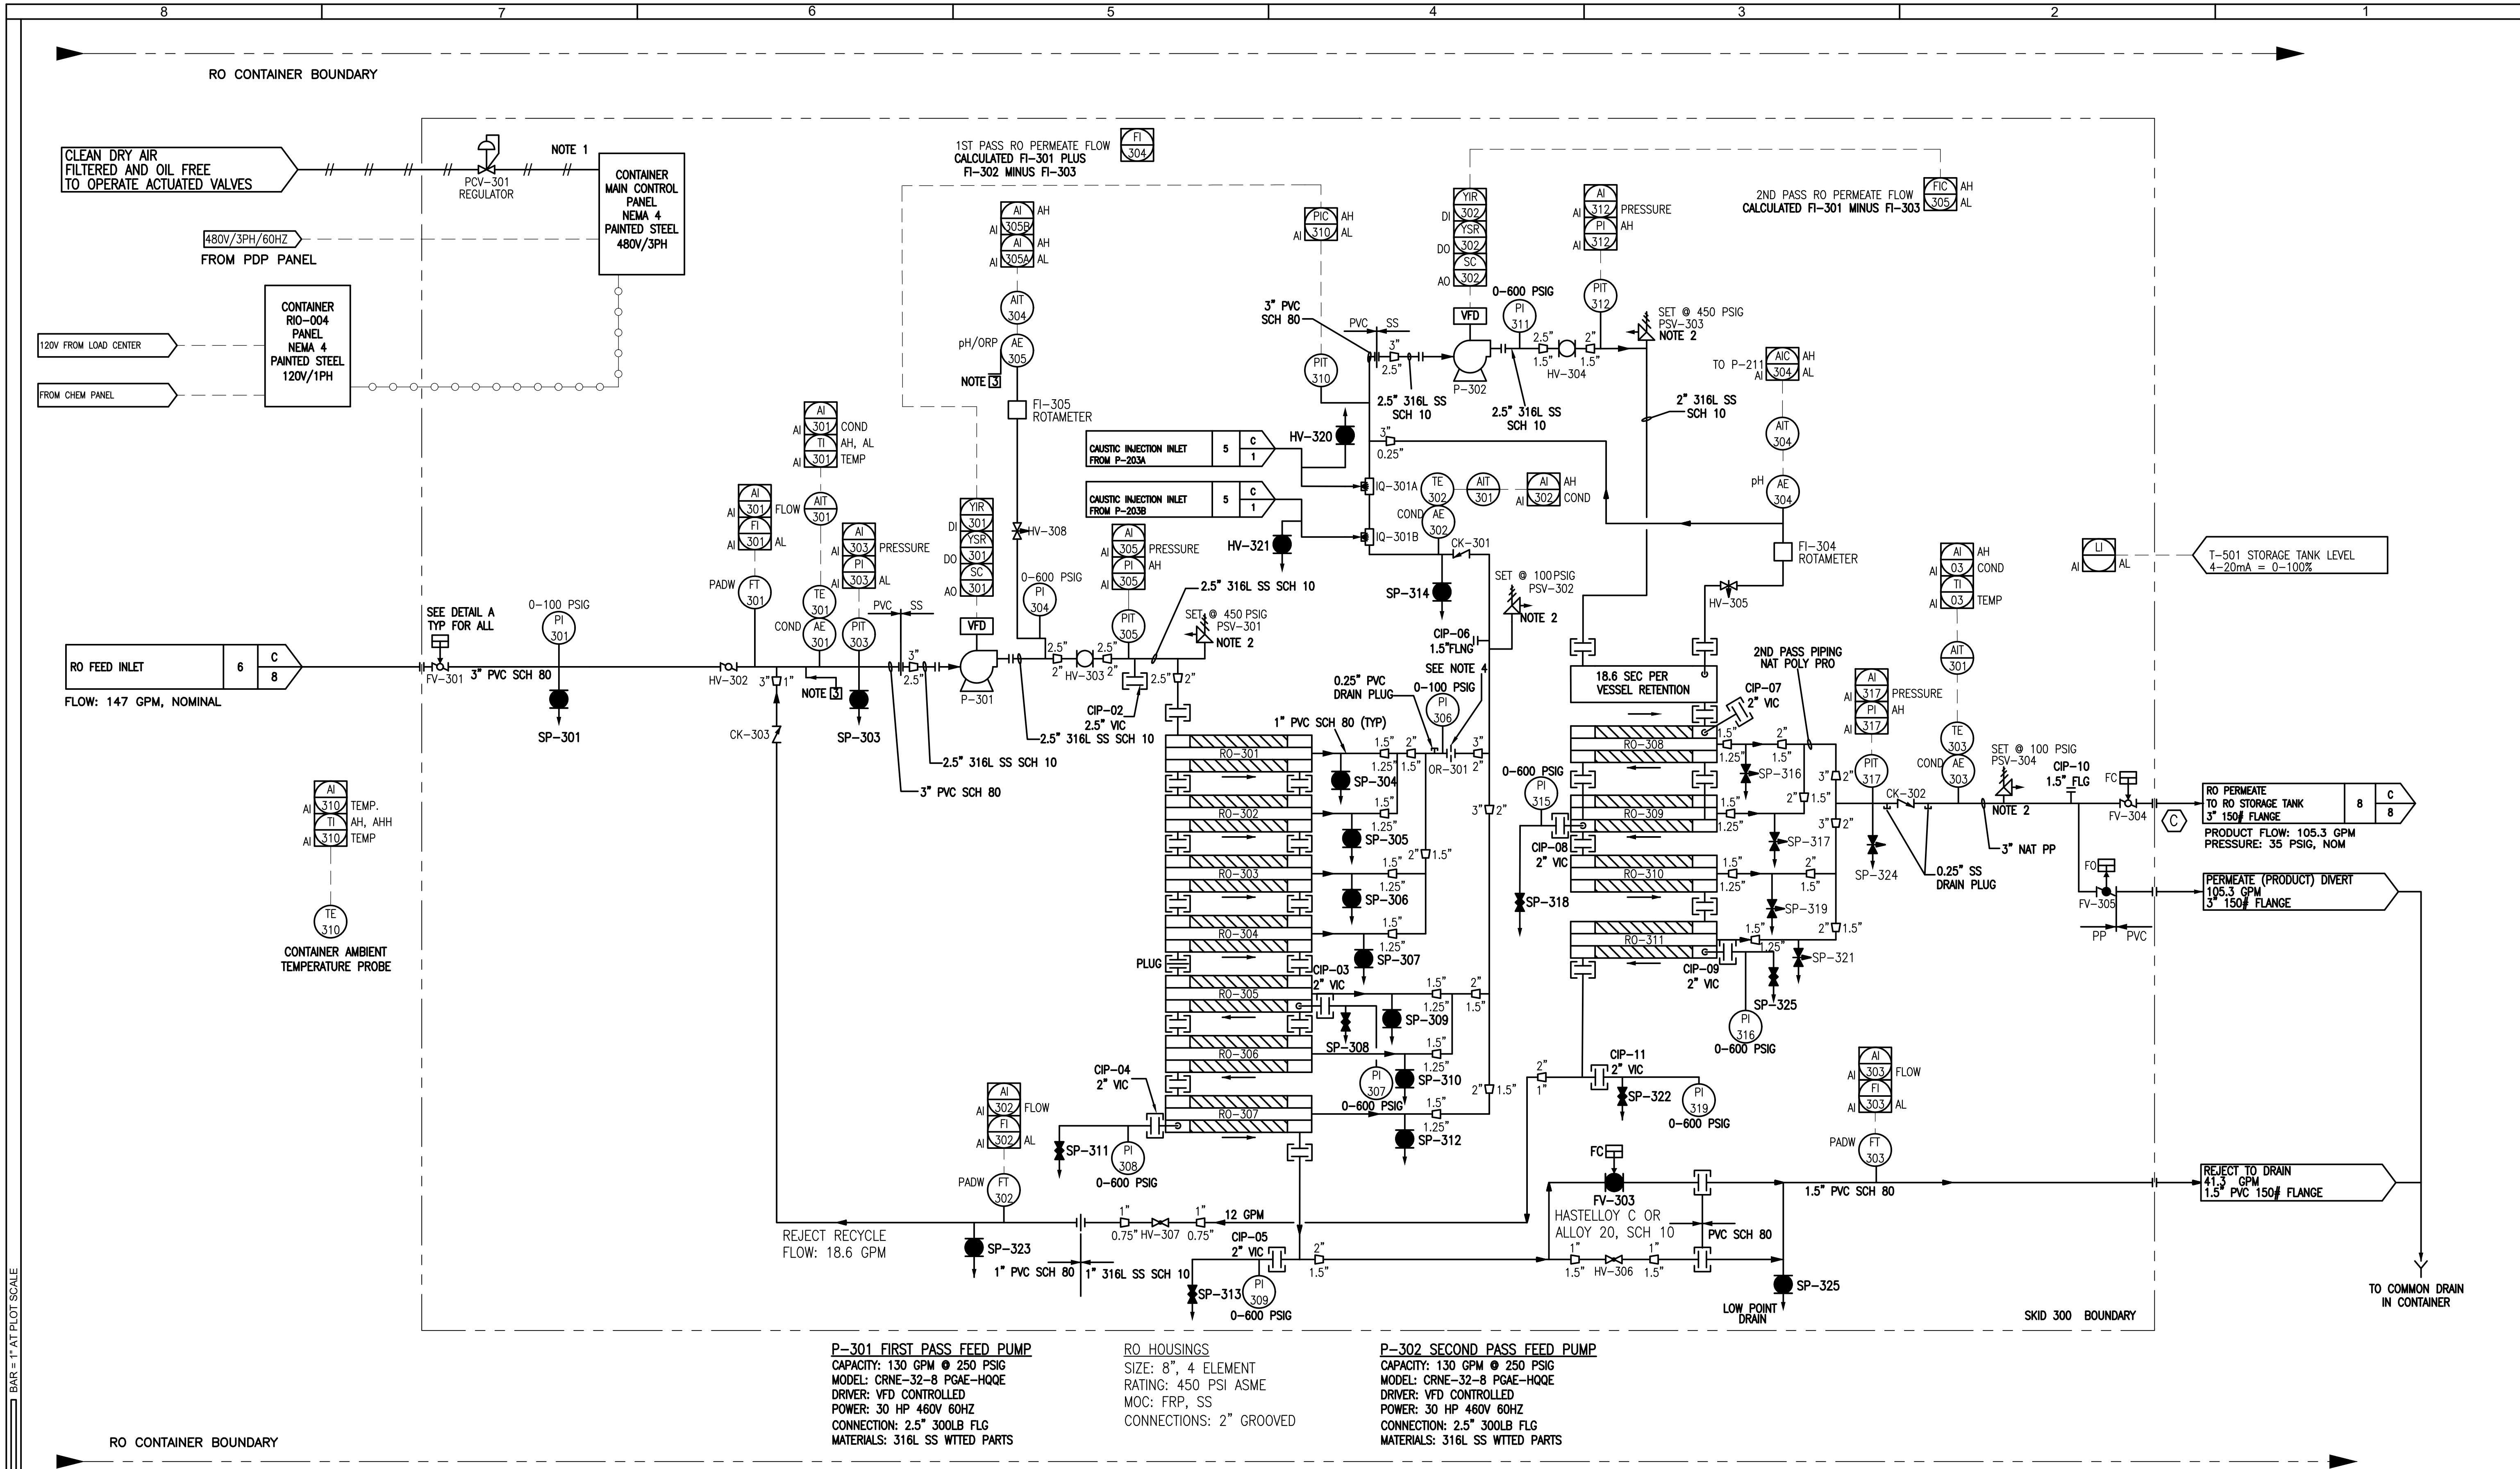

NOTES, UNLESS OTHERWISE STATED:

1. SUPPLY AIR FEEDS SOLENOID MANIFOLD ON CONTROL PANEL
2. RELIEF VALVE DISCHARGE IS PLUMBED TOWARD FLOOR.
3. pH/ORP SIDESTREAM RETURN CONNECTION POINTS.
4. ORIFICE @ FULL PIPE DIAMETER.
5. ——C—— DENOTES CUSTOMER PIPING

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05
CKD BY: K.KALUNG	DATE 2024-12-05
APPD BY: N.VLACIC	DATE 2024-12-05
MGD BY: P.RYAN	SCALE NTS

TITLE PIPING & INSTRUMENTATION DIAGRAM
CONTAINERIZED 2-PASS RO & CDI
WITH PRETREATMENT

CLIENT ELECTRIC HYDROGEN
MIDLAND, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	7 OF 12	7

STD22x34_D v4.1
BAR = 1" AT PLOT SCALE

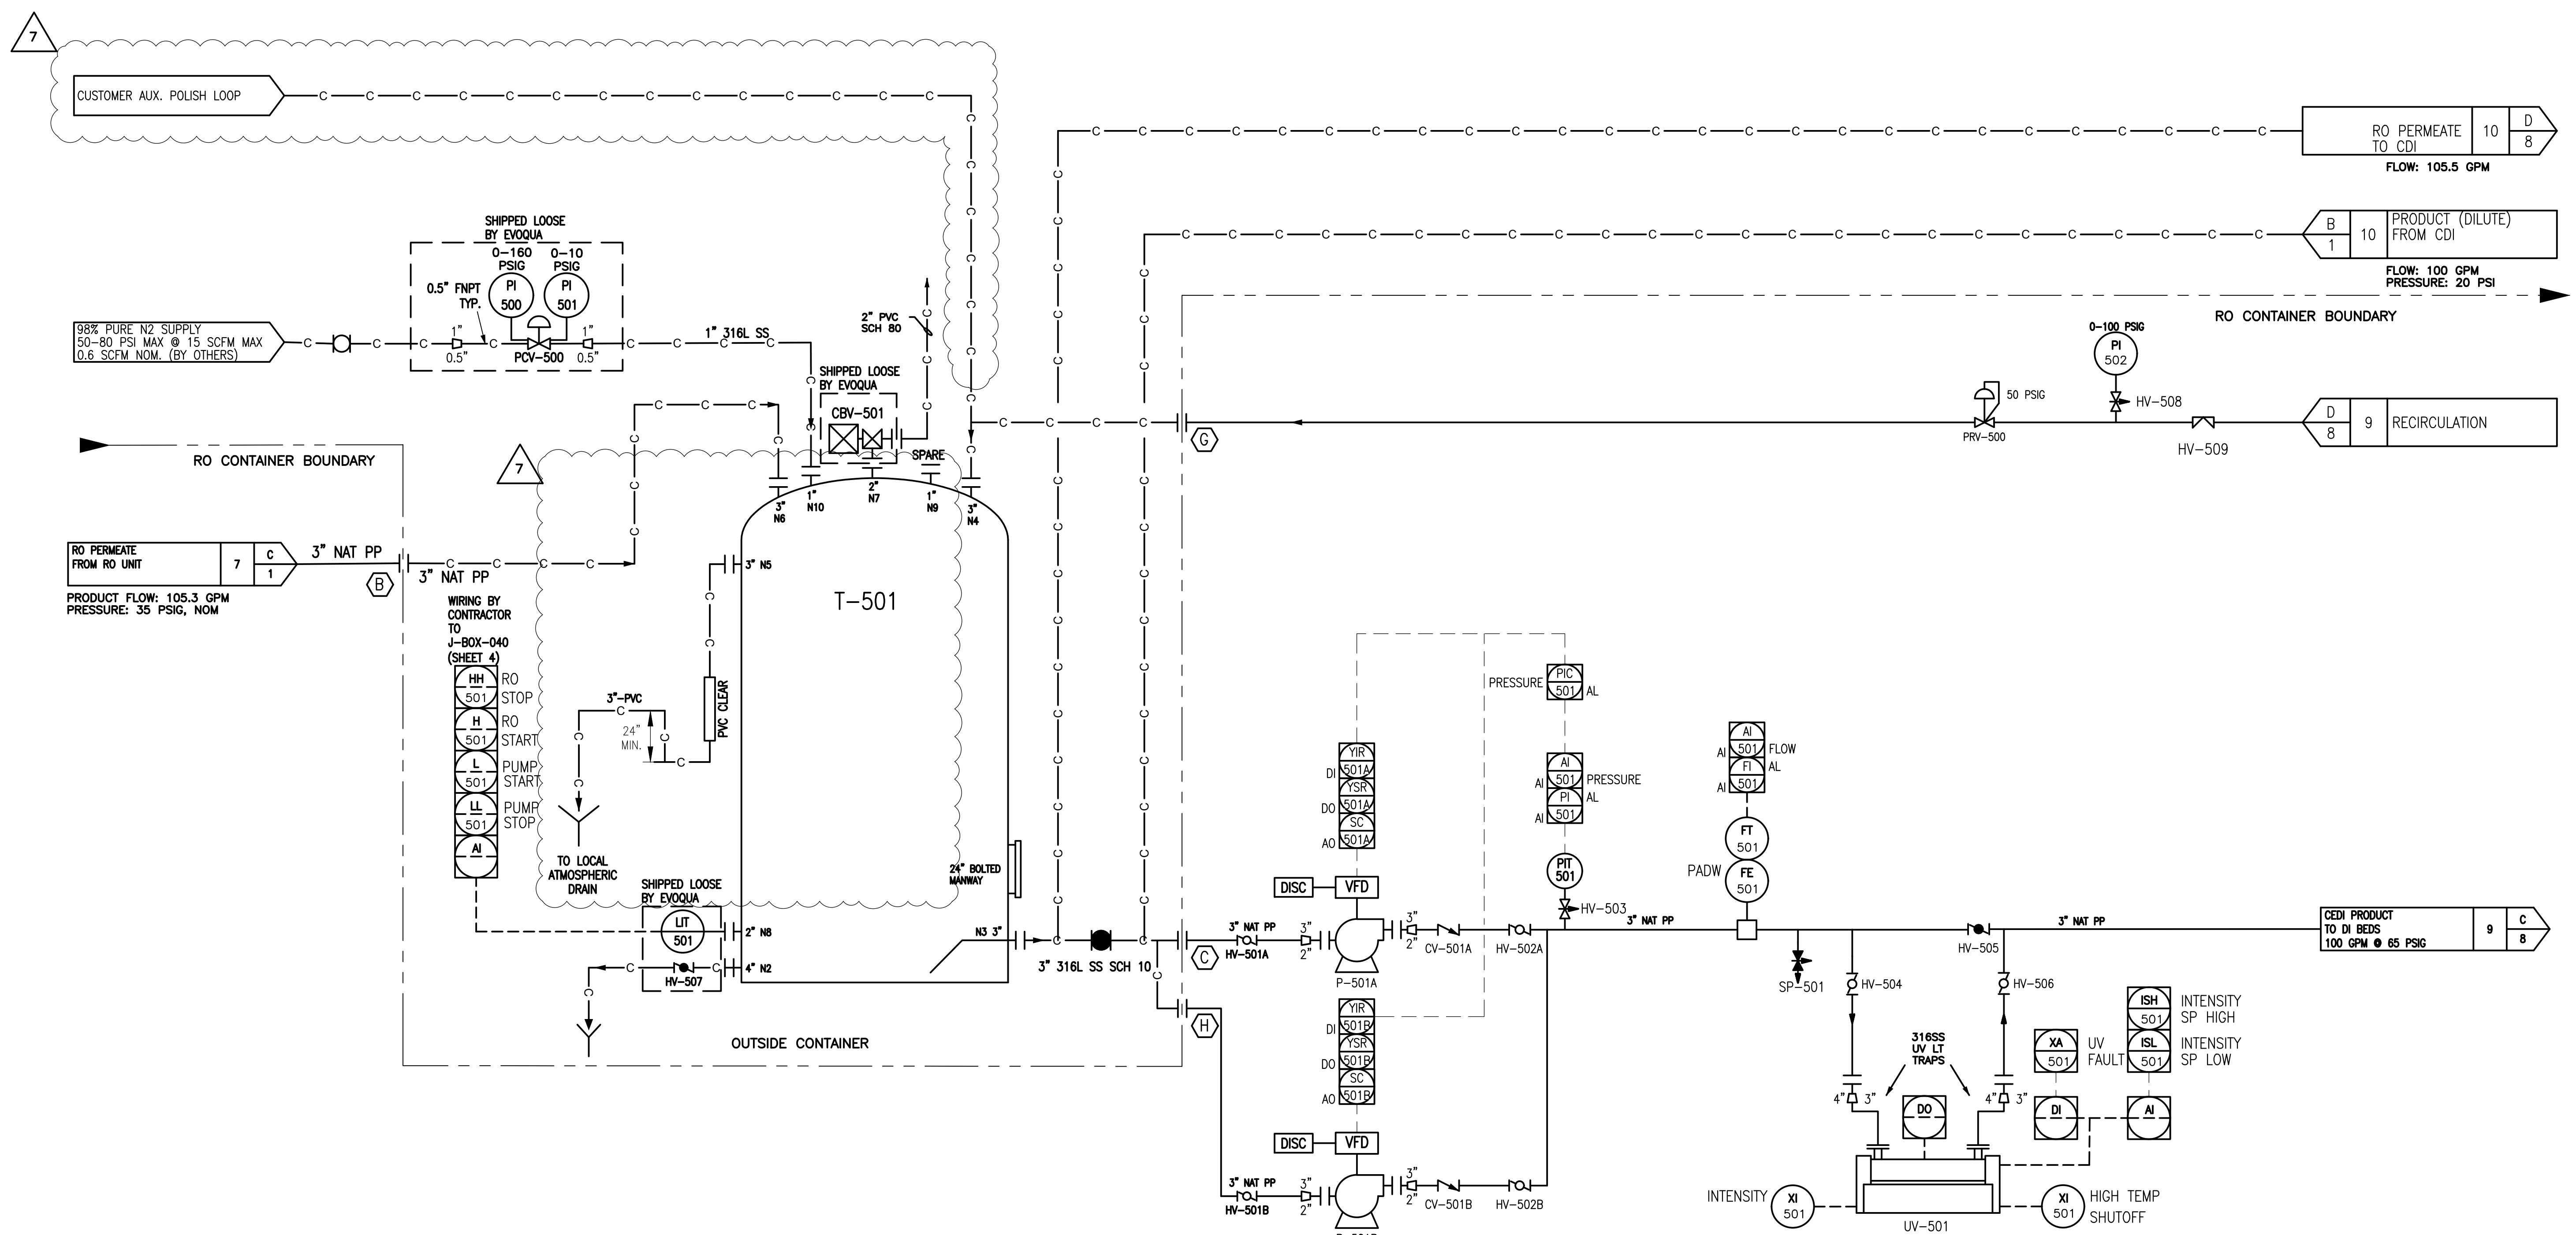

PCV-500
NITROGEN BLANKETING REGULATOR
MFG: CASHCO
MODEL: 1088
SIZE: 0.5" NPT
MOC: SS316, PTFE DIAPHRAGM, VITON SEALS
SET POINT: 1.5" W.C.

T-501
RO PERMEATE STORAGE TANK
MFG: DESIGN TANKS
CAPACITY: 5672 GALLONS
WORKING VOLUME: 5000 GALLONS
SIZE: 8' DIA x 15'-8" HT
MOC: FRP, PIGMENTED WHITE EXT COATING WITH 24" DIA BOLTED MANWAY

CBV-501
CONSERVATION VENT / FILTER
MFG: CASHCO
MODEL: 3200
SIZE: 2" INLET, 2" OUTLET 150LB RF FLANGE
MOC: ALUMINUM, SS316 TRIM, FEP DIAPHRAGM
SET POINT: 6" W.C. PRESSURE, 2" W.C. VACUUM
FILTER RATING: 1.12 HEPA

P-501A/B DISTRIBUTION PUMP EACH @ 100%
CAPACITY: 105.3 GPM @ 70 PSI
DRIVER: VFD CONTROLLED
MODEL: CRNE 15-4 N-FGJ-A-E-HQQE
POWER: 7.5 HP 460V 60HZ
MOC: SS316 WETTED PARTS
CONNECTIONS: 2" FLANGE 300#

UV-501
FINAL TOC REDUCTION ULTRAVIOLET LIGHT
MFG: AQUAFINE
MODEL: OPV12DTL
ELECTRICAL: 120VAC, 60 HZ
MOC: WETTED - SS316L
CONNECTIONS: 4" FLANGE 150#

RO CONTAINER BOUNDARY

INSIDE CONTAINER

NOTES, UNLESS OTHERWISE STATED:
1. ——C—— DENOTES CUSTOMER PIPING
2. TANK IS NON-INSULATERD. HEATER OR HEAT TRACE, IF REQUIRED, IS BY OTHERS
3. MAX PRESSURE DROP ACROSS UV IS ~10 PSI

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
MGD BY: P.RYAN	SCALE NTS	

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	8 OF 12	7

STD.22x34_D v4.1 BAR = 1" AT PLOT SCALE

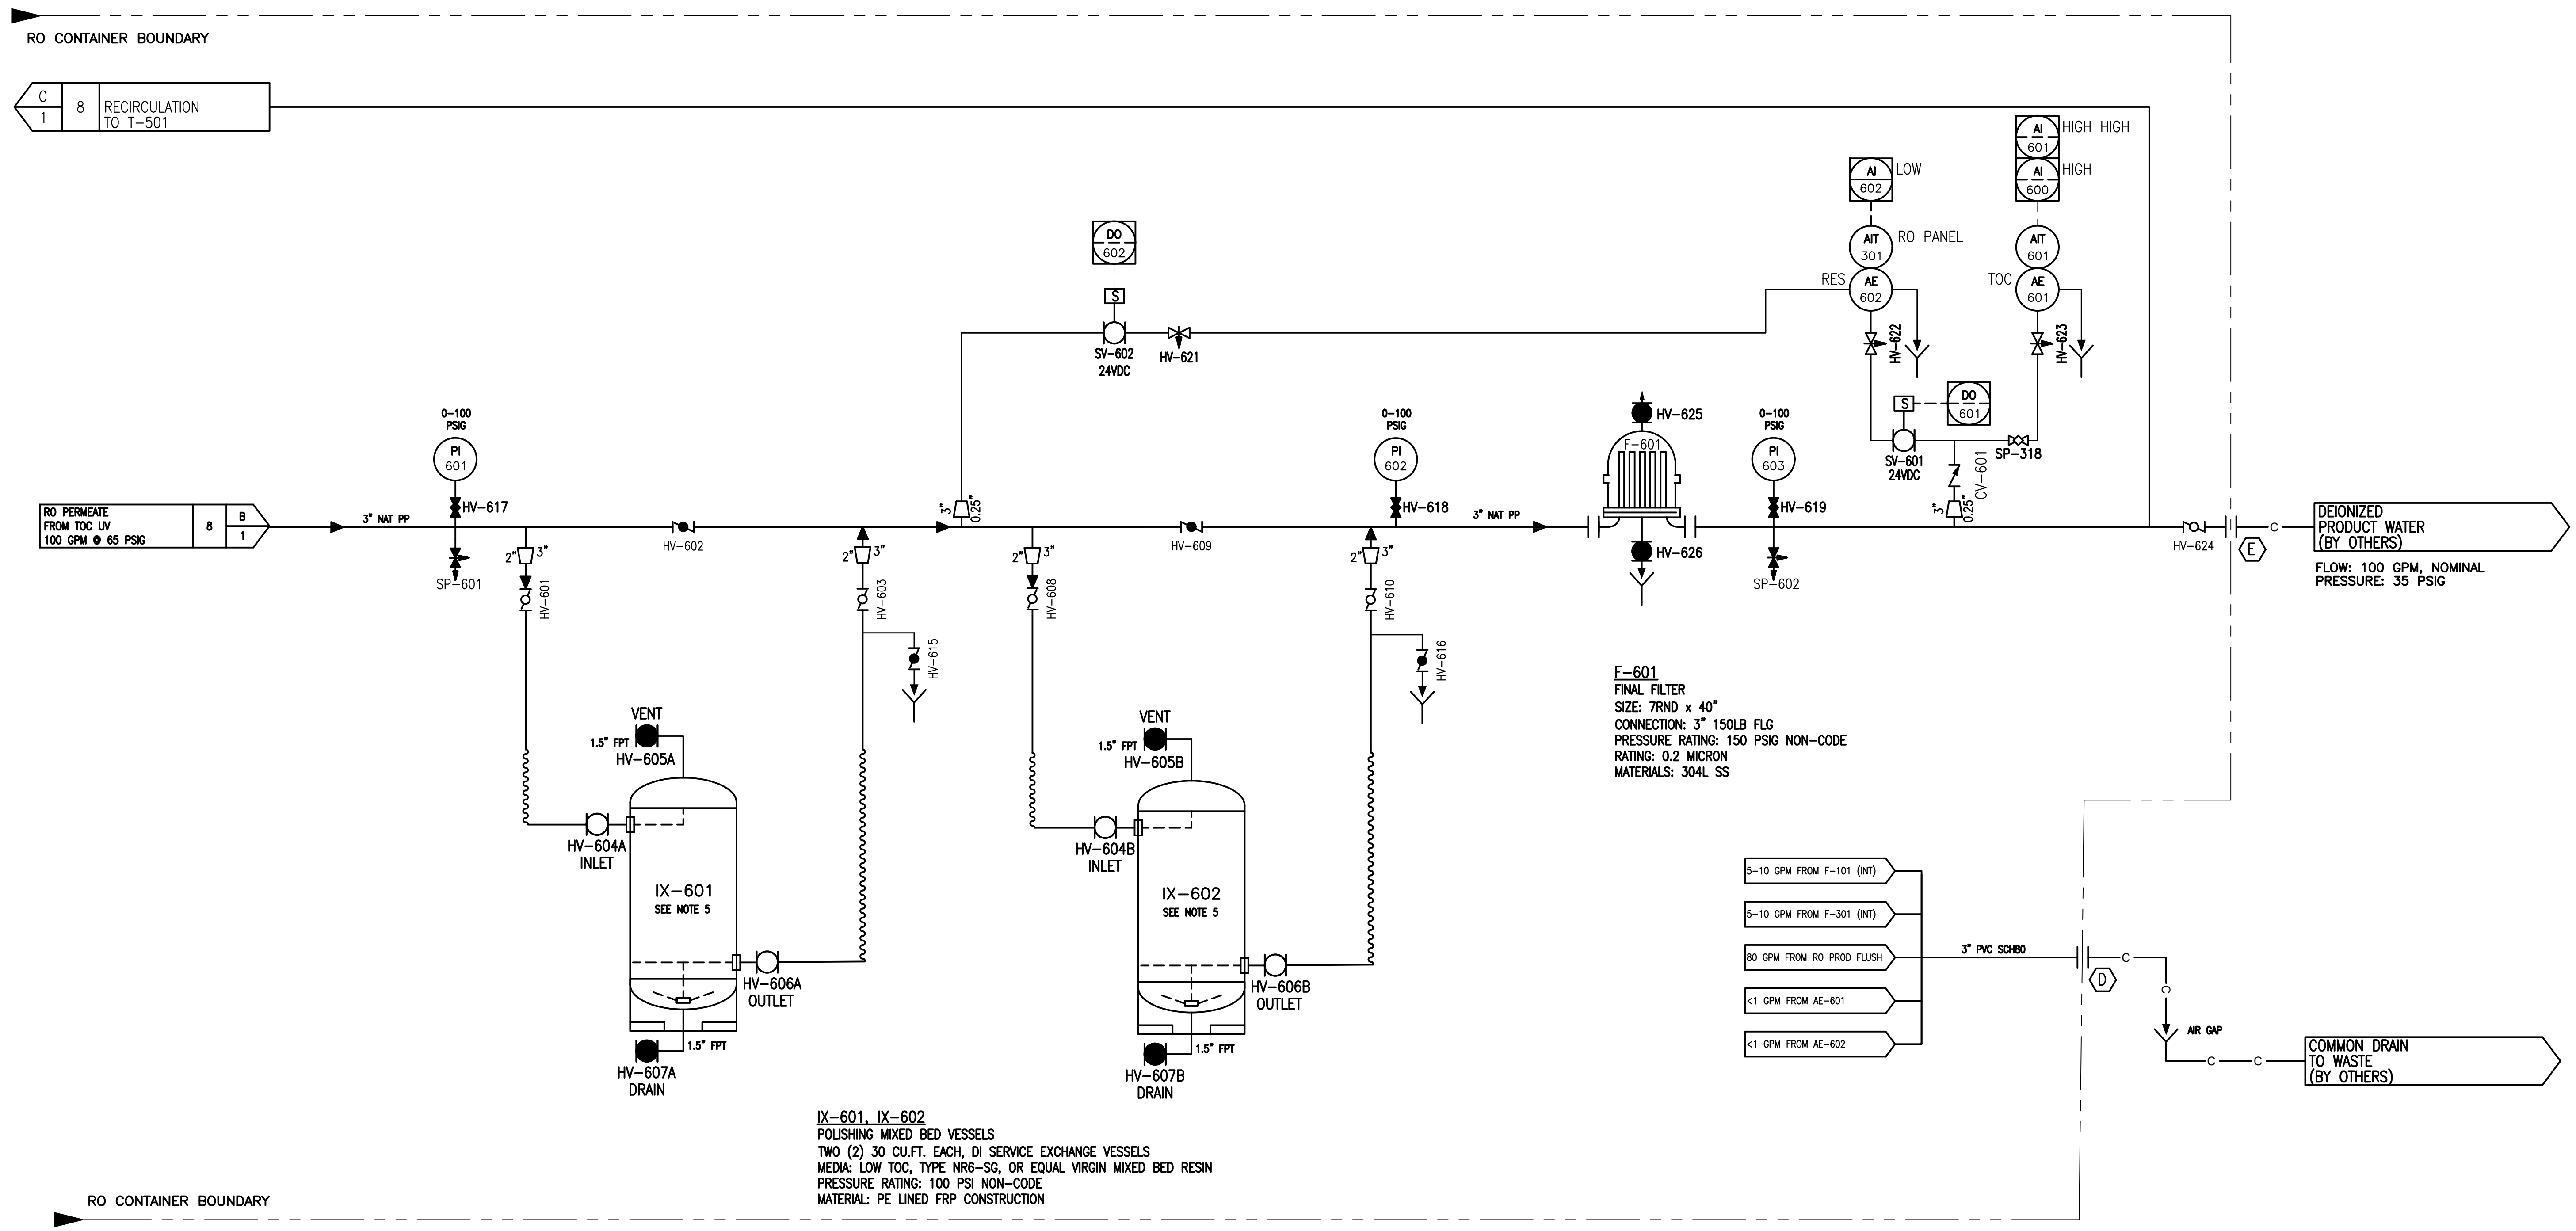

NOTES, UNLESS OTHERWISE STATED:

1. ——C—— DENOTES CUSTOMER PIPING
2. CUSTOMER DRAIN LINE TO HAVE ZERO BACK PRESSURE TO THE CONTAINER FOR GRAVITY DRAIN.
3. MAX DP ACROSS IX-601 AND IX-602 IS 15 PSI (EACH)
4. MAX DP ACROSS F-601 IS 10 PSI
5. HV-604A/B THRU HV-607A/B ARE NOT PHYSICALLY TAGGED AND PART OF THE RENTAL UNIT

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
MGD BY: P.RYAN	SCALE NTS	

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	9 OF 12	7

STD22x34_D v4.1 BAR = 1" AT PLOT SCALE

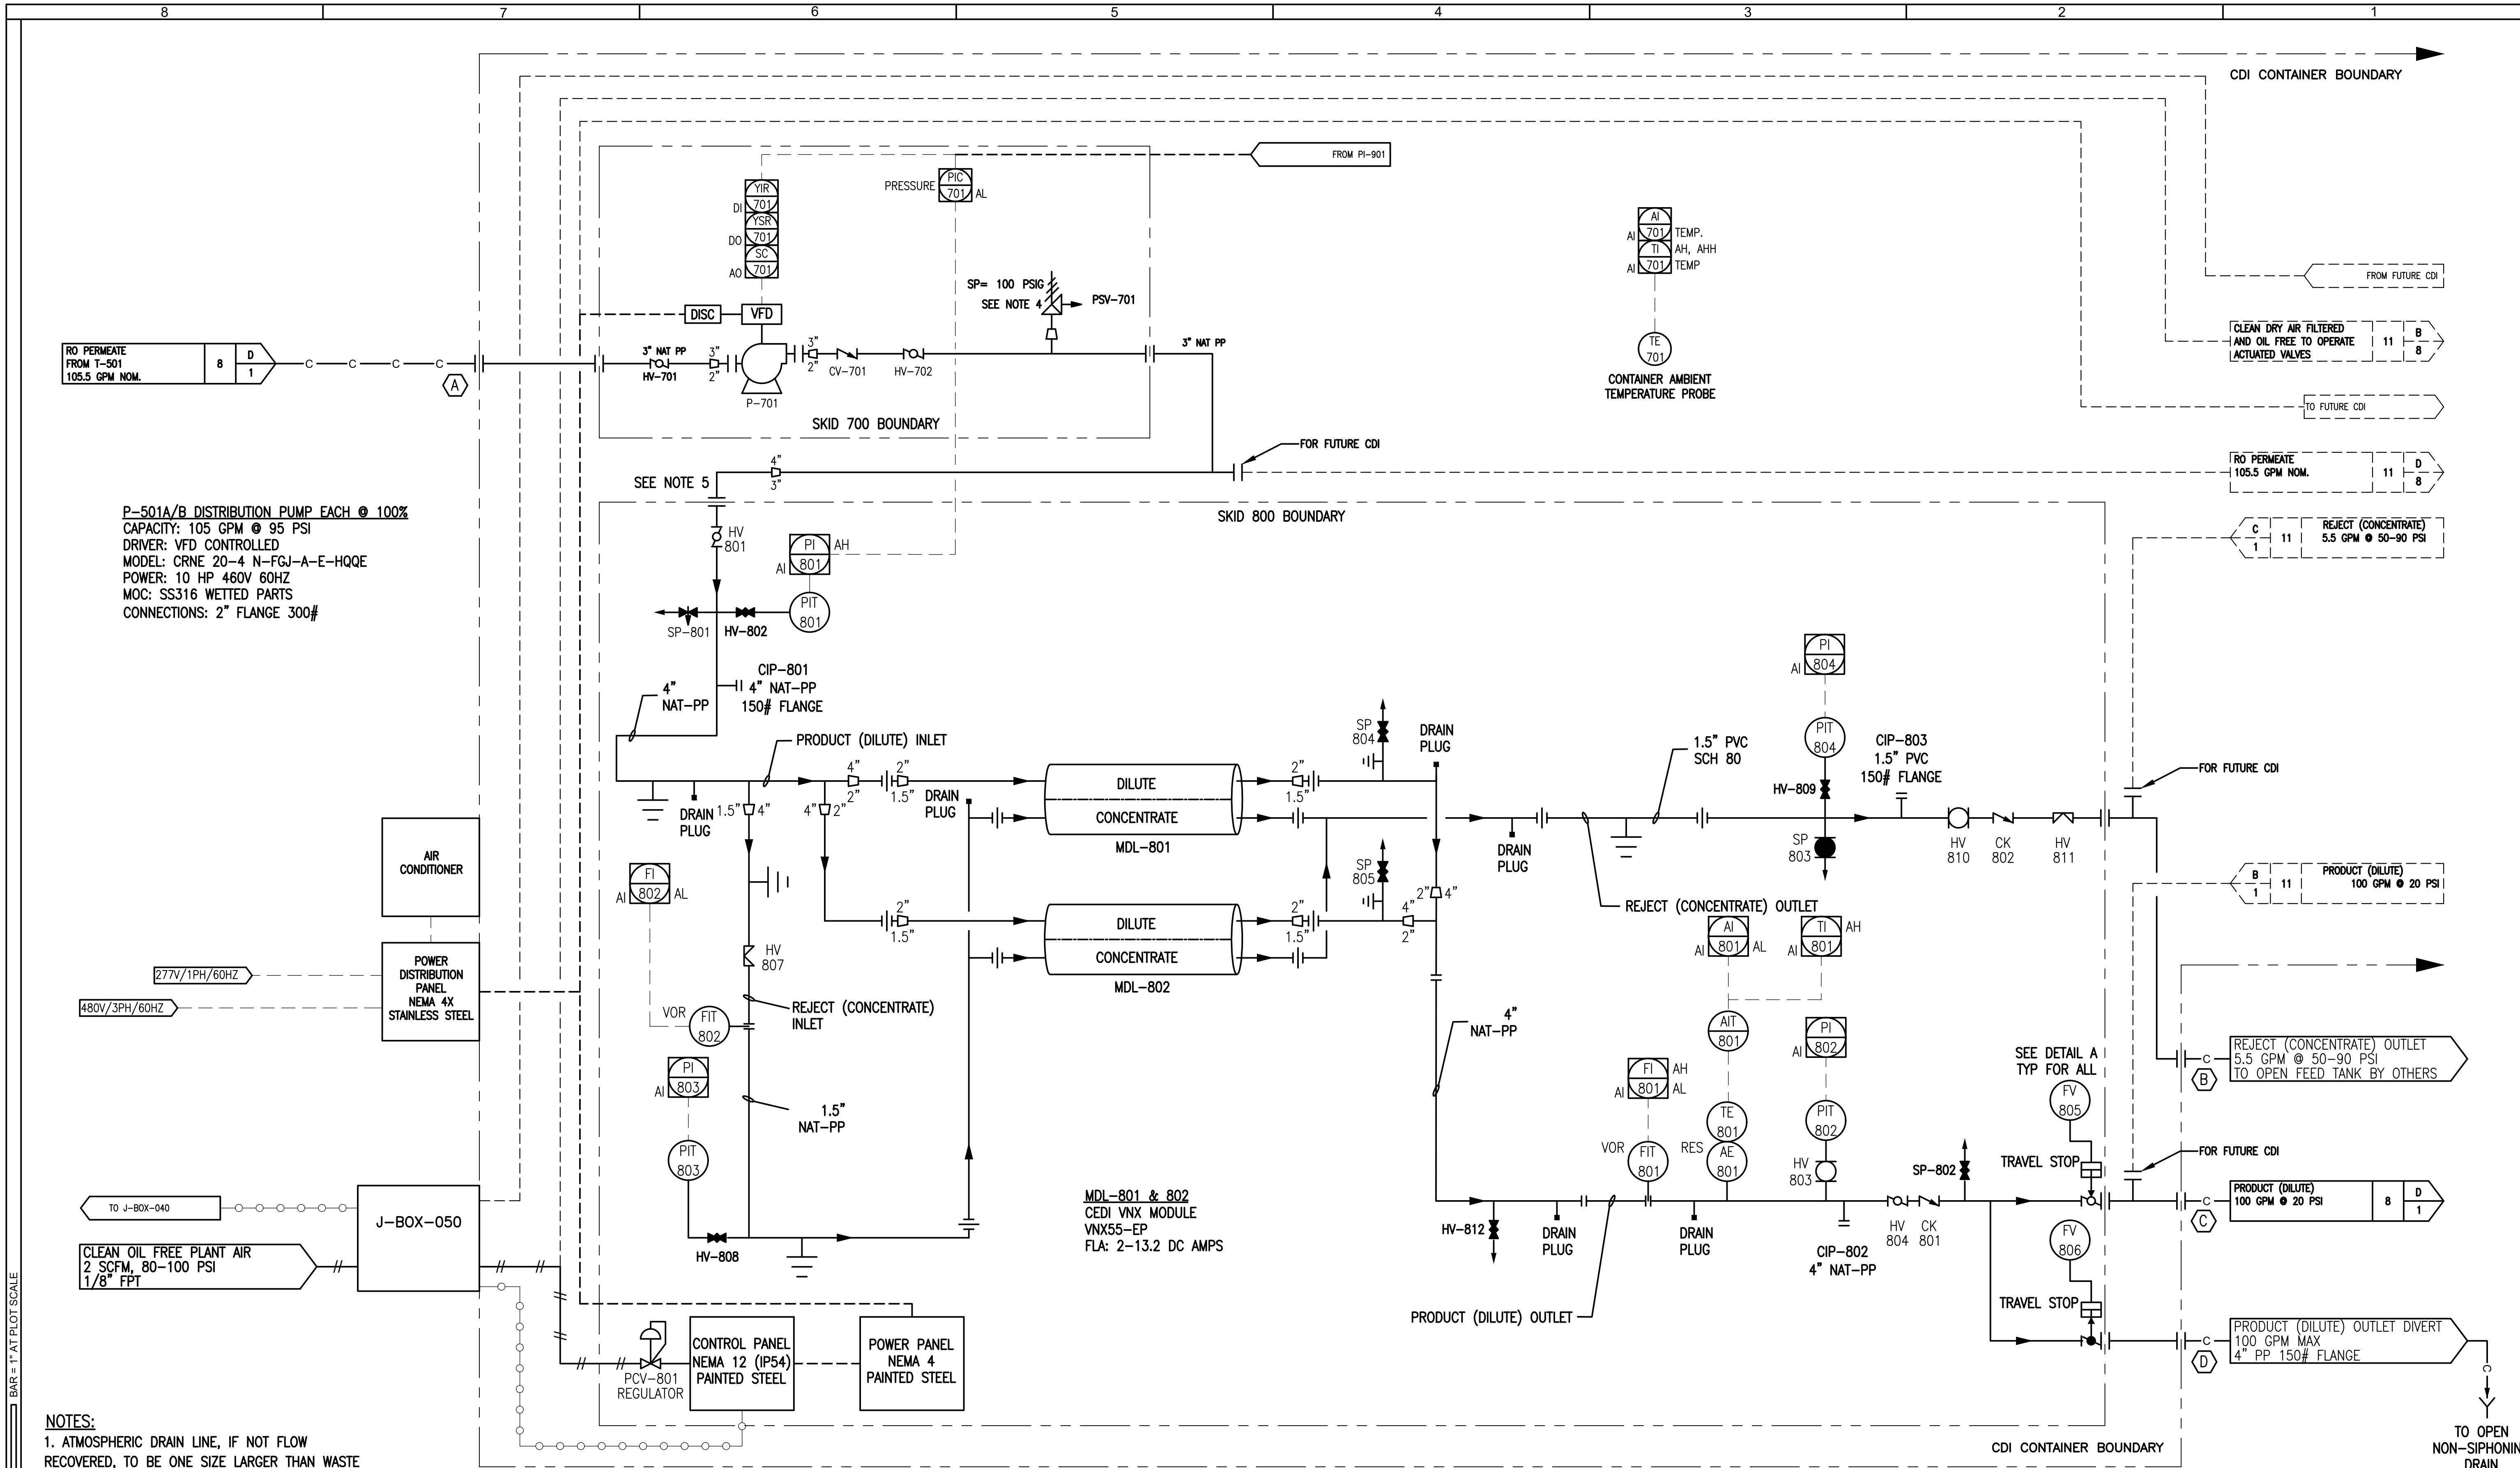

NOTES:

1. ATMOSPHERIC DRAIN LINE, IF NOT FLOW RECOVERED, TO BE ONE SIZE LARGER THAN WASTE PIPING.
2. —C— CUSTOMER FIELD PIPING.
3. LOW POINT DRAIN IS 1/4" NPT.
4. BASED ON 95% RECOVERY @ NOMINAL PRODUCT FLOW.
5. STABLE BACKPRESSURE REQUIRED TO MAINTAIN PROPER FLOW.
6. PIT-802 MUST READ 3-5 PSI HIGHER THAN PIT-804. SEE O&M FOR MORE DETAILS.

TP	CDI CONTAINER CONNECTION TABLE	SIZE	TYPE
A	RO PRODUCT FROM T-501	3"	FLANGE RF NATURAL PP 150LB
B	REJECT TO OPEN FEED TANK	1.5"	FLANGE RF PVC80 150LB
C	CDI PRODUCT TO P-501A/B	4"	FLANGE RF NATURAL PP 150LB
D	CDI PRODUCT DIVERT TO OPEN DRAIN	4"	FLANGE RF NATURAL PP 150LB
E	CDI PRODUCT DIVERT TO OPEN DRAIN	4"	FLANGE RF NATURAL PP 150LB

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
MGD BY: P.RYAN	SCALE NTS	

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	10 OF 12	7

STD-22x34_D v4.1

BAR = 1" AT PLOT SCALE

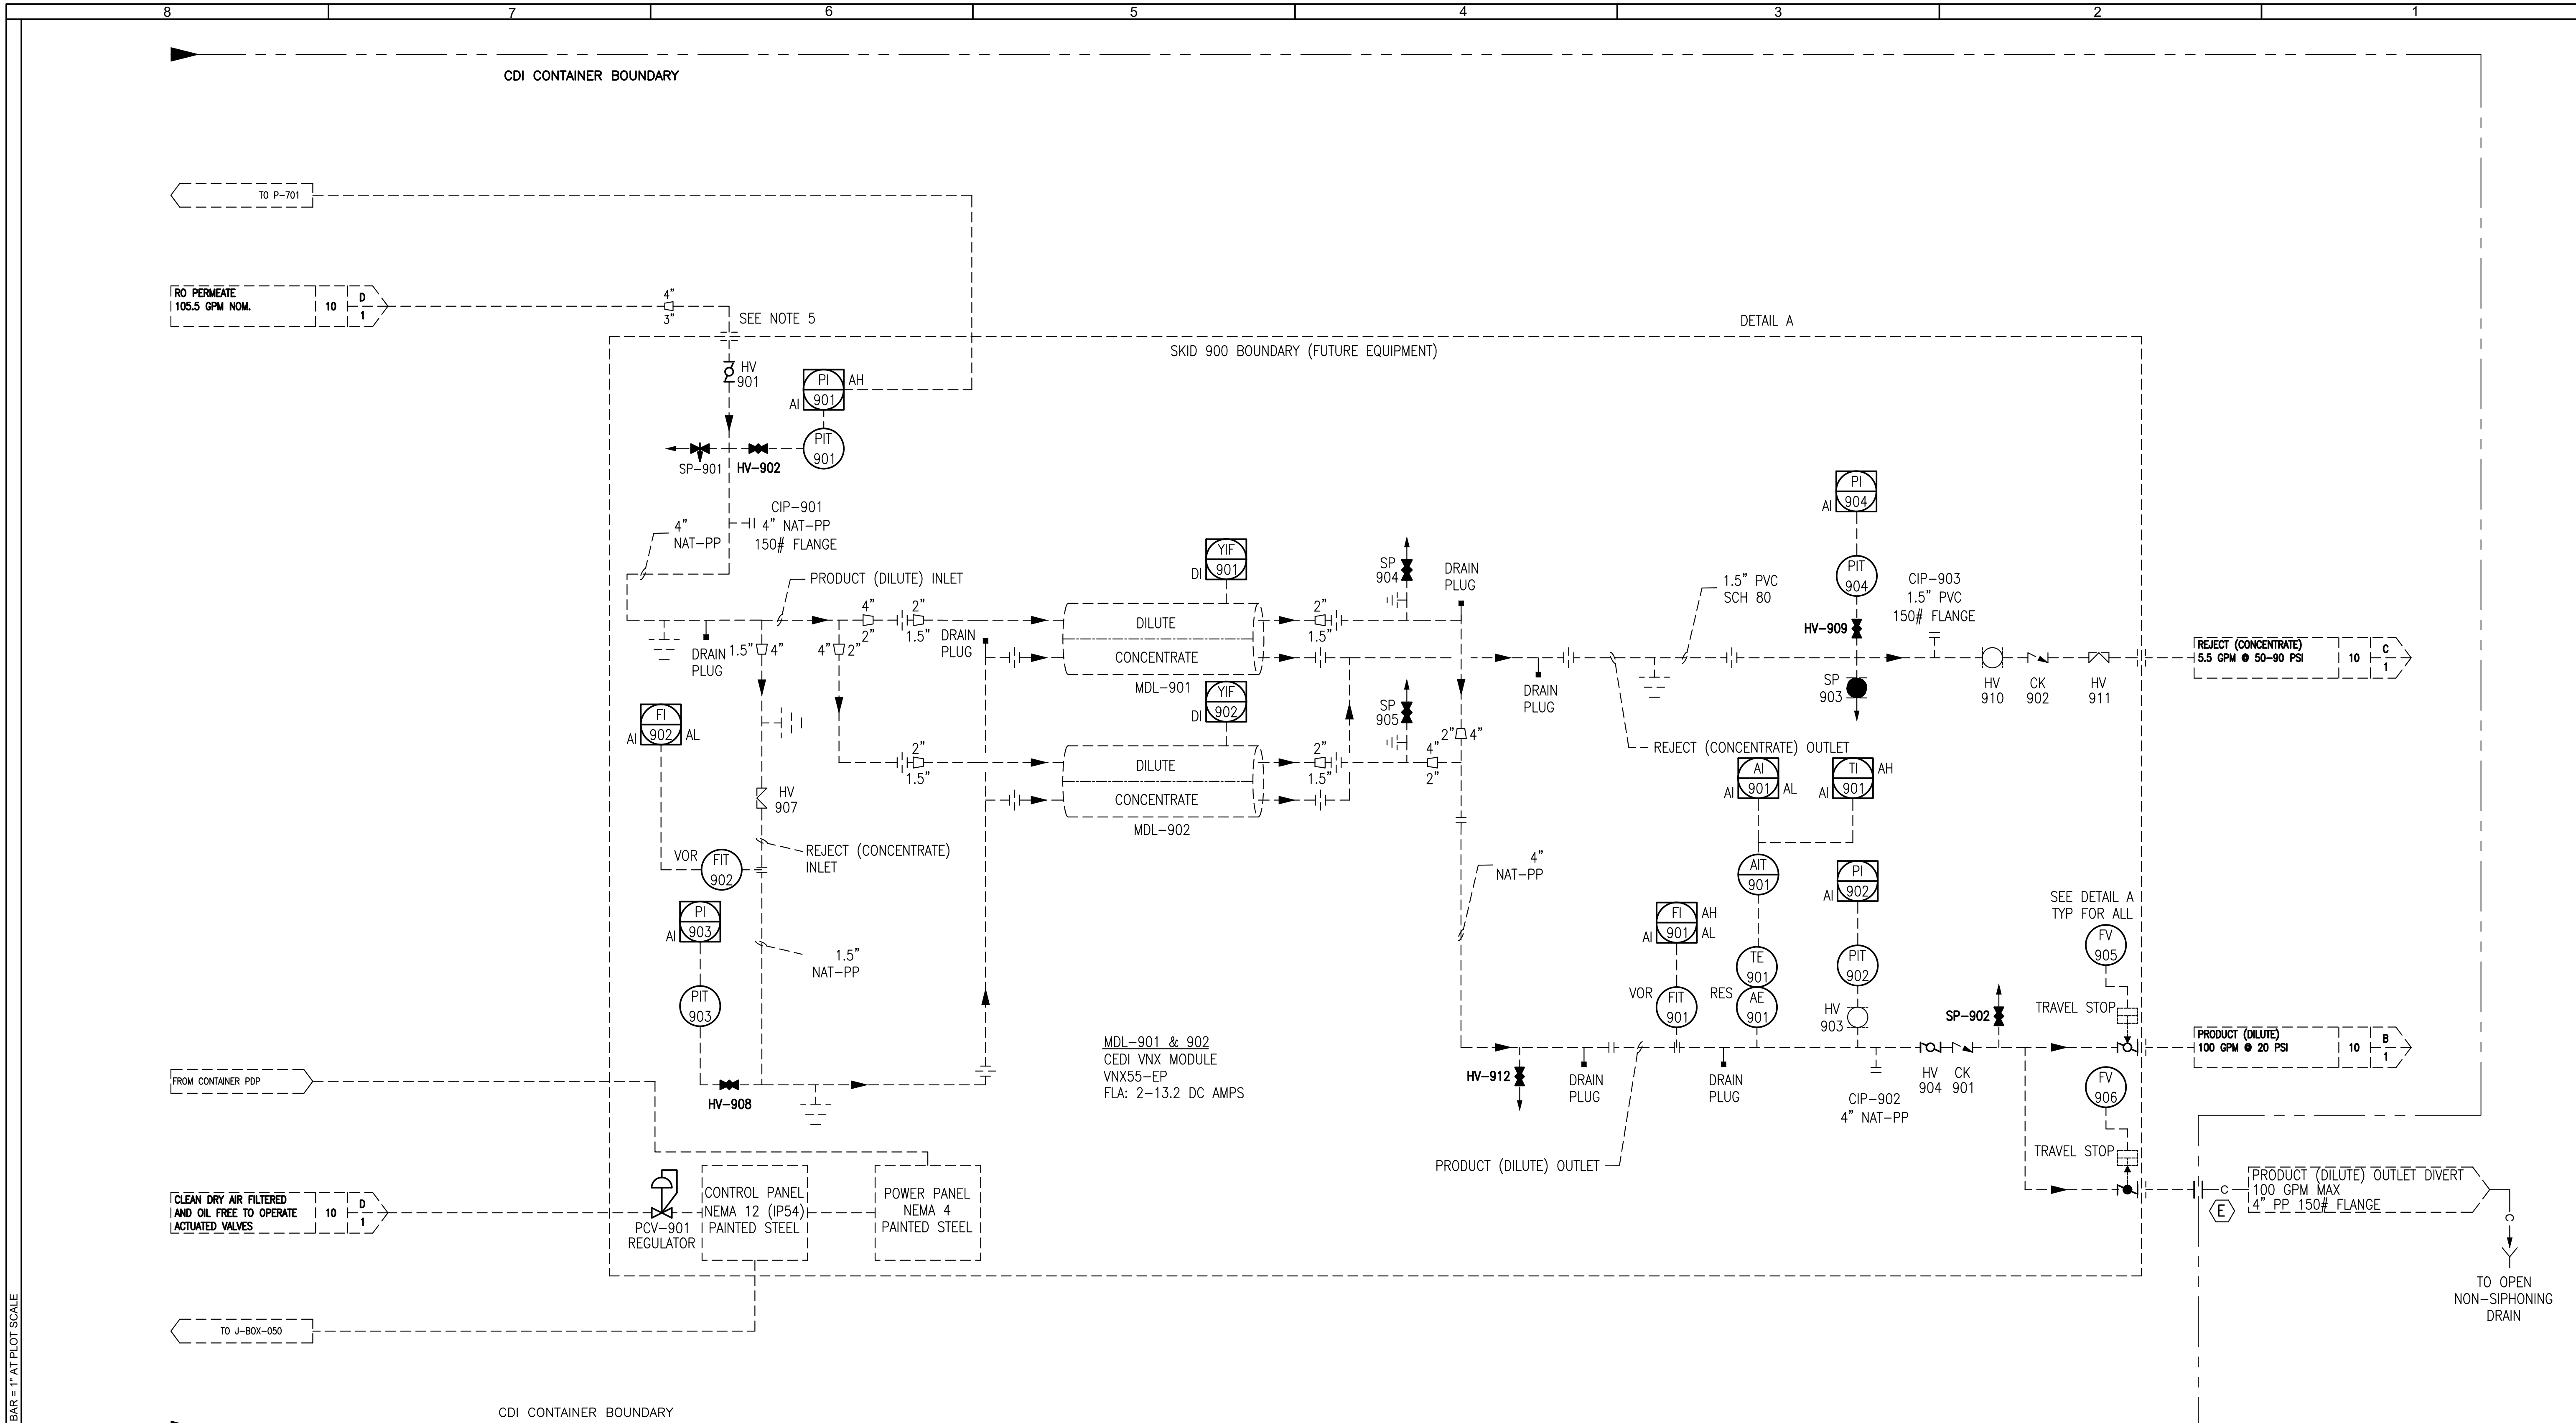

NOTES:

1. ATMOSPHERIC DRAIN LINE, IF NOT FLOW RECOVERED, TO BE ONE SIZE LARGER THAN WASTE PIPING.
2. —C— CUSTOMER FIELD PIPING.
3. LOW POINT DRAIN IS 1/4" NPT.
4. BASED ON 95% RECOVERY @ NOMINAL PRODUCT FLOW.
5. STABLE BACKPRESSURE REQUIRED TO MAINTAIN PROPER FLOW.
6. PIT-03 MUST READ 3-5 PSI HIGHER THAN PIT-04. SEE O&M FOR MORE DETAILS.

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE	PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT	ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	EVOQUA WATER TECHNOLOGIES	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
MGD BY: P.RYAN	SCALE NTS		

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	11 OF 12	7

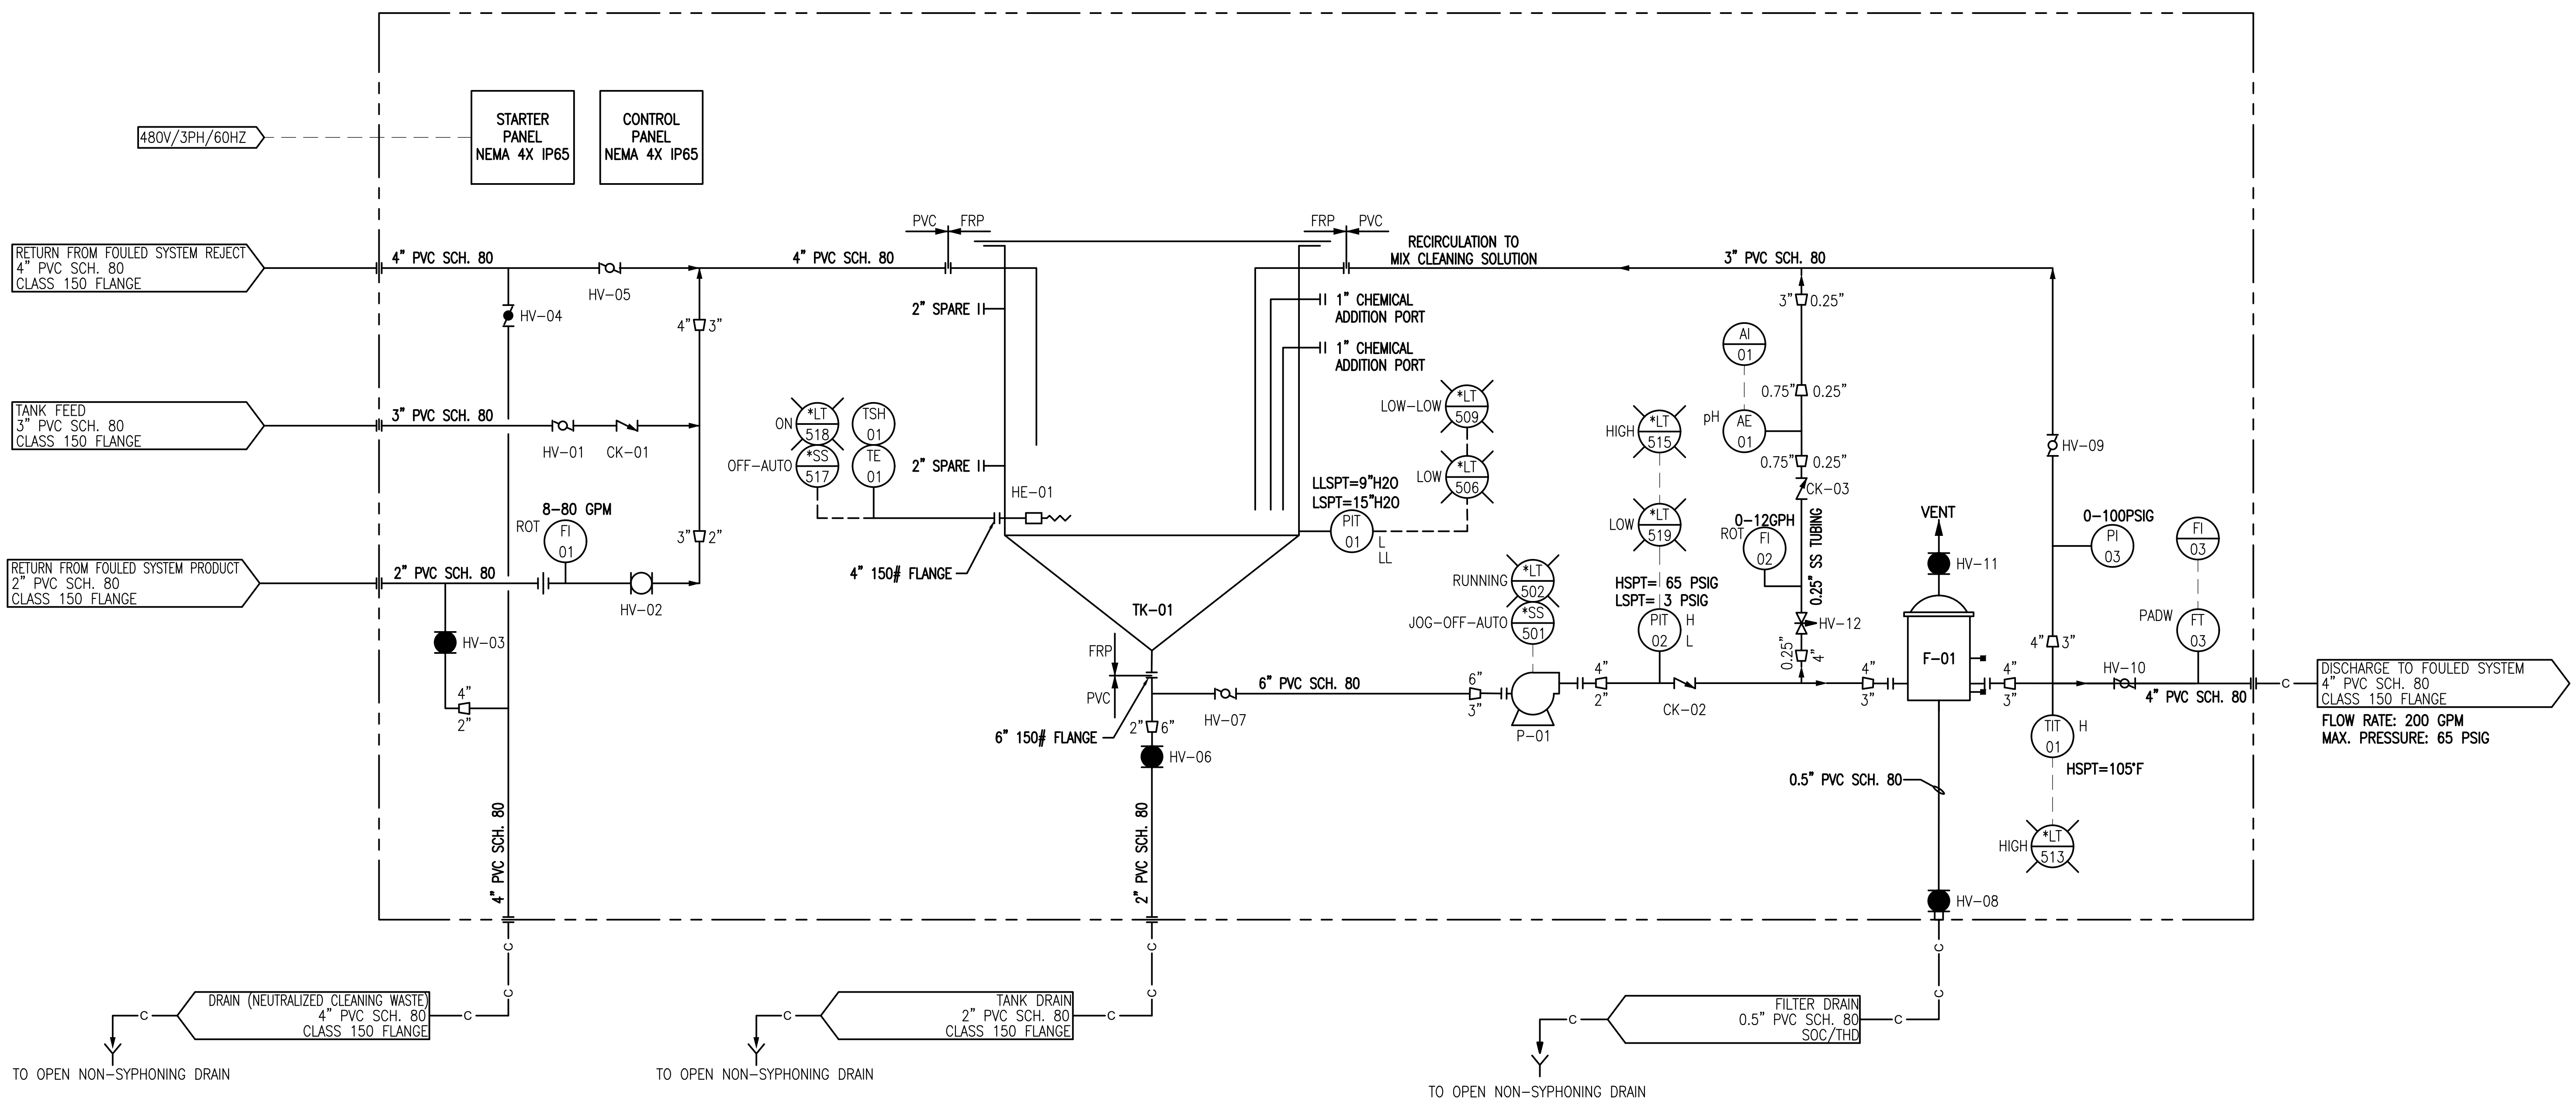

HE-01
HEATER
TYPE: IMMERSION
CAPACITY: 18KW
POWER: 480VAC/ 3PHASE
FLA: 21.65 AMPS

TK-01
TANK (w/HINGED COVER)
SIZE: 48" DIA. X 70" HIGH
OPERATING CAPACITY: 400 GAL.
MATERIAL: FRP

P-01
BOOSTER PUMP
MOTOR: 15HP, TEFC, 3500 RPM
DESIGN: 200GPM@140FT. TDH (60 PSIG)
IMPELLER: 5 15/16"
MATERIAL: 316 SS
POWER: 480VAC/ 3PHASE/ 60HZ
FLA: 17 AMPS

F-01
FILTER CARTRIDGE HOUSING
5 MICRON, DOUBLE OPEN END
SIZE; 12 ROUND X 40" H
HOUSING; 316L SS

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	SEE SHEET ONE					

DWN BY: N.VLACIC	DATE 2024-12-05	TITLE	PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
CKD BY: K.KALUNG	DATE 2024-12-05	CLIENT	ELECTRIC HYDROGEN MIDLAND, TX
APPD BY: N.VLACIC	DATE 2024-12-05	EVOQUA WATER TECHNOLOGIES	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
MGD BY: P.RYAN	SCALE NTS		

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
N/A	2034/001845	D-DOS02	V112053190	12 OF 12	7

STD 22x34_D v4.1
BAR = 1" AT PLOT SCALE