
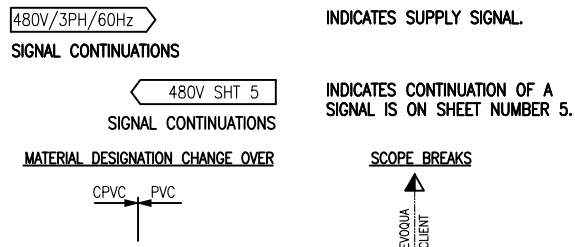
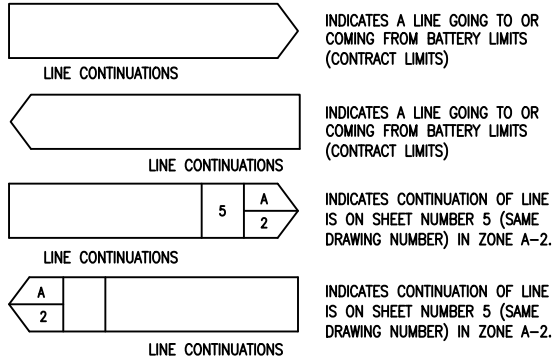



FLOWS & LINES

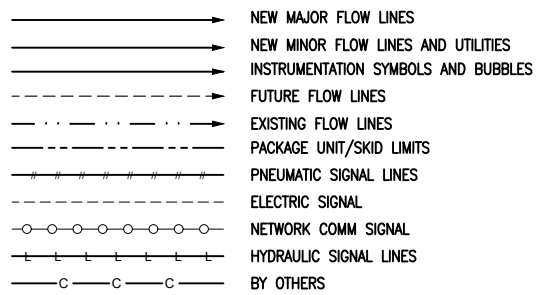


LINE IDENTIFIER

3" PVC SCH80


ACTUATOR SYMBOLS

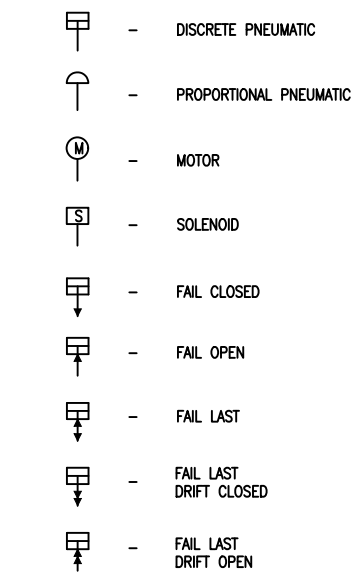


VALVE SYMBOLS

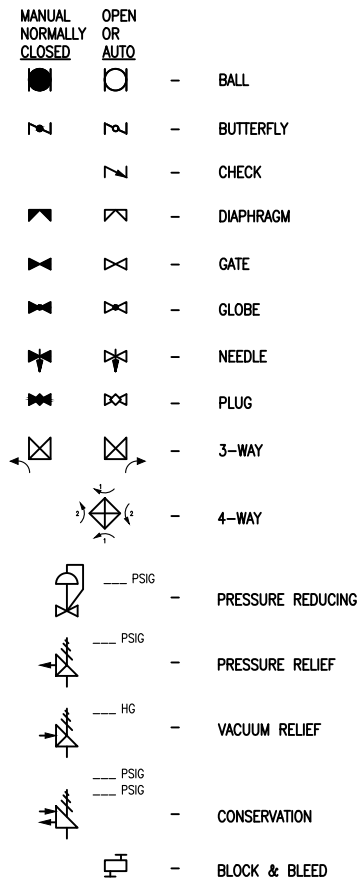

PUMP & AGITATOR SYMBOLS

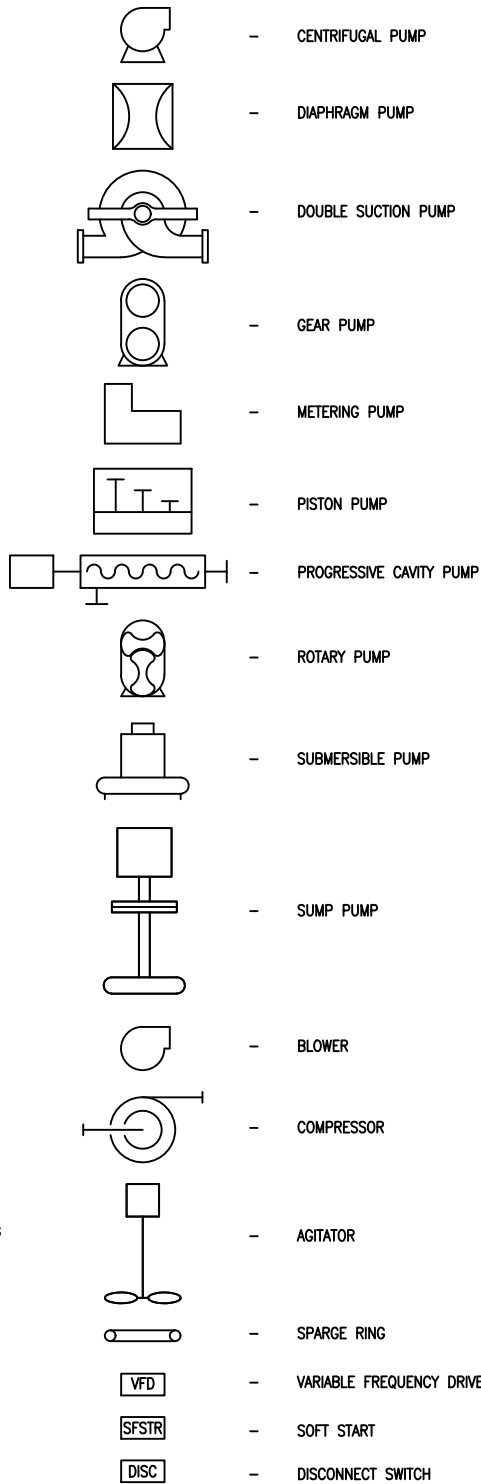

PIPING ACCESSORIES

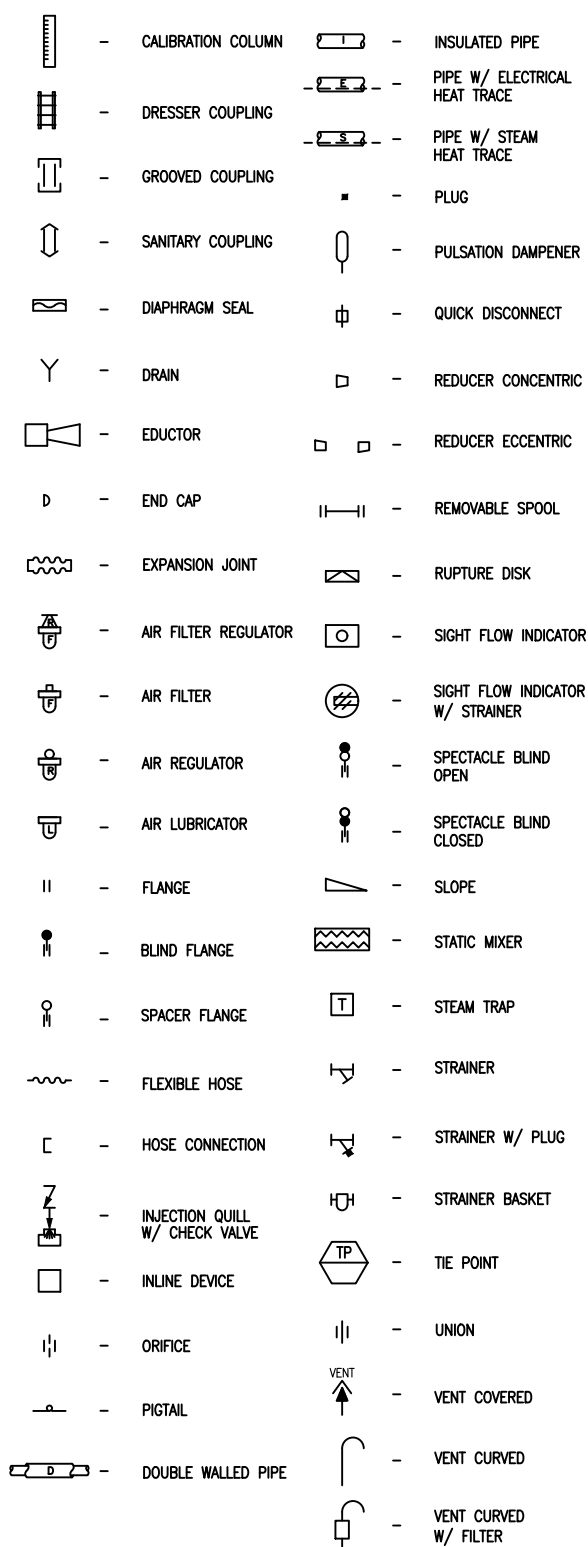

INSTRUMENTATION BUBBLES

	FIELD MOUNTED (IE: PIPE MOUNTED)	MAIN PANEL ACCESSIBLE TO OPERATOR (IE: FRONT OF MAIN)	MAIN PANEL INACCESSIBLE TO OPERATOR (IE: INSIDE OF MAIN)	SECONDARY LOCATION ACCESSIBLE TO OPERATOR (IE: FRONT OF REMOTE)	SECONDARY LOCATION INACCESSIBLE TO OPERATOR (IE: INSIDE OF REMOTE)
DISCRETE INSTRUMENT	** ***				
BASIC PROCESS CONTROL SYSTEM (PLC/HMI/DCS)					
HIGH LEVEL CONTROL SYSTEM (PLANT CONTROL)					
SAFETY INSTRUMENTED SYSTEM (SIS)					

* LOCATION ABBREVIATIONS OF THE USER'S CHOICE SUCH AS IP1 (INSTRUMENT PANEL #1), MCP (MAIN CONTROL PANEL), CC3 (COMPUTER CONSOLE #3), ETC.

** INSTRUMENT TYPE SUCH AS COND, pH, ORP, TURB, VISC, RTD, TC, MAG, ROT, SON

*** INSTRUMENT ALARMS OR SIGNALS ASSOCIATED WITH THIS DEVICE SUCH AS AHH, AH, AL, ALL, STRT, STOP, HOA, RUN, MID, S/S, R/L

EQUIPMENT TAG



A AGITATOR, AERATOR, MIXER
B BLOWER
C COMPRESSOR
CC CALIBRATION COLUMN
CP CONTROL PANEL
D DRYER
DS DIAPHRAGM SEAL
E HEAT EXCHANGER
ED EJECTOR/EDUCTOR
EJ EXPANSION JOINT
F FILTER
FP FILTER PRESS
H HOSE
HT HEATER
HV HAND VALVE
I SOFTENER, DEMINERALIZER
IQ INJECTION QUILL
JB JUNCTION BOX
M MOTOR
P PUMP
PD PULSATION DAMPENER
R CLARIFIER, THICKENER, SEPARATOR
RO REVERSE OSMOSIS UNIT
SB SPECTACLE BLIND
SK SKID
SM STATIC MIXER
SR STRAINER
ST STEAM TRAP
T TOWER
TK TANK
V VESSEL
XV AUTOMATIC VALVE
YV AUTOMATIC PILOT VALVE


EQUIPMENT LEGENDS

TK-101
TANK
SIZE: X'-X"ID x X'-X"H
TOTAL CAP: XXX GALLON
ORP CAP: XXX GALLON
MATERIAL:
NOTES:

P-101
PUMP
CAPACITY: XX GPM @ XX' TDH
DRIVER: XX HP / XX RPM
SP GR =
MATERIAL:
NOTES:

A-101
AGITATOR
IMPELLER: XX"DIA / XX RPM
DRIVER: XX HP / XX RPM
MATERIAL:
NOTES:

-101
EQUIPMENT
SIZE:
CAPACITY:
MATERIAL:
NOTES:

5	TEMP PROBE, AE 601 & 602 SWAP AND J-BOX ADD	2024-07-30	N.VLACIC	K.KALUNG	N.VLACIC	128095	COMPANY CONFIDENTIAL INFORMATION THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.	DWN BY:	DATE	TITLE		
4	RECIRCULATION LINE CHANGE	2024-02-13	N.VLACIC	K.KALUNG	N.VLACIC	127120		N.VLACIC	2024-12-05	PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT		
3	UPDATE FLOW RATES FOR RO	2024-01-15	J.FOURNI	K.KISITU	P.RYAN	126931		CKD BY:	DATE	CLIENT		
2	RETURN LOOP CHANGE	2023-12-15	J.FOURNI	K.KISITU	P.RYAN	126786		K.KALUNG	2024-12-05	ELECTRIC HYDROGEN MIDLAND, TX		
7	CORRECTIONS PER CUSTOMER REDLINES AND SAMPLE PORT/INSTRUMENT SHUT OFF VALVE CORRECTIONS.	2025-02-05	N.VLACIC	K.KISITU	N.VLACIC	129209		APPD BY:	DATE	 EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600		
6	PROJECT LOCATION CHANGE, CDI, SPARE LOOP PUMP, & CHEM PUMPS ADDED, MMF & CONTAINER ADDED.	2024-12-05	N.VLACIC	K.KALUNG	N.VLACIC	128890		N.VLACIC	2024-12-05			
REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN	PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
							N/A	2034/001845	D-DOS02	V112053190	1 OF 12	7


TANKS




- FLAT BOTTOM WITHOUT TOP




- FLAT BOTTOM W/ ROUNDED TOP



- CONE BOTTOM W/ FLAT TOP



- CONE BOTTOM W/ REMOVEABLE COVER



- HORIZONTAL VESSEL



- VERTICAL VESSEL



- TOTE



- DRUM



- BAFFLE



- HEATER



- INSULATION




- MANWAY



- SIGHT GLASS




- SPRAY BALL



- WATERLINE


MISCELLANEOUS EQUIPMENT



- AIR COMPRESSOR



- AIR COMPRESSOR GENERIC




- AIR DRYER



- AIR DYER GENERIC




- BAG FEEDER




- BELT PRESS



- BELT SKIMMER




- BIO GAS HOLDER




- CENTRIFUGE




- CHLINATOR/EVAPORATOR



- CLARIFIER



- FLOCCULATING CLARIFIER



- SOLIDS CONTACT CLARIFIER



- BELT CONVEYOR



- SCREW CONVEYOR



- COOLING TOWER




- CYCLONE




- DECARBONATOR



- EMERGENCY EYE WASH & SHOWER




- AUTO SELF CLEANING FILTER



- BIO FILTER



- CARTRIDGE FILTER




- CONTINOUS BACKWASH GRAVITY FILTER




- MULTI FILTER




- FILTER PRESS



- FILTER PRESS DETAIL



- PRESSURE FILTER




- ROTARY VACUUM FILTER




- FLARE




- HEAT EXCHANGER



- PLATE & FRAME HEAT EXCHANGER



- INCLINED PLATE SEPERATOR



- MAG DRUM



- RO VESSEL




- SAMPLER




- SHEAR MILL




- SHEAR MILL INLINE




- SPLITTER BOX



- THICKENER



- UV UNIT

								COMPANY CONFIDENTIAL INFORMATION THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.		DWN BY:	DATE	TITLE
										N.VLACIC	2024-12-05	PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
										CKD BY:	DATE	CLIENT ELECTRIC HYDROGEN MIDLAND, TX
										K.KALUNG	2024-12-05	
										APPD BY:	DATE	
										N.VLACIC	2024-12-05	 EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
SEE SHEET ONE										MGD BY:	SCALE	
										P.RYAN	NTS	
REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN	PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
							N/A	2034/001845	D-DOS02	V112053190	2 OF 12	7

STD:22x34 D v4.1 BAR = 1" AT PLOT SCALE

INSTRUMENT IDENTIFICATION KEY AND ASSOCIATED ABBREVIATIONS

INSTRUMENT TYPE ABBREVIATIONS **

ABS ABSOLUTE PRESSURE
CAP CAPACITANCE
COL COLOR
COND CONDUCTIVITY
COR CORIOLIS
DEN DENSITY
DEW DEW POINT
DP DIFFERENTIAL PRESSURE
FLM FLUME
FLN FLOW NOZZLE
FLT FLOAT
GWR GUIDED WAVE RADAR
HUM HUMIDITY
I/P CURRENT TO PRESSURE
LC LOAD CELL
LSR LASER
MAG MAGNETIC
MOIST MOISTURE
MS MASS SPECTROMETER
OP ORIFICE PLATE
ORP OXIDATION REDUCTION POTENTIAL
P PRESSURE
PADW PADDLEWHEEL
PD POSITIVE DISPLACEMENT
pH HYDROGEN ION
PROX PROXIMITY
PT PILOT TUBE
P-V PRESSURE-VACUUM
RAD RADAR
RES RESISTANCE
ROT ROTAMETER
RTD RESISTANCE TEMP DETECTOR
SG STRAIN GAUGE
SON ULTRASONIC
TC THERMOCOUPLE
THRM THERMISTOR
TOC TOTAL ORGANIC CARBON
TUR TURBINE
TURB TURBIDITY
TW THERMAL WELL
UV ULTRAVIOLET
VAC VACUUM
VIB VIBRONIC
VISC VISCOSITY
VOR VORTEX
WEIR WEIR
WS WEIGH SCALE

* LOCATION ABBREVIATION OF THE USER'S CHOICE SUCH AS IP1 (INSTRUMENT PANEL #1), MCP (MAIN CONTROL PANEL), CC3 (COMPUTER CONSOLE #3), ETC.

** INSTRUMENT TYPE ABBREVIATION FROM THE LIST SUCH AS COND, pH, ORP, TURB, VISC, RTD, TC, MAG, ROT, SON

*** INSTRUMENT ALARMS OR SIGNALS ASSOCIATED WITH THIS DEVICE FROM THE LIST SUCH AS AHH, AH, AL, ALL, STRT, STOP, HOA, RUN, MID, S/S, R/L

**** INSTRUMENT IDENTIFICATION ABBREVIATION FROM THE LIST OR IF NOT ON THE LIST DERIVED FROM THE TABLE BELOW

INSTRUMENT IDENTIFICATION ABBREVIATIONS ****

AE	ANALYTICAL ELEMENT	PCV	PRESSURE REGULATOR
AI	ANALYTICAL INDICATOR	PD	PRESSURE DIFFERENTIAL INDICATOR
AIC	ANALYTICAL INDICATING CONTROLLER	PDIC	PRESSURE DIFFERENTIAL INDICATING CONTROLLER
AIT	ANALYTICAL TRANSMITTER (INDICATING)	PDIT	PRESSURE DIFFERENTIAL TRANSMITTER (INDICATING)
ASH	ANALYTICAL SWITCH (HIGH)	PDSH	PRESSURE DIFFERENTIAL SWITCH (HIGH)
ASL	ANALYTICAL SWITCH (LOW)	PDSL	PRESSURE DIFFERENTIAL SWITCH (LOW)
AT	ANALYTICAL TRANSMITTER (BLIND)	PDT	PRESSURE DIFFERENTIAL TRANSMITTER (BLIND)
BA	BURNER ALARM	PDY	PRESSURE DIFFERENTIAL RELAY
BZ	BURNER ACTUATOR	PI	PRESSURE INDICATOR
EI	VOLTAGE INDICATOR	PIC	PRESSURE INDICATING CONTROLLER
FCV	FLOW REGULATOR	PIT	PRESSURE TRANSMITTER (INDICATING)
FE	FLOW ELEMENT	PO	PRESSURE ORIFICE
FI	FLOW INDICATOR	PSE	RUPTURE DISK (Pressure Safety Element)
FIC	FLOW INDICATING CONTROLLER	PSH	PRESSURE SWITCH (HIGH)
FIT	FLOW TRANSMITTER (INDICATING)	PSL	PRESSURE SWITCH (LOW)
FO	FLOW ORIFICE	PSV	PRESSURE RELIEF VALVE (Pressure Safety Valve)
FQI	FLOW TOTALIZER / INDICATOR	PT	PRESSURE TRANSMITTER (BLIND)
FSH	FLOW SWITCH (HIGH)	PY	PRESSURE RELAY
FSL	FLOW SWITCH (LOW)	SC	SPEED CONTROLLER
FT	FLOW TRANSMITTER (BLIND)	SI	SPEED INDICATOR
FY	FLOW RELAY	SSL	SPEED SWITCH (LOW)
HC	HAND CONTROLLER	TCV	TEMPERATURE CONTROL VALVE
HS	HAND SWITCH	TE	TEMPERATURE ELEMENT
HV	HAND VALVE	TI	TEMPERATURE INDICATOR
IE	CURRENT ELEMENT	TIC	TEMPERATURE INDICATING CONTROLLER
II	CURRENT INDICATOR	TIT	TEMPERATURE TRANSMITTER (INDICATING)
IIT	CURRENT INDICATING TRANSMITTER	TSH	TEMPERATURE SWITCH (HIGH)
ISH	CURRENT SWITCH (HIGH)	TSL	TEMPERATURE SWITCH (LOW)
ISL	CURRENT SWITCH (LOW)	TT	TEMPERATURE TRANSMITTER (BLIND)
JI	POWER INDICATOR	TY	TEMPERATURE RELAY
JIT	POWER INDICATING TRANSMITTER	VSH	VIBRATION SWITCH (HIGH)
JT	POWER TRANSMITTER	WE	WEIGHT OR TORQUE ELEMENT
KQI	TIME TOTALIZER / INDICATOR	WI	WEIGHT OR TORQUE INDICATOR
KY	TIME RELAY	WIT	WEIGHT OR TORQUE TRANSMITTER (INDICATING)
LCV	LEVEL REGULATOR	WSH	WEIGHT OR TORQUE SWITCH (HIGH)
LE	LEVEL ELEMENT	WT	WEIGHT OR TORQUE TRANSMITTER (BLIND)
LG	LEVEL GAUGE	XL	PILOT LIGHT
LI	LEVEL INDICATOR	XV	AUTOMATIC VALVE
LIC	LEVEL INDICATING CONTROLLER	XY	DISCRETE RELAY
LT	LEVEL TRANSMITTER (INDICATING)	YV	AUTOMATIC PILOT VALVE
LSH	LEVEL SWITCH (HIGH)	ZSO	POSITION SWITCH-OPEN
LSL	LEVEL SWITCH (LOW)	ZSC	POSITION SWITCH-CLOSED
LSM	LEVEL SWITCH (MID)	ZT	POSITION FEEDBACK TRANSMITTER
LT	LEVEL TRANSMITTER (BLIND)	Z	INSTRUMENT IN SAFETY INSTRUMENTED SYSTEM
LY	LEVEL RELAY		

ONLY USE THIS TABLE IF INSTRUMENT IDENTIFICATION ABBREVIATION IS NOT IN THE LIST ABOVE

ISA INSTRUMENT IDENTIFICATION TABLE (BASED ON TABLE 4.1 IN ISA-5.1)			
FIRST LETTER		SUCCEEDING LETTERS	
PROCESS VARIABLE	MODIFIER (IF NEEDED)	READOUT OR OUTPUT	MODIFIER (IF NEEDED)
A	ANALYSIS	ALARM	
B	BURNER, COMBUSTION	USER'S CHOICE	USER'S CHOICE
C	USER'S CHOICE	CONTROL	CLOSE
D	USER'S CHOICE		DEVIATION
E	VOLTAGE	SENSOR (PRIMARY ELEMENT)	
F	FLOW RATE	RATIO (FRACTION)	
G	USER'S CHOICE	GLASS, VIEWING DEVICE	
H	HAND		HIGH
I	CURRENT (ELECTRICAL)	INDICATE	
J	POWER	SCAN	
K	TIME, TIME SCHEDULE	TIME RATE OF CHANGE	CONTROL STATION
L	LEVEL	LIGHT	LOW
M	USER'S CHOICE	MOMENTARY	MIDDLE, INTERMEDIATE
N	USER'S CHOICE	USER'S CHOICE	USER'S CHOICE
O	USER'S CHOICE	ORIFICE (RESTRICTION)	OPEN
P	PRESSURE, VACUUM	POINT (TEST CONNECTION)	
Q	QUANTITY	INTEGRATE, TOTALIZE	
R	RADIATION	RECORD	RUN
S	SPEED, FREQUENCY	SAFETY	STOP
T	TEMPERATURE	TRANSMIT	
U	MULTIVARIABLE	MULTIFUNCTION	MULTIFUNCTION
V	VIBRATION, MECH. ANALYSIS	WELL	
W	WEIGHT, FORCE	UNCLASSIFIED	UNCLASSIFIED
X	UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED
Y	EVENT, STATE OR PRESENCE	RELAY, COMPUTE, CONVERT	
Z	POSITION, DIMENSION	SIS (SAFETY INTEGRATED SYSTEM)~ DRIVER, ACTUATOR, UNCLASSIFIED FINAL CONTROL ELEMENT	

~ - "Z" IN THE SECOND POSITION (Z_) FOR DEVICES IN AN SIS (SAFETY INTEGRATED SYSTEM)
Ex. PIT IN AN SIS WOULD BE PZIT.

INSTRUMENT ALARM & SIGNAL ***

AHH ALARM HIGH HIGH
AH ALARM HIGH
AL ALARM LOW
ALL ALARM LOW LOW
ART ALARM RATE
FLT FAULT
HOA HAND/OFF/AUTO
HH HIGH HIGH
H HIGH
L LOW
LL LOW LOW
MID MIDDLE
R/L REMOTE/LOCAL
RT RATE
RUN RUN
S/S SELECTOR SWITCH
STOP STOP
STRT START


GENERAL ABBREVIATIONS

ADD'L ADDITIONAL
A TO C AIR TO CLOSE
A TO O AIR TO OPEN
AVG AVERAGE
BAR(d) BAR - DIFFERENTIAL
BAR(g) BAR - GAUGE
BC BOLT CIRCLE
B/EL BOTTOM ELEVATION
CAL CALIBRATION
CAP CAPACITY
CIP CLEAN IN PLACE
cm CENTIMETERS
CL CENTER LINE
CW CITY WATER (POTABLE)
CONT'D CONTINUED
CFM CUBIC FEET PER MINUTE
REQ DEVICE REQUIRED TO RUN
DIA DIAMETER
DWG DRAWING
EL ELEVATION
FC FAIL CLOSED
FO FAIL OPEN
FT FEET OF WATER
FRL FILTER/REGULATOR/LUBRICATOR
GAL GALLONS
GPD GALLONS PER DAY
GPH GALLONS PER HOUR
GPM GALLONS PER MINUTE
HB HOSE BIB
HG INCHES OF MERCURY
HP HORSEPOWER
ID INSIDE DIAMETER
IA INSTRUMENT AIR
INV INVERT
kPa KILOPASCALS
kW KILOWATTS
L LITERS
LPD LITERS PER DAY
LPH LITERS PER HOUR
LPM LITERS PER MINUTE
LPS LITERS PER SECOND
MH MANHOLE
MW MANWAY
MAT MATERIAL
m METERS
m2 SQUARE METERS
m3 CUBIC METERS


m3/h CUBIC METERS PER HOUR
m3/d CUBIC METERS PER DAY
m3/m CUBIC METERS PER MINUTE
m3/m CUBIC METERS PER MINUTE
um MICROMETERS
mm MILLILITERS
MGD MILLION GALLONS PER DAY
MCC MOTOR CONTROL CENTER
NC NORMALLY CLOSED
ND NOMINAL DIAMETER
NO NORMALLY OPEN
OPR CAP OPERATING CAPACITY
OD OUTSIDE DIAMETER
OAL OVERALL LENGTH
ORP OXIDATION REDUCTION POTENTIAL
PA PLANT AIR
PW PLANT WATER
POS POSITION
PSIG POUNDS PER SQUARE INCH - GAUGE
PCP PROCESS CONTROL PANEL
RED REDUCER
RPM REVOLUTIONS PER MINUTE
SP SAMPLE POINT
SCH SCHEDULE
SW SEAL WATER
SWD SIDE WATER DEPTH
EWT EVOQUA WATER TECHNOLOGIES
SPT SETPOINT
SG SPECIFIC GRAVITY
SSH STRAIGHT SIDE HEIGHT
CNTRL SPEED CONTROL
STD STANDARD
SCFM STANDARD CUBIC FEET PER MINUTE
TP TERMINATION POINT
T/T TIP-TO-TIP
TBA TO BE ASCERTAINED
TDH TOTAL DYNAMIC HEAD(FT OF FLUID)
T/EL TOP ELEVATION
TURB TURBIDITY
TYP TYPICAL
VAC VACUUM
VSD VARIABLE SPEED DRIVE
WC WATER COLUMN
WD WATER DEPTH
WL WATER LEVEL
W/ WITH
W/O WITHOUT
WV WORKING VOLUME (DOES NOT INCLUDE FREEBOARD OR HEEL)

PIPING AND TUBING MATERIAL ABBREVIATIONS

ABS ACRYLONITRILE BUTADIENE STYRENE TRUSS PIPE
ALM ALUMINUM PIPE OR TUBING
ARP ALUMINUM REINFORCED PLASTIC PIPE
BL BLACK IRON PIPE
BPT BRAIDED PLASTIC TUBING-PVC
CS CARBON STEEL PIPE
MI CARBON STEEL PIPE W/MALLEABLE IRON FITTINGS
CI CAST IRON PIPE
CISP CAST IRON SOIL PIPE
CMH CHEMICAL HOSE
CPVC CHLORINATED POLYVINYL CHLORIDE PIPE
CMCP CORRUGATED METAL CULVERT PIPE
CMP CORRUGATED METAL PIPE
COP COPPER PIPE
DI DUCTILE CAST IRON PIPE
ERP EPOXY RESIN PIPE
FRP FIBERGLASS REINFORCED PLASTIC PIPE
HOSE FLEXIBLE HOSE
GS GALVANIZED STEEL PIPE
HSI HIGH SILICON IRON PIPE
NLS NEOPRENE LINED STEEL PIPE
NEO NEOPRENE HOSE
NI NICKEL ALLOY PIPE
KLS PVDF LINED STEEL PIPE (KYNAR LINED TYPICAL)
KYN PVDF (KYNAR)
PRP PHENOLIC RESIN PIPE
PEP POLYETHYLENE PIPE
PETB POLYETHYLENE TUBING
PLS POLYPROPYLENE LINED STEEL PIPE
POP POLYPROPYLENE PIPE
PVC POLYVINYL CHLORIDE PIPE
PVC HOSE POLYVINYL CHLORIDE HOSE
PVDF POLYVINYLIDENE FLUORIDE PIPE
RCP REINFORCED CONCRETE PIPE
ROCP REINFORCED CONCRETE CULVERT PIPE
RBR RUBBER
SLH SARAN TUBING
SLS SARAN LINED STEEL PIPE
SAR SLUDGE HOSE
SS STAINLESS STEEL PIPE OR TUBING
TEF TEFLON
TLS TEFLON LINED STEEL PIPE
TI TITANIUM ALLOY PIPE
TYB TYGON TUBING-BRAIDED
TYG TYGON TUBING-UNBRAIDED

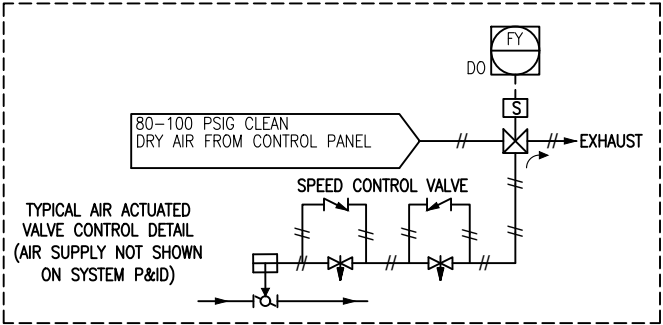


							COMPANY CONFIDENTIAL INFORMATION THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.	DWN BY: N.VLACIC CKD BY: K.KALUNG APPD BY: N.VLACIC MGD BY: P.RYAN	DATE: 2024-12-05 DATE: 2024-12-05 DATE: 2024-12-05 SCALE: NTS	TITLE: PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT CLIENT: ELECTRIC HYDROGEN MIDLAND, TX	PROJ/PROD NUMBER: 2034/001845 CODE: D-DOS02 FILE/DRAWING NUMBER: V112053190 SHEET: 3 OF 12 REV: 7
--	--	--	--	--	--	--	---	---	--	---	---

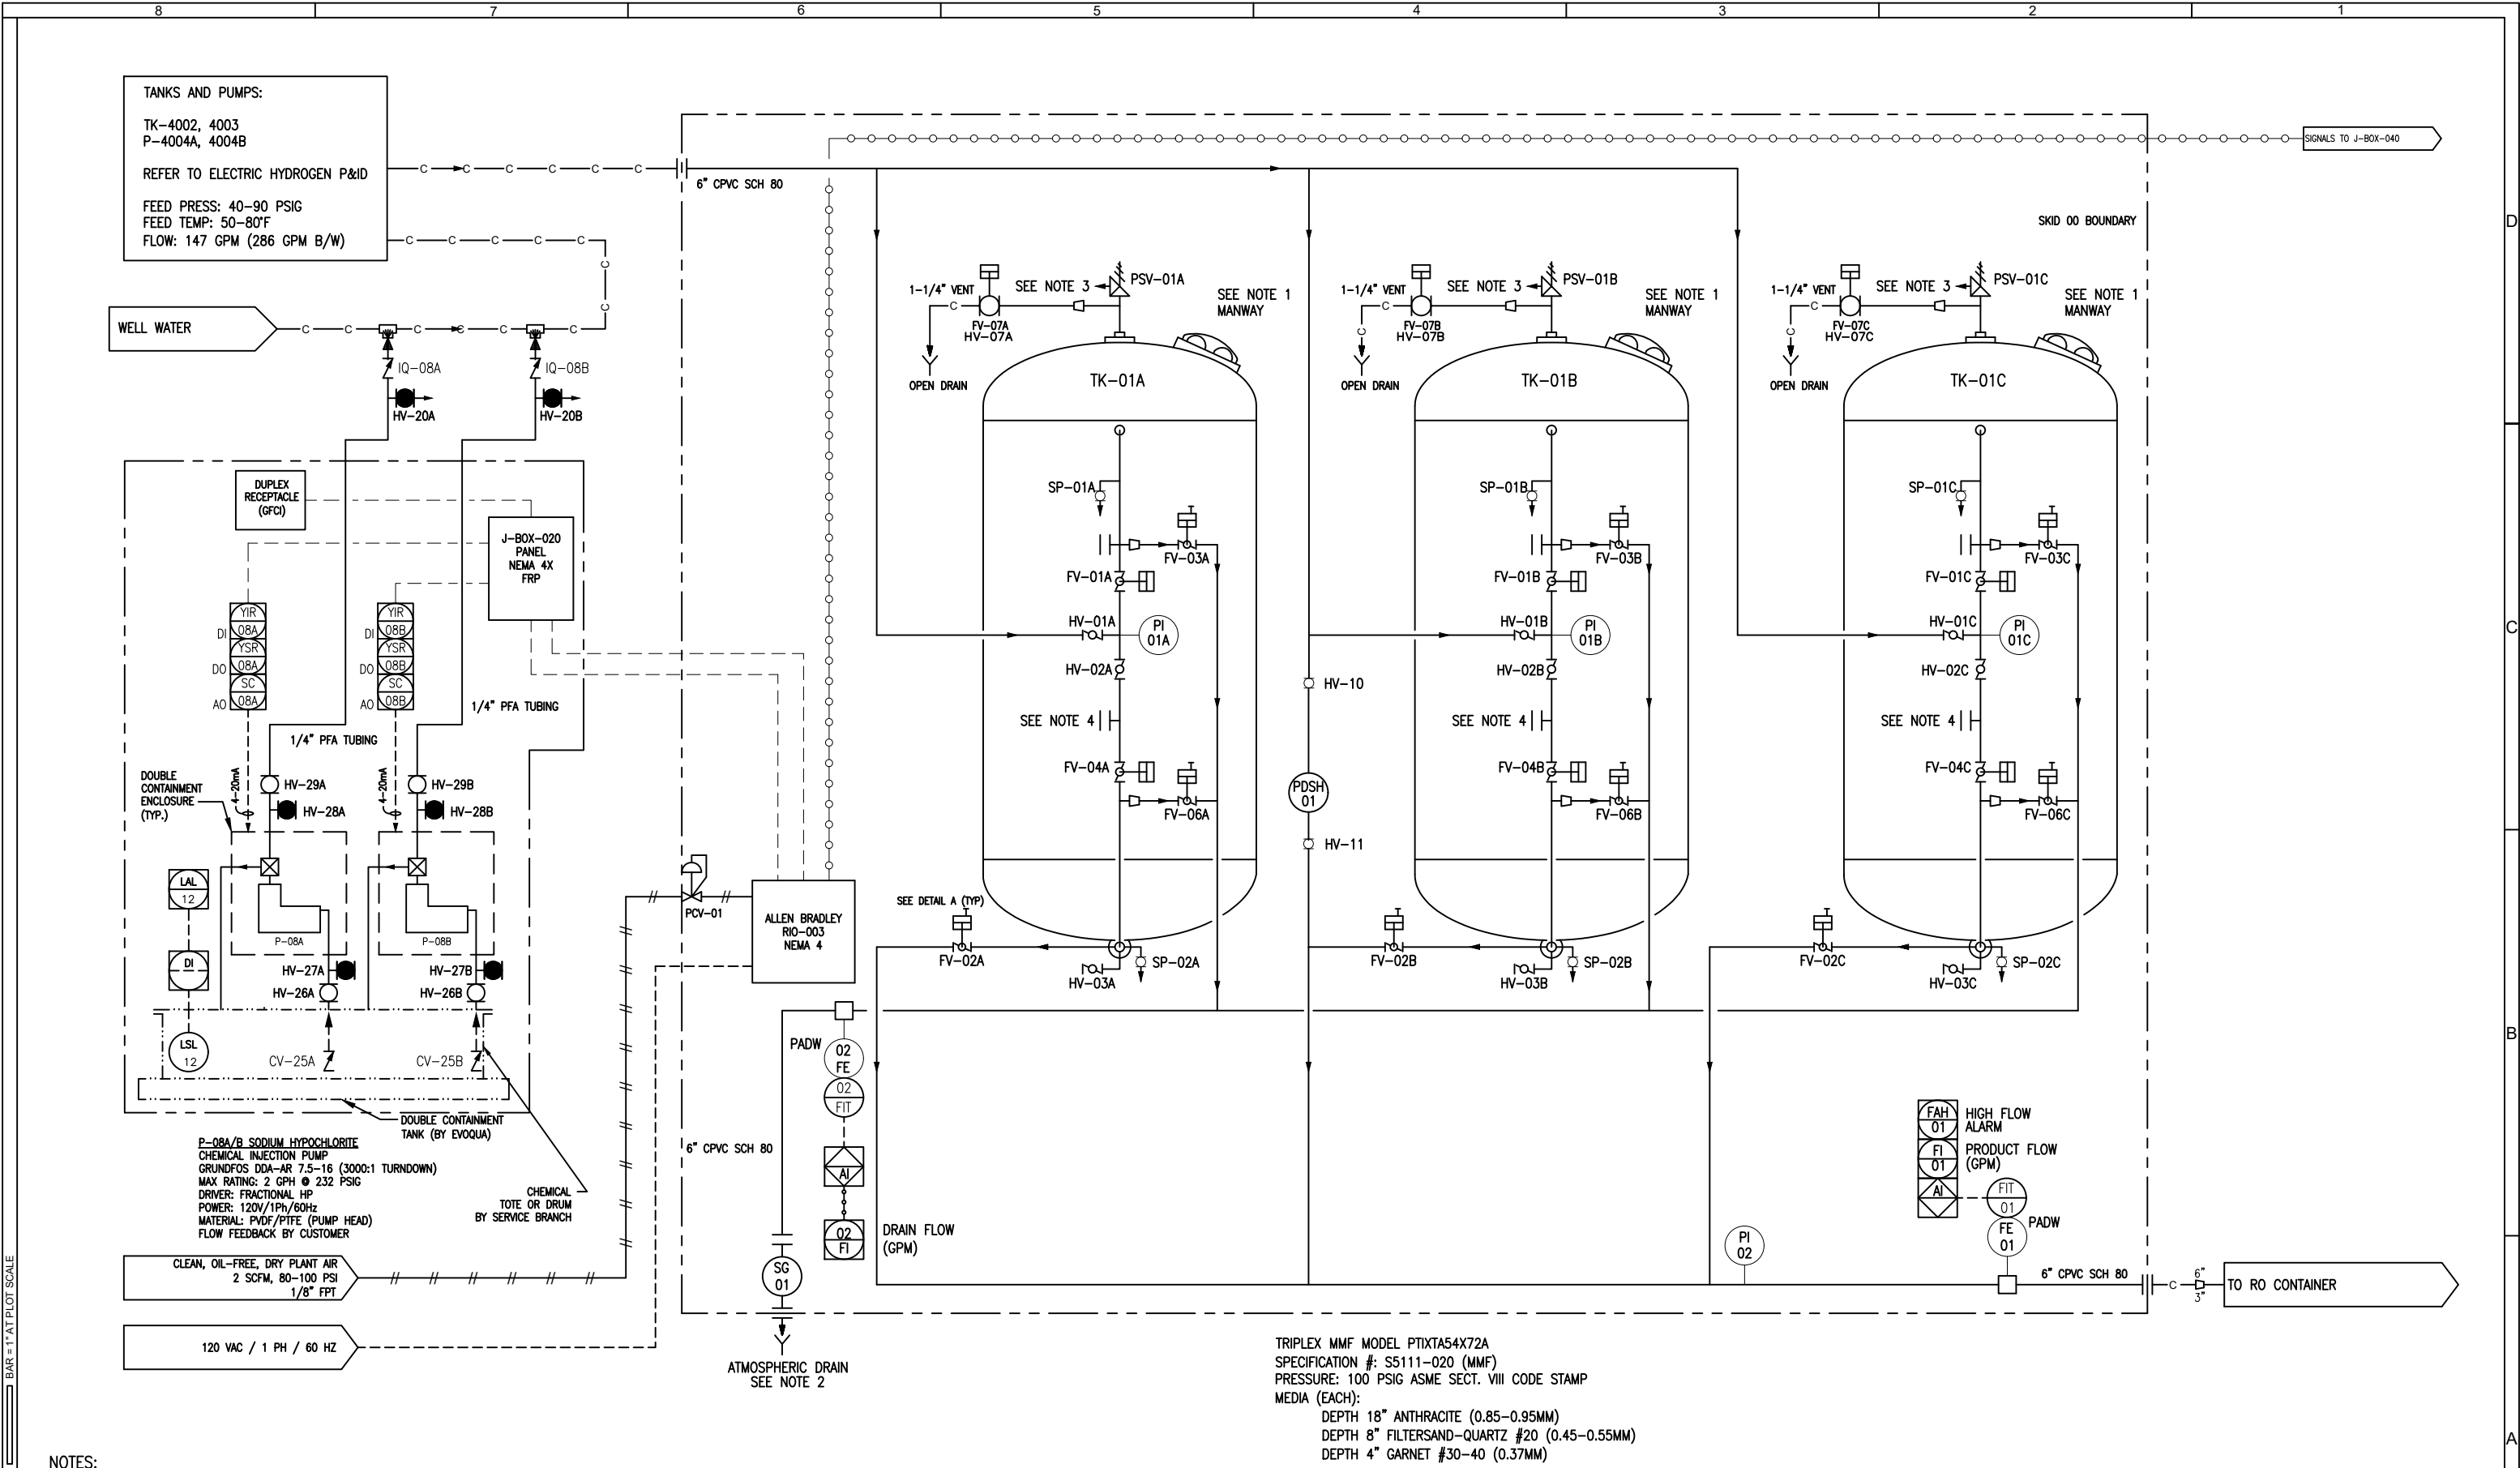

- NOTES:
- ONE 12 X 16 MANWAY PROVIDED.
 - DRAIN LINE NOT TO EXCEED 24" ABOVE DRAIN LINE EXIT. ATMOSPHERIC DRAIN LINE TO BE ONE SIZE LARGER THAN WASTE PIPING.
 - PRESSURE RELIEF VALVE IS SIZED FOR THERMAL RELIEF ONLY.
 - MANUAL OPERATED VALVE ON PLUS PACKAGES.
 - C— CUSTOMER FIELD PIPING.
 - PDSH-01 IS AT 15PSI

TRIPLEX MMF MODEL PTXTA54X72A
SPECIFICATION #: S5111-020 (MMF)
PRESSURE: 100 PSIG ASME SECT. VIII CODE STAMP
MEDIA (EACH):
DEPTH 18" ANTHRACITE (0.85-0.95MM)
DEPTH 8" FILTERSAND-QUARTZ #20 (0.45-0.55MM)
DEPTH 4" GARNET #30-40 (0.37MM)

							COMPANY CONFIDENTIAL INFORMATION THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.										DWN BY: N.VLACIC DATE: 2024-12-05 CKD BY: K.KALUNG DATE: 2024-12-05 APPD BY: N.VLACIC DATE: 2024-12-05 MGD BY: P.RYAN SCALE: NTS		TITLE: PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT CLIENT: ELECTRIC HYDROGEN MIDLAND, TX  EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600							
SEE SHEET ONE							PART NUMBER		2034/001845		CODE		D-DOS02		FILE/DRAWING NUMBER		V112053190		SHEET		4 OF 12		REV		7	
REV	DESCRIPTION						DATE	DWN	CKD	APPD	ECN															

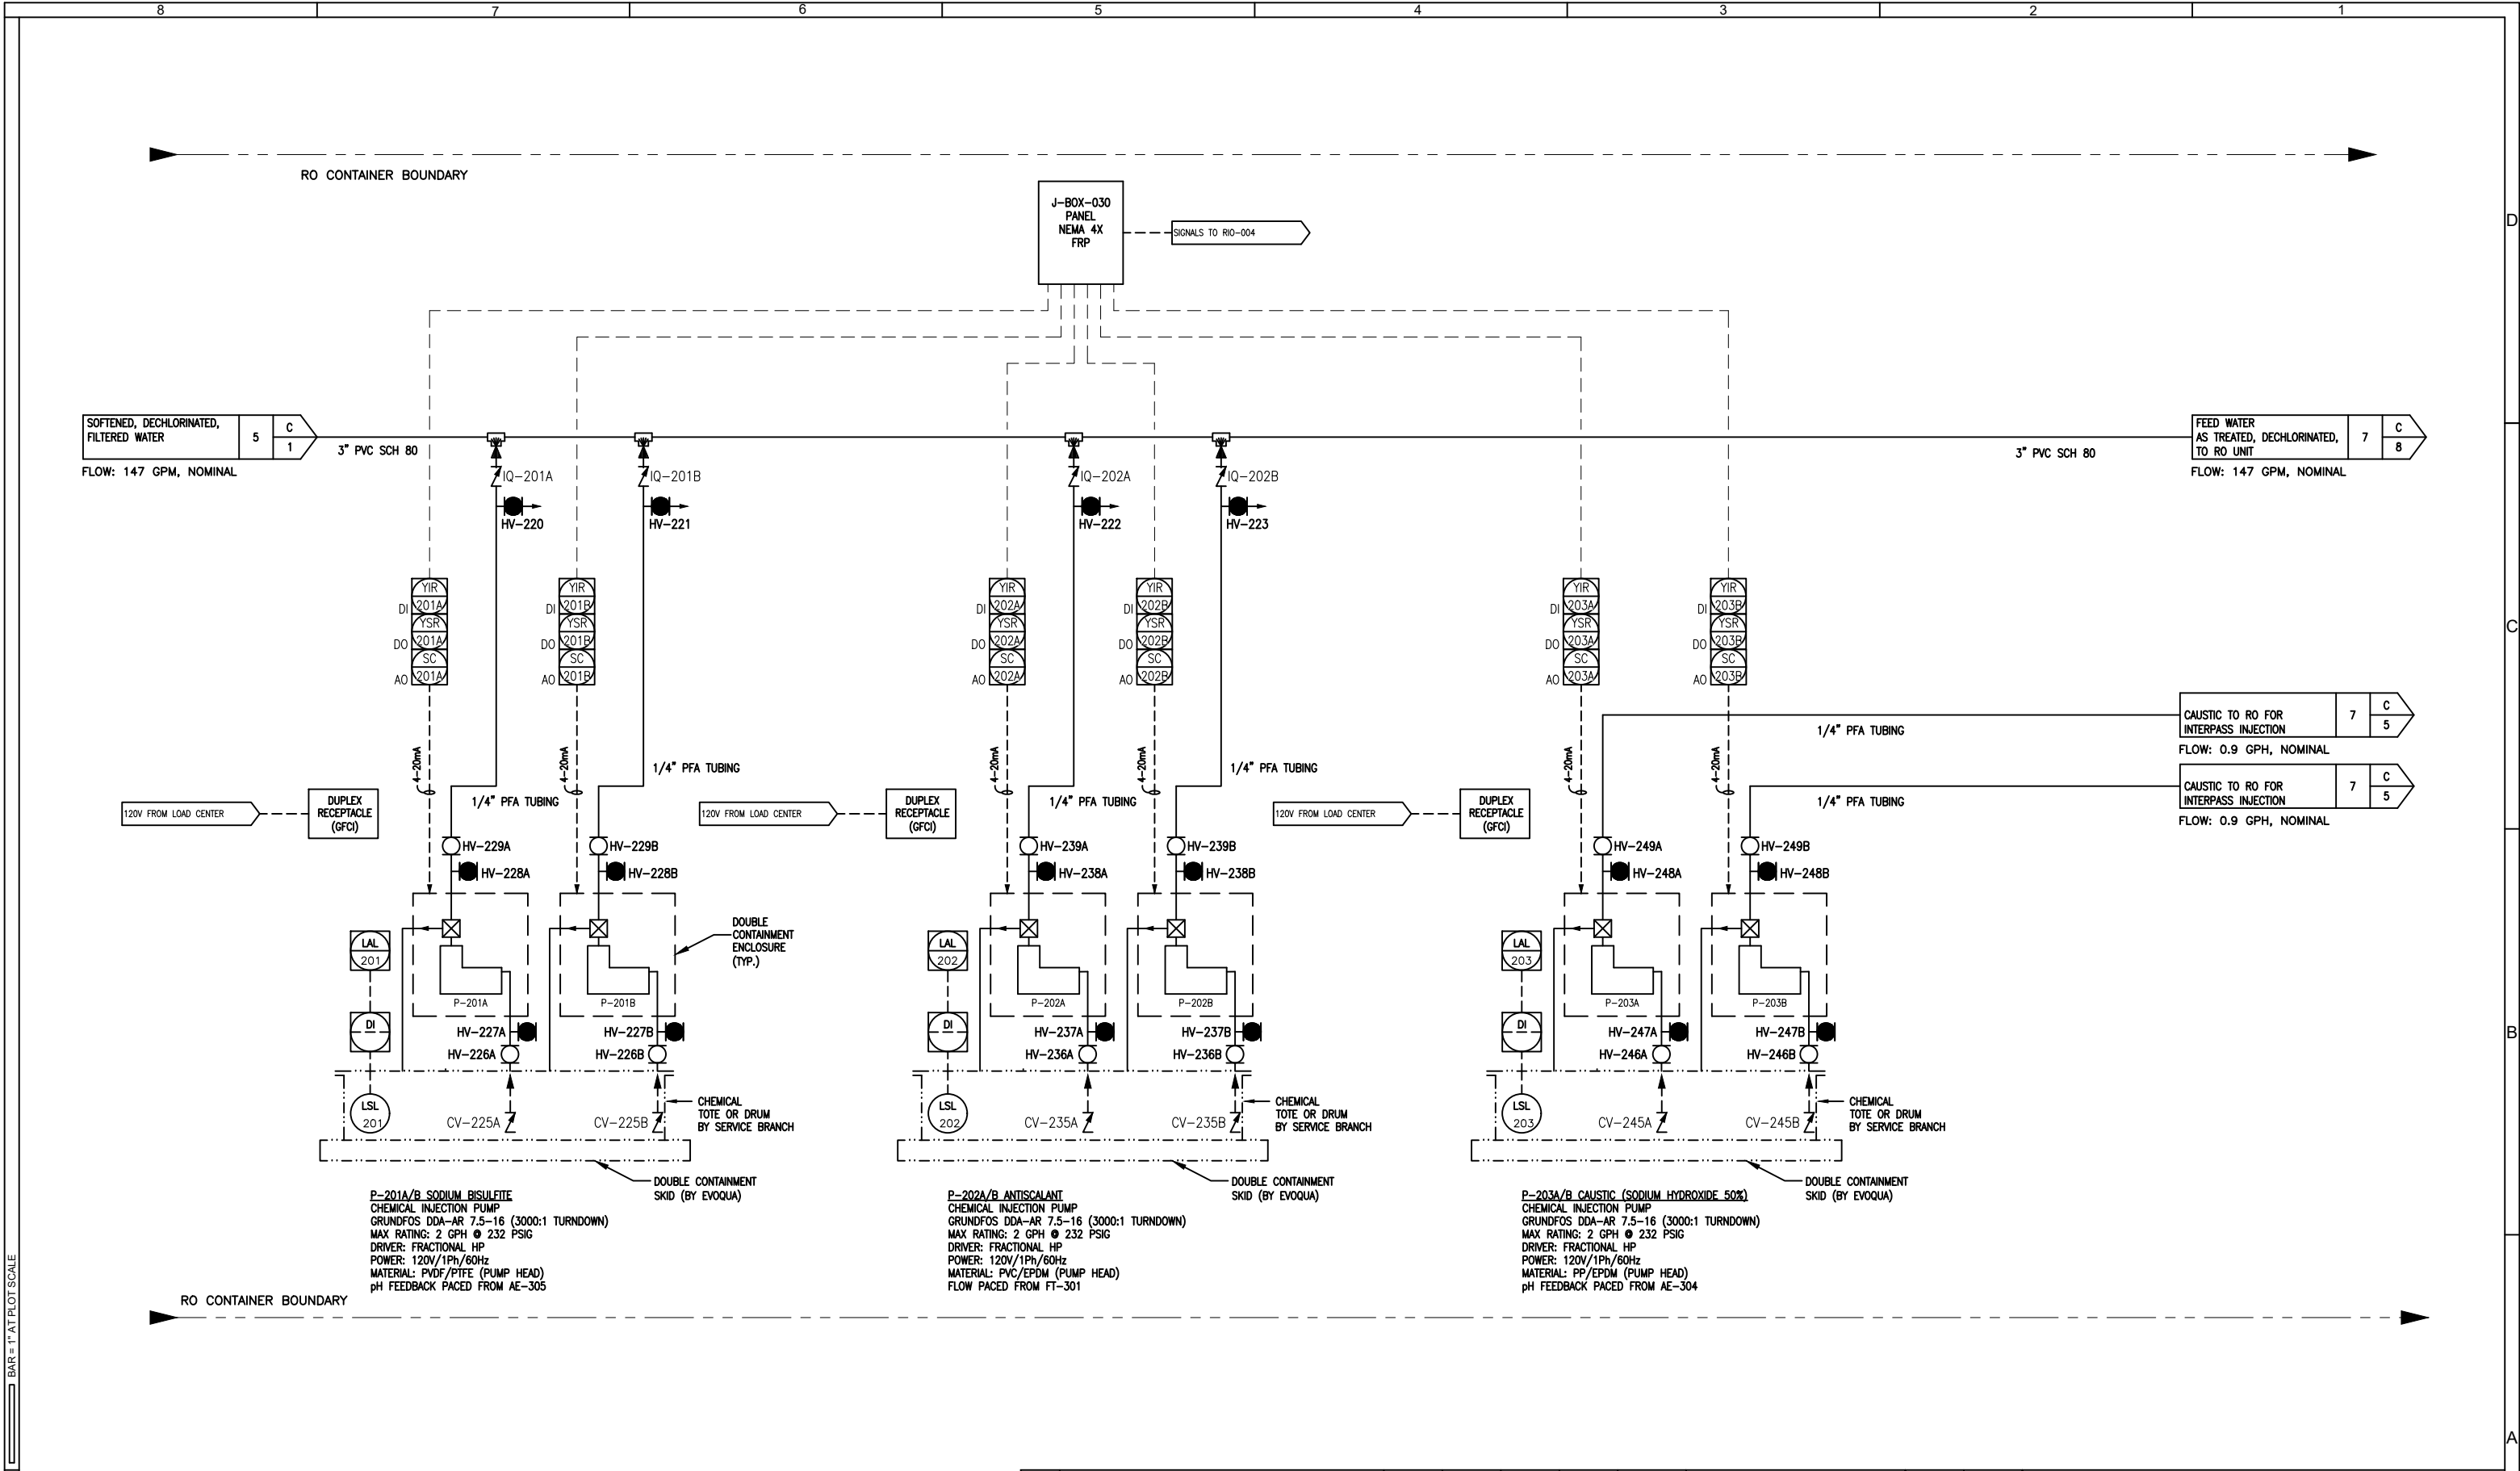

STD-2234-D v4.1 BAR = 1" AT PLOT SCALE


- NOTES, UNLESS OTHERWISE STATED:
1. —C— CUSTOMER FIELD PIPING
2. CHEMICALS PROVIDED BY OTHERS

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN	COMPANY CONFIDENTIAL INFORMATION THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.	DWN BY: N.VLACIC CKD BY: K.KALUNG APPD BY: N.VLACIC MGD BY: P.RYAN	DATE 2024-12-05 2024-12-05 2024-12-05 SCALE NTS	TITLE PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT CLIENT ELECTRIC HYDROGEN MIDLAND, TX	EVOQUA EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600	PART NUMBER N/A	PROJ/PROD NUMBER 2034/001845	CODE D-DOS02	FILE/DRAWING NUMBER V112053190	SHEET 6 OF 12	REV 7
-----	-------------	------	-----	-----	------	-----	---	---	--	---	---	--------------------	---------------------------------	-----------------	-----------------------------------	------------------	----------



1. —C— DENOTES CUSTOMER PIPING
2. TANK IS NON-INSULATED. HEATER OR HEAT TRACE, IF REQUIRED, IS BY OTHERS
3. MAX PRESSURE DROP ACROSS UV IS ~10 PSI

							COMPANY CONFIDENTIAL INFORMATION THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.									
SEE SHEET ONE							DWN BY:	N.VLACIC	DATE:	2024-12-05	TITLE:	PIPING & INSTRUMENTATION DIAGRAM CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT				
							CKD BY:	K.KALUNG	DATE:	2024-12-05	CLIENT:	ELECTRIC HYDROGEN MIDLAND, TX				
							APPD BY:	N.VLACIC	DATE:	2024-12-05	 EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600					
							MGD BY:	P.RYAN	SCALE:	NTS						
REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN	PART NUMBER	PROJ/PROD NUMBER		CODE	FILE/DRAWING NUMBER		SHEET	REV		
							N/A	2034/001845		D-DS02	V112053190		8 OF 12	7		

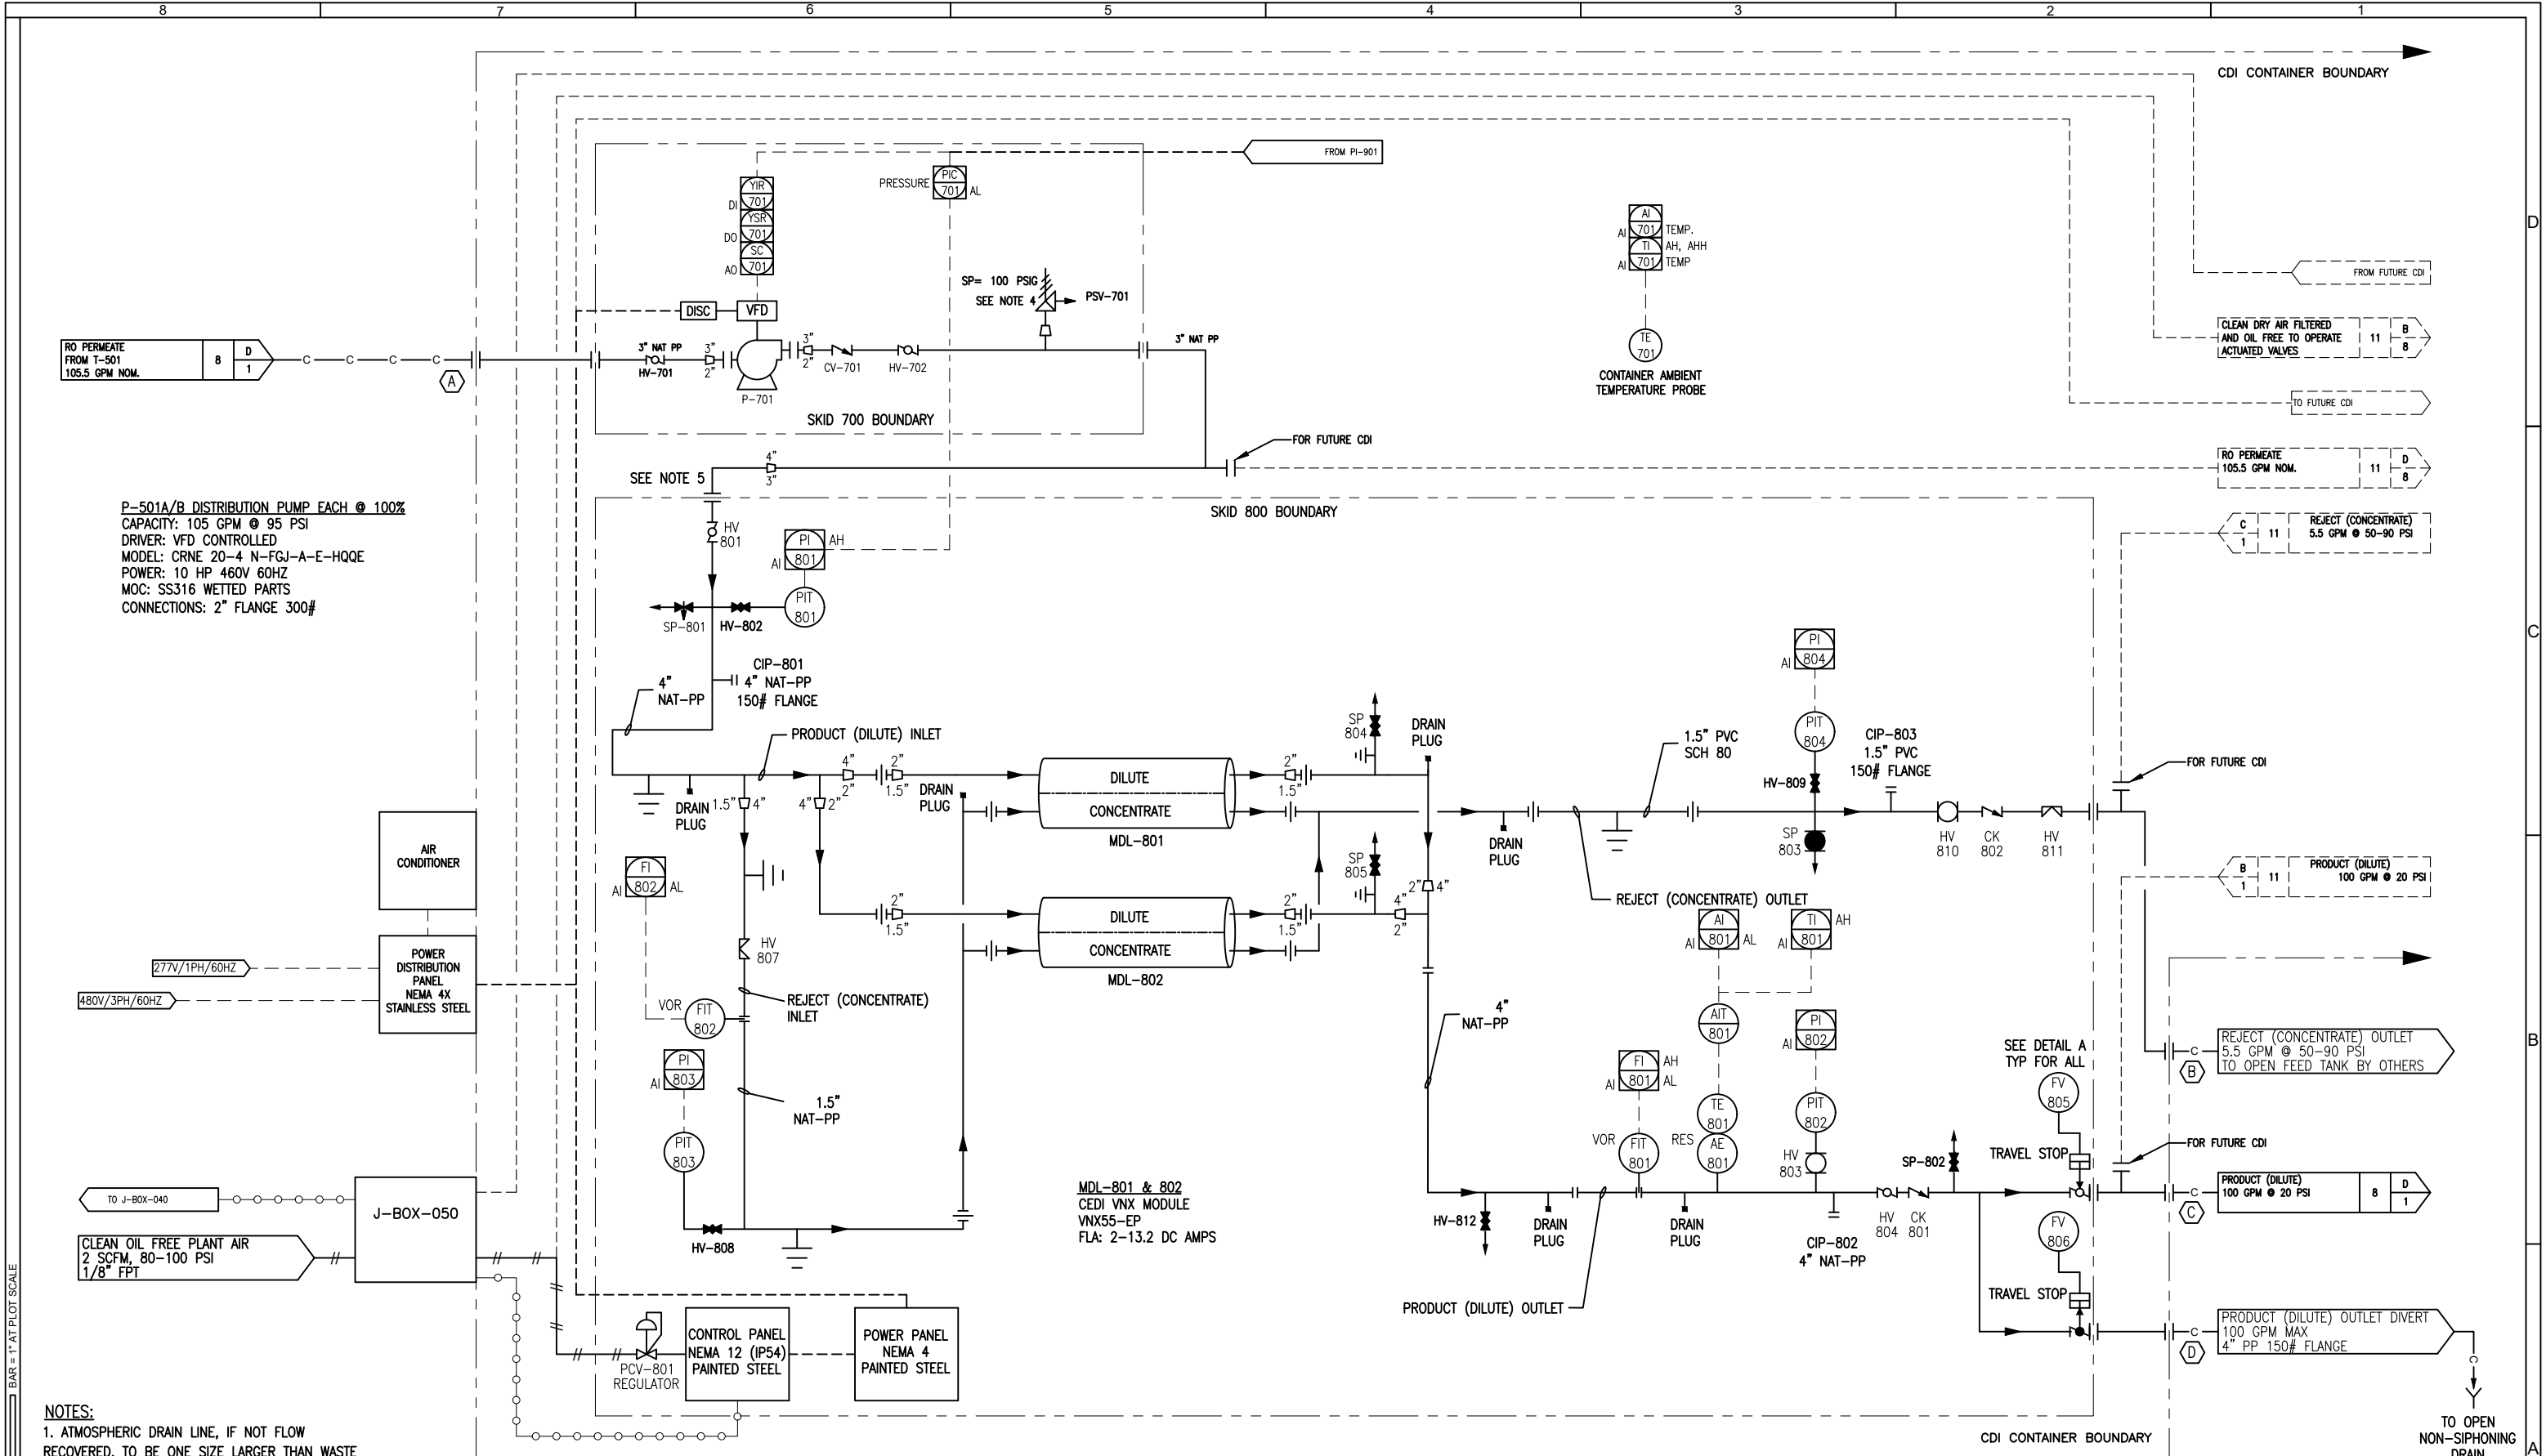

- NOTES:**
1. ATMOSPHERIC DRAIN LINE, IF NOT FLOW RECOVERED, TO BE ONE SIZE LARGER THAN WASTE PIPING.
 2. — c — CUSTOMER FIELD PIPING.
 3. LOW POINT DRAIN IS 1/4" NPT.
 4. BASED ON 95% RECOVERY @ NOMINAL PRODUCT FLOW.
 5. STABLE BACKPRESSURE REQUIRED TO MAINTAIN PROPER FLOW.
 6. PIT-802 MUST READ 3-5 PSI HIGHER THAN PIT-804. SEE O&M FOR MORE DETAILS.

TP	CDI CONTAINER CONNECTION TABLE	SIZE	TYPE
A	RO PRODUCT FROM T-501	3"	FLANGE RF NATURAL PP 150LB
B	REJECT TO OPEN FEED TANK	1.5"	FLANGE RF PVC80 150LB
C	CDI PRODUCT TO P-501A/B	4"	FLANGE RF NATURAL PP 150LB
D	CDI PRODUCT DIVERT TO OPEN DRAIN	4"	FLANGE RF NATURAL PP 150LB
E	CDI PRODUCT DIVERT TO OPEN DRAIN	4"	FLANGE RF NATURAL PP 150LB

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	SEE SHEET ONE					

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: N.VLACIC	DATE: 2024-12-05	TITLE: PIPING & INSTRUMENTATION DIAGRAM
CKD BY: K.KALUNG	DATE: 2024-12-05	CONTAINERIZED 2-PASS RO & CDI WITH PRETREATMENT
APPD BY: N.VLACIC	DATE: 2024-12-05	CLIENT: ELECTRIC HYDROGEN MIDLAND, TX
MGD BY: P.RYAN	SCALE: NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
PART NUMBER: N/A	PROJ/PROD NUMBER: 2034/001845	CODE: D-DOS02
	FILE/DRAWING NUMBER: V112053190	SHEET: 10 OF 12
		REV: 7

