EVOQUA WATER TECHNOLOGIES

ELECTRIC HYDROGEN
BEAUMONT, TX
PROJECT NUMBER: 2034/001845

EVOQUA MUST IDENTIFY HOW TO GET SHIPPED LOOSE LIT-501 WIRING INTO THE CONEX CONTAINER. HIGHLY ENCOURAGE A NEW JUNCTION BE ADDED OVER THE TOP OF THE POWER DISTRIBUTION PANEL (PDP) FOR LIT-501 AND CUSTOMER CONTROLS INTERFACE CONNECTIONS (4PR #16 & TWO ETHERNET CABLES).

M&H	Project No.: 22MH194		
	P.O. No.: 8027	Tag No.:	
1	Approved Without Comments		
2	Approved With Comments; Revise and Resubmit		
3	Revise and Resubmit		
4	For Information Only		
5	Certified as Final Data		

Ron Perego — Project Manager — Date 6/17/24

Bart Rajtar — Project Engineer — Date 6/17/24

EH2 Representative — Date

SHEET	PART NUMBER	FILENAME/DRAWING	DRAWING DESCRIPTION
1	W3T602507	V112057483-01	COVER SHEET
2	W3T602507	V112057483-02	ELECTRICAL SCHEMATIC NOTES
3	W3T602507	V112057483-03	POWER DISTRIBUTION - 480VAC
4	W3T602507	V112057483-04	POWER DISTRIBUTION - 480VAC
5	W3T602507	V112057483-05	POWER DISTRIBUTION - 120VAC
6	W3T602507	V112057483-06	POWER DISTRIBUTION - 120VAC
7	W3T602507	V112057483-07	POWER DISTRIBUTION - 120VAC
8	W3T602507	V112057483-08	PLC COMMUNICATION
9	W3T602507	V112057483-09	PLC I/O - DISCRETE INPUT
10	W3T602507	V112057483-10	PLC I/O - ANALOG INPUT
11	W3T602507	V112057483-11	PLC I/O - ANALOG INPUT
12	W3T602507	V112057483-12	PLC I/O - ANALOG INPUT/DIGITAL INPUT
13	W3T602507	V112057483-13	PLC I/O - FPD/DIGITAL OUTPUT
14	W3T602507	V112057483-14	PLC I/O - ANALOG INPUT/DIGITAL OUTPUT
15	W3T602507	V112057483-15	CONTROL RELAY CONNECTION
16	W3T602507	V112057483-16	INTENTIONALLY LEFT BLANK
17	W3T602507	V112057483-17	ELECTRICAL ENCLOSURE LAYOUT
18	W3T602507	V112057483-18	ELECTRICAL ENCLOSURE CUTOUT
19	W3T602507	V112057483-19	ELECTRICAL SUBPANEL LAYOUT
20	W3T602507	V112057483-20	ELECTRICAL TERMINAL LAYOUT
21	W3T602507	V112057483-21	ELECTRICAL NAME PLATE SCHEDULE

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MOD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE: ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT: ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-01	1 OF 21	1

STD: Electrical v4.3 — BAR = 1" AT PLOT SCALE

ELECTRICAL SCHEMATIC NOTES

NOTES: UNLESS OTHERWISE SPECIFIED

1. ALL INTERNAL PANEL WIRING TO BE #14 AWG EXCEPT CLASS 2 CONTROL CIRCUITS AND PLC I/O TO BE #18 AWG.

2. [· — ·] DENOTES REMOTE PANELS OR COMPONENT(S).

3. ALL FIELD WIRING TO BE COPPER CONDUCTORS SIZED AT MIN 60°C.

4. --s---s-- DENOTES SKID WIRING BY FACTORY.

5. -------- DENOTES FIELD WIRING TO EXTERNAL COMPONENTS (BY OTHERS).

6. WIRE COLORS:

BLK	120/230V AND ABOVE POWER
RED	120/230V CONTROL
WHT	NEUTRAL
BLU	DC POSITIVE
BLU/WHT	DC UNGROUNDED COMMON
WHT/BLU	DC GROUNDED COMMON
ORG	EXTERNALLY POWERED OR UNGROUNDED CONDUCTORS REMAINING ENERGIZED WHEN MAIN SUPPLY CIRCUIT DISCONNECT IS IN OFF POSITION
WHT/ORG	GROUNDED AC CIRCUIT CONDUCTOR REMAINING ENERGIZED WHEN MAIN SUPPLY CIRCUIT DISCONNECT IS IN OFF POSITION
GRN/YEL	GROUNDING

7. ALL SKID WIRING TO BE #14 AWG THHN MINIMUM, EXCEPT FOR MULTI-CONDUCTOR CABLES WITH OVERALL JACKET.

8. SHIELDED SIGNAL CABLE FOR CLASS 1 CONTROL CIRCUITS TO BE 600V BELDEN 1120A OR EQUIVALENT.

9. SHIELDED SIGNAL CABLE FOR CLASS 2 CONTROL CIRCUITS TO BE 300V BELDEN 8760 OR EQUIVALENT.

10. --c---c--DENOTES CONTAINER WIRING BY FACTORY.

STD: Electrical v4.3

BAR = 1" AT PLOT SCALE

0307/0308

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	TITLE	ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300
CKD BY: S.THANGA	DATE 2023-11-28	CLIENT	ELECTRIC HYDROGEN BEAUMONT, TX
APPD BY: K.KISITU	DATE 2023-11-28		
MGD BY: P.RYAN	SCALE NTS		EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-02	2 OF 21	1

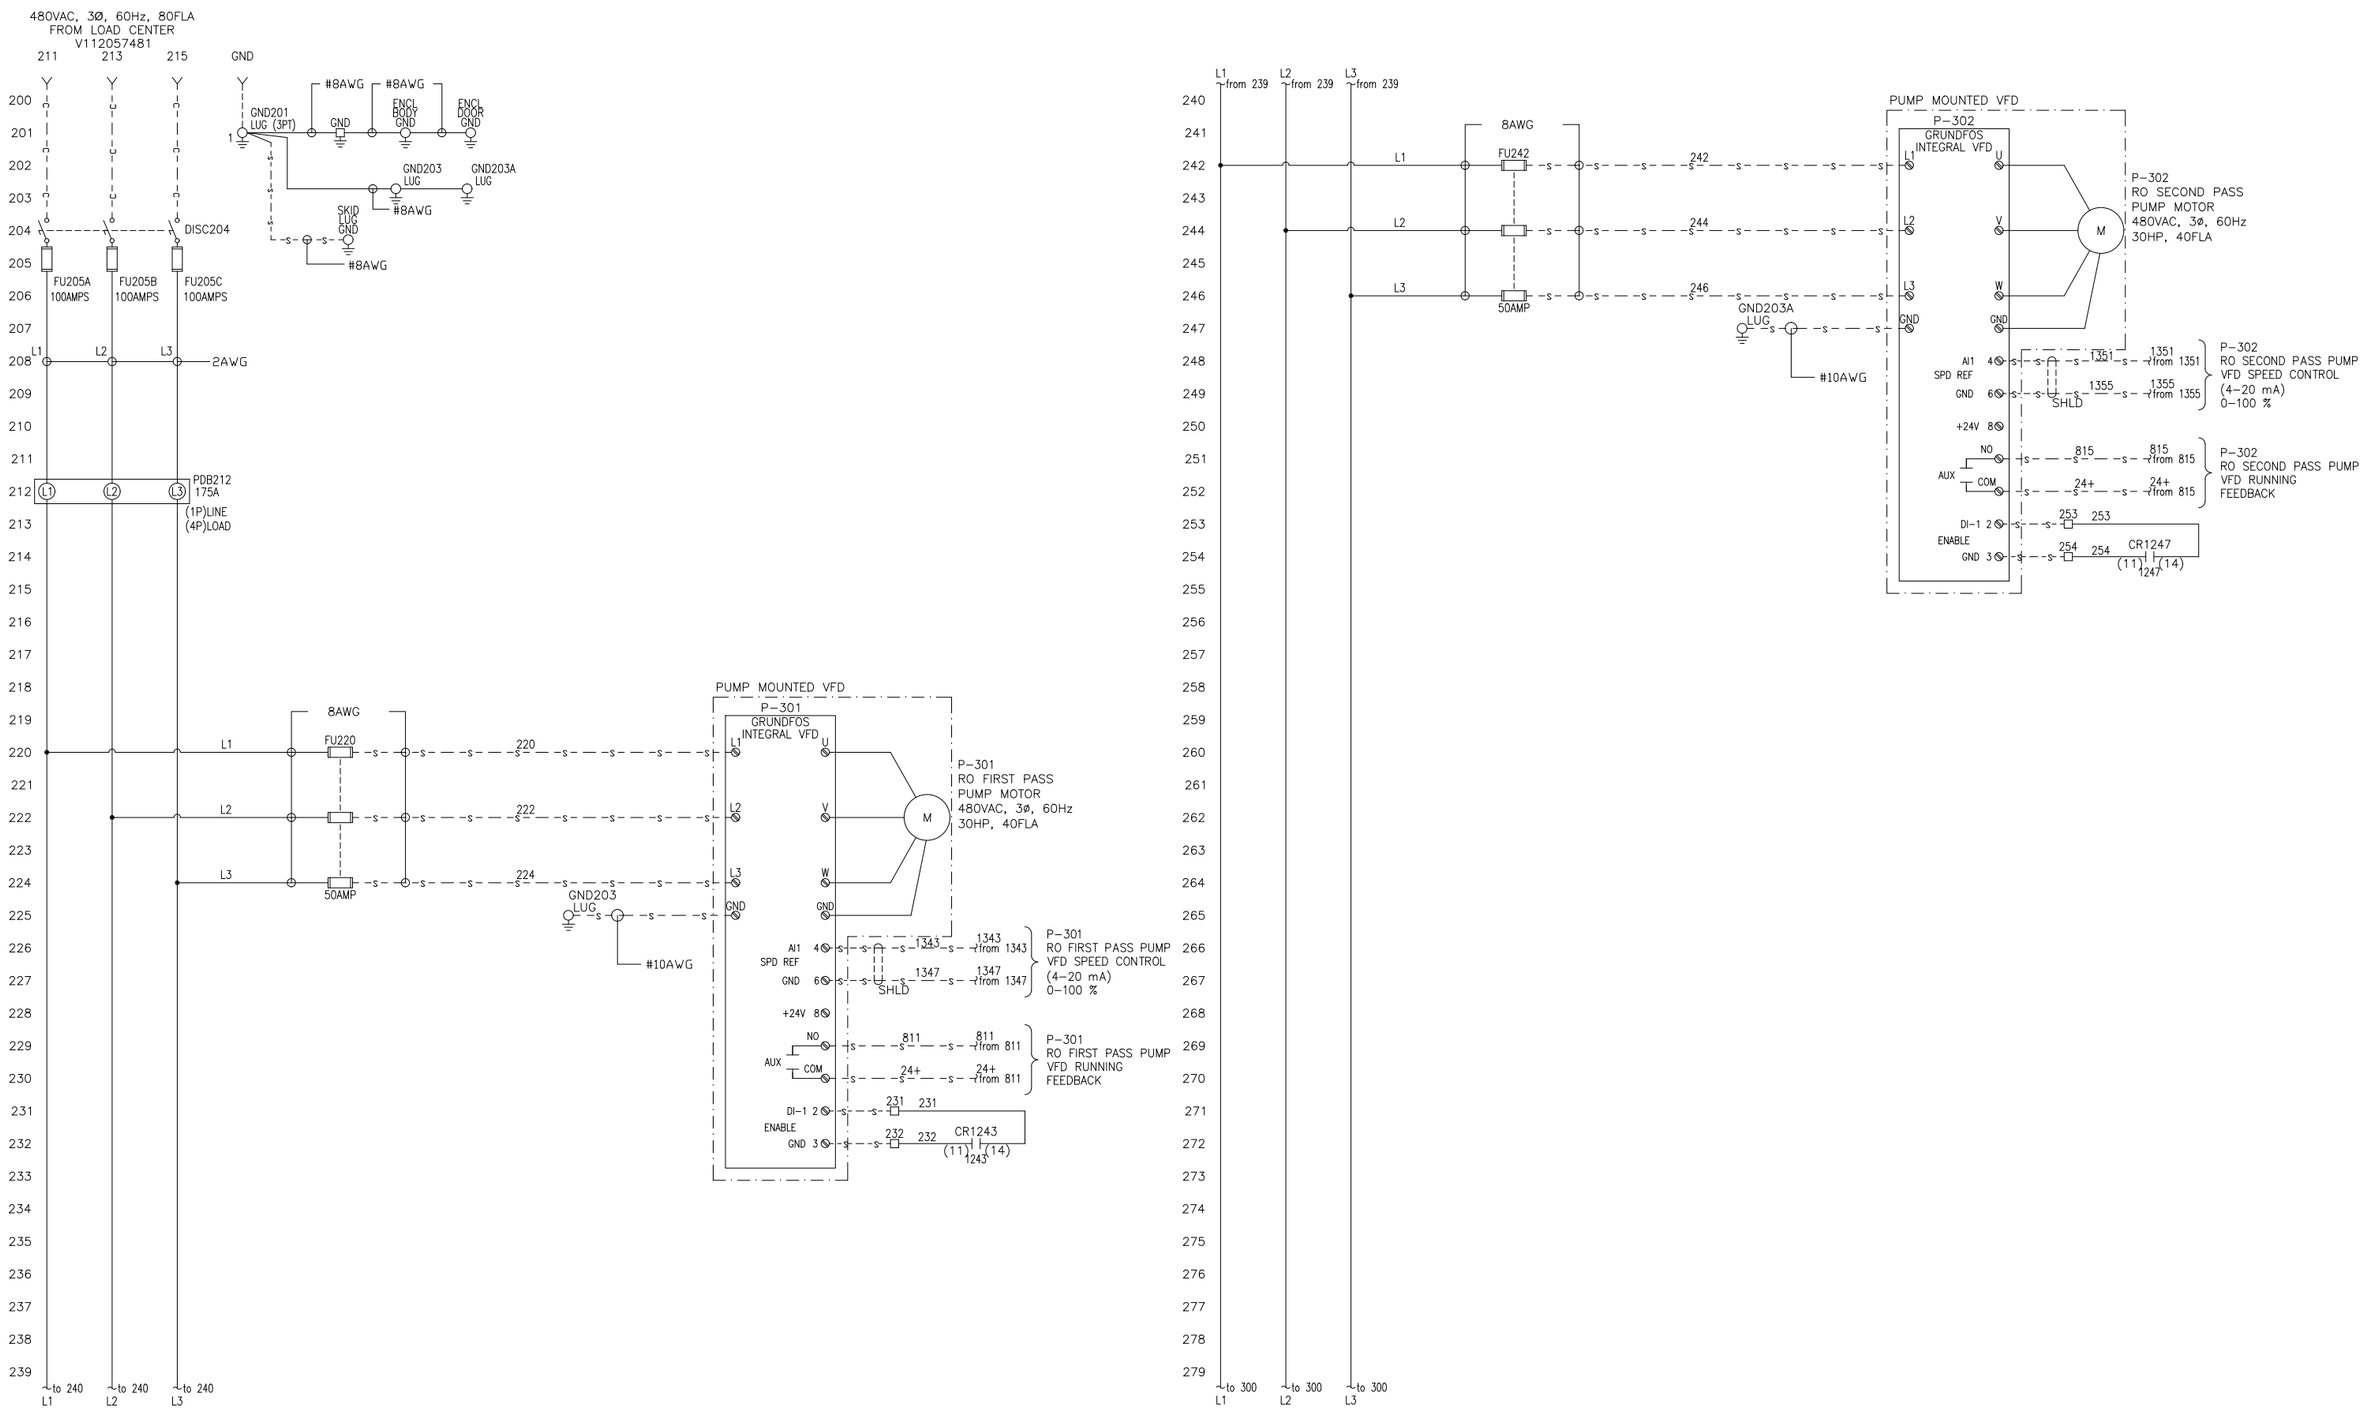

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28
CKD BY: S.THANGA	DATE 2023-11-28
APPD BY: K.KISITU	DATE 2023-11-28
MGD BY: P.RYAN	SCALE NTS

TITLE: ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT: ELECTRIC HYDROGEN
BEAUMONT, TX

evoqua WATER TECHNOLOGIES
EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-03	3 OF 21	1

STD: Electrical v4.3 — BAR = 1" AT PLOT SCALE

L1 from 279 L2 from 279 L3 from 279

INTENTIONALLY LEFT BLANK

L1 to 340 L2 to 340 L3 to 340

L1 from 339 L2 from 339 L3 from 339

INTENTIONALLY LEFT BLANK

BAR = 1" AT PLOT SCALE

STD: Electrical v4.3

0307/0308

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-04	4 OF 21	1

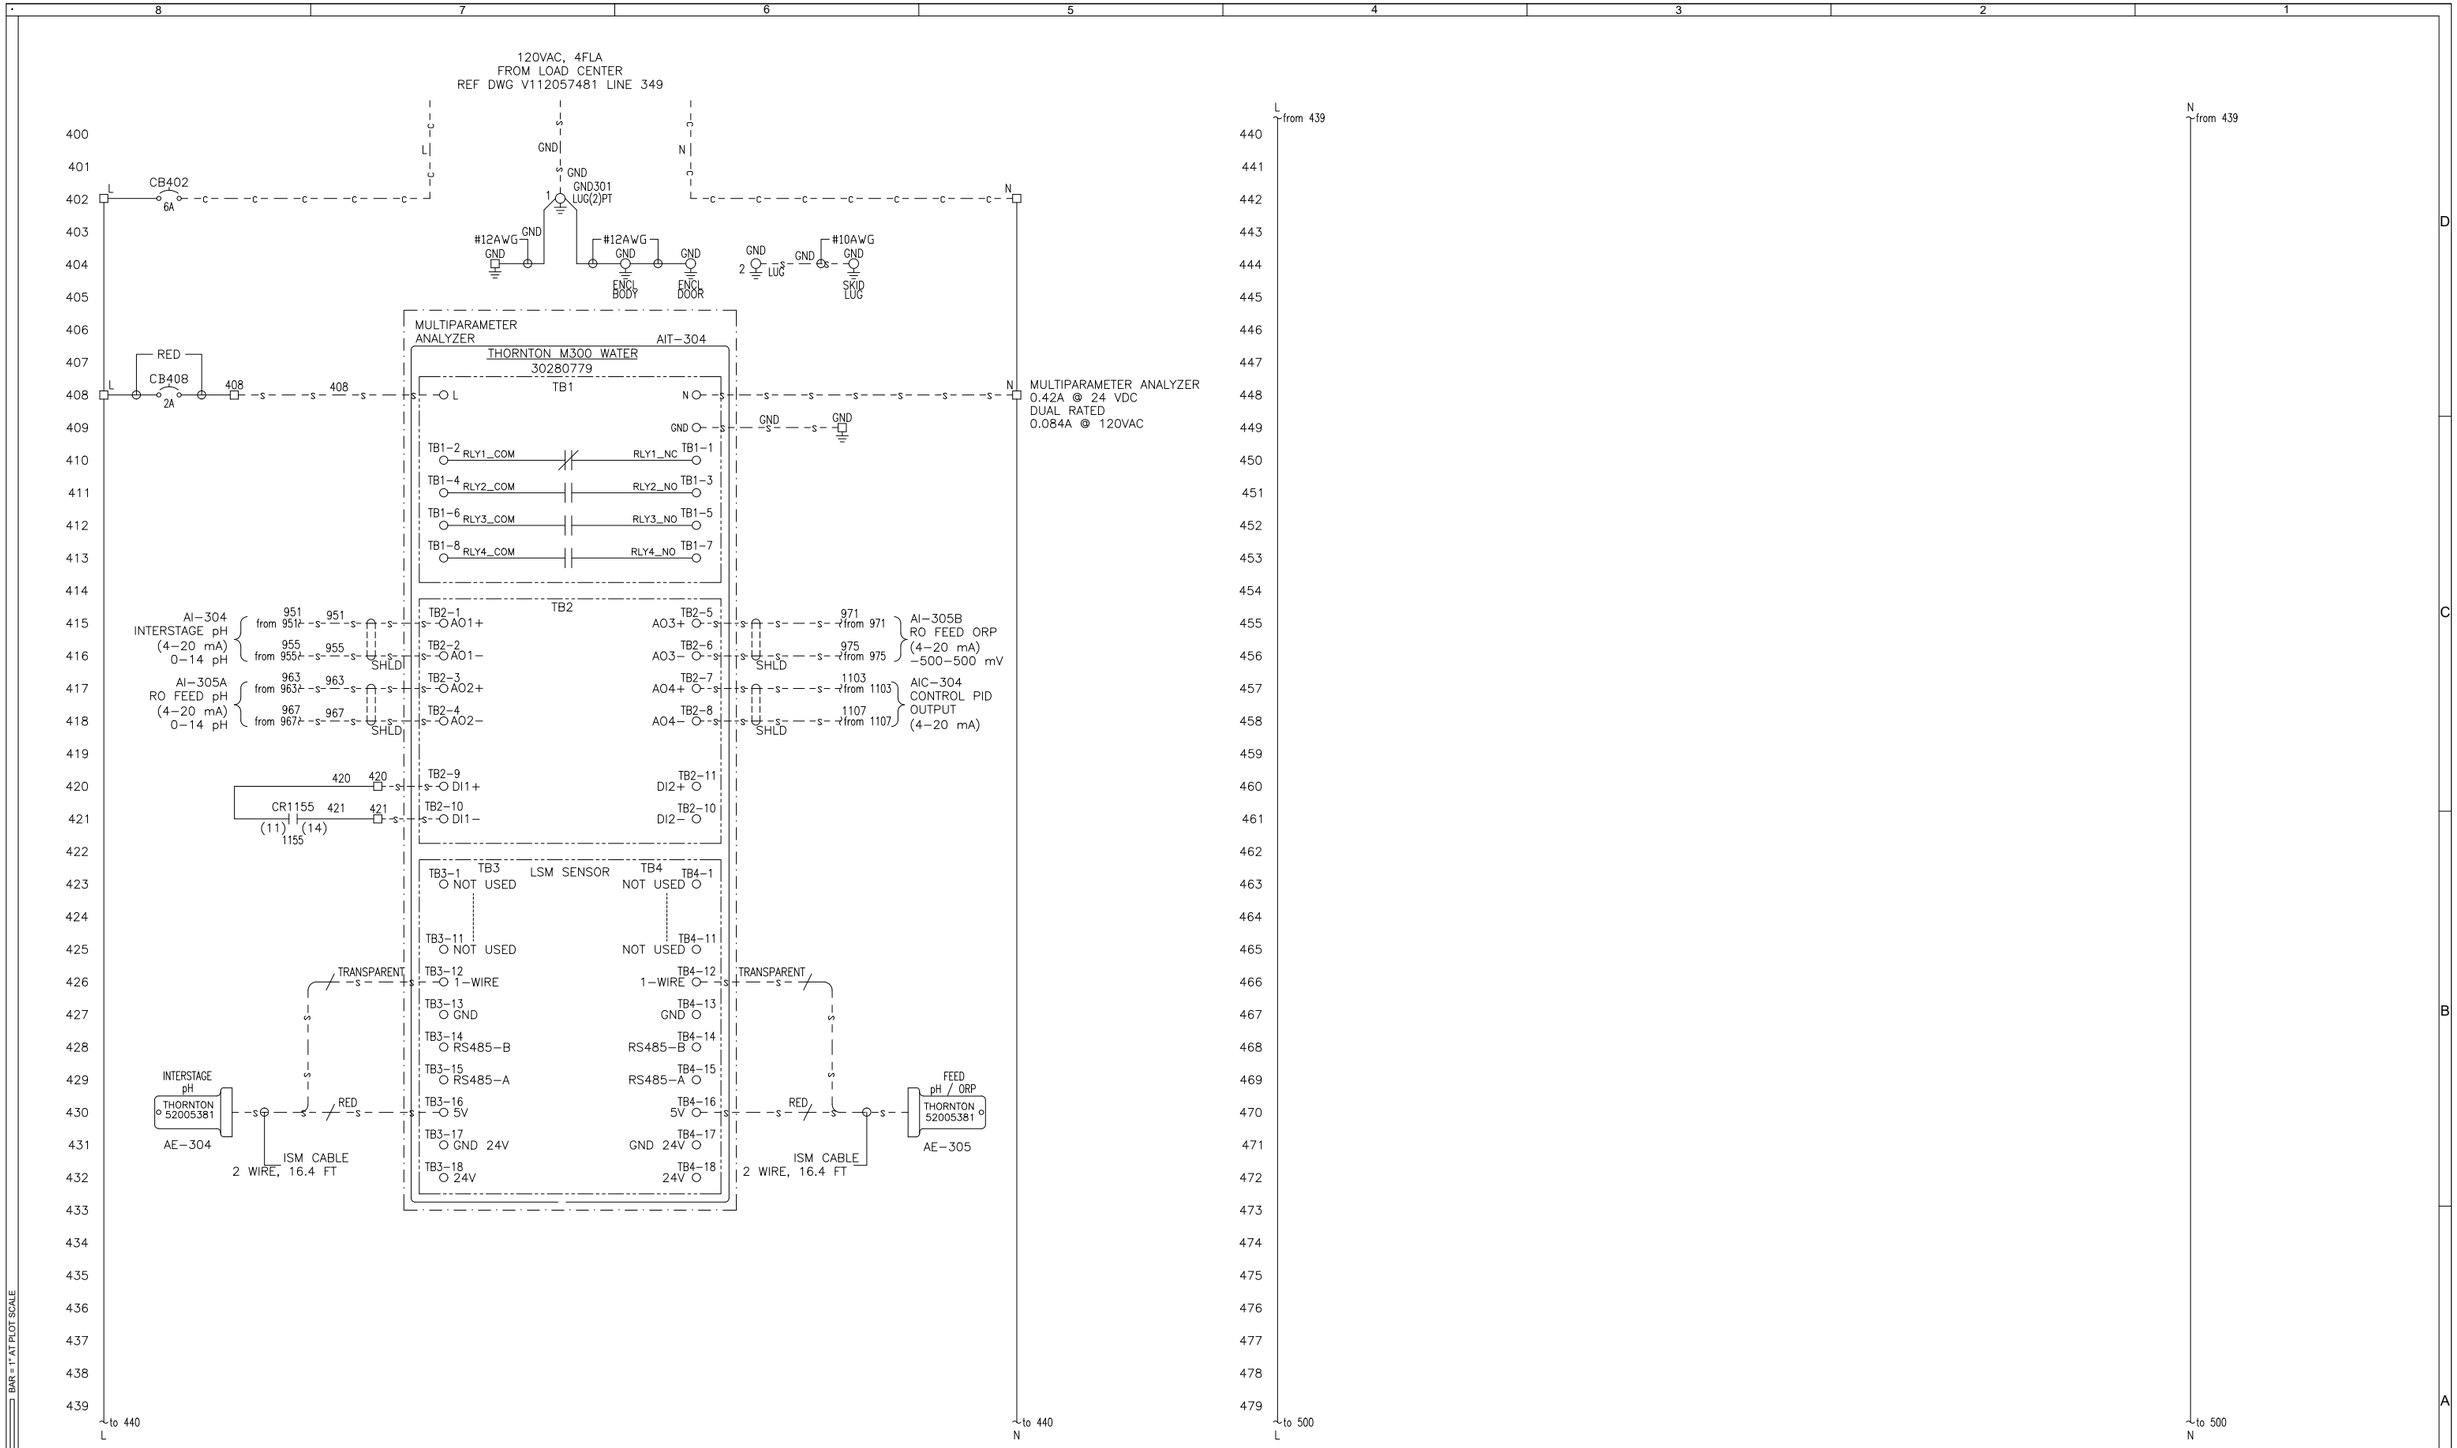

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28
CKD BY: S.THANGA	DATE 2023-11-28
APPD BY: K.KISITU	DATE 2023-11-28
MGD BY: P.RYAN	SCALE NTS

TITLE: ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT: ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-05	5 OF 21	1

STD: Electrical v4.3
BAR = 1" AT PLOT SCALE

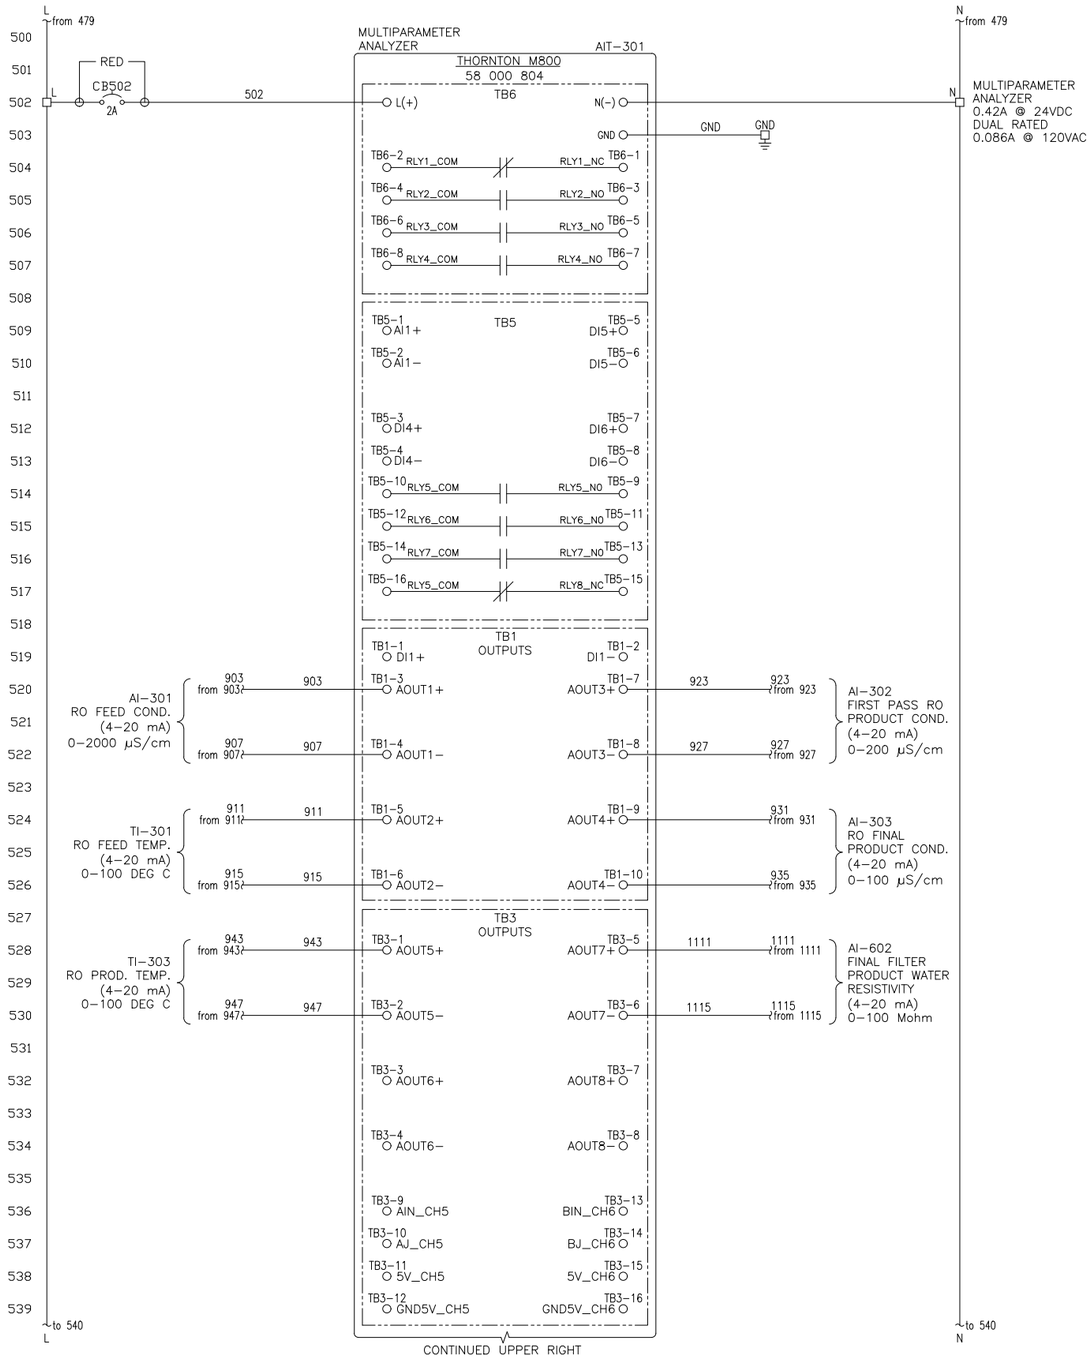

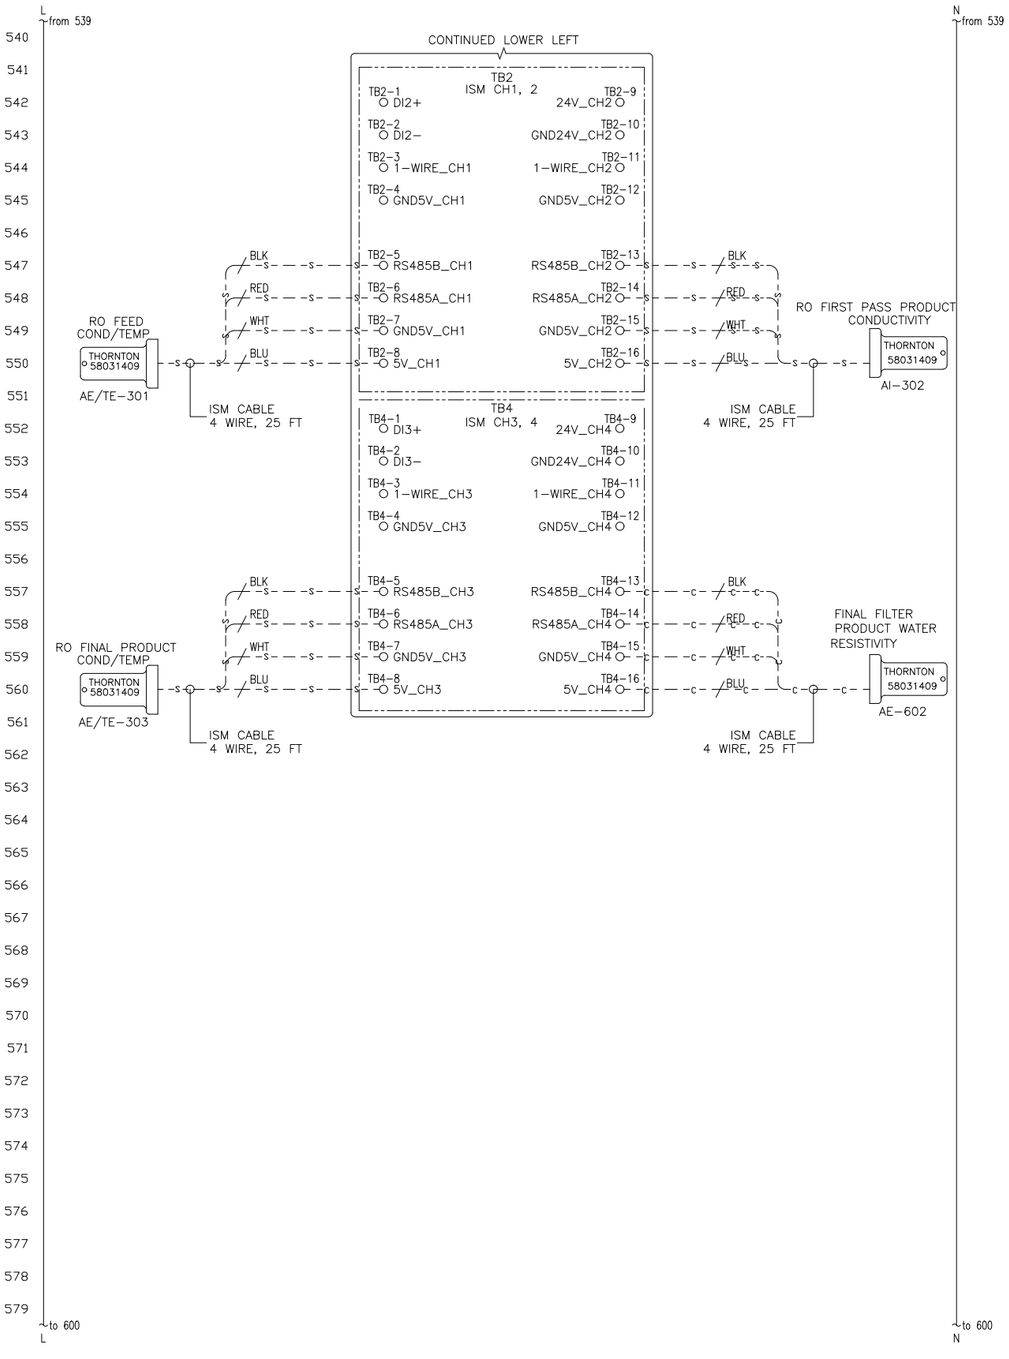

STD: Electrical v4.3

BAR = 1" AT PLOT SCALE

0307/0308

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300
CKD BY: S.THANGA	DATE 2023-11-28	CLIENT ELECTRIC HYDROGEN BEAUMONT, TX
APPD BY: K.KISITU	DATE 2023-11-28	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600
MGD BY: P.RYAN	SCALE NTS	

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-06	6 OF 21	1

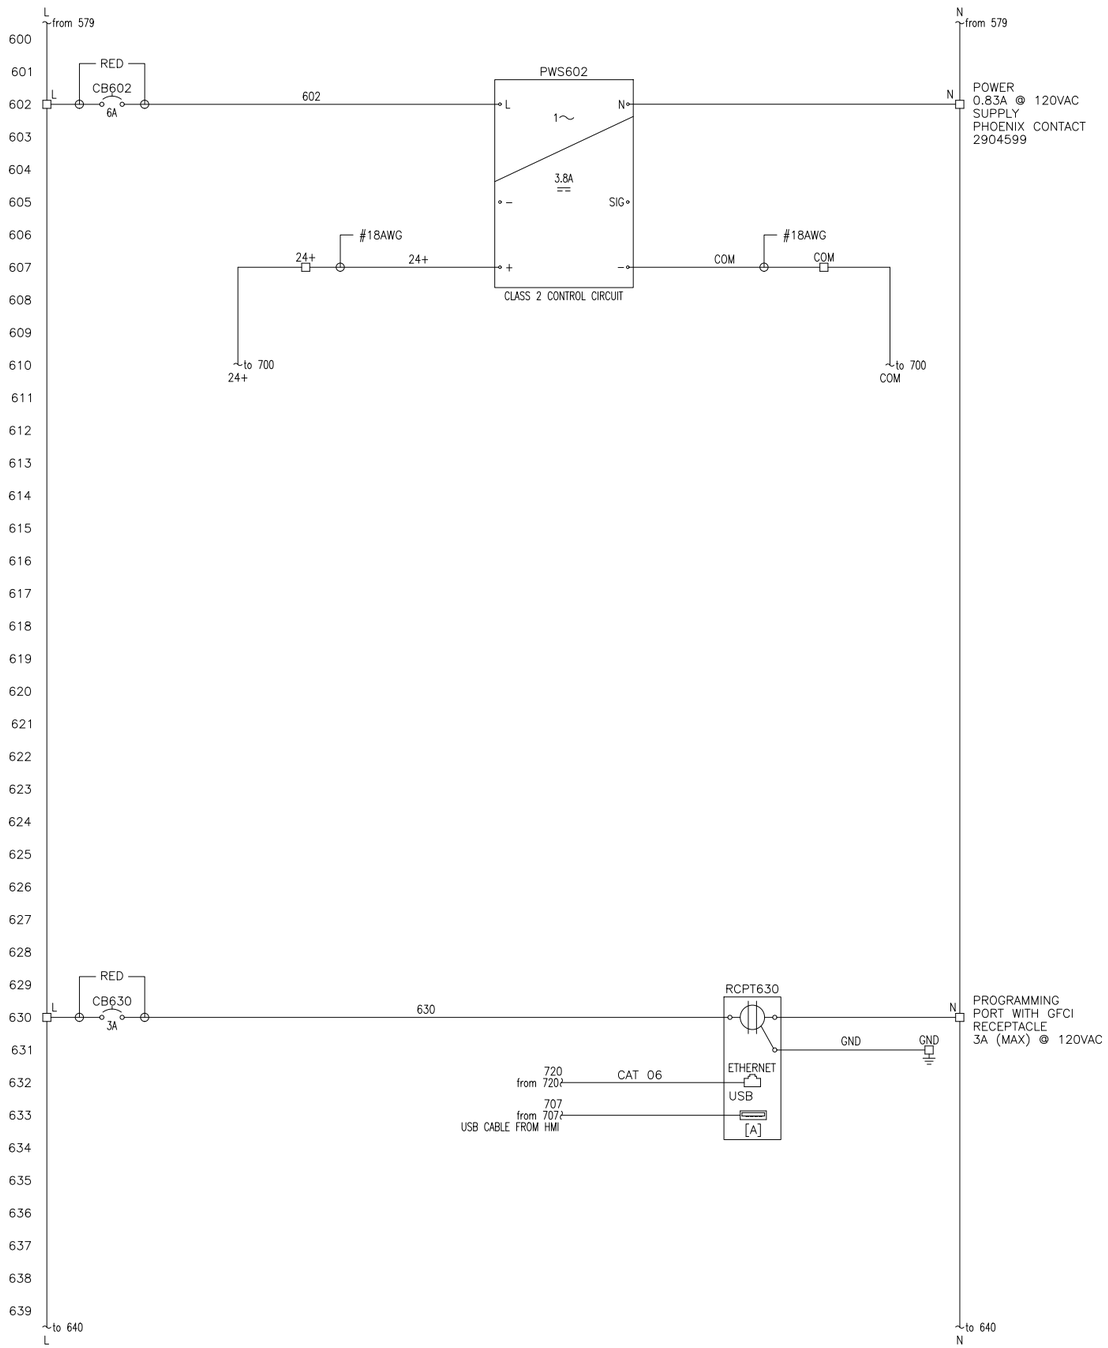

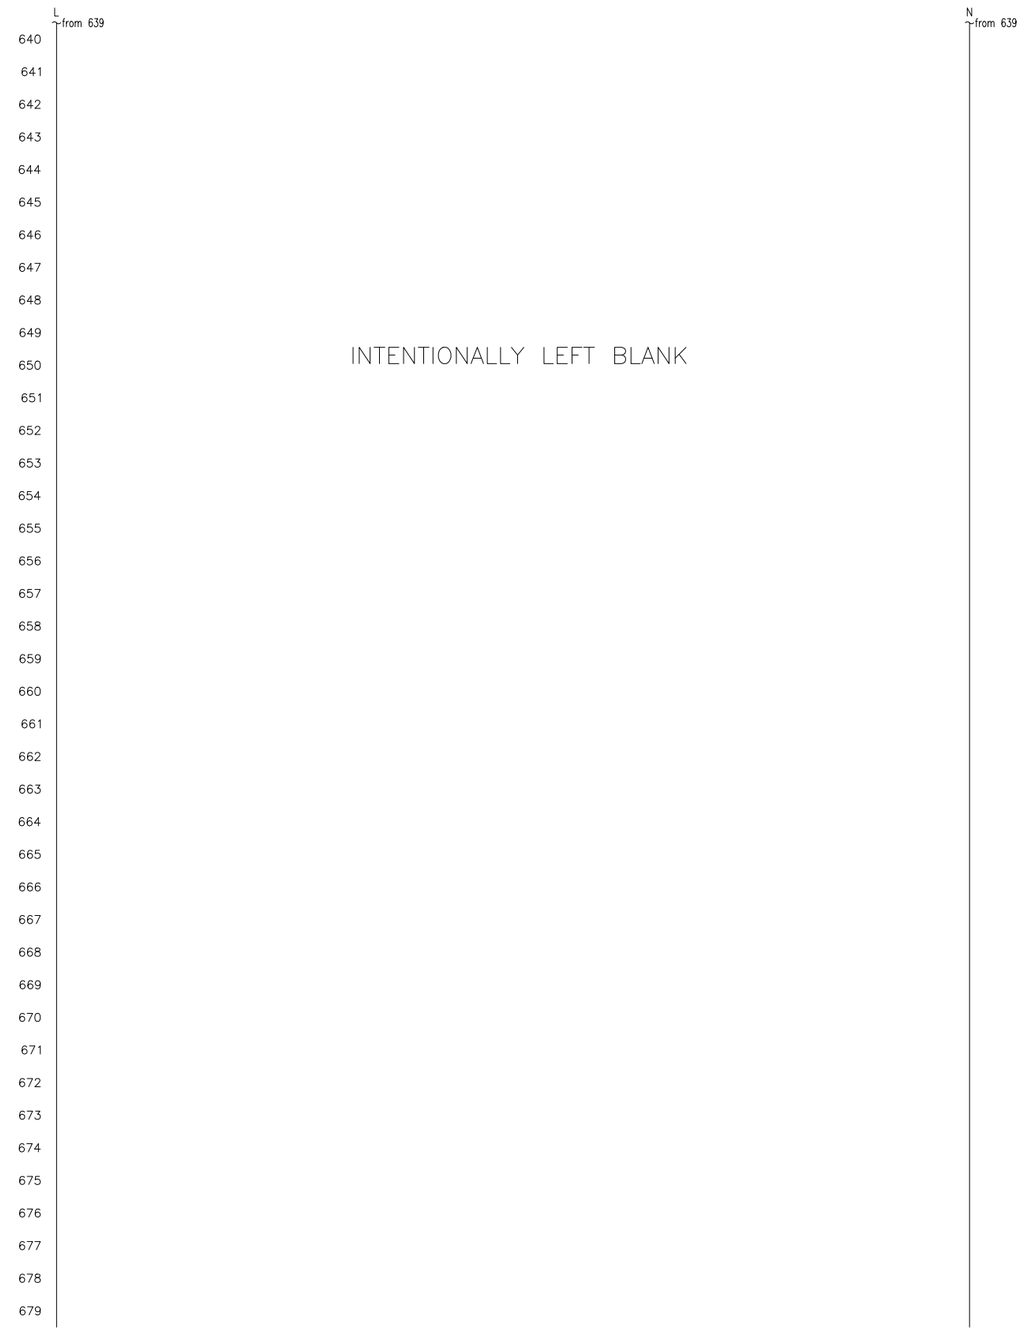

INTENTIONALLY LEFT BLANK

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-07	7 OF 21	1

STD: Electrical v4.3

BAR = 1" AT PLOT SCALE

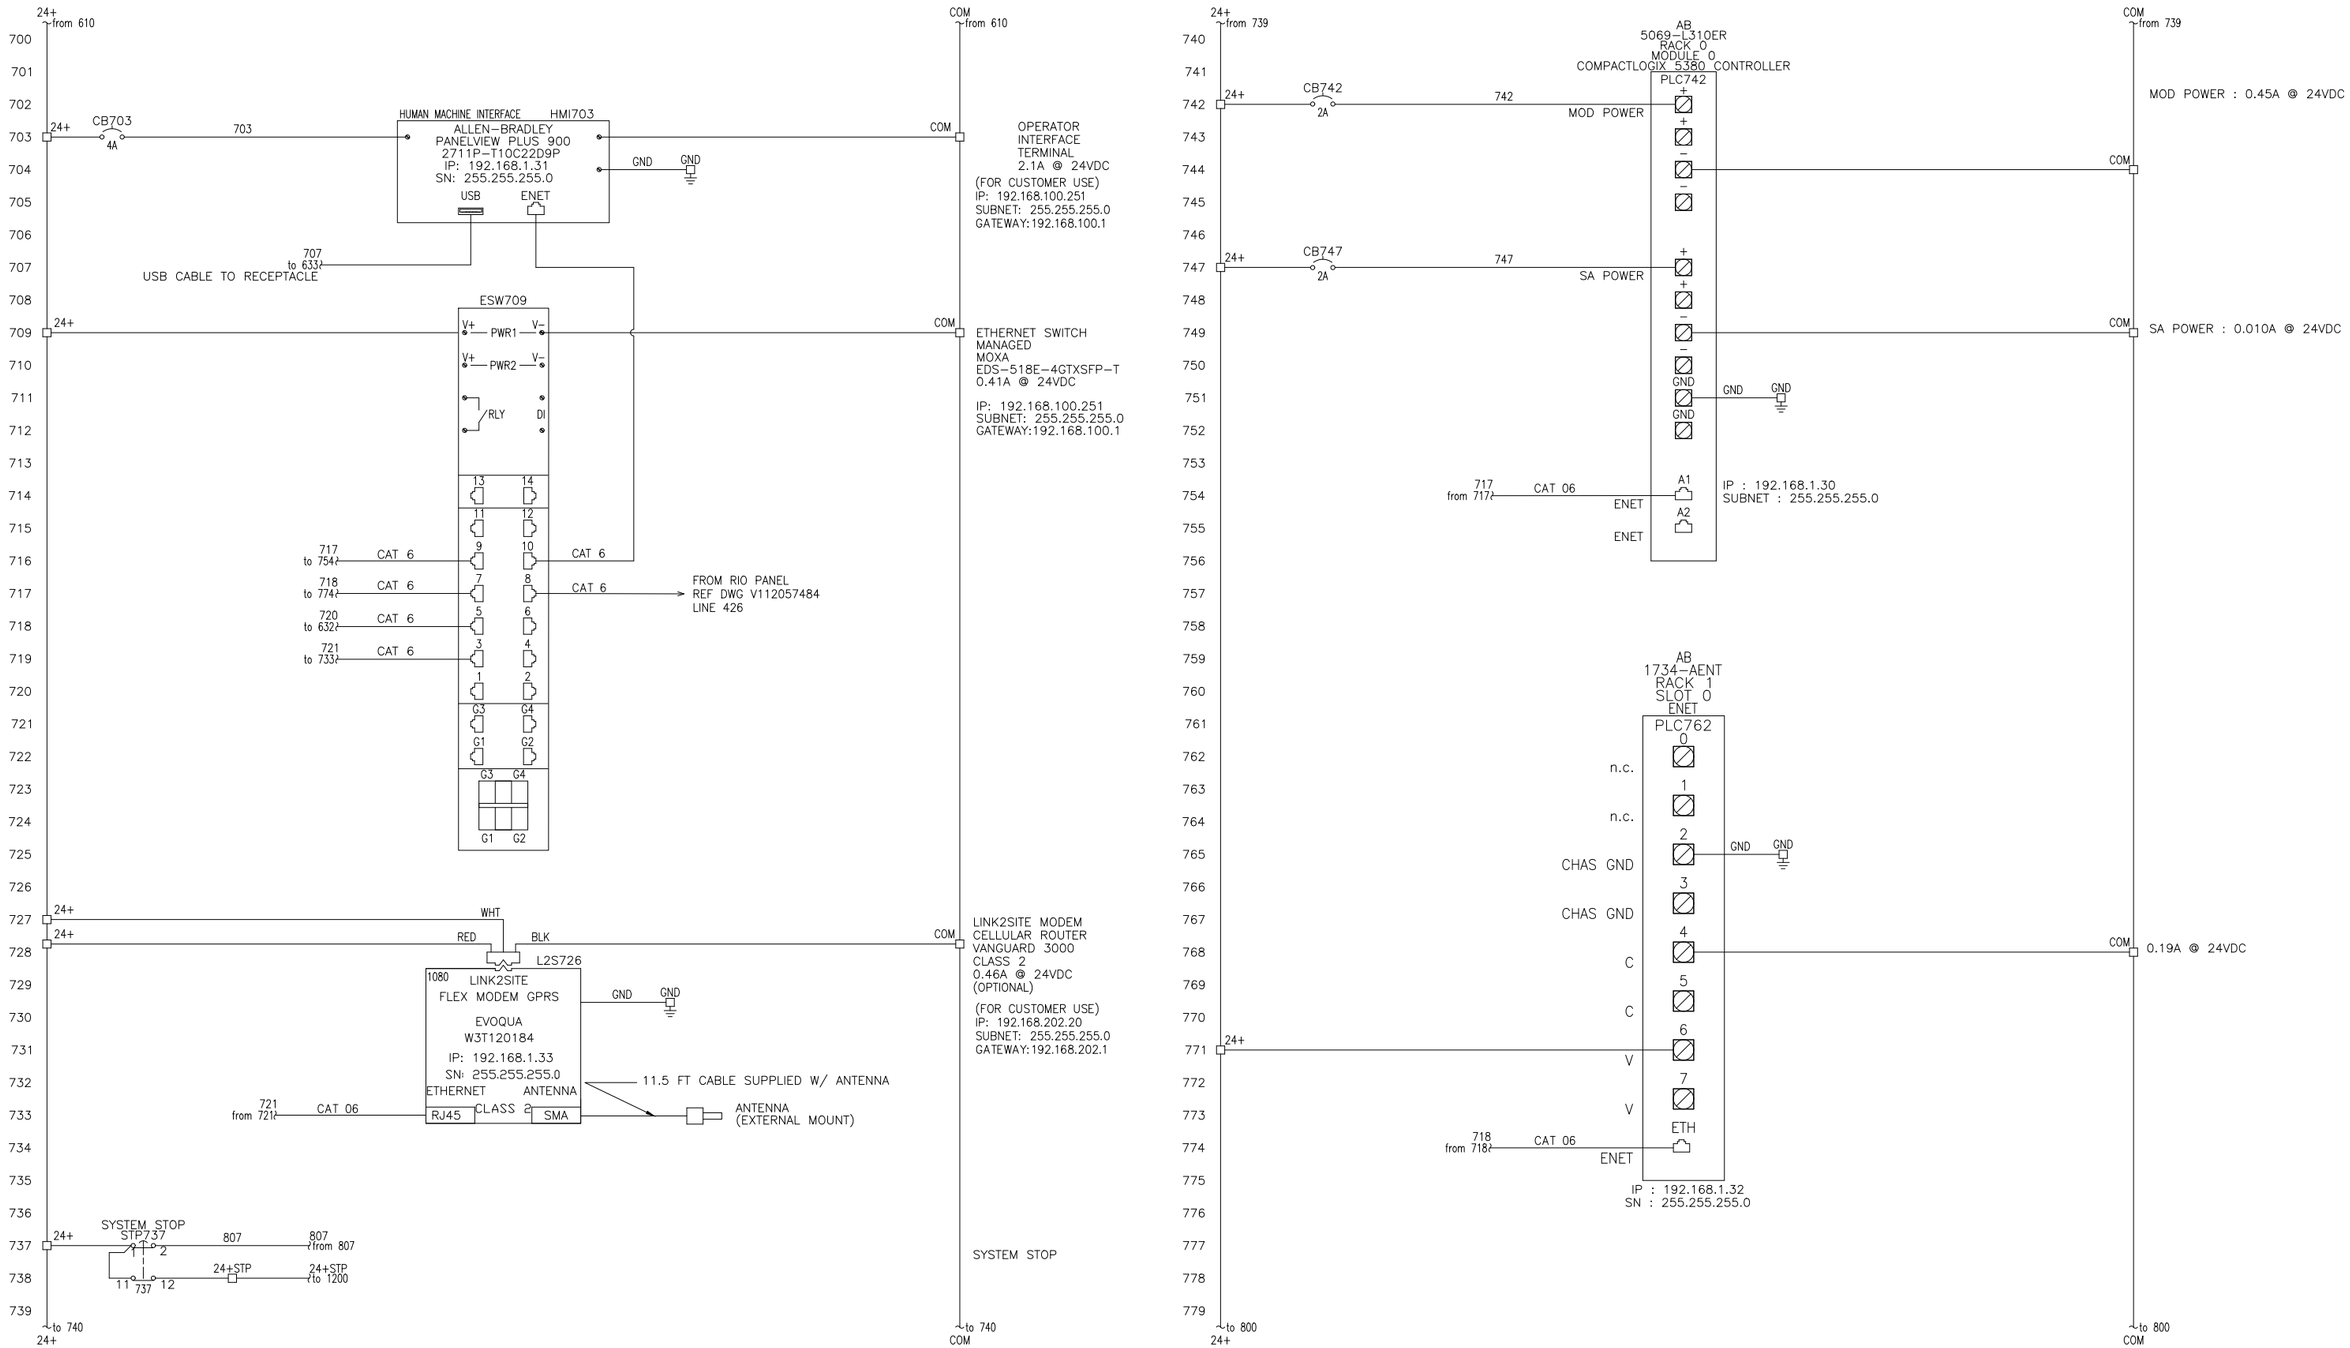

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300
CKD BY: S.THANGA	DATE 2023-11-28	CLIENT ELECTRIC HYDROGEN BEAUMONT, TX
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-08	8 OF 21	1

BAR = 1" AT PLOT SCALE

STD: Electrical v4.3

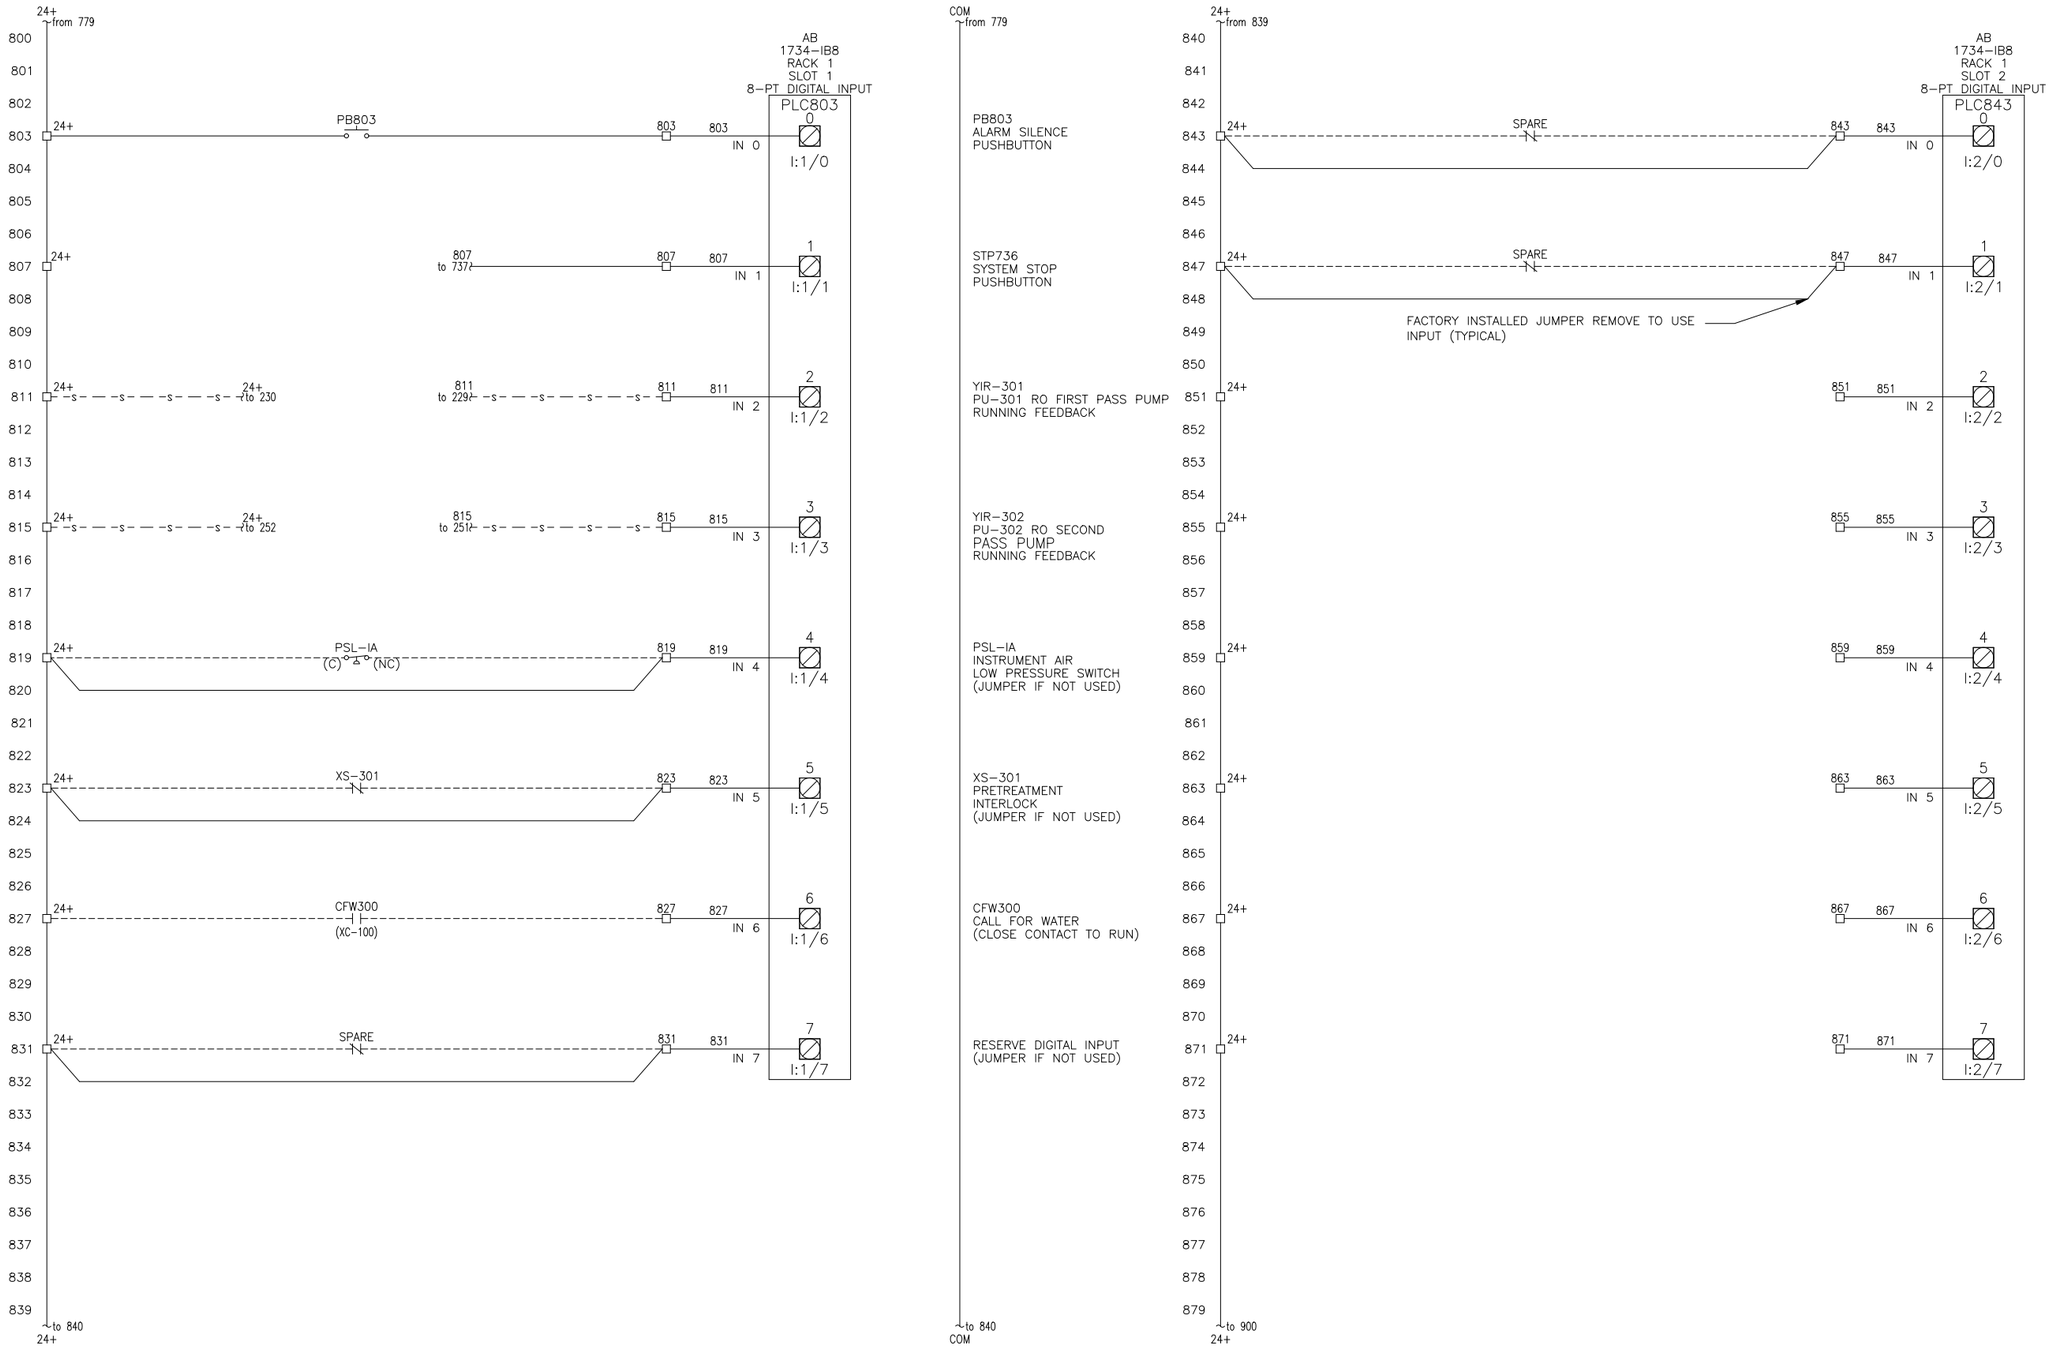

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE: ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300

CLIENT: ELECTRIC HYDROGEN BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-09	9 OF 21	1

BAR = 1" AT PLOT SCALE

STD: Electrical v4.3

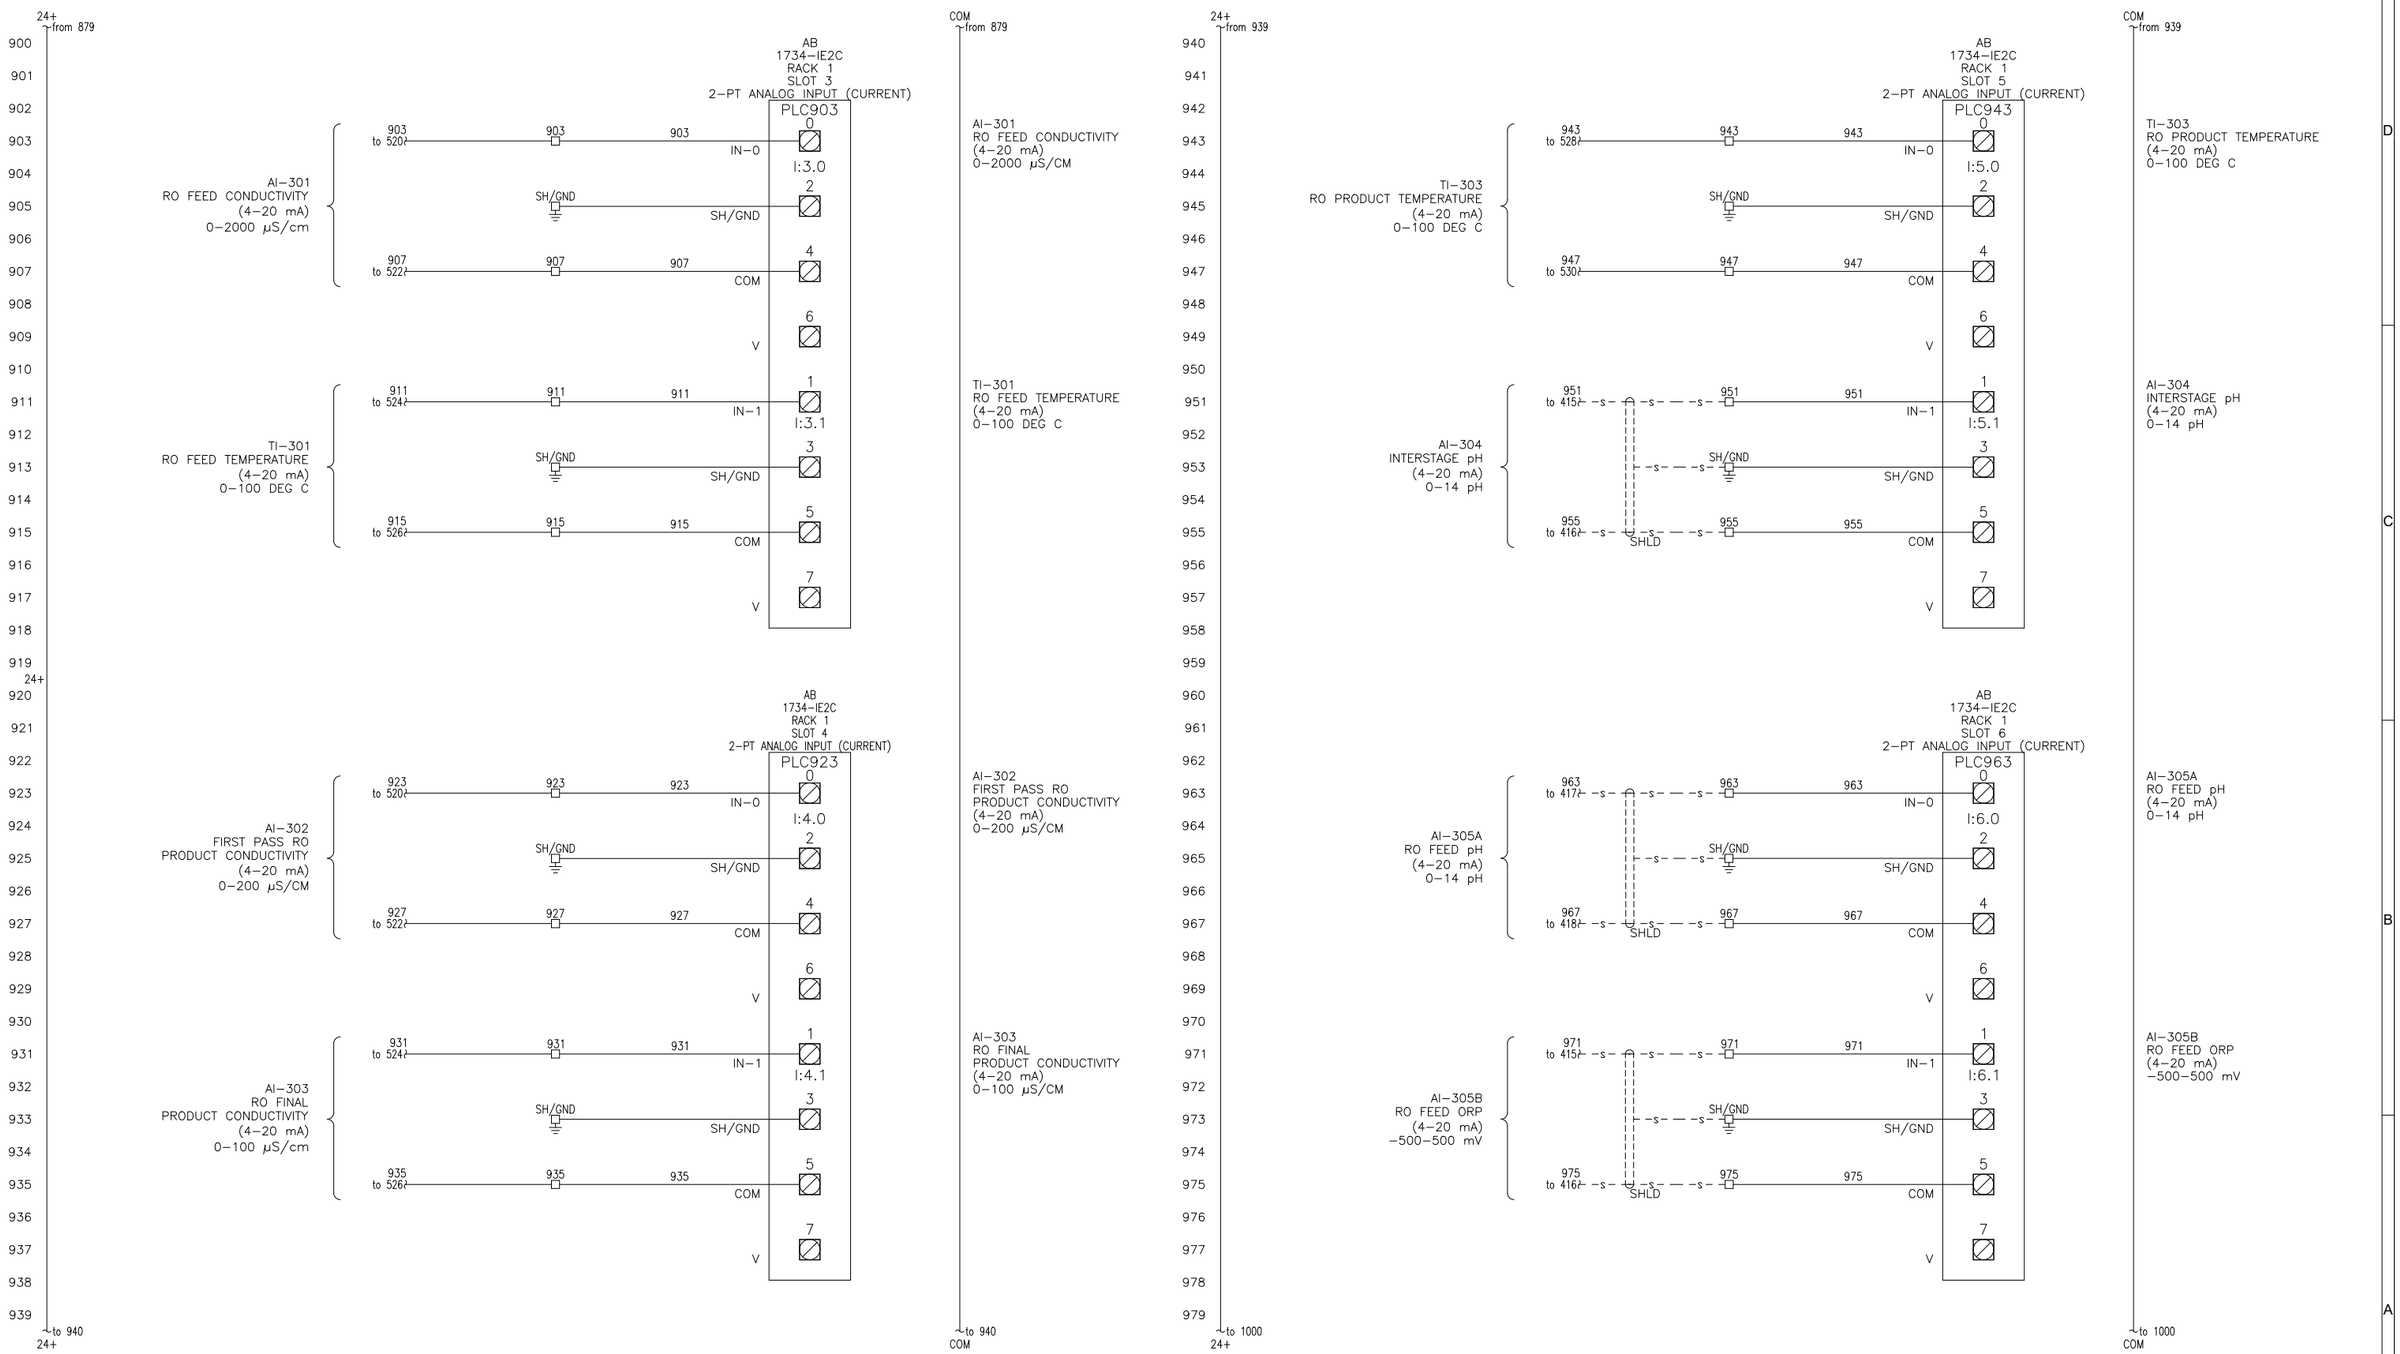

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA WATER TECHNOLOGIES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

evoqua WATER TECHNOLOGIES
EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-10	10 OF 21	1

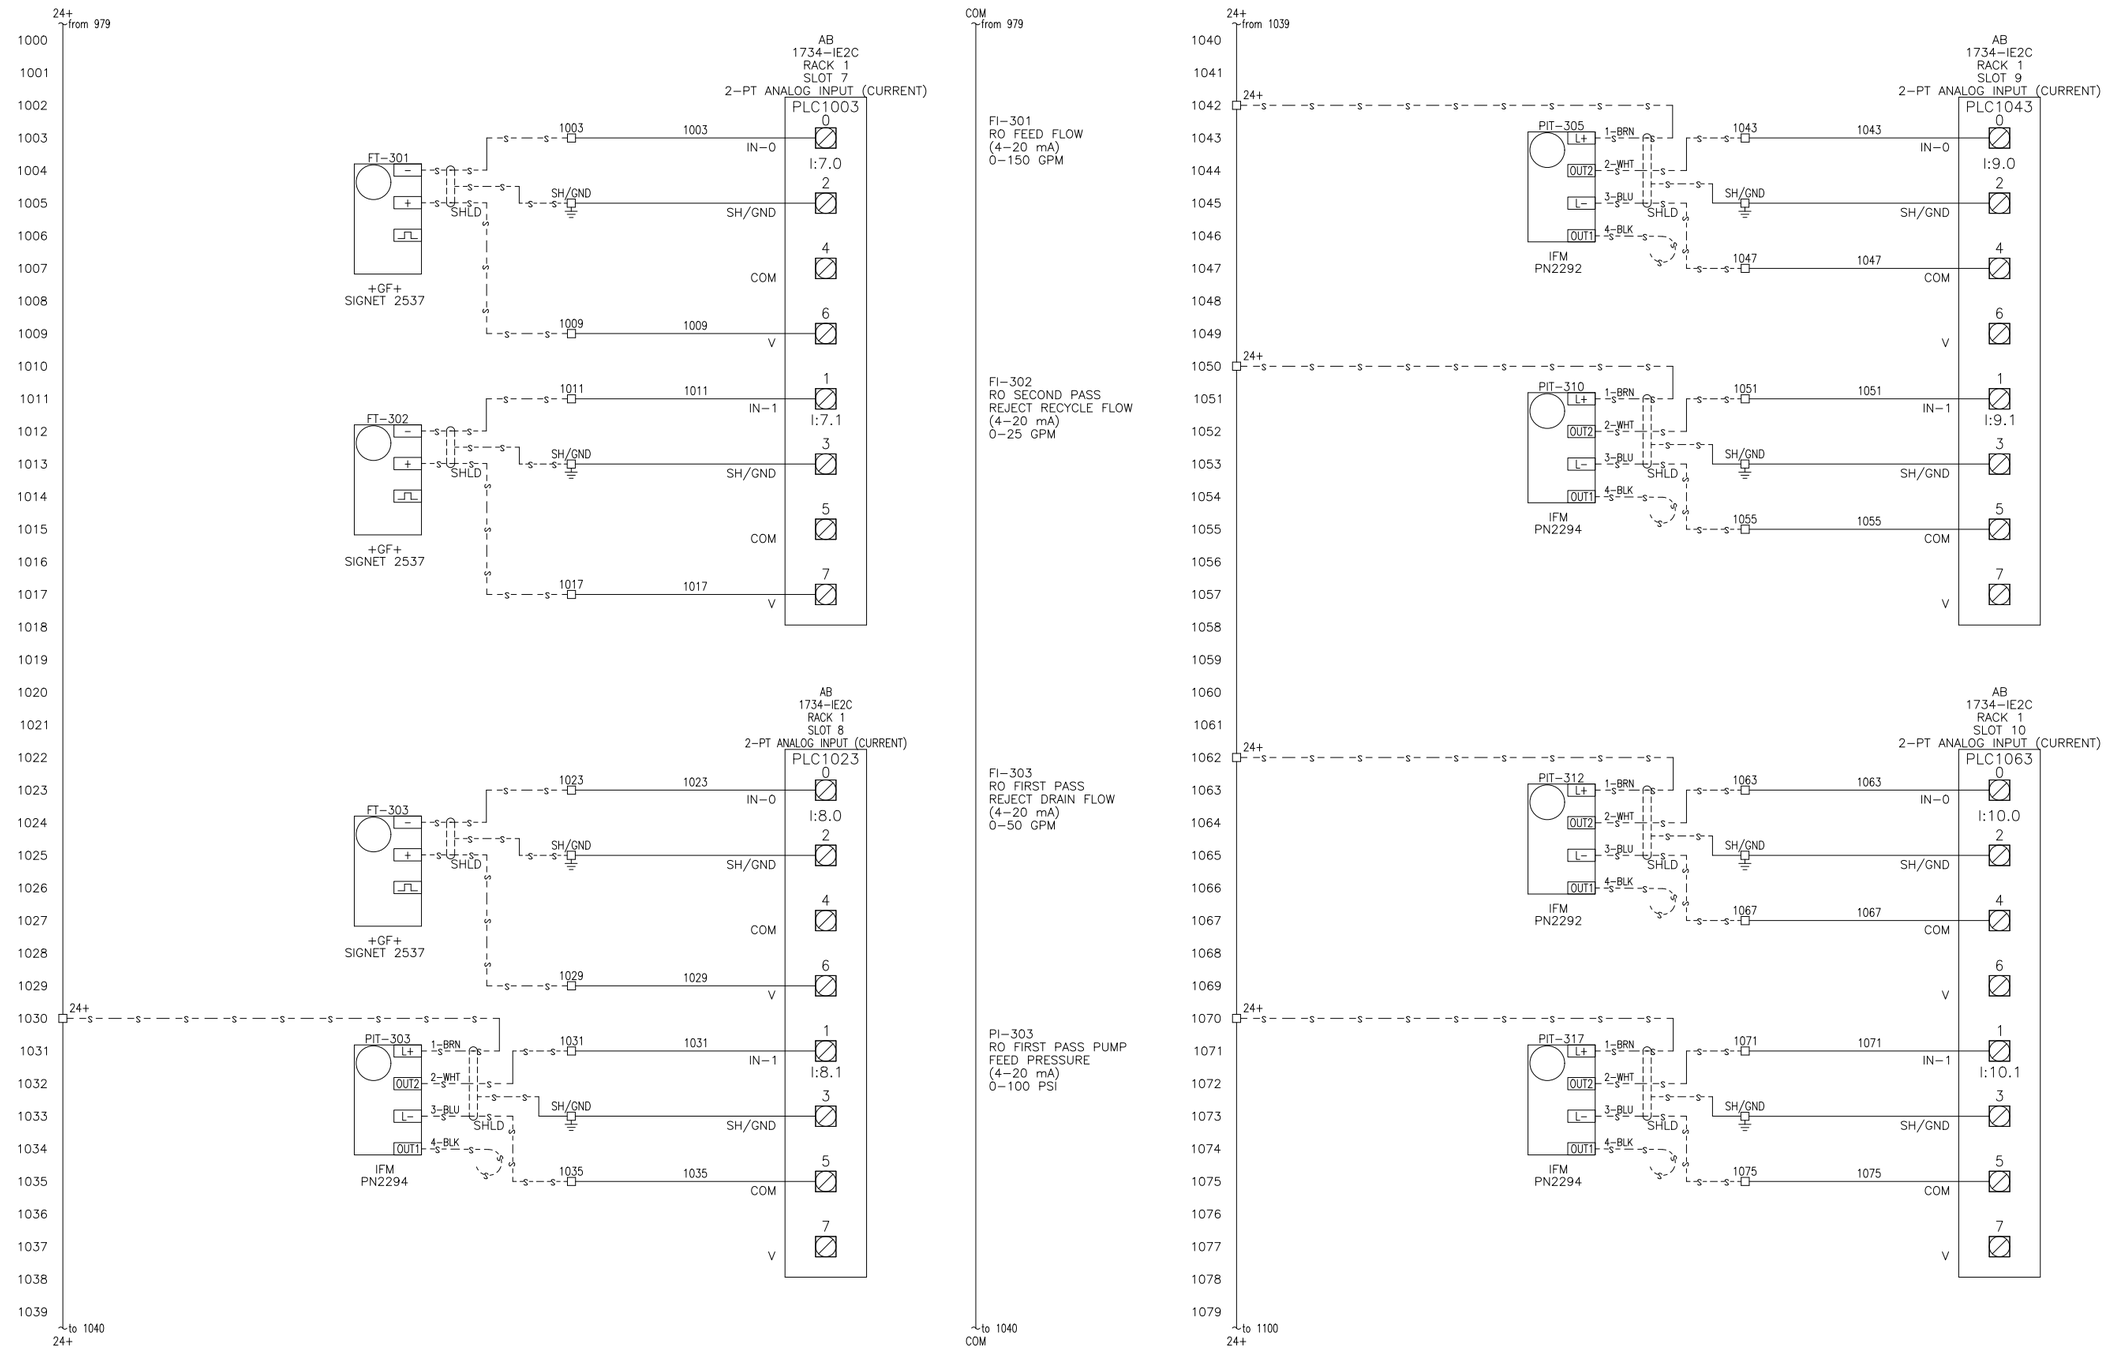

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA WATER TECHNOLOGIES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

evoqua WATER TECHNOLOGIES
EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-11	11 OF 21	1

STD: Electrical v4.3
BAR = 1" AT PLOT SCALE

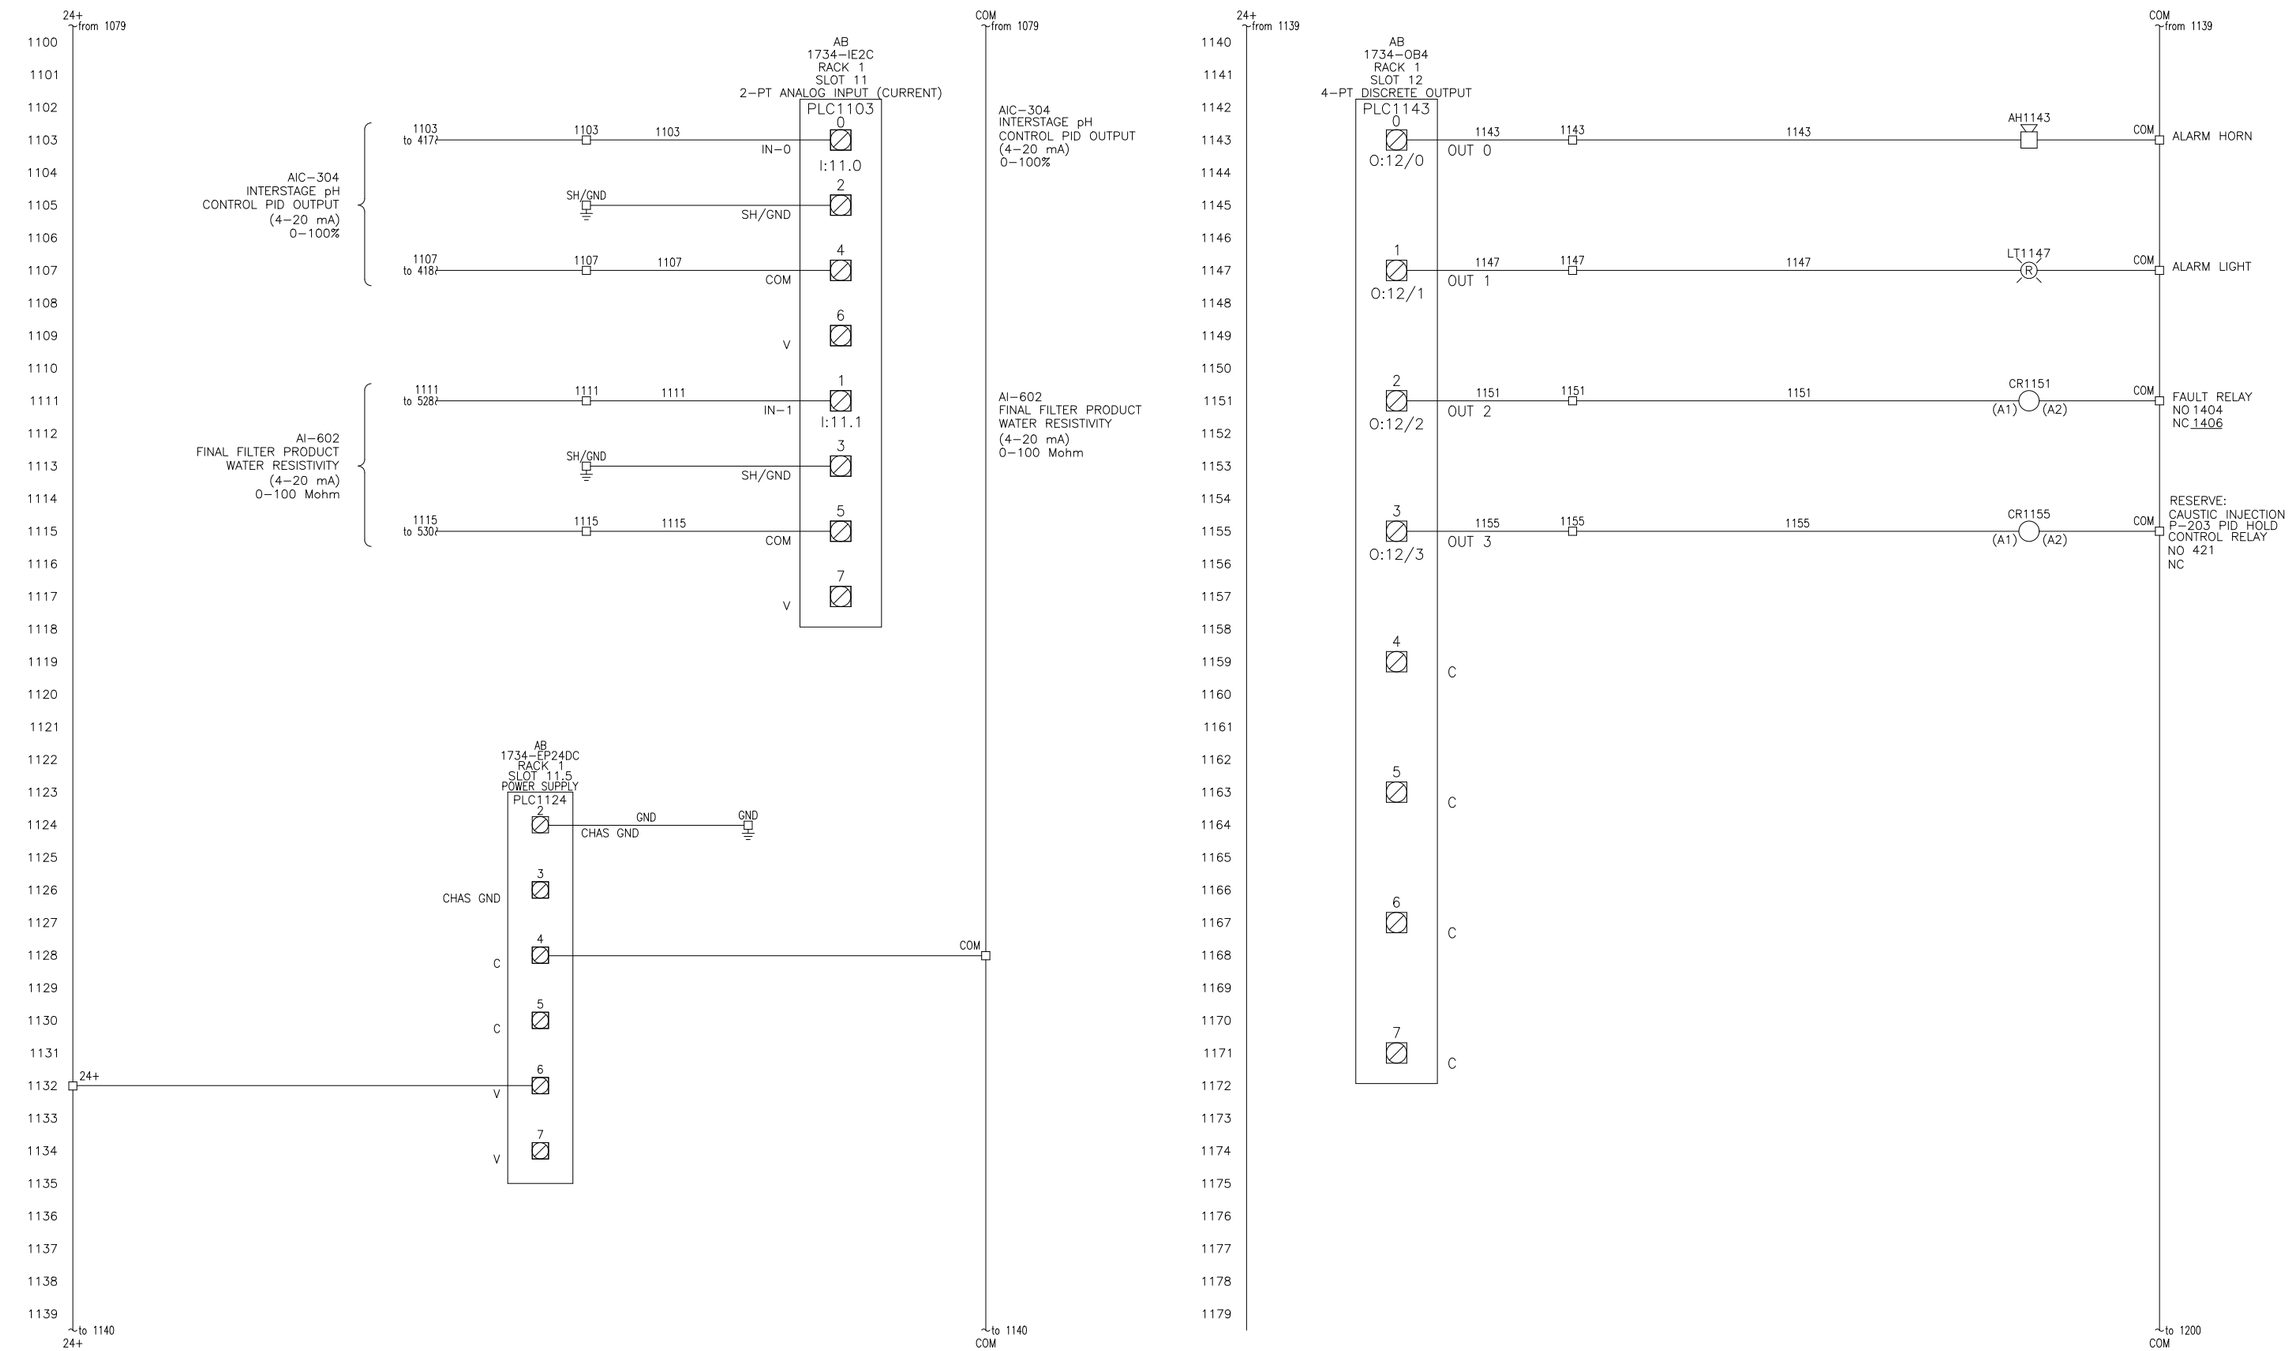

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE: ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT: ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-12	12 OF 21	1

BAR = 1" AT PLOT SCALE

STD: Electrical v4.3

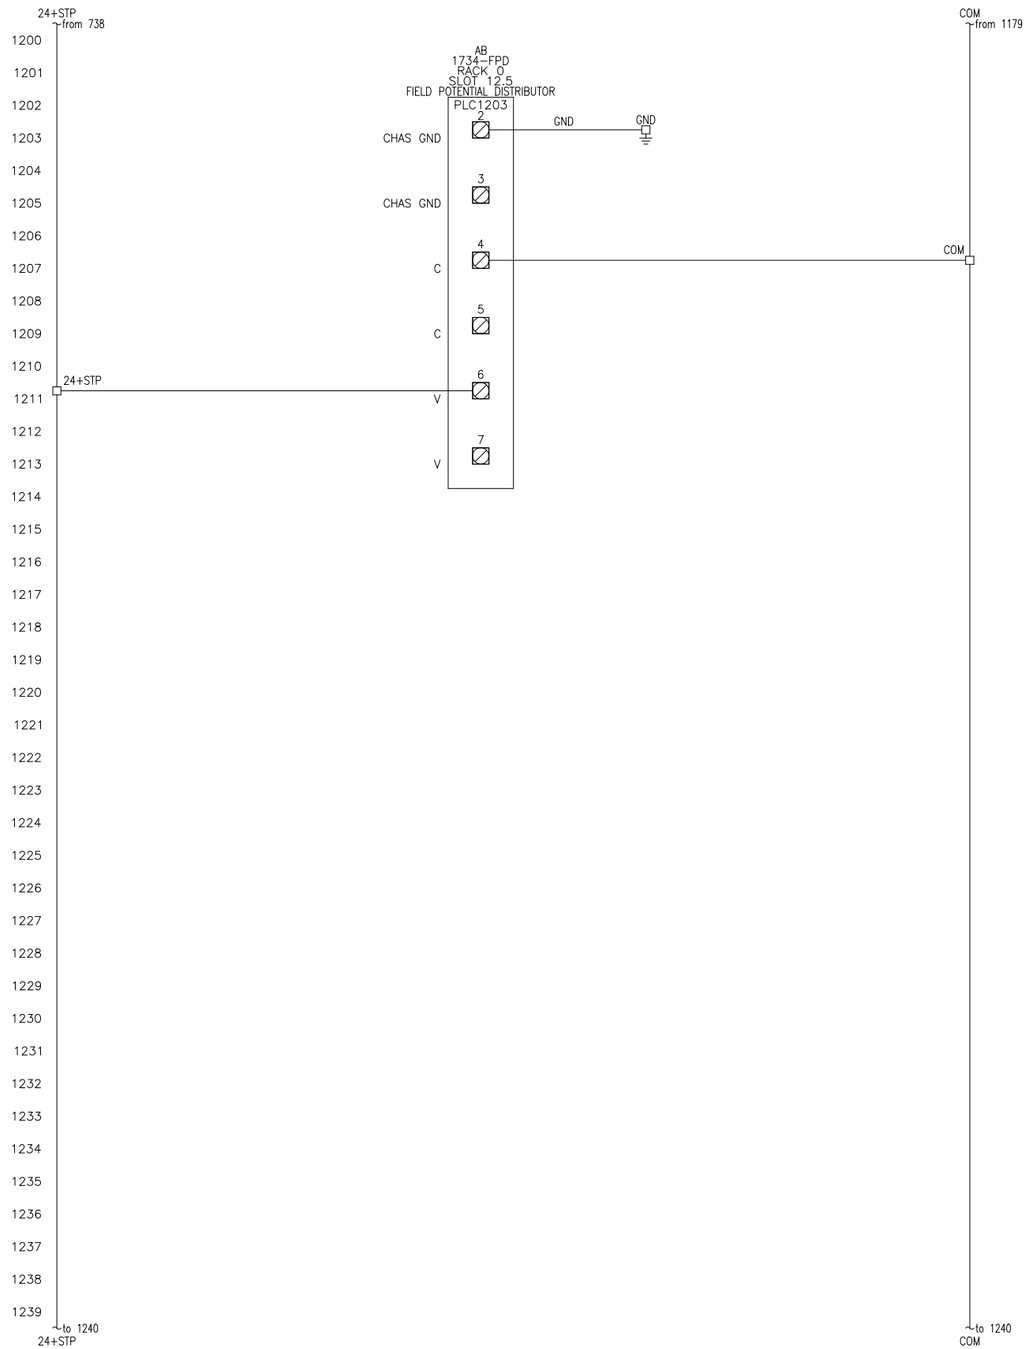

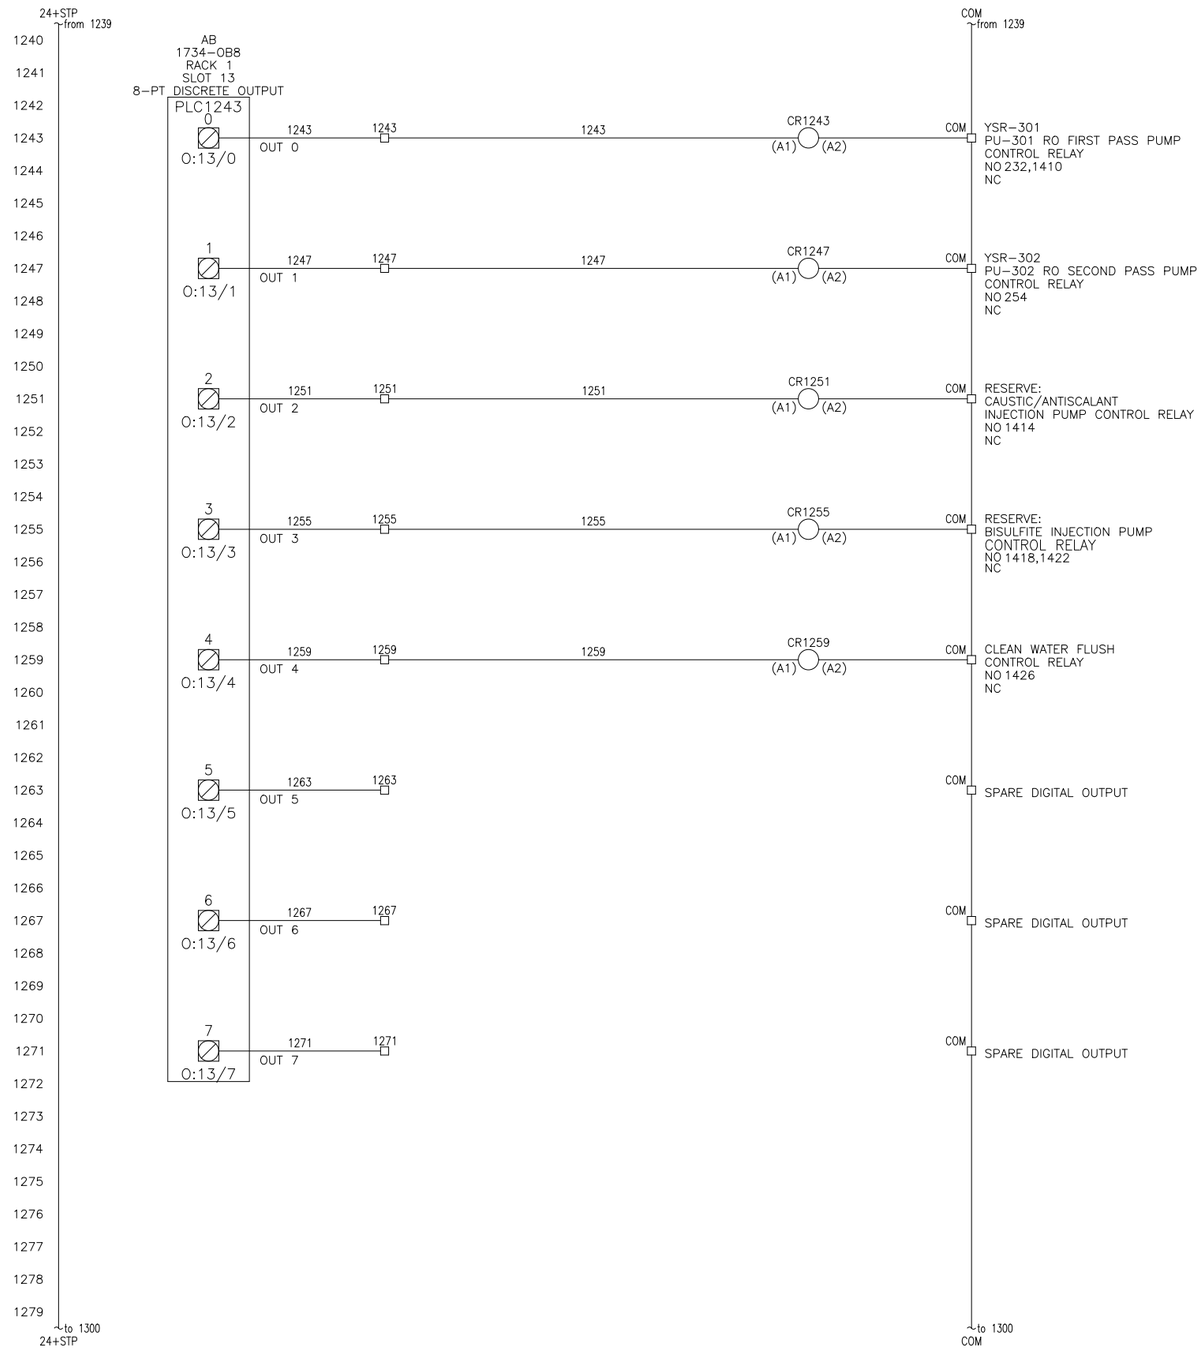

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

evoqua WATER TECHNOLOGIES
EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-13	13 OF 21	1

BAR = 1" AT PLOT SCALE

STD: Electrical v4.3

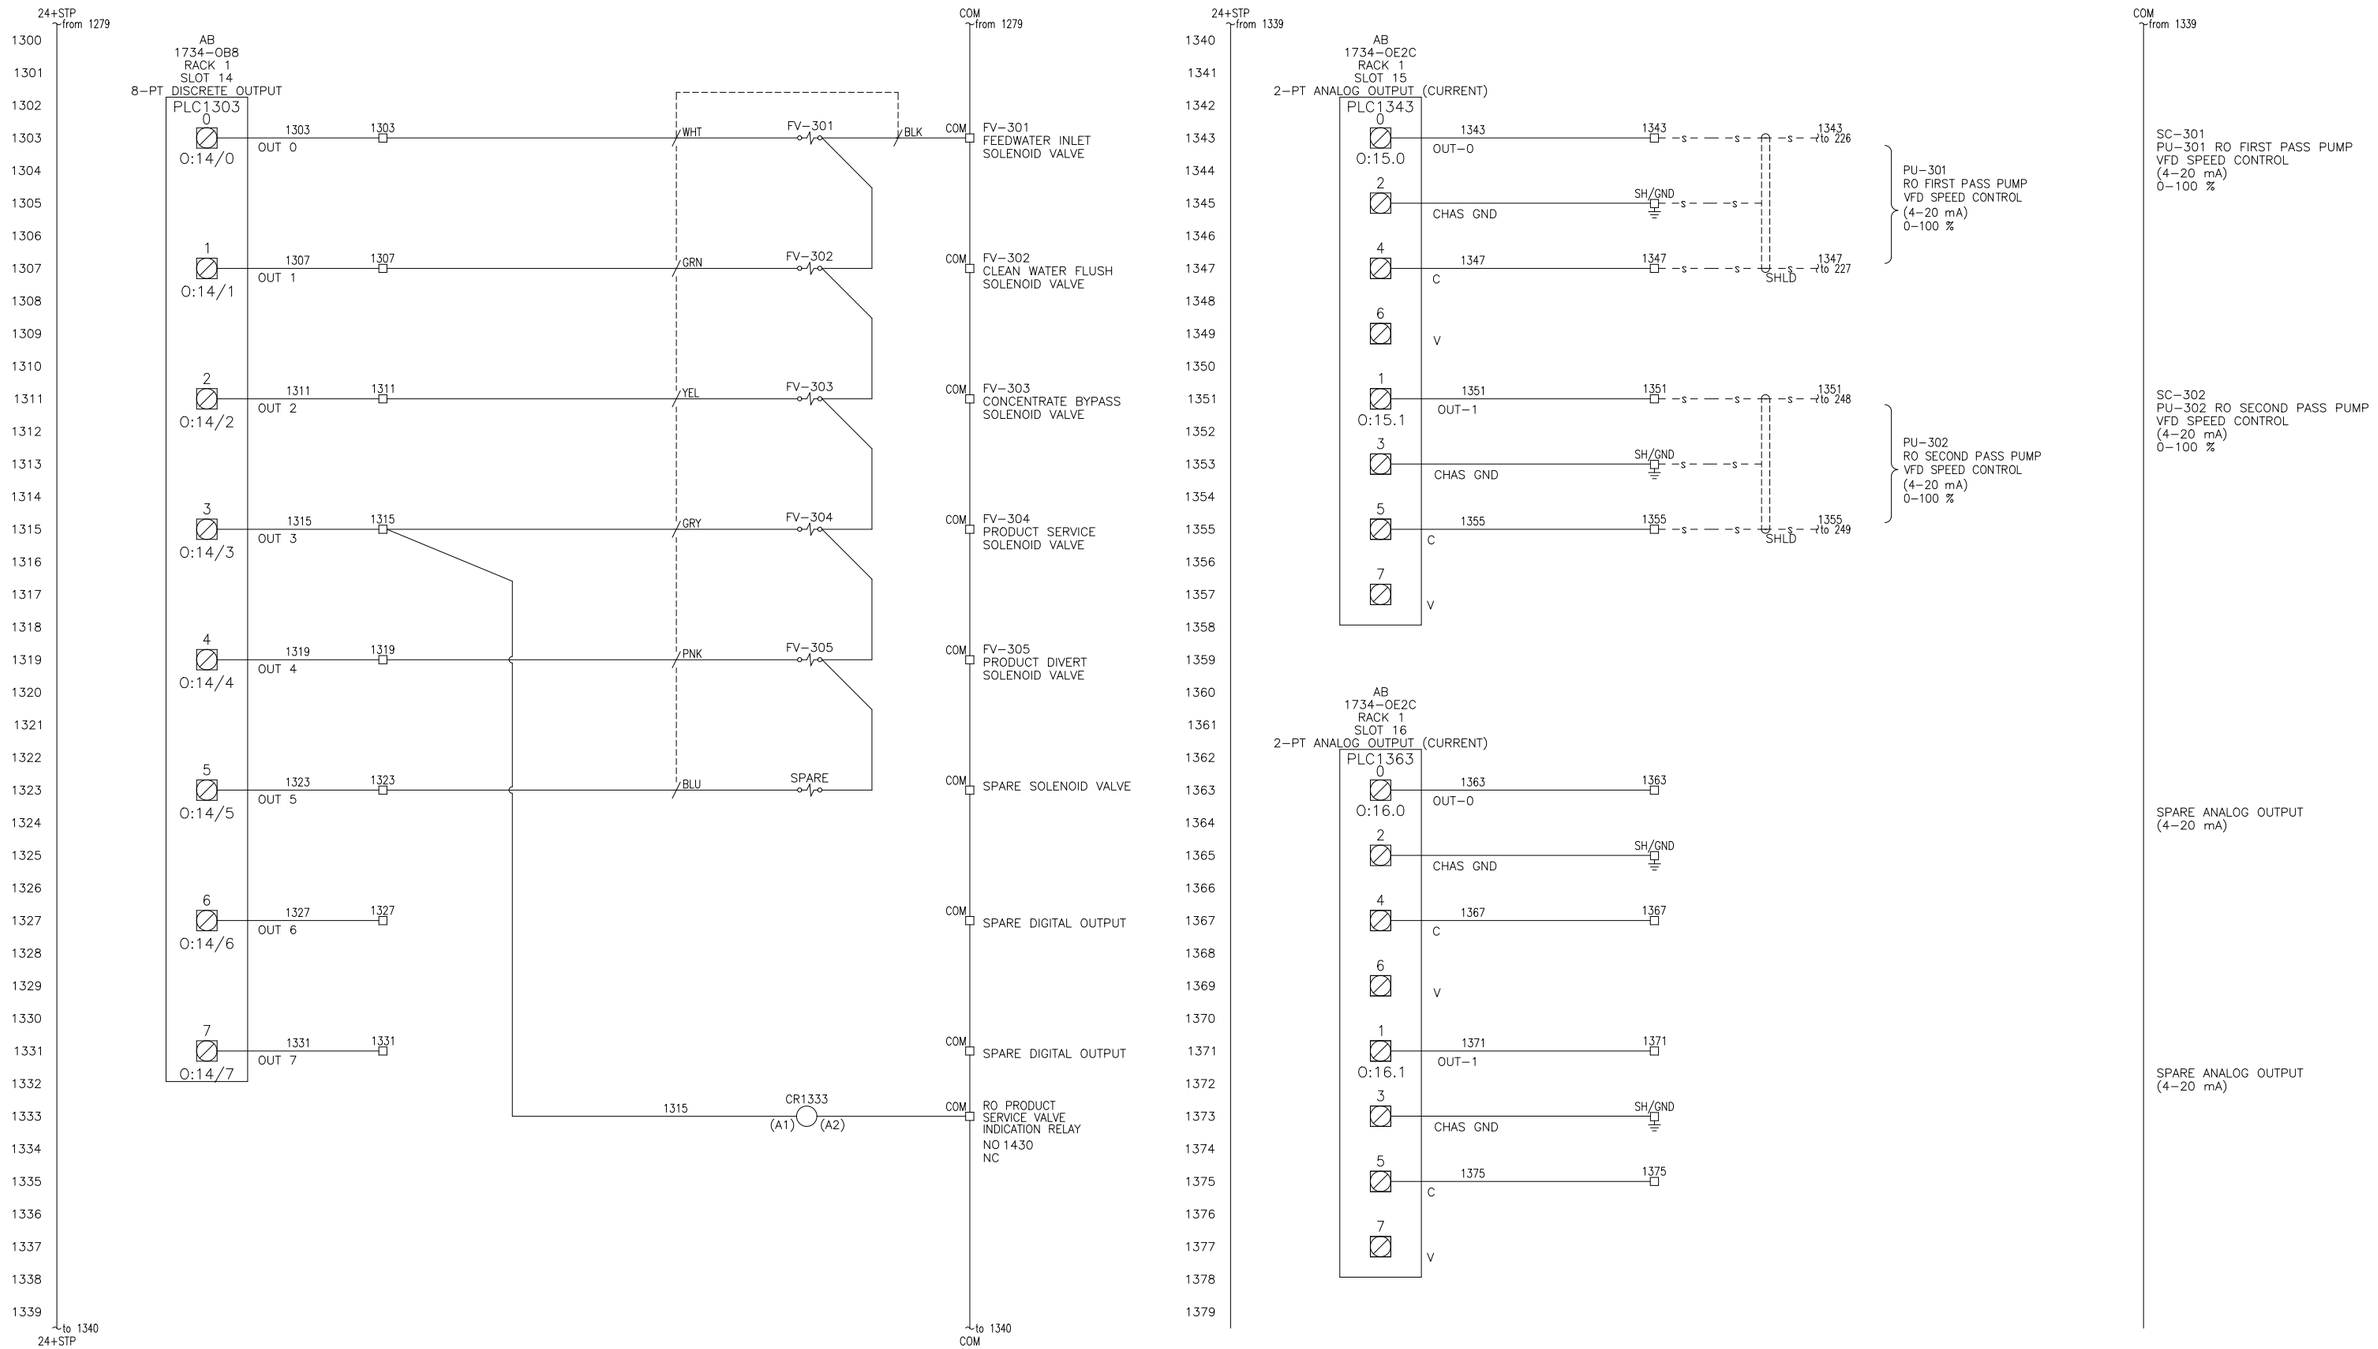

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTIES OF EVOQUA WATER TECHNOLOGIES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

evoqua WATER TECHNOLOGIES
EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-14	14 OF 21	1

STD: Electrical v4.3

BAR = 1" AT PLOT SCALE

TB4 – USER TERMINALS

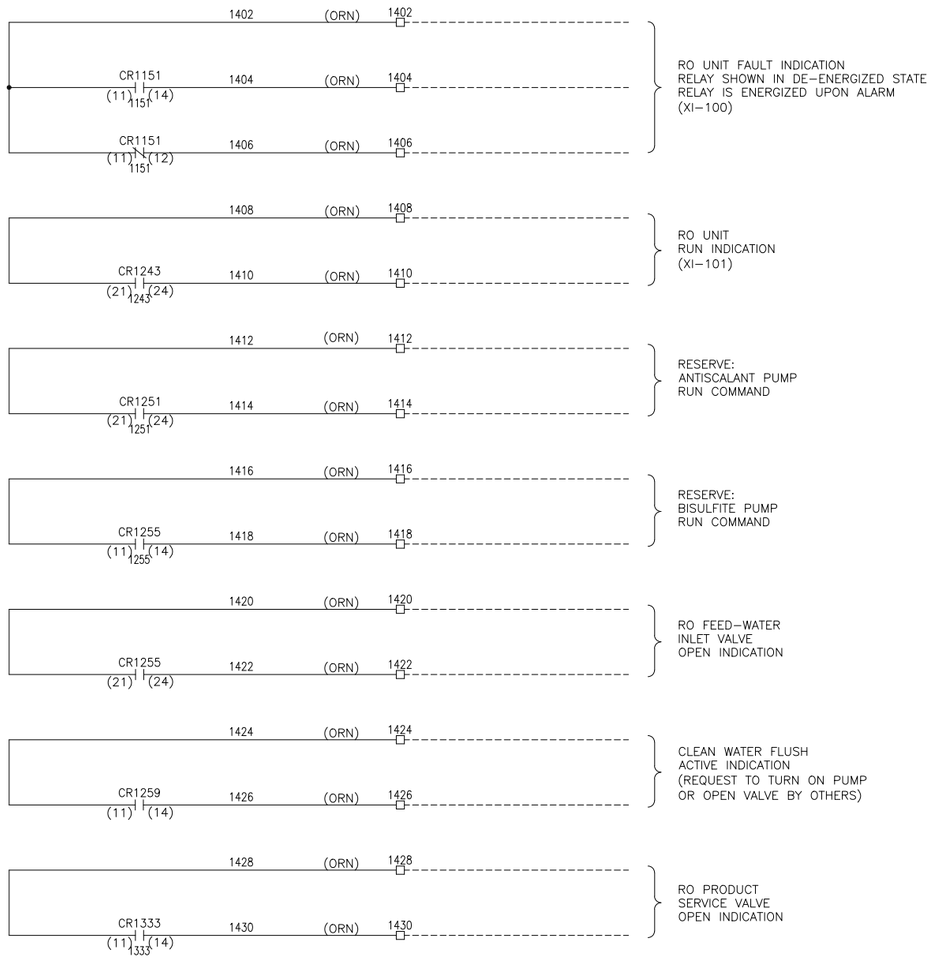

INTENTIONALLY LEFT BLANK

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300
CKD BY: S.THANGA	DATE 2023-11-28	CLIENT ELECTRIC HYDROGEN BEAUMONT, TX
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/0018	45 EC-DOS03	V112057483-15	15 OF 21	1

STD: Electrical v4.3 — BAR = 1" AT PLOT SCALE

INTENTIONALLY LEFT BLANK

INTENTIONALLY LEFT BLANK

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT PRIOR WRITTEN AUTHORIZATION FROM EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	
PART NUMBER W3T602507		

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-16	16 OF 21	1

STD: Electrical v4.3 — BAR = 1" AT PLOT SCALE

NOTES: UNLESS OTHERWISE SPECIFIED

1. THIS PANEL TO BE MOUNTED ON THE RO SKID 0300.
2. THIS ENCLOSURE IS TO BE NEMA 4 CARBON STEEL
3. MANUFACTURING TO LAYOUT BACKPANEL AS SHOWN.
4. ALL WIREWAYS TO BE 4" HIGH.
5. MANUFACTURING TO VERIFY ALL DIMENSIONS AND CUTOUT SIZES BEFORE CUTTING OR DRILLING PANEL.
6. DIN RAIL TO BE MOUNTED ON 1" STANDOFFS.
7. FUSIBLE DISCONNECT WILL VARY DEPENDING ON MODEL.
8. CONDUIT MATERIAL TO BE EMT.
9. PNEUMATIC TUBING MATERIAL TO BE PE.

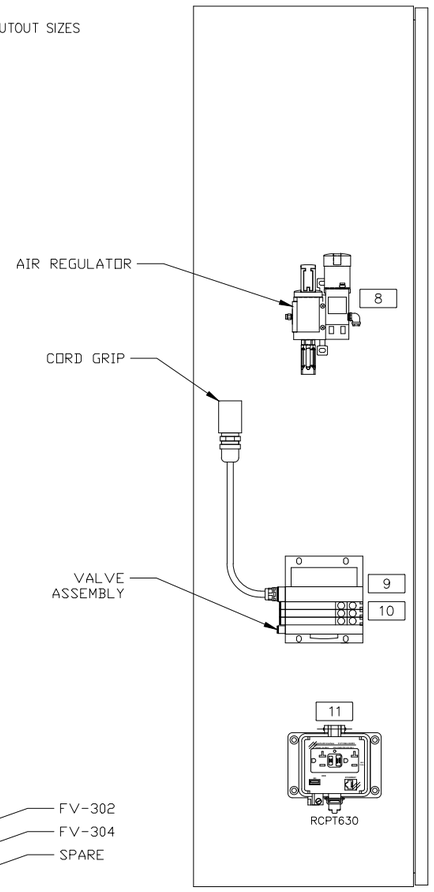

LEFT SIDE VIEW

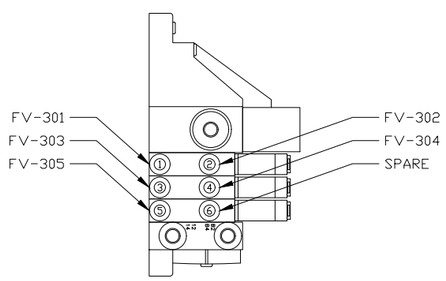

TUBING CONNECTIONS
LEFT SIDE OF
VALVE ASSEMBLY

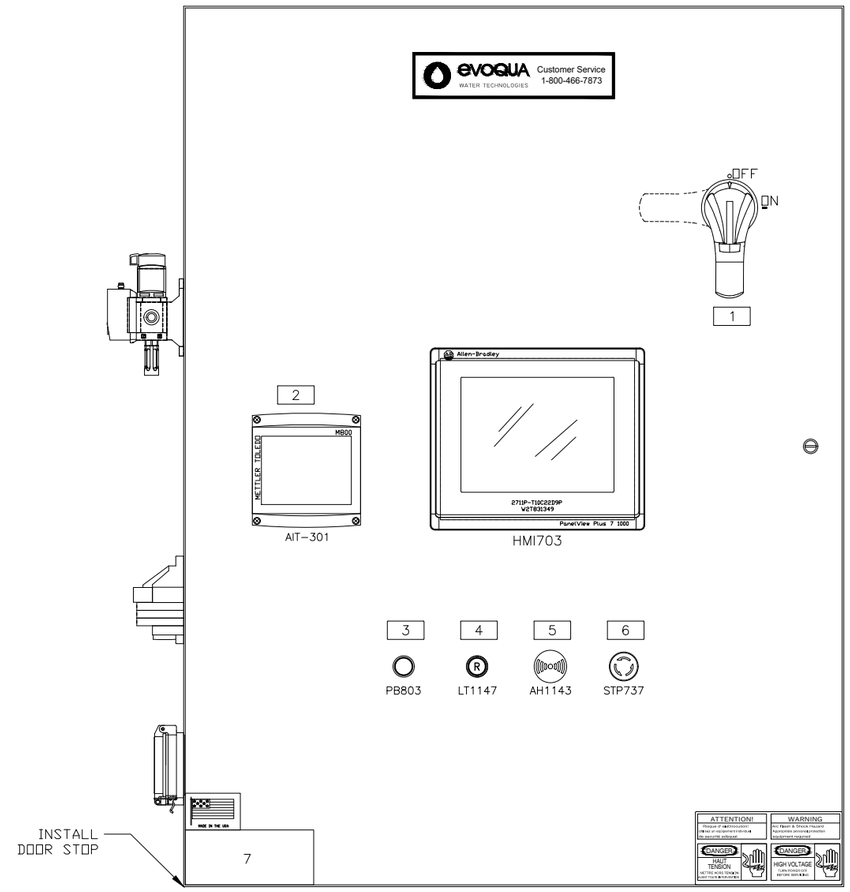

PANEL LAYOUT
48"x36"x12"
[1219 X 914 X 305]



RIGHT SIDE VIEW

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28
CKD BY: S.THANGA	DATE 2023-11-28
APPD BY: K.KISITU	DATE 2023-11-28
MGD BY: P.RYAN	SCALE NTS
PART NUMBER W3T602507	

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
2034/001845	EC-DOS03	V112057483-17	17 OF 21	1

STD: Electrical v4.3 — BAR = 1" AT PLOT SCALE

NOTES: SEE SHEET ONE

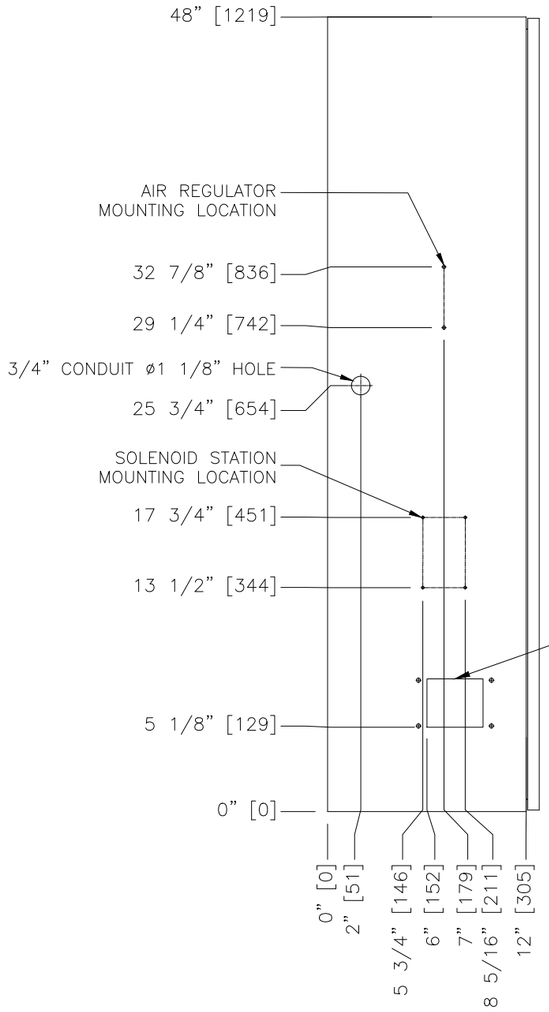

LEFT SIDE DETAIL

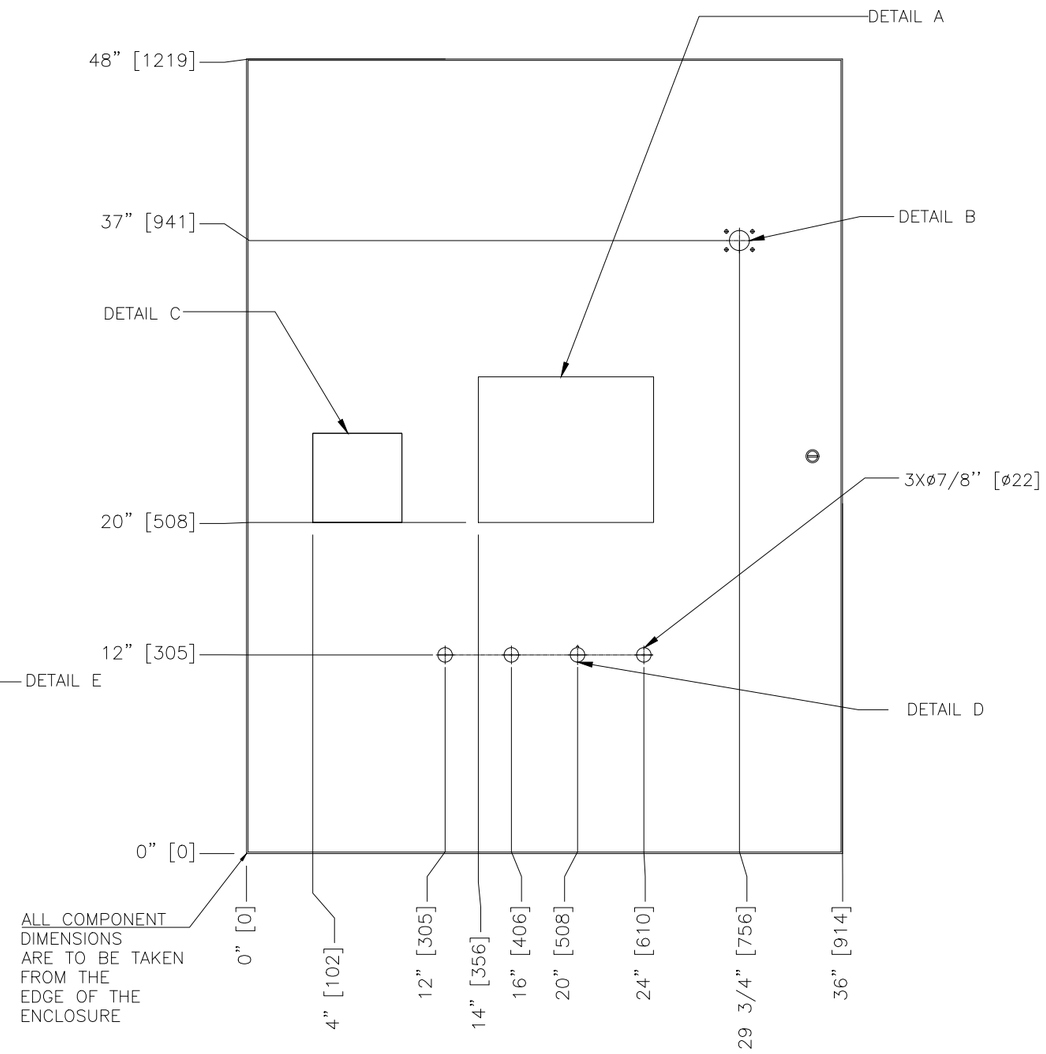

PANEL DETAIL



DETAIL A

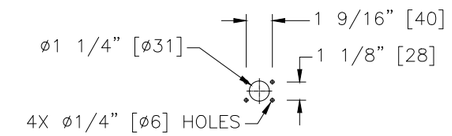

DETAIL B



DETAIL C

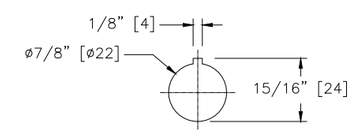

DETAIL D

USE GREENLEE 720 FOR NOTCH

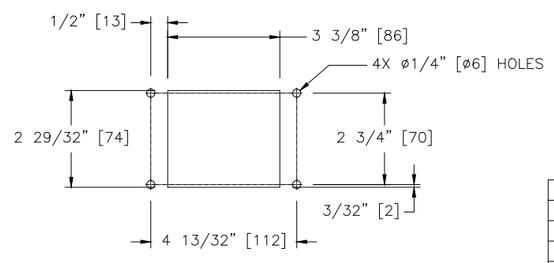

DETAIL E

0307/0308

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300
CKD BY: S.THANGA	DATE 2023-11-28	CLIENT ELECTRIC HYDROGEN BEAUMONT, TX
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-18	18 OF 21	1

STD: Electrical v4.3 BAR = 1" AT PLOT SCALE

NOTES: SEE SHEET ONE

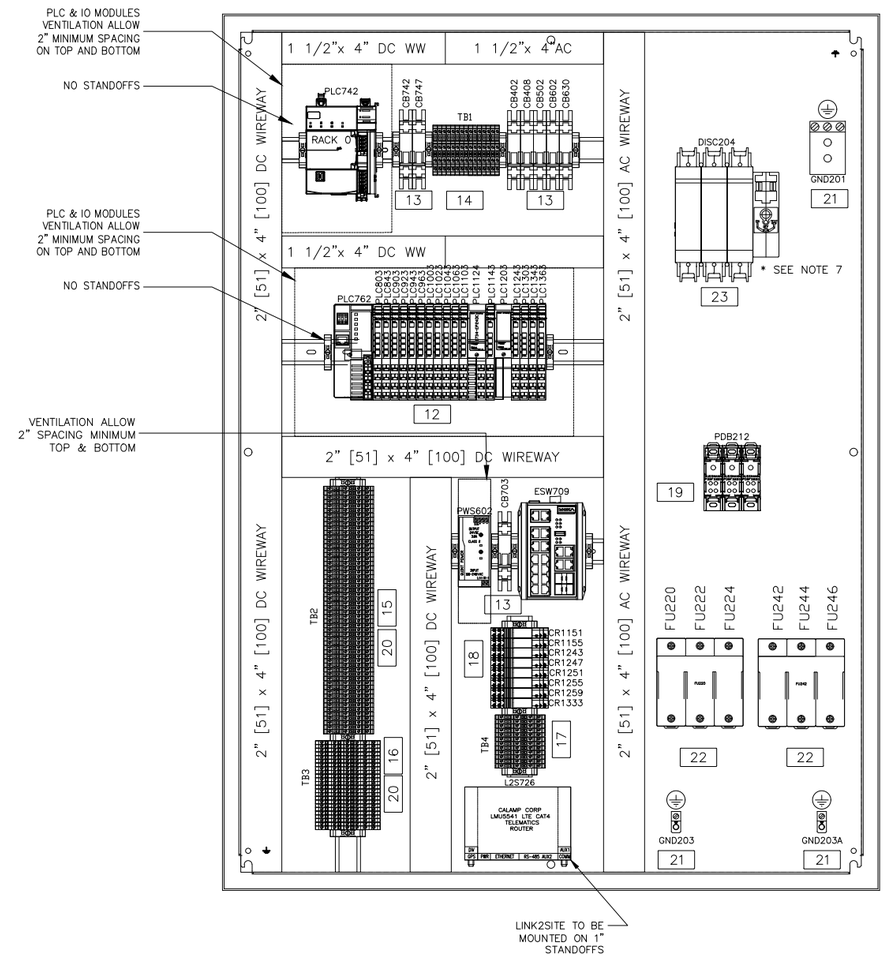

BACKPANEL LAYOUT

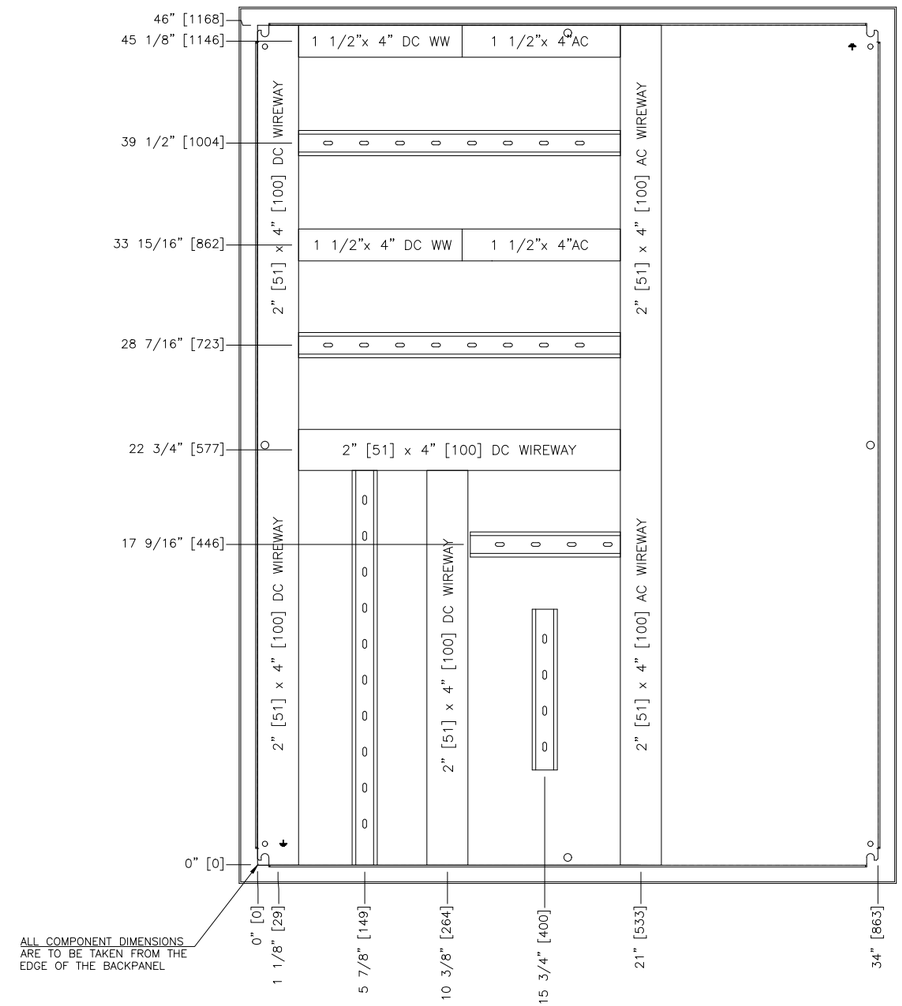

BACKPANEL DETAIL

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus) CONTAINERIZED 2-PASS RO WITH PRETREATMENT RO PANEL - SKID 0300
CKD BY: S.THANGA	DATE 2023-11-28	CLIENT ELECTRIC HYDROGEN BEAUMONT, TX
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	EVOQUA WATER TECHNOLOGIES COLORADO SPRINGS CO USA +1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-19	19 OF 21	1

STD: Electrical v4.3 BAR = 1" AT PLOT SCALE

	TB1 - AC	
	BOTTOM	TOP
1	N	L
	N	L
	N	L
	N	L
	N	L
	N	L
	N	408
	SPARE	SPARE
	SPARE	SPARE
10	GND	GND
	GND	GND
	GND	GND
	GND	GND
	GND	GND
	GND	GND
16	GND	GND

	TB2 - DC	
	BOTTOM	TOP
1	COM	24+
	COM	24+
	COM	24+
	COM	24+
	COM	24+
	COM	24+
	COM	24+
	COM	24+
	COM	24+
10	COM	24+
	24+	24+
	24+	24+
	24+	24+
	24+	803
	24+	807
	24+	811
	24+	815
	24+	819
	24+	823
20	24+	827
	24+	831
	24+	843
	24+	847
	24+	851
	24+	855
	24+	859
	24+	863
	24+	867
	24+	871
30	COM	24+STP
	COM	24+STP
	COM	1143
	COM	1147
	COM	1151
	COM	1155
	COM	1243
	COM	1247
	COM	1251
	COM	1255
40	COM	1259
	COM	1263
	COM	1267
	COM	1271
	COM	1303
	COM	1307
	COM	1311
	COM	1315
	COM	1319
	COM	1323
50	COM	1327
	COM	1331
	232	231
	254	253
	SPARE	SPARE
	SPARE	SPARE
56	SPARE	SPARE

	TB3-DC		
	BOTTOM	MIDDLE	TOP
1	SH/GND	907	903
	SH/GND	915	911
	SH/GND	927	923
	SH/GND	935	931
	SH/GND	947	943
	SH/GND	955	951
	SH/GND	967	963
	SH/GND	977	971
	SH/GND	1009	1003
10	SH/GND	1017	1011
	SH/GND	1027	1023
	SH/GND	1035	1031
	SH/GND	1047	1043
	SH/GND	1055	1051
	SH/GND	1067	1063
	SH/GND	1077	1071
	SH/GND	1107	1103
	SH/GND	1115	1111
	SH/GND	1347	1343
20	SH/GND	1355	1351
	SH/GND	1367	1363
	SH/GND	1375	1371
	SPARE	SPARE	SPARE
24	SPARE	SPARE	SPARE

	TB4	
	BOTTOM	TOP
1	SPARE	1402
	1406	1404
	1410	1408
	1414	1412
	1418	1416
	1422	1420
	1426	1424
	1430	1428
	421	420
10	SPARE	SPARE
	SPARE	SPARE
12	SPARE	SPARE

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

0307/0308

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28	
CKD BY: S.THANGA	DATE 2023-11-28	
APPD BY: K.KISITU	DATE 2023-11-28	
MGD BY: P.RYAN	SCALE NTS	

TITLE: ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT: ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-20	20 OF 21	1

STD: Electrical v4.3 — BAR = 1" AT PLOT SCALE

NAMEPLATE LEGEND

NAMEPLATES TO BE 3/4" X 2" WHITE LAMACOID WITH 1/8" BLACK LETTERING. * DENOTES NAMEPLATE TO BE MOUNTED INSIDE ENCLOSURE.

NO.		NAMEPLATE TEXT	REF
1	1 2 3	DISCONNECT	DISC204
2	1 2 3	MULTIPARAMETER ANALYZER	AIT-301
3	1 2 3	ALARM SILENCE	PB803
4	1 2 3	ALARM LIGHT	LT1147
5	1 2 3	ALARM HORN	AH1143
6	1 2 3	SYSTEM STOP	STP737
7	1 2 3	PANEL NAMEPLATE	SEE DETAIL THIS SHT
8	1 2 3	AIR REGULATOR	–
9	1 2 3	WARNING DO NOT OVERRIDE SOLENOID VALVES	–
10	1 2 3	SOLENOID NAMEPLATE	SEE DETAIL THIS SHT
11	1 2 3	PROGRAMMING PORT 3 AMP MAXIMUM	RCPT630
*12	1 2 3	POINT I/O RTB TORQUE TERMINALS TO 5.5 LB-IN	PLC762-PLC1363

NO.		NAMEPLATE TEXT	REF	
*13	1 2 3	CIRCUIT BREAKERS TORQUE TERMINALS TO 31 LB-IN.	CB402-CB747	X3
*14	1 2 3	TB1 TORQUE TERMINALS TO 6.0 LB-IN.	TB1	
*15	1 2 3	TB2 TORQUE TERMINALS TO 6.0 LB-IN.	TB2	
*16	1 2 3	TB3 TORQUE TERMINALS TO 4.4 LB-IN.	TB3	
*17	1 2 3	TB4 TORQUE TERMINALS TO 6.0 LB-IN.	TB4	
*18	1 2 3	CONTROL RELAYS TORQUE TERMINALS TO 9.0 LB-IN.	CR1151-CR1327	
*19	1 2 3	ETHERNET SWITCH	ESW715	
*20	1 2 3	CLASS 2 CONTROL CIRCUIT	–	X2
*21	1 2 3	GROUND LUG TORQUE TERMINAL TO 35 LB-IN.	GND201 GND203 GND203A	X3
*22	1 2 3	FU220-FU246 REPLACE ONLY WITH 50AMP CLASS J	FU220 FU246	X2
*23	1 2 3	FU205A-FU205C REPLACE ONLY WITH 100AMP CLASS J	FU205A FU205B FU205C	

RED W/WHITE LETTERING

RED W/WHITE LETTERING

CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL -0307
FOR
ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES

Colorado Springs, CO
Industrial Control Panel (NEMA 4/UL Type-1 Enclosure)

ELEC DWG-V112057483 MECH DWG- V113600049

SOURCE	VOLTS	PHASE	Hz	FLA	HP	SCCR
1	480VAC	3Ø	60	80	30	100 kA RMS SYM
2	120VAC	1Ø	60	4	-	14 kA RMS SYM

PANEL NAMEPLATE

SIZE LETTERING AS REQUIRED
WHITE LAMICOID WITH BLACK LETTERING
NAMEPLATE SIZE 3" X 7"

BOTTOM '14' PORTS	TOP '12' PORTS
FV-301	FV-302
FV-303	FV-304
FV-305	SPARE

SOLENOID NAMEPLATE

SIZE LETTERING AS REQUIRED
WHITE LAMICOID WITH BLACK LETTERING
NAMEPLATE SIZE 2 1/4" X 1 7/8"
MOUNTED OUTSIDE

0307/0308

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
1	REVISE SCHEMATIC NOTE #3 & ETHERNET SWITCH CHANGE	2024-05-14	C.HANER	K.KALUNG	K.KALUNG	ECM127665
0	ISSUED FOR CONSTRUCTION	2023-12-28	M.KALIRA	S.THANGA	K.KISITU	N/A

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM, ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: M.KALIRA	DATE 2023-11-28
CKD BY: S.THANGA	DATE 2023-11-28
APPD BY: K.KISITU	DATE 2023-11-28
MGD BY: P.RYAN	SCALE NTS

TITLE ELECTRICAL SCHEMATICS & ENCLOSURE DIAGRAMS (cETLus)
CONTAINERIZED 2-PASS RO WITH PRETREATMENT
RO PANEL - SKID 0300

CLIENT ELECTRIC HYDROGEN
BEAUMONT, TX

EVOQUA WATER TECHNOLOGIES
COLORADO SPRINGS CO USA
+1 719-570-9600

PART NUMBER	PROJ/PROD NUMBER	CODE	FILE/DRAWING NUMBER	SHEET	REV
W3T602507	2034/001845	EC-DOS03	V112057483-21	21 OF 21	1

STD: Electrical v4.3 BAR = 1" AT PLOT SCALE