



DALMIA CEMENT (B) LIMITED – CEMENT PLANT

ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

Scope/Purpose : This SOP is applicable for bypassing the UPS panel without the output supply being affected.

Responsibility : Instrumentation Engineer

Accountability : Instrumentation Technician

PPE:

1. Hand gloves
2. Nose Mask
3. Goggle
4. Apron coat

Tools:

1. Screw Driver
2. Multimeter



DALMIA CEMENT (B) LIMITED – CEMENT PLANT

ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

Hazard Analysis:

Risks associated

Electrocution

Mitigating Measures

Use insulated hand gloves and tools

Procedure:



DALMIA CEMENT (B) LIMITED – CEMENT PLANT



ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

To switch OFF the UPS panel:

1. We have to fail the inverter (i.e., battery, input and the UPS must be switched OFF)

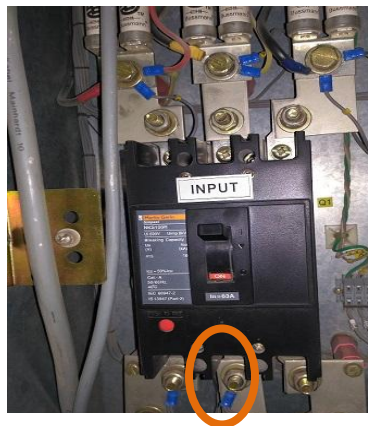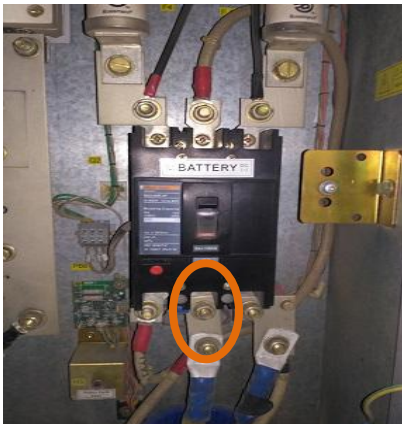

2. Manual bypass must be switched ON.






DALMIA CEMENT (B) LIMITED – CEMENT PLANT

ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

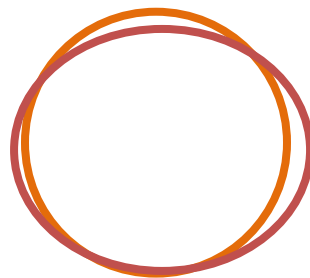

3. Switch off the bypass input breaker and the output breaker.





DALMIA CEMENT (B) LIMITED – CEMENT PLANT

ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

To switch on the UPS panel again, the following procedure should be followed.

To switch ON the UPS panel:

1. Switch ON the bypass input breaker and the output breaker.





DALMIA CEMENT (B) LIMITED – CEMENT PLANT

ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

2. Switch OFF the manual bypass.



3. UPS input breaker must be switched ON.






DALMIA CEMENT (B) LIMITED – CEMENT PLANT


ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
Issued By: M.R		Approved By: HOD-Instrumenetation	
SOP FOR BYPASSING THE UPS PANEL			

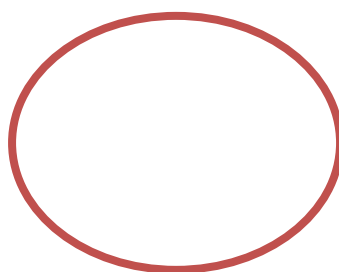

(Note: Once these steps are over, (1), (2), (3) LED's will be ON and LED (7) will be flashing.

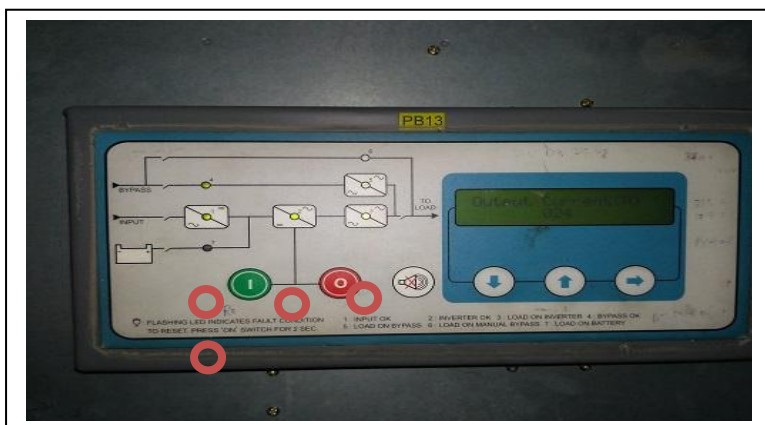

4. Switch ON the battery Input.



DALMIA CEMENT (B) LIMITED – CEMENT PLANT

ARIYALUR

INSTRUMENTATION DEPARTMENT

Issue No. 02	Rev. No: 00	Effective Date: 01.11.2019	SOP/INST/58
--------------	-------------	----------------------------	-------------

Issued By: M.R

Approved By: HOD-Instrumenetation

SOP FOR BYPASSING THE UPS PANEL

