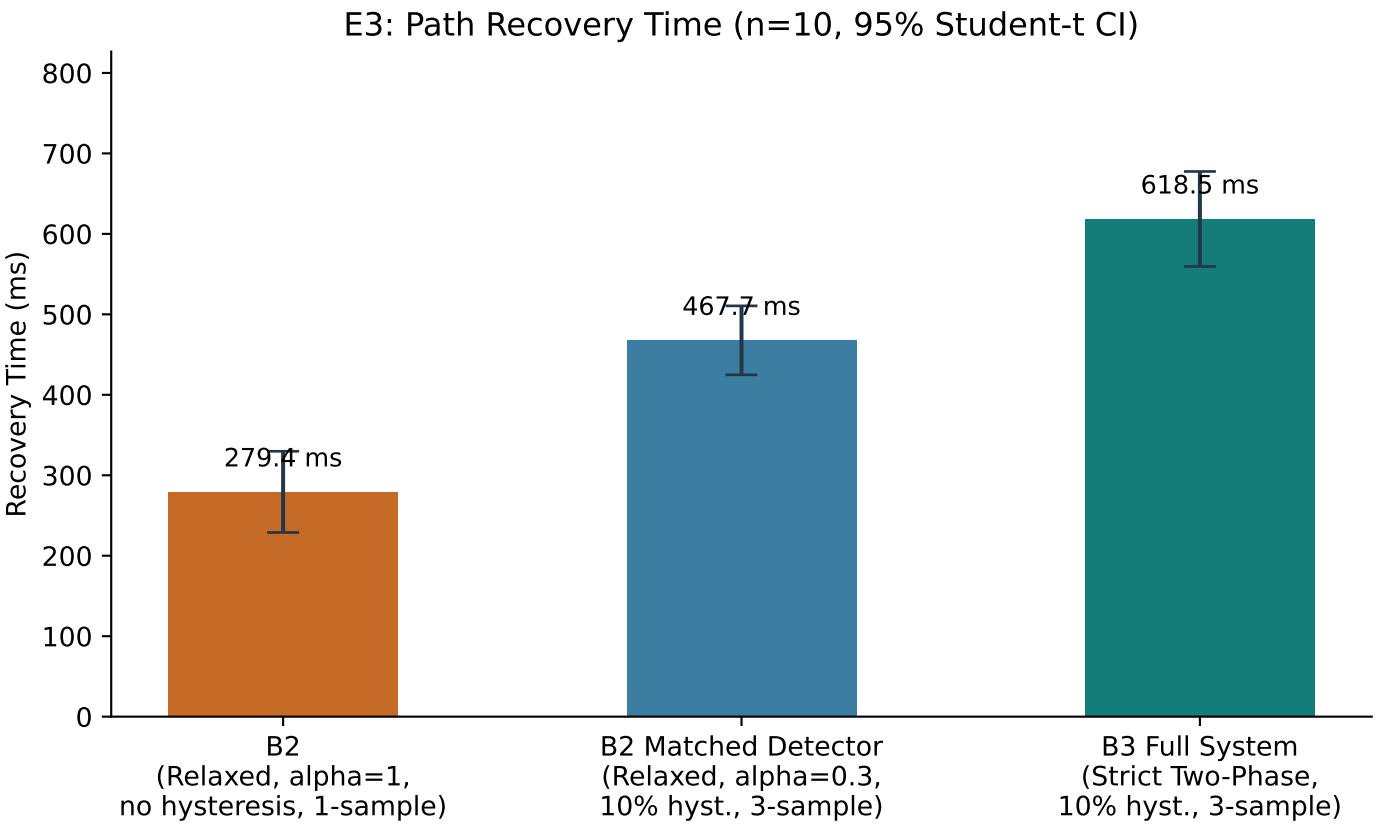
E3: Path Recovery Time (n=10, 95% Student-t CI)
Recovery Time (ms)
0
100
200
300
400
500
600
700
800
279.4 ms
467.7 ms
618.5 ms
B2
(Relaxed, alpha=1,
no hysteresis, 1-sample)
B2 Matched Detector
(Relaxed, alpha=0.3,
10% hyst., 3-sample)
B3 Full System
(Strict Two-Phase,
10% hyst., 3-sample)