Randomized BB84 · commissioning diagnostic
38,744 selected photons · gate 50–80 ns · trial alignment UNVERIFIED

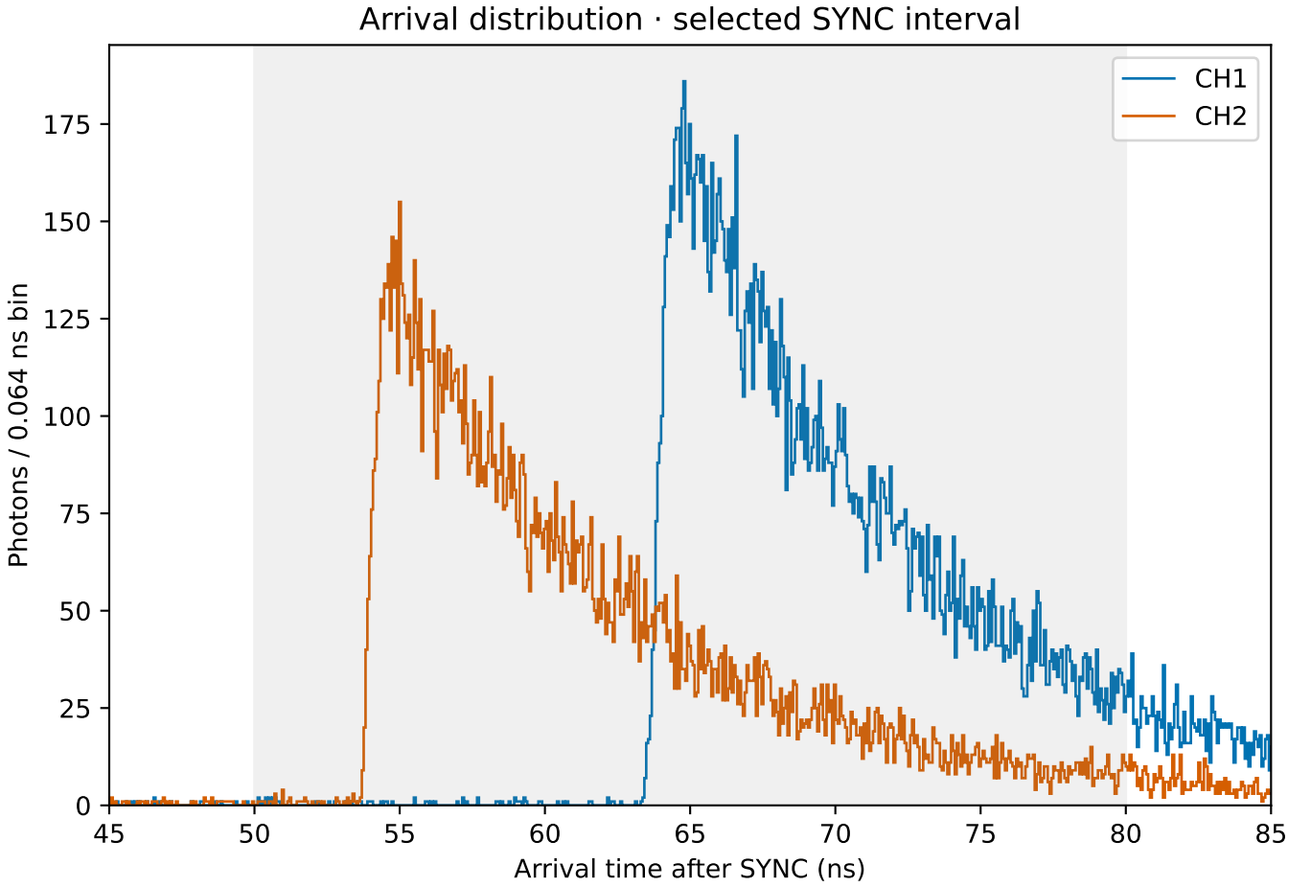

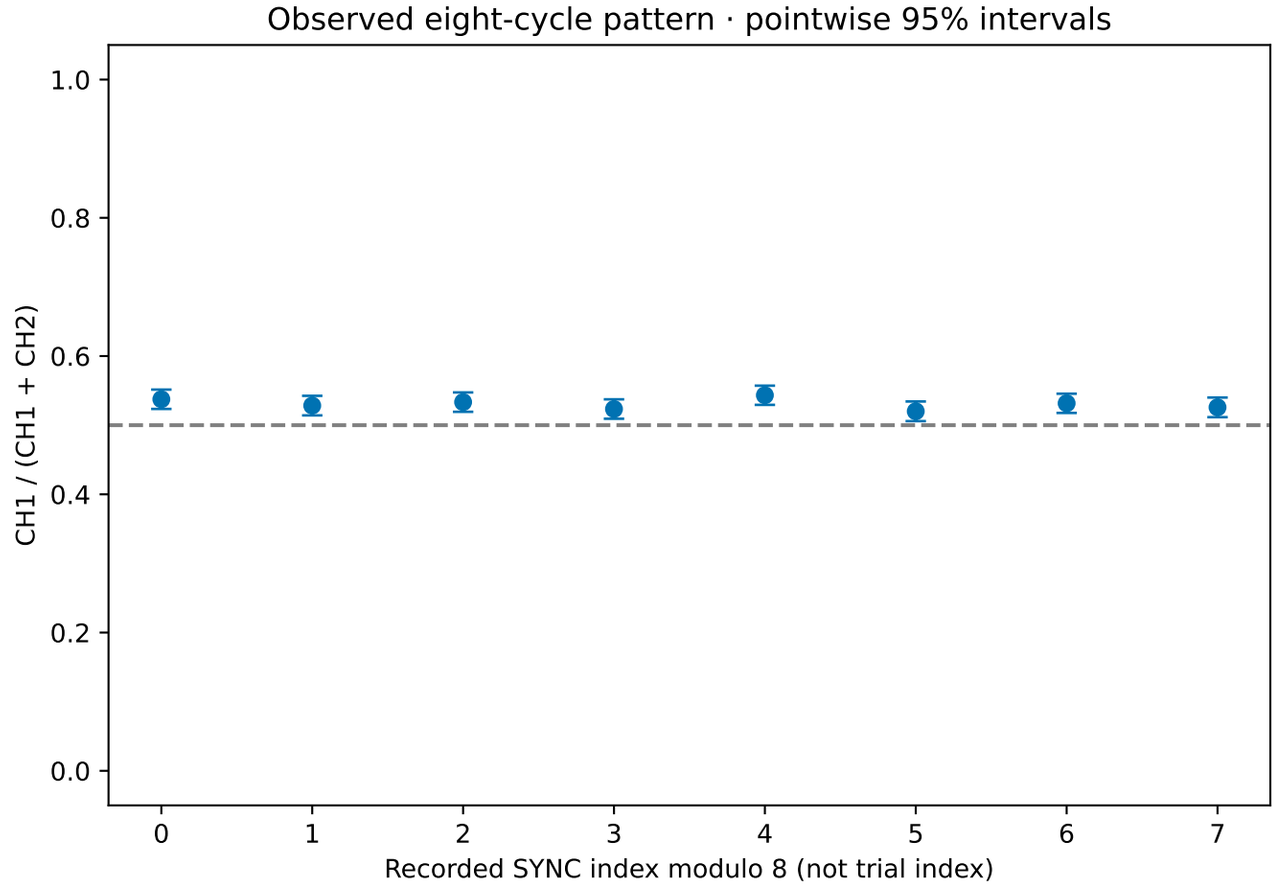

Randomized run: no trial origin supplied.

Arrival and phase diagnostics only.
State fidelity requires independently established
SYNC-to-trial correspondence and saved choices.

Assumed CH1 outcomes: HV→V, RL→L. Physical labels provisional. No background/efficiency correction.
Phase agreement does not prove trial origin, missing-pulse integrity, QBER, or secure-key performance.