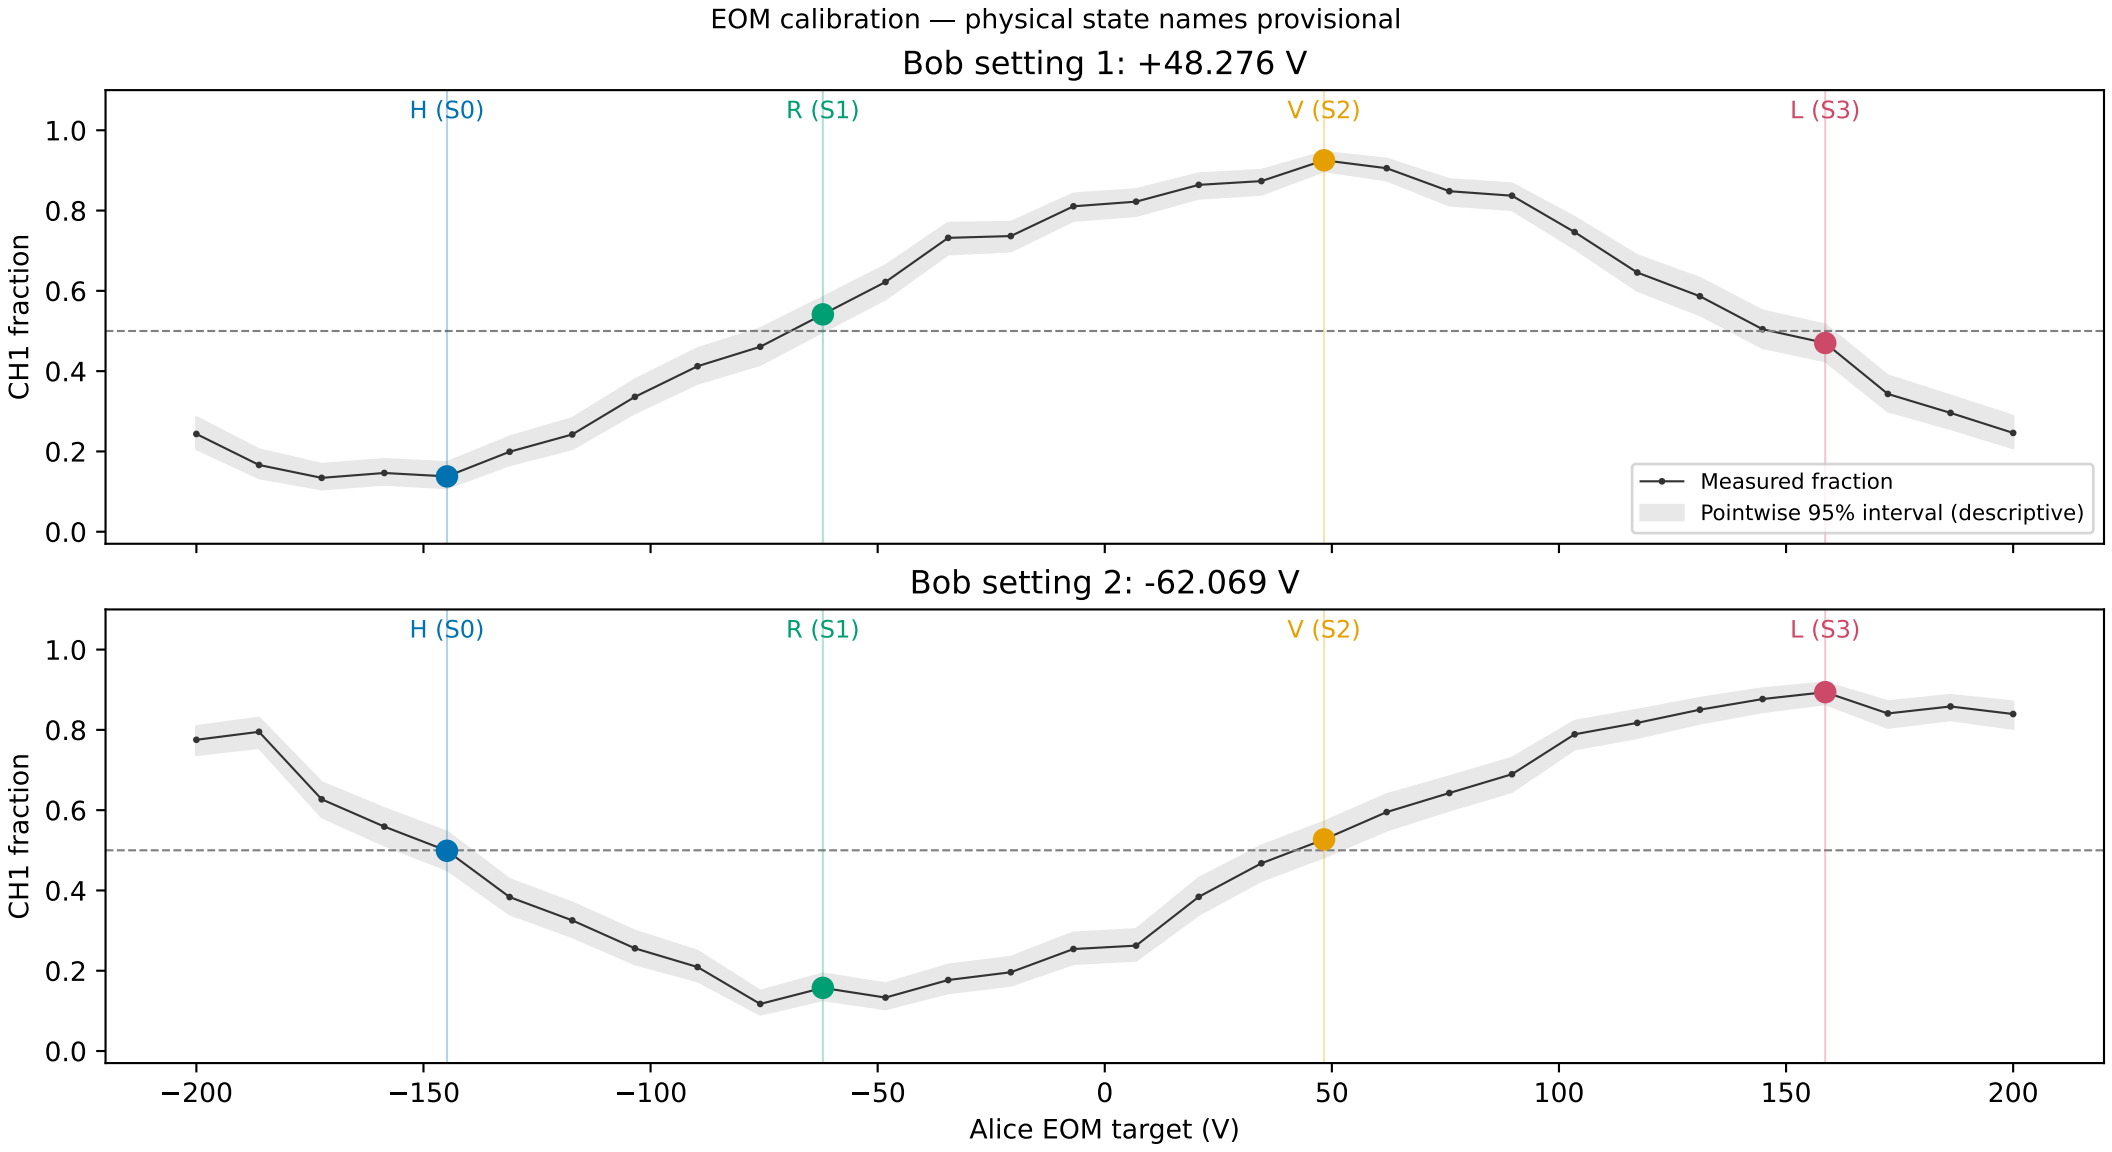
EOM calibration — physical state names provisional
Bob setting 1: +48.276 V
H (S0)
R (S1)
V (S2)
L (S3)
CH1 fraction
Measured fraction
Pointwise 95% interval (descriptive)
Bob setting 2: -62.069 V
Alice EOM target (V)