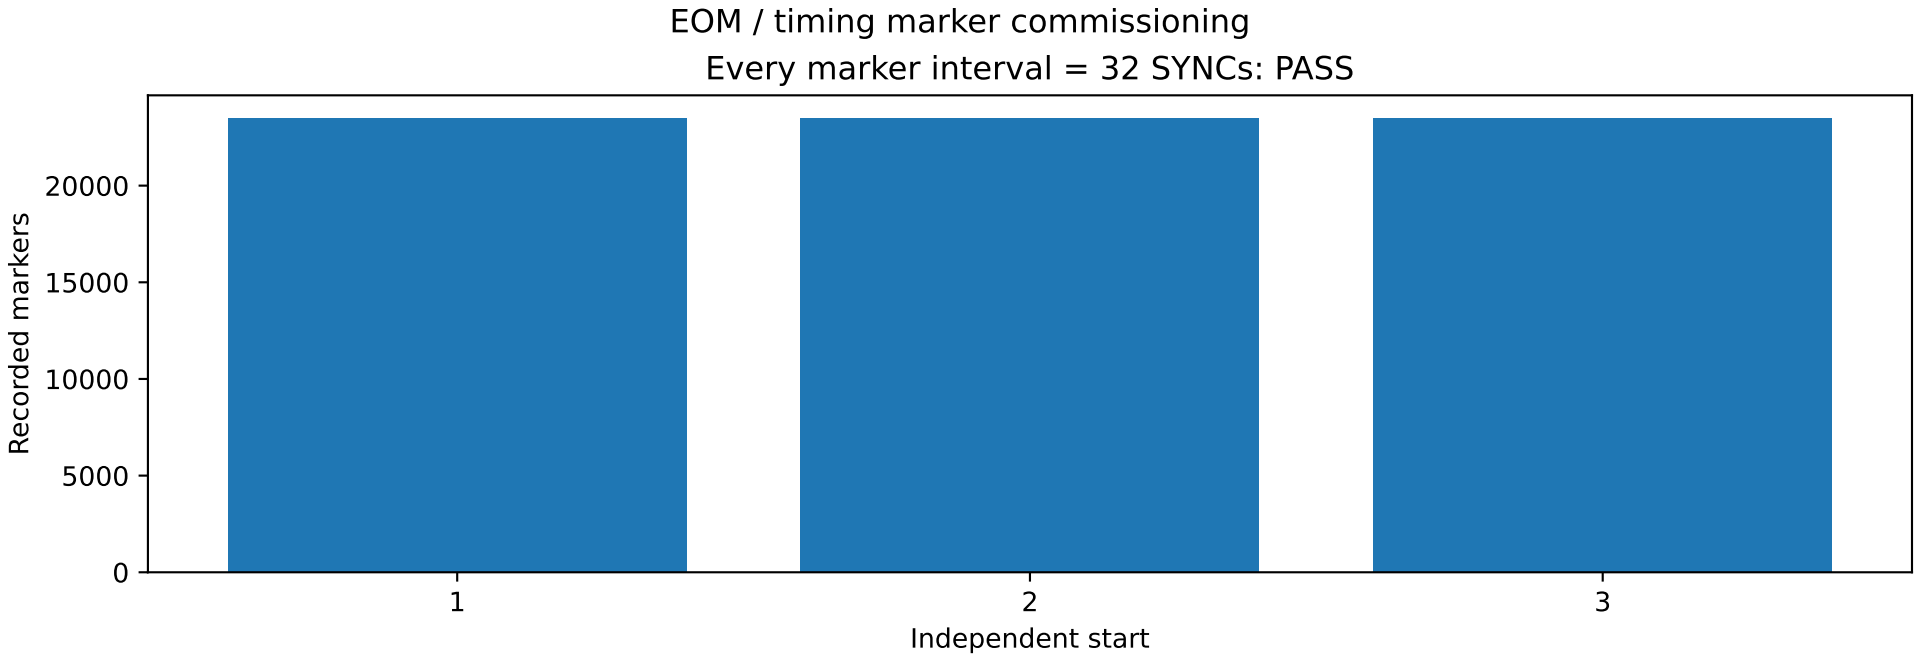
EOM / timing marker commissioning
Every marker interval = 32 SYNCs: PASS
Recorded markers
0
5000
10000
15000
20000
1
2
3
Independent start

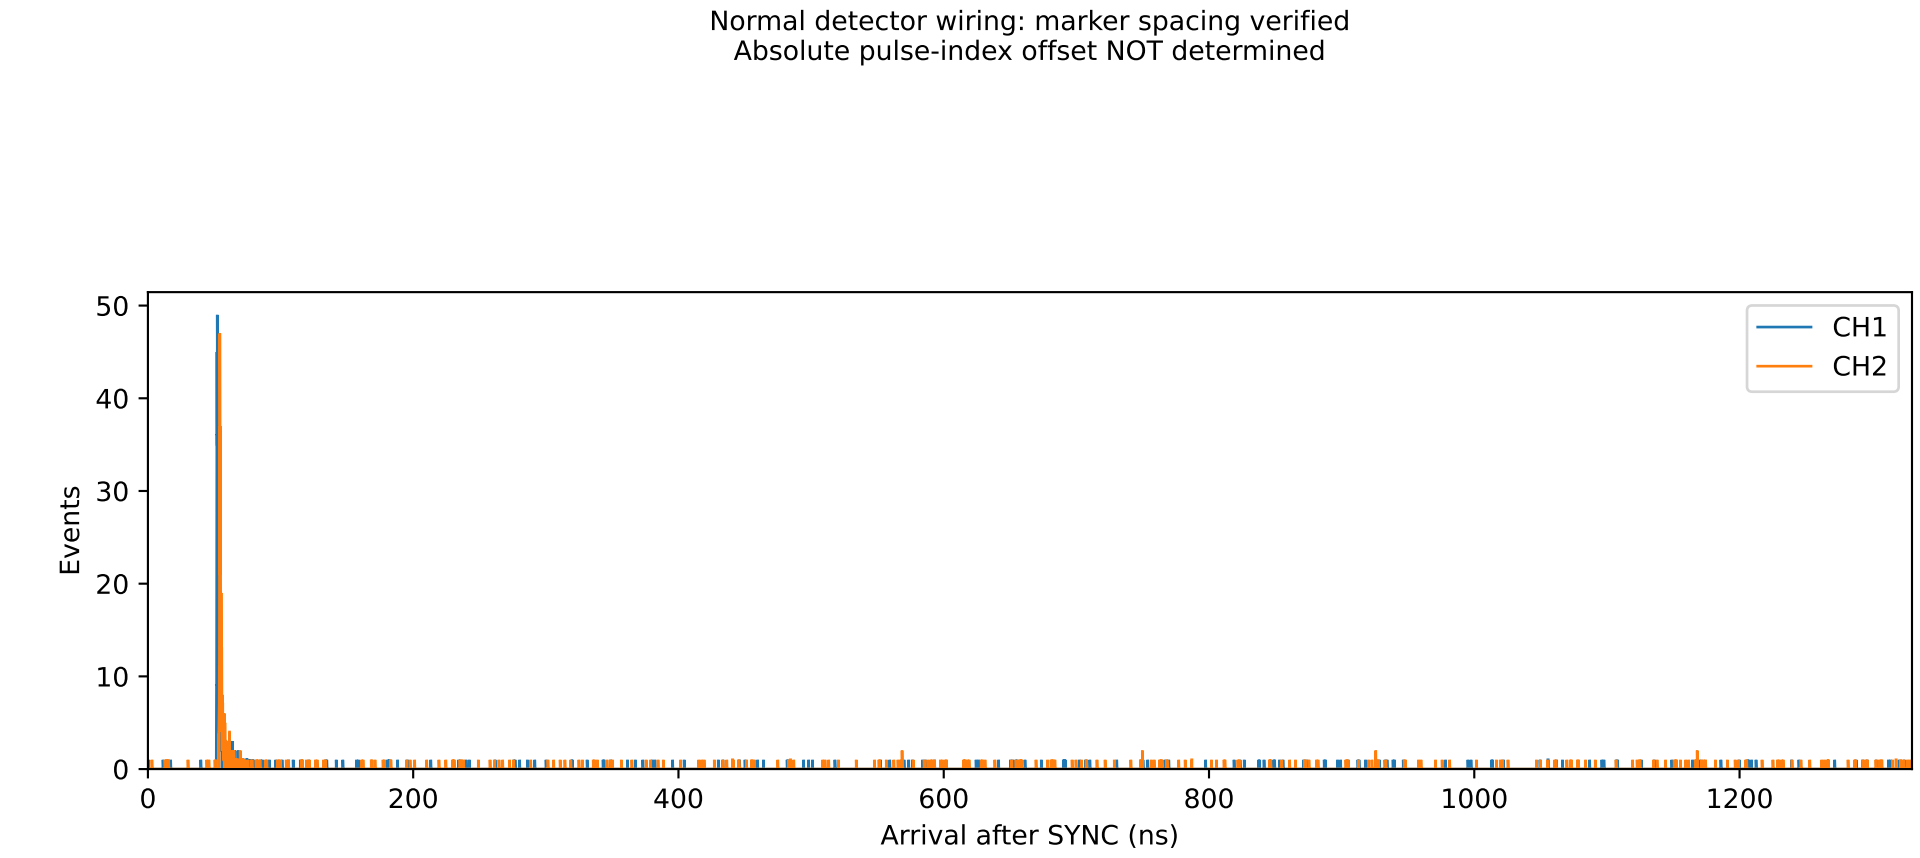
Normal detector wiring: marker spacing verified
Absolute pulse-index offset NOT determined
Events
0
10
20
30
40
50
0
200
400
600
800
1000
1200
Arrival after SYNC (ns)
CH1
CH2