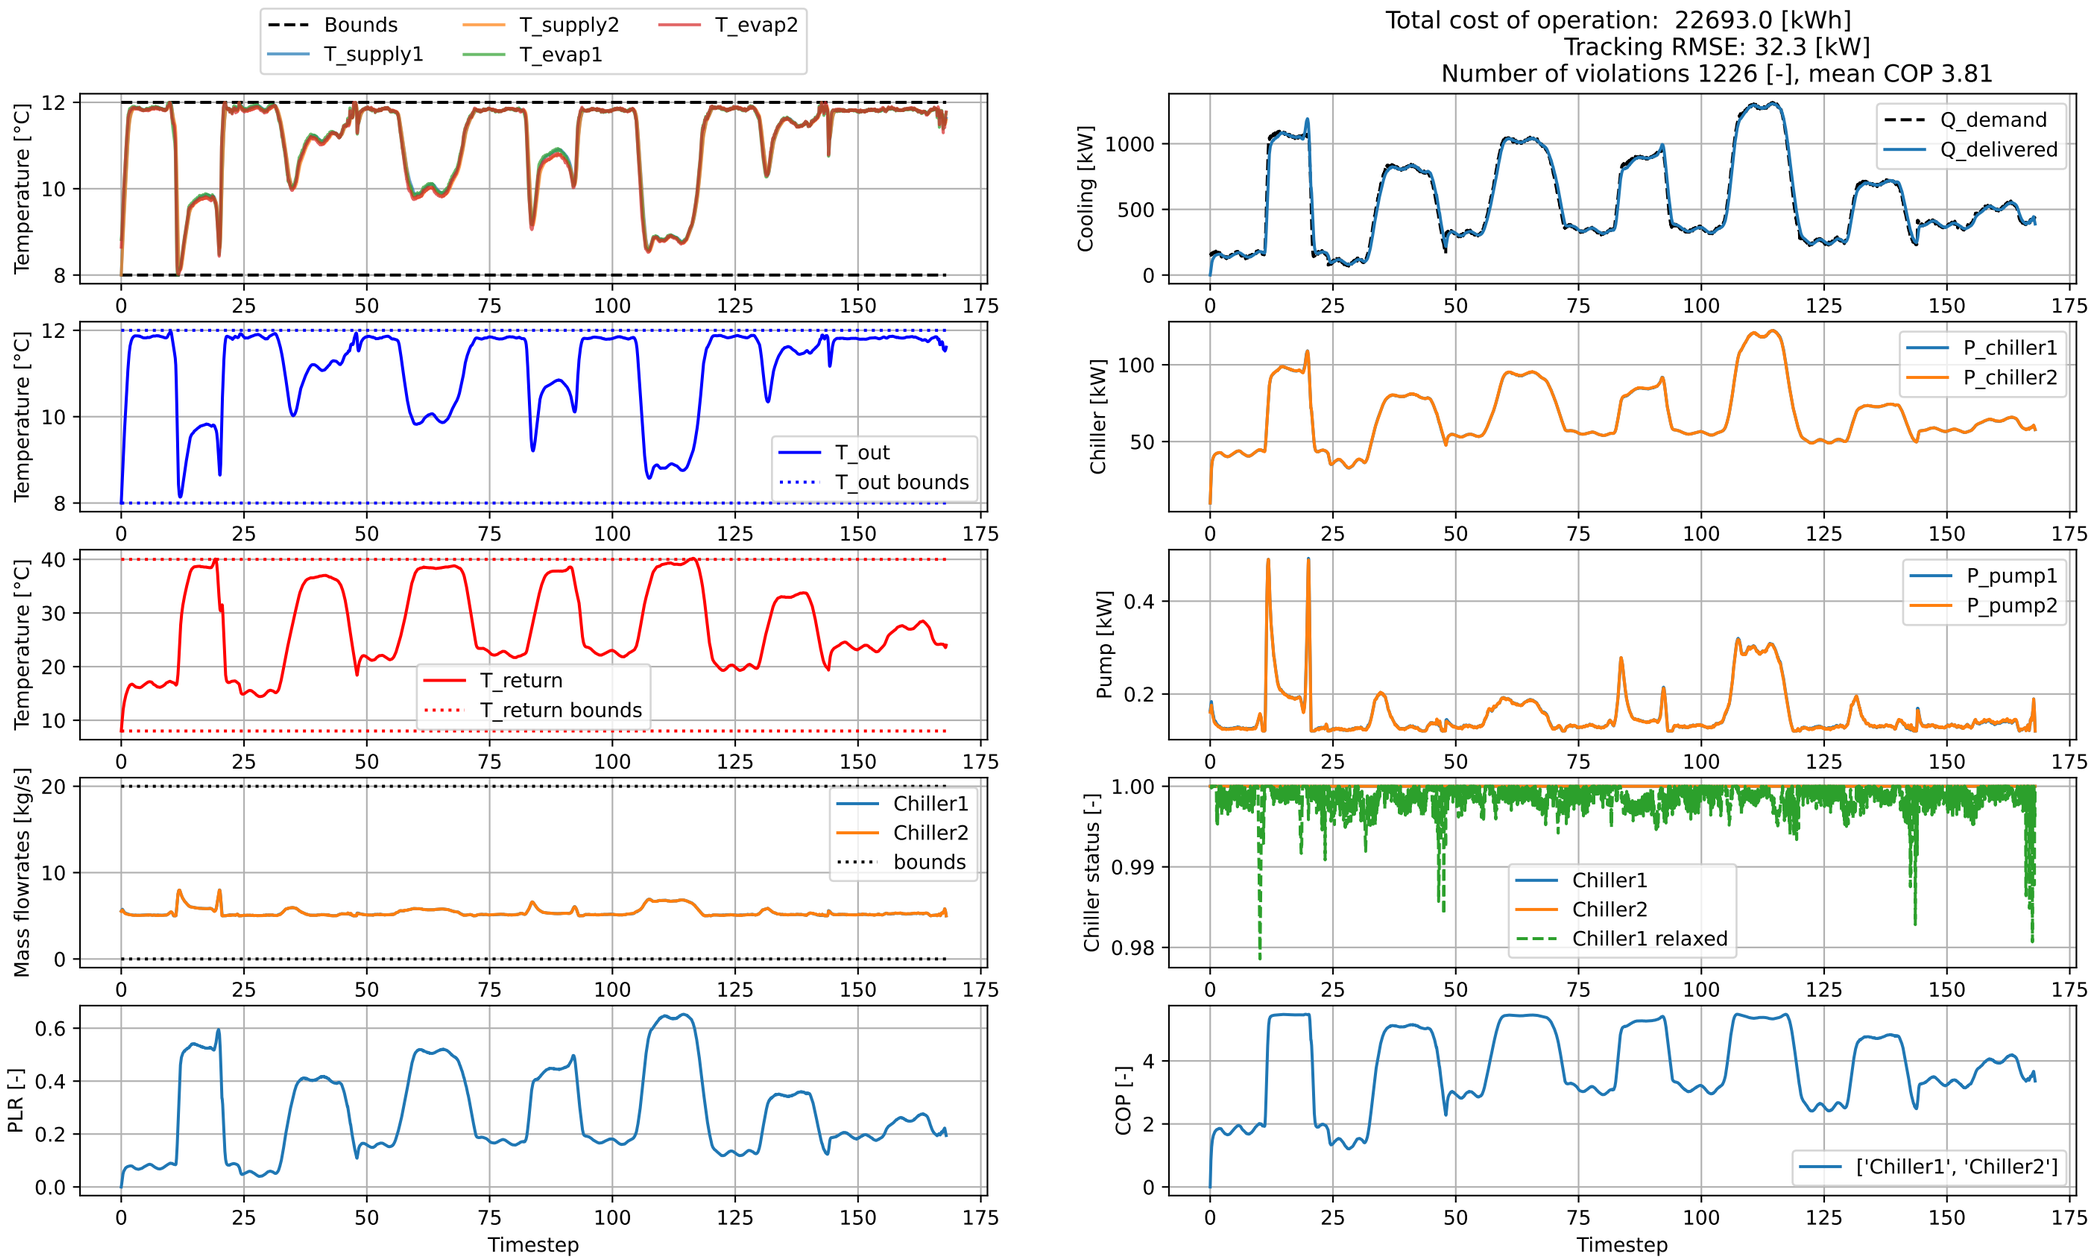
Bounds
T_supply1
T_supply2
T_evap1
T_evap2
Temperature [°C]
T_out
T_out bounds
T_return
T_return bounds
Mass flowrates [kg/s]
Chiller1
Chiller2
bounds
PLR [-]
Timestep
Total cost of operation: 22693.0 [kWh]
Tracking RMSE: 32.3 [kW]
Number of violations 1226 [-], mean COP 3.81
Cooling [kW]
Q_demand
Q_delivered
Chiller [kW]
P_chiller1
P_chiller2
Pump [kW]
P_pump1
P_pump2
Chiller status [-]
Chiller1
Chiller2
Chiller1 relaxed
COP [-]
['Chiller1', 'Chiller2']
Timestep