


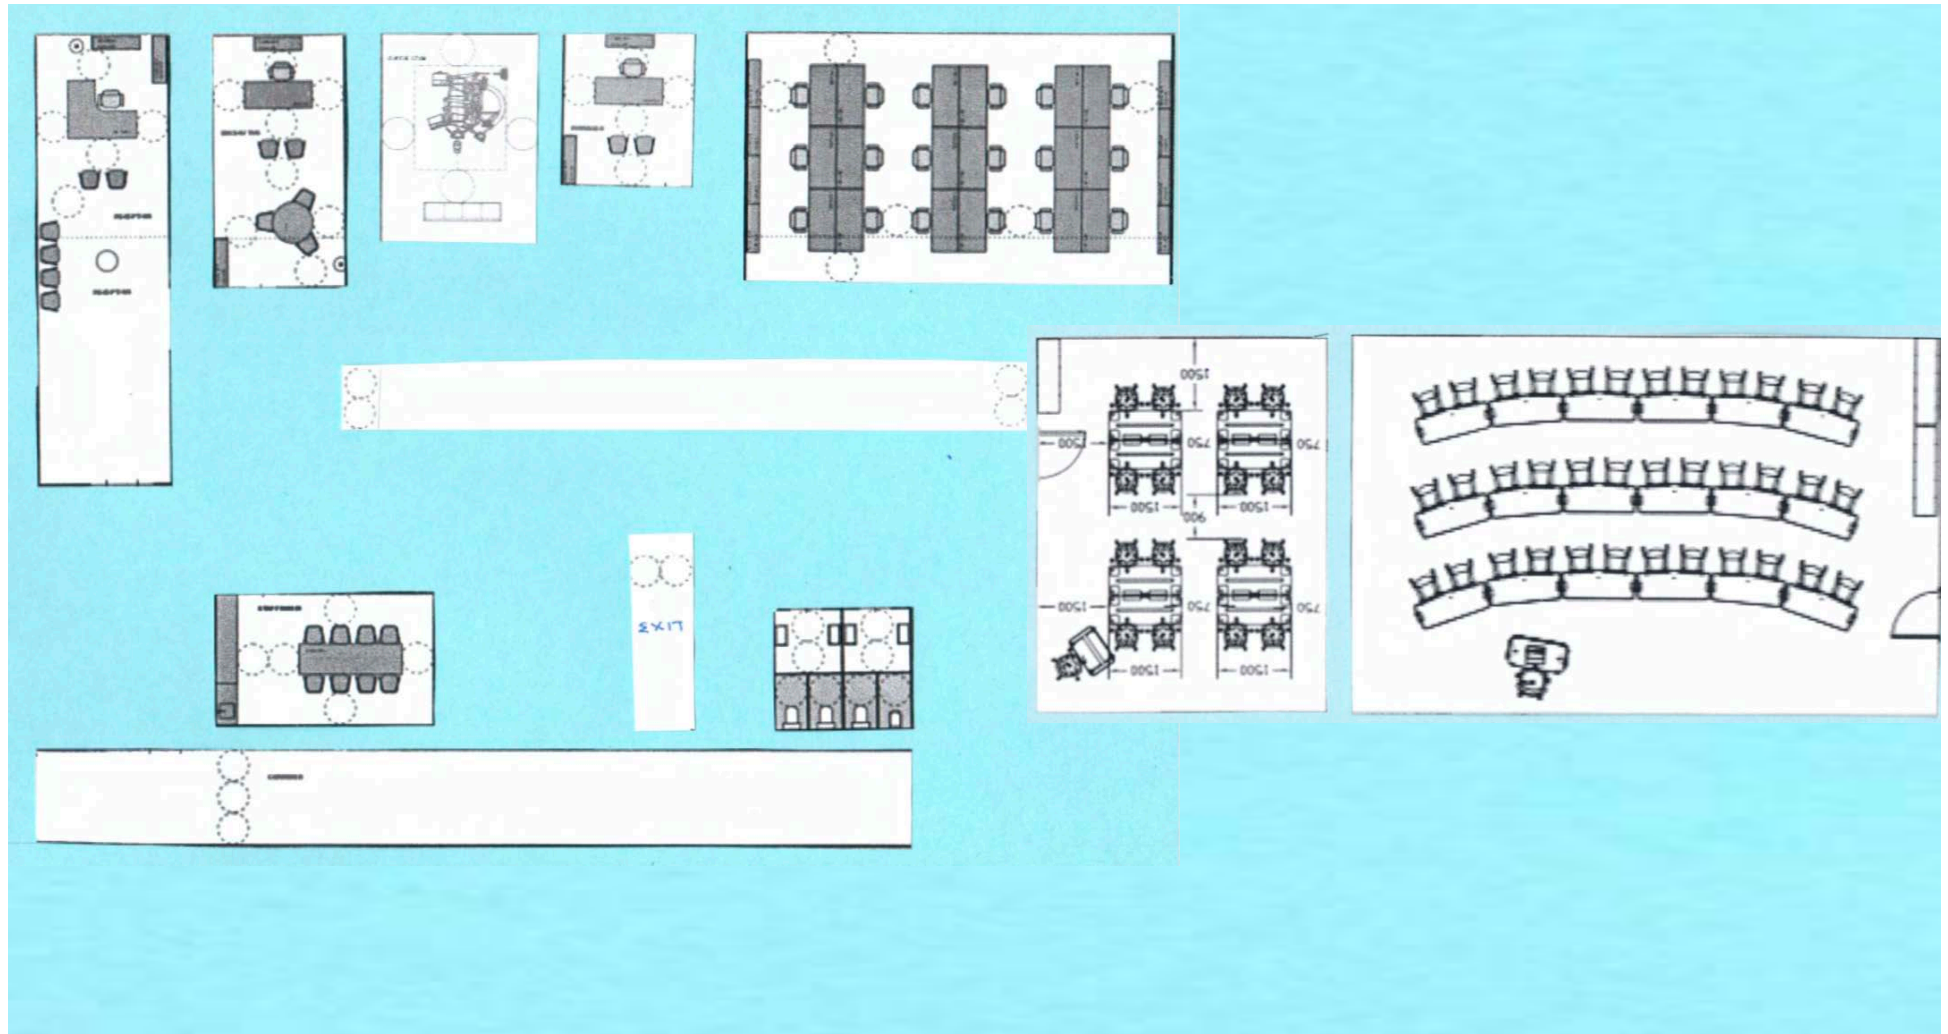


MW3:

MW: Here we can see that the Spatial Taxonomy related to the “Reception” is similar to that of the full-width laboratory with a “Clean Room” or the “Auditorium” for the Professional Office – Academic and the “Court Room” for the Professional Office – Civic.

Professional Office — Business Small

SKETCH 2

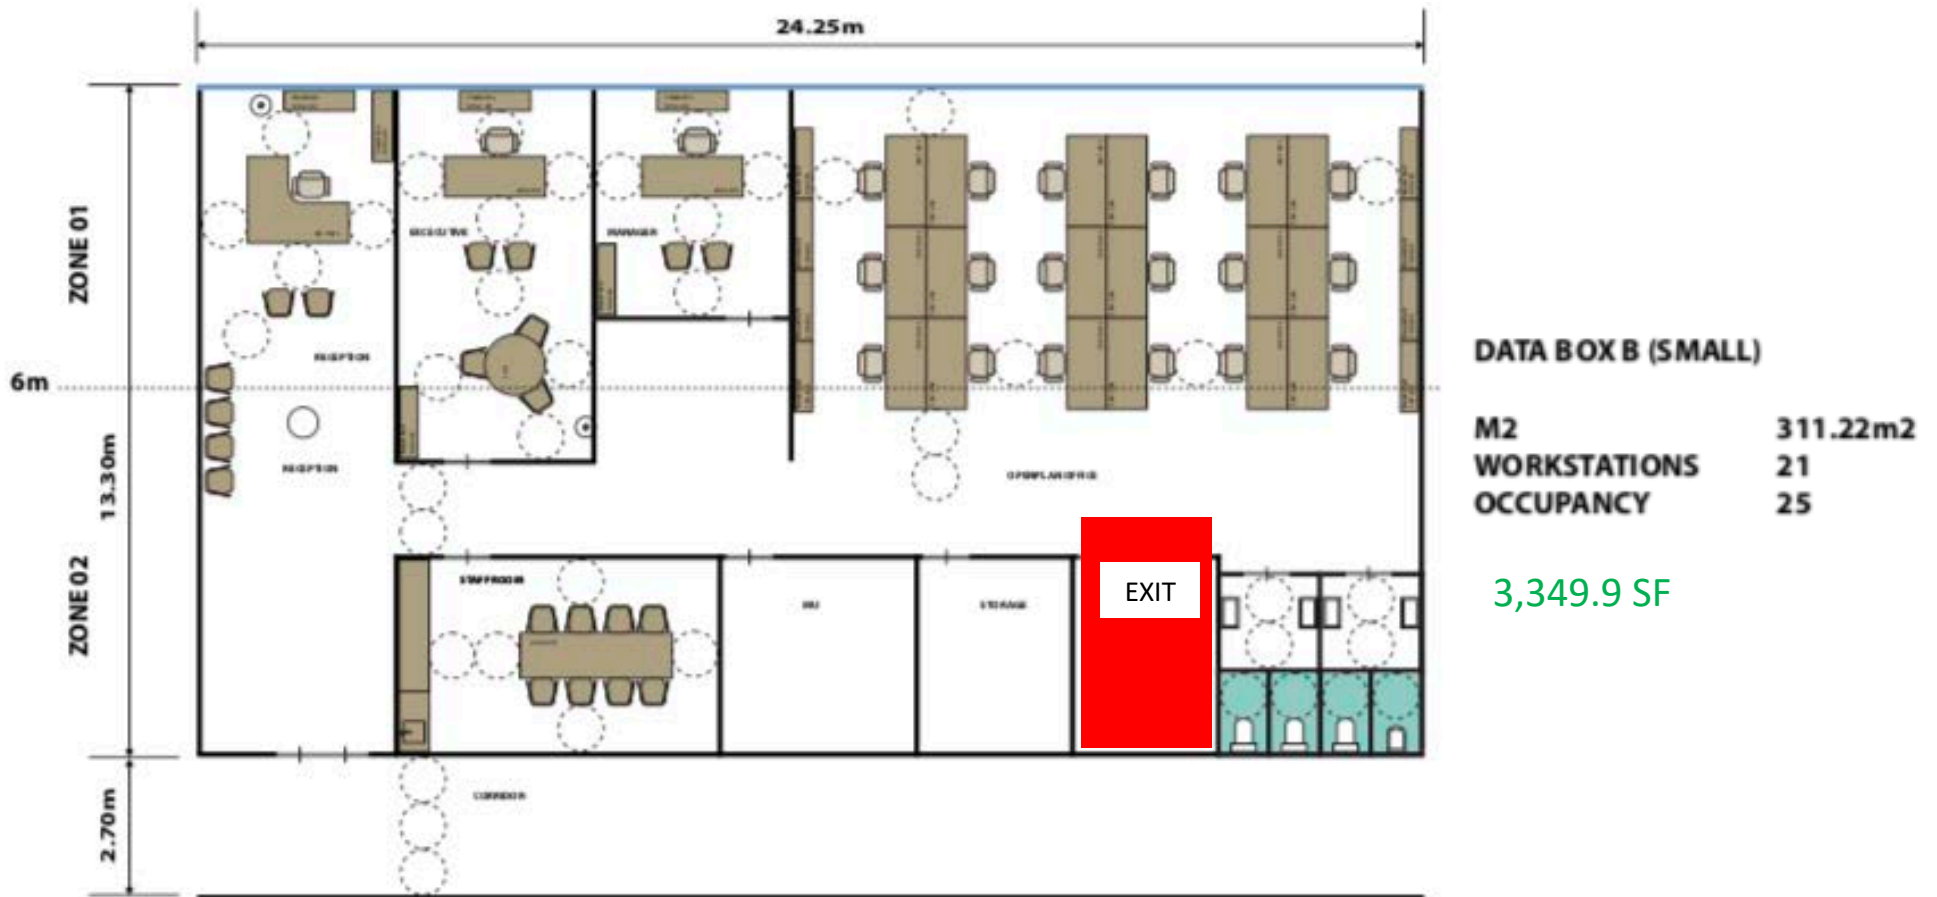

MW3:

MW: It may be worth adding a Restroom to the Professional Office — Business (Small) in order to take pressure off the Local Codes with regard to the capacity of the Building Core Washrooms.


MW: Also, having a Washroom with the Professional Office — Business (Small) would allow us to present the scaling of the Washroom required over the three samples: small, medium, and large.

MW: The addition of the Washroom is a deviation from the original outline that we sent as part of the "Key Plans — Small, Medium, and Large" email.


NOTES V3

** Blue = unallocated and/or inefficient space

Option A

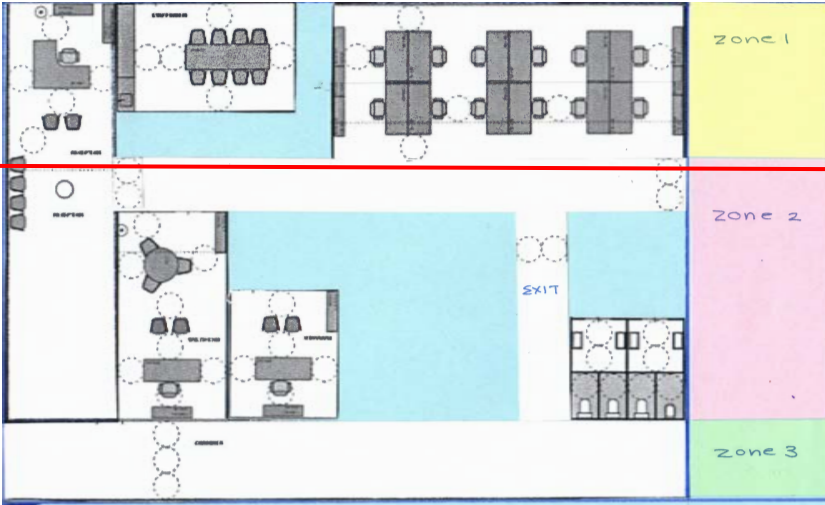

Option B (Sketch 2)

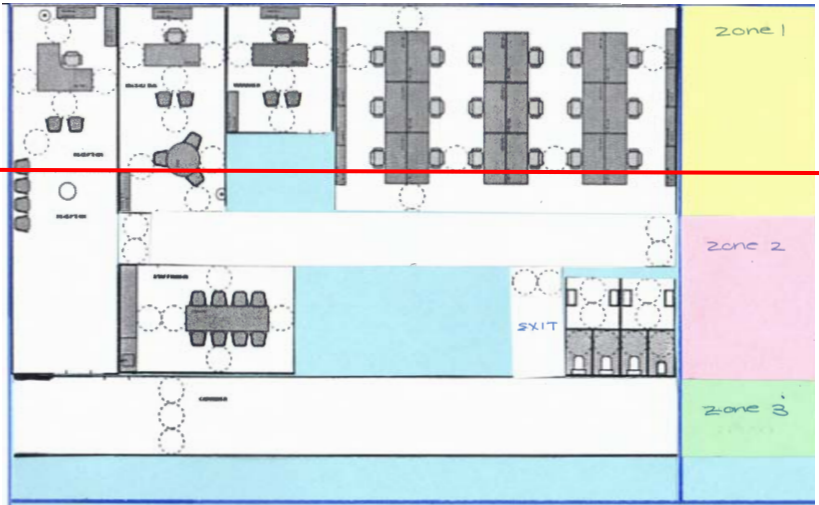


6.0 meters


	Option A	Option B (Sketch 2)
Workstations:	15 30.0 m ² per person 323.3 SF per person	21 19.0 m ² per person 204.7 SF per person
Occupancy:	34 13.2 m ² per person 142.6 SF per person	42 9.5 m ² per person 102.3 SF per person
Zone 1 — Habitat	5.51 m	7.39 m
Zone 2 — Magazine	9.26 m	6.76 m
Zone 3 — Corridor	2.75 m	2.75 m
Total	17.52 m	16.90 m
Square footage	450.7 m ² 4,850 SF	399.6 m ² 4,300 SF

** Blue = unallocated and/or inefficient space

Option C

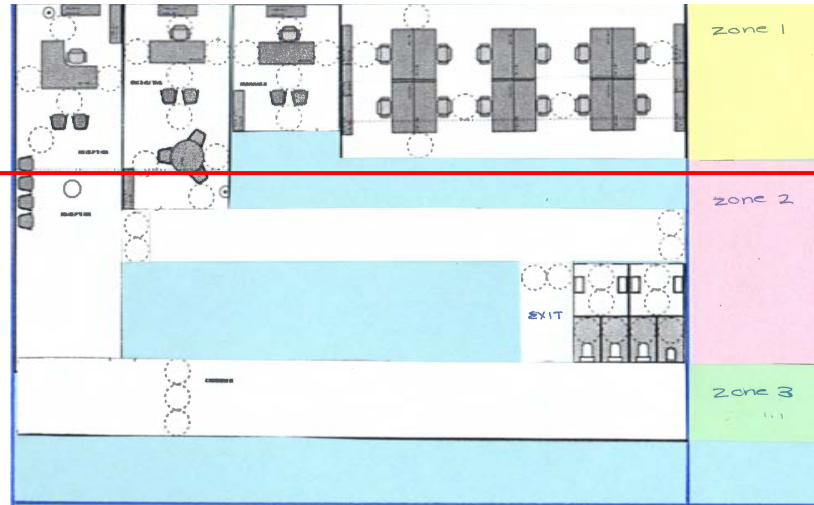

Option D

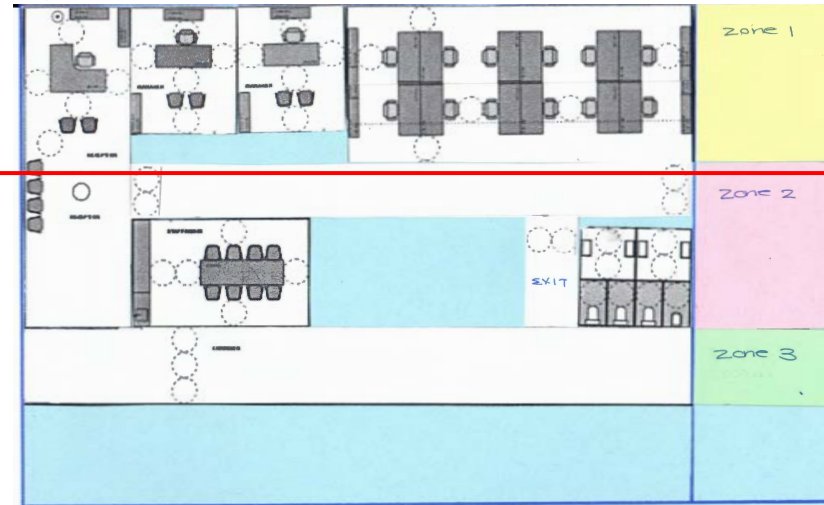

6.0 meters

	Option C	Option D
Workstations:	15 23.0 m ² per person 247.8 SF per person	15 22.6 m ² per person 243.6 SF per person
Occupancy:	28 12.3 m ² per person 132.7 SF per person	33 10.2 m ² per person 110.72 SF per person
Zone 1 — Habitat	5.63 m	5.51 m
Zone 2 — Magazine	6.63 m	5.76 m
Zone 3 — Corridor	2.75 m	2.75 m
Total	15.01 m	14.02 m
Square footage	345.5 m ² 3,718 SF	339.5 m ² 3,654 SF


Building Width Options

Façade Frontage										
Zone 1 — Habitat	5.51	5.63	5.63	7.39	5.51	7.39	5.51	7.39	5.51	5.51
Zone 2 — Magazine	5.76	6.63	6.63	6.76	9.26	6.76	9.26	6.76	9.26	9.26
Zone 3 — Corridor	2.75	2.75	2.75	2.75	2.75	2.75	2.75	2.75	2.75	2.75
Zone 2 — Magazine	5.76	5.76	6.63	5.51	5.51	6.63	6.63	6.76	6.76	9.26
Zone 1 — Habitat	5.51	5.51	5.63	5.51	5.51	5.63	5.63	7.39	7.39	5.51
Façade Frontage										
Total (m)	25.29	26.28	27.27	27.92	28.54	29.16	29.78	31.05	31.67	32.29
Options	D / D	C / D	C / C	B / D	A / D	B / C	A / C	B / B	A / B	A / A

MW3: Although we do not 100% agree, it would be possible for the combining of the Building Width Options if absolutely required in order to create a more aesthetically pleasing Building Design.

MW3: Options vary from the shortest being 25.29 meters to the longest being 32.29 meters.

MW3: Any empty Zone 2 — Magazine area that is unallocated will give the opportunity for Interior Design to create Informal Areas and storage to support the occupancy.

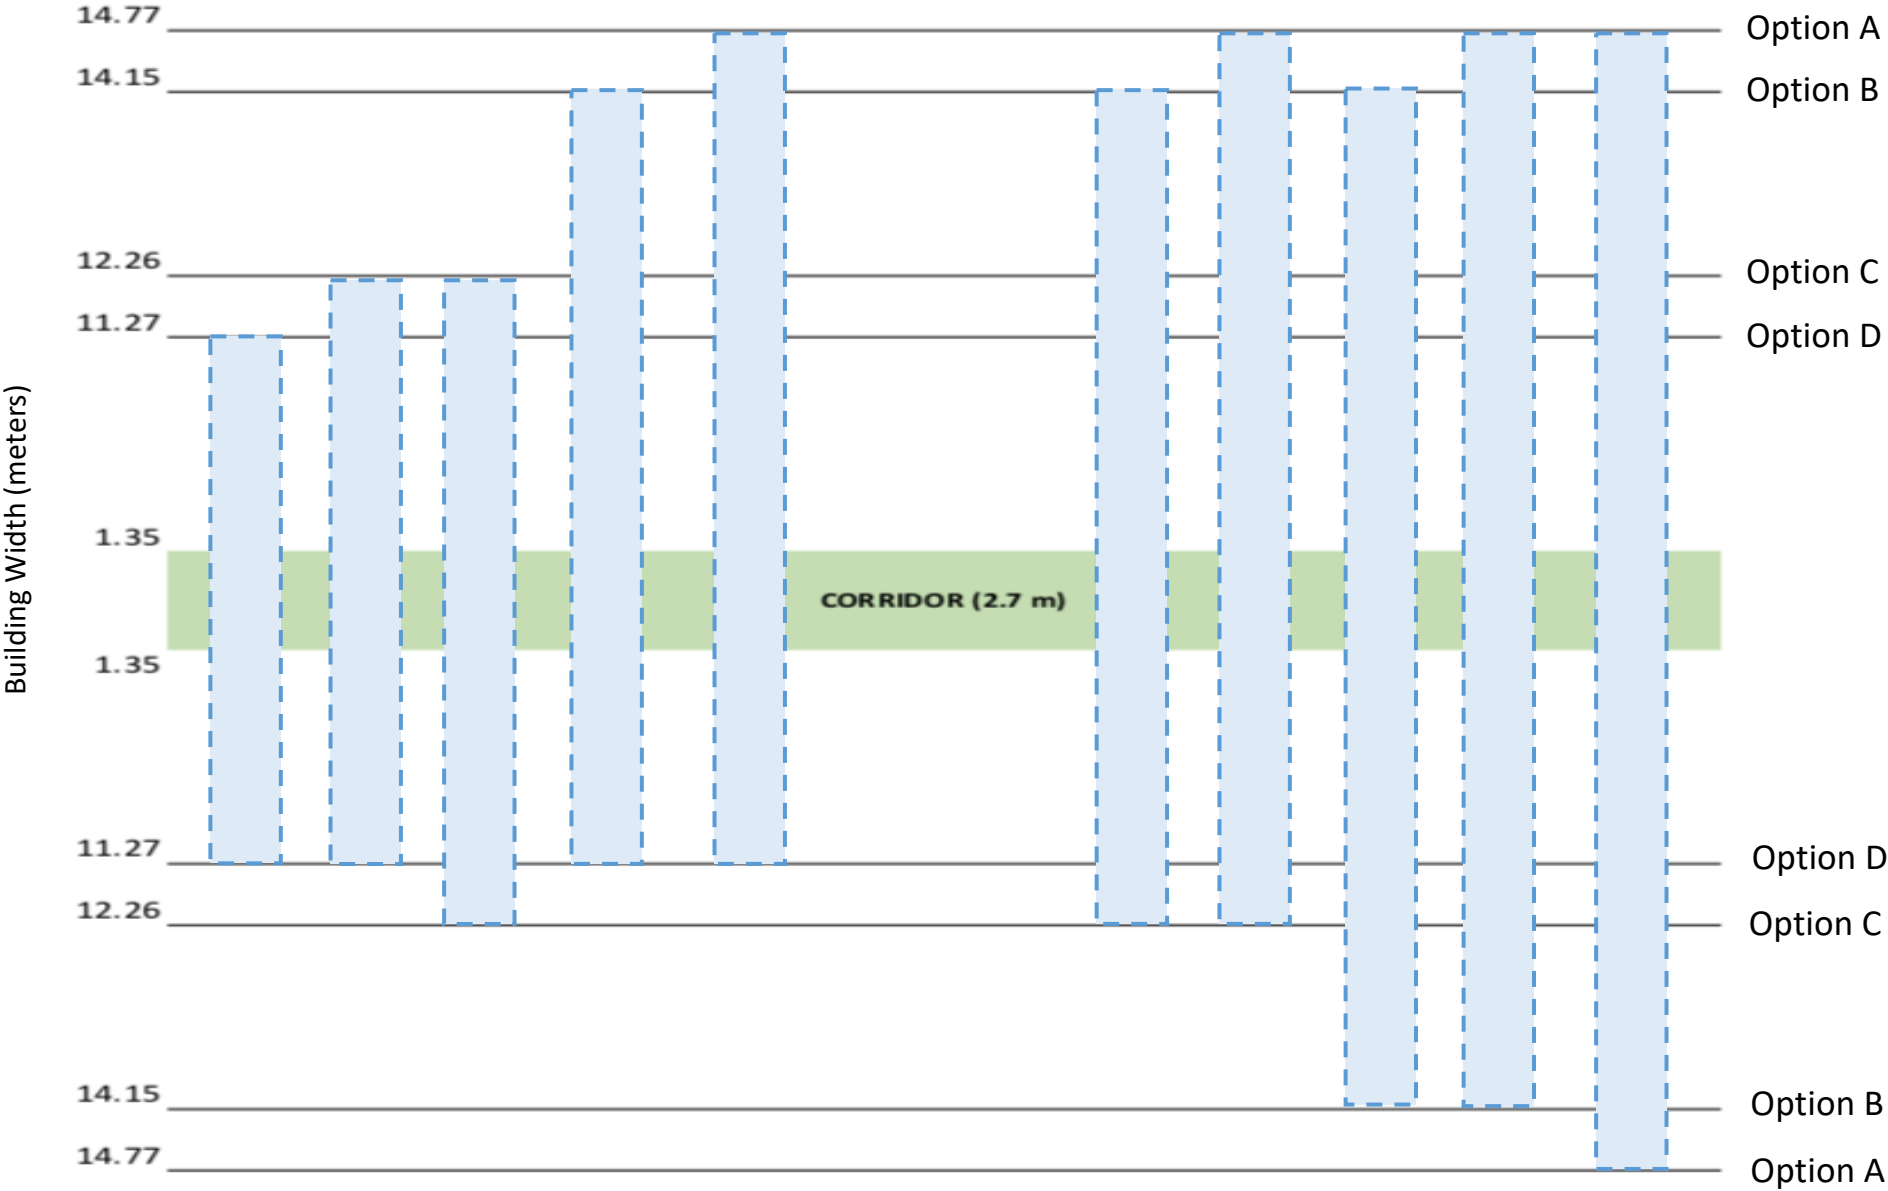

MW3:

MW: It is often suggested that 6.0 meters can be the mechanism for the provision of Natural Light, which we agree with, but as these Sketches hopefully point out, the 6.0 meters must be taken in conjunction with the functionality of the Use Cases which are determined by their furniture arrangements.

MW: The final Building Width Calculator and the furniture arrangements it represents should take into consideration the potential for Tenants who require their own Building Certification within their leaseholds as National Tenants looking for Class-A Building specifications in the Regional Markets.

MW: It can be seen here that Zone 1 – Habitat and Zone 2 – Magazine are not necessarily fixed after the Building Width Calculator has been established. Tenants should find it easy to position enclosed offices at the Facade Frontage or push them back into Zone 2 – Magazine while maintaining their furniture arrangements and circulation.

MW: The big difference between Option A and Option B (Sketch 2) is how much of the 6.0 meters of the Natural Light is captured by either Zone 1 – Habitat or Zone 2 – Magazine.

MW: Option D highlights the case when we would need to trim the Building Width Calculator in order to provide greater building aesthetics or as may be required to bring the overall area of the Fixed Floor Plates in line (Professional Centres at approximately 19,000 SF to 23,000 SF and Suburban Office at approximately 17,000 SF to 21,000 SF).

MW: Under Option C there is less flexibility to adjust the sizing of either Zone 1 – Habitat or Zone 2 – Magazine for the potential Tenants.

MW: Under Option D we lose the ability to maintain the “Executive Office,” which is interesting. At a later time, we need to check if the “Dentist Chair” still works well with the Building Width Calculator.

MW: As well, Option D also reduces the width available to the Building Core, being an Offset Pulled Back Building Core.




DATA BOX C (MEDIUM)	
M2	399.66m2
WORKSTATIONS	21
OCCUPANCY	25

4,301.90 SF

Professional Office — Business Large

SKETCH 4

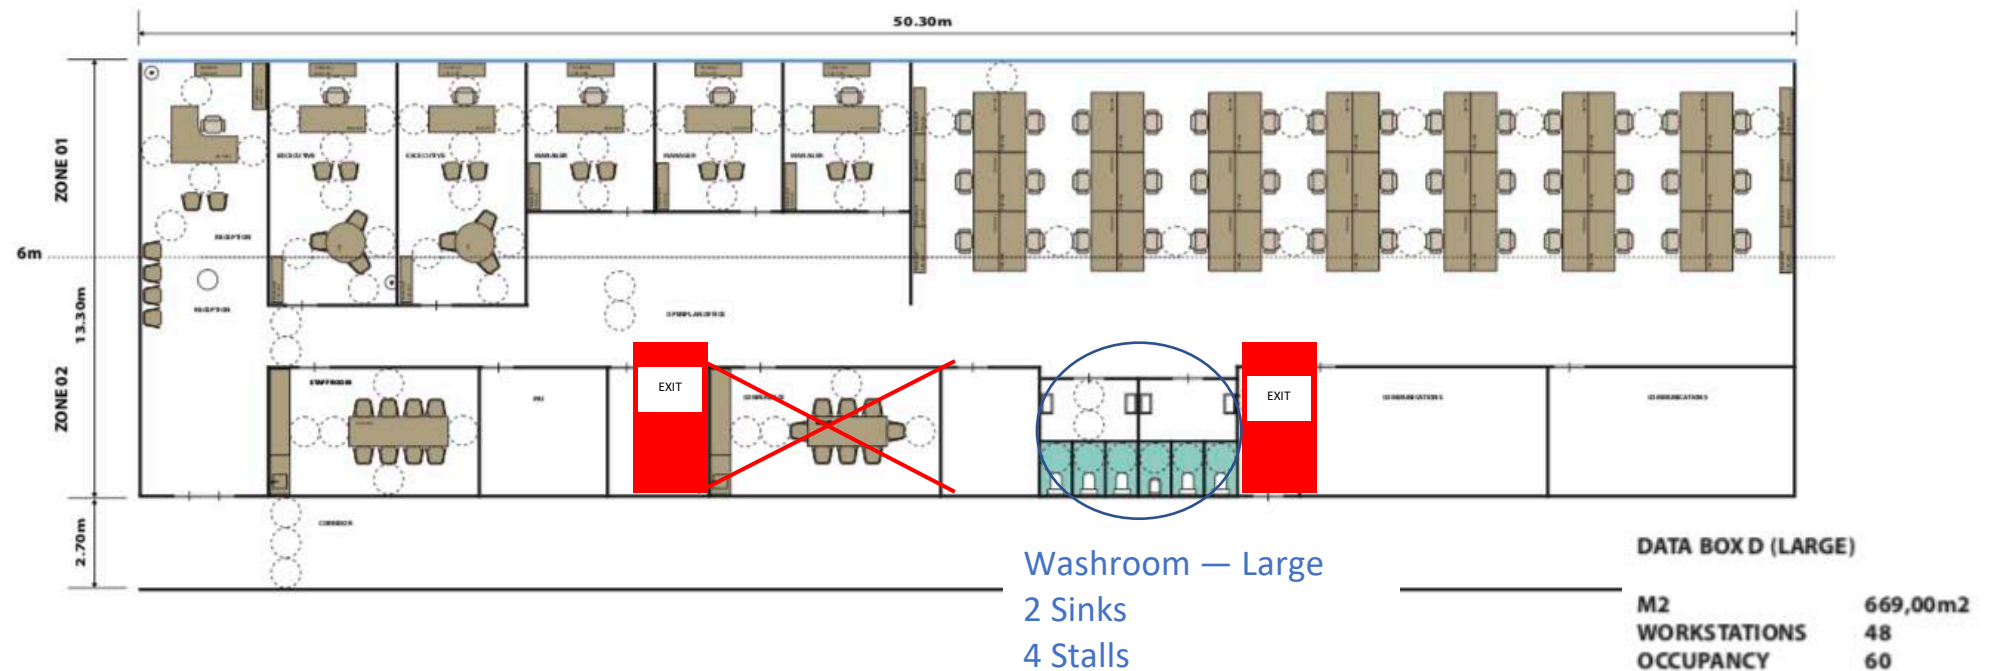

MW3:

7,523.97 SF


MW: It is critical to lay out the full 7 rows of “Workstations” so that we can compare to the sizing of the “Auditorium” for the Professional Office – Academic, which is similar to the “Court Room” for the Professional Office – Civic.

MW: Yes. Each of the Key Plans for Small, Medium, and Large for all of the Use Cases we are examining are too large — Business, Academic, Laboratory, Medical, and Civic.


MW: However, it would be best to complete the set as prescribed in that we can still compare apples to apples in terms of how the furniture morphs the leaseholds across the Use Cases, as scaling down is not so much an issue when the transformations are known. At this point all the Key Plans are too Large. That will be something to be addressed at a later time.

NOTES V3


Tenant Washroom — Small (2 Stalls)

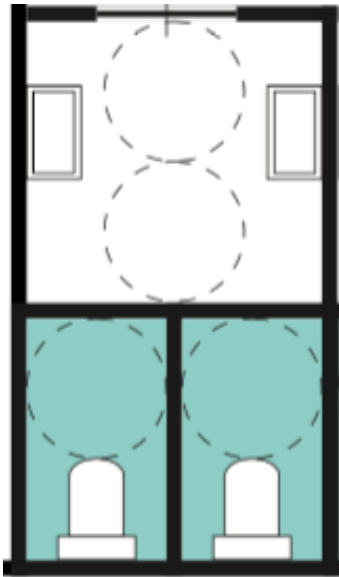


Option A

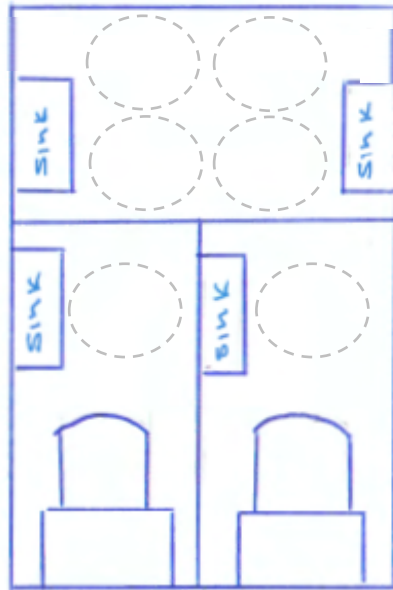


Option B

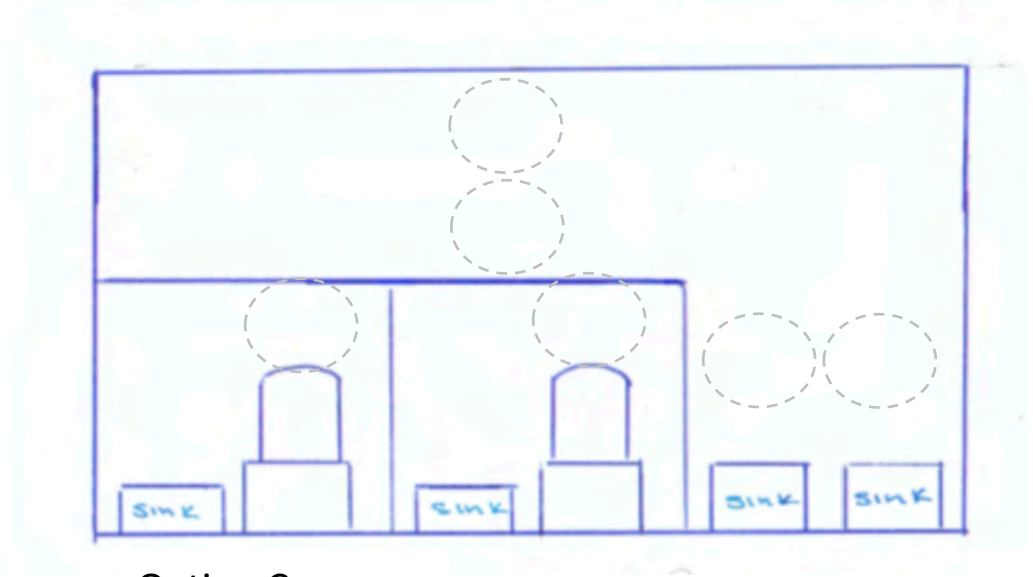

Option C

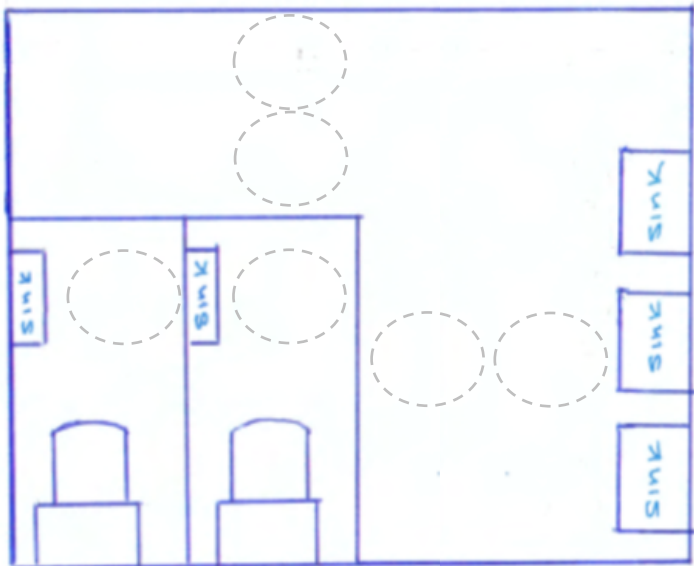

Option D

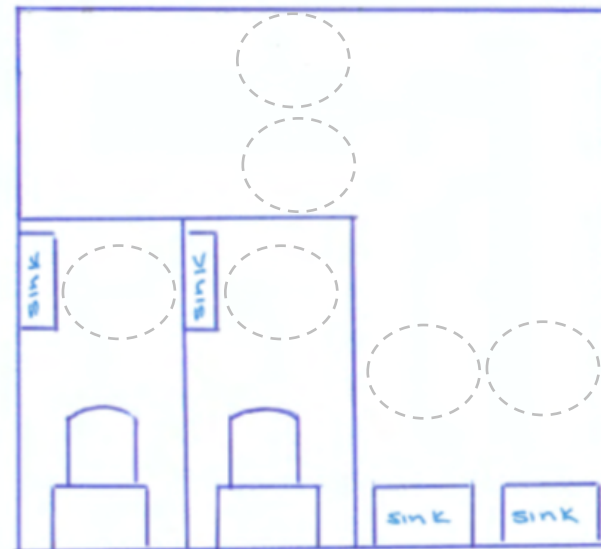

Option E

Tenant Washroom — Small (2 Stalls)

MW3: In relation to the Tenant Washrooms and the Building Width Calculator, the idea is to find the minimum width required to carry full-size stalls with sinks and a vestibule, which can be contained in Zone 2—Magazine.

MW3: The minimum width of Zone 2—Magazine corresponds to either the minimum width of the Staff/Conference Room or the minimum width of the Tenant Washrooms when fully accounting for proper furniture specifications/dimensions and circulation.