System Advisor Model Report

Detailed Photovoltaic	12 DC kW Nameplate	33.45, -111.98
Commercial	$5.94/W Installed Cost	UTC -7

Performance Model

Modules	
LONGi Green Energy Technology Co. Ltd. LR4-72HPH-44	
Cell material	Mono-c-Si
Module area	2.12 m²
Module capacity	445.21 DC Watts
Quantity	26
Total capacity	11.58 DC kW
Total area	55 m²

Inverters	
SMA America: SB7.7-1TP-US-40	
Unit capacity	7.76 AC kW
Input voltage	270 - 480 VDC DC V
Quantity	1
Total capacity	7.76 AC kW
DC to AC Capacity Ratio	1.49
AC losses (%)	0.00

Array	
Strings	2
Modules per string	13
String Voc (DC V)	638.30
Tilt (deg from horizontal)	8.00
Azimuth (deg E of N)	180
Tracking	no
Backtracking	-
Self shading	no
Rotation limit (deg)	-
Shading	no
Snow	no
Soiling	yes
DC losses (%)	4.44

Performance Adjustments	
Availability/Curtailment	none
Degradation	none
Hourly or custom losses	none

Annual Results (in Year 1)	
GHI kWh/m²/day	5.79
POA kWh/m²/day	144.00
Net to inverter	21,090 DC kWh
Net to grid	19,530 AC kWh
Capacity factor	19.3
Performance ratio	0.75

Financial Model

Project Costs	
Total installed cost	$68,735
Salvage value	$0

Analysis Parameters	
Project life	25 years
Inflation rate	2.5%
Real discount rate	6.4%

Project Debt Parameters	
Debt fraction	100%
Amount	$68,735
Term	25 years
Rate	4%

Tax and Insurance Rates	
Federal income tax	21 %/year
State income tax	7 %/year
Sales tax (% of indirect cost basis)	5%
Insurance (% of installed cost)	0 %/year
Property tax (% of assessed val.)	0 %/year

Incentives	
Federal ITC	30%

Electricity Demand and Rate Summary
Annual peak demand 274.2 kW
Annual total demand 726,208 kWh
SG - Secondary General Service
Fixed charge: $40/month
Monthly excess with kWh rollover
Flat energy buy rate: $0.03156/kWh

Results	
Nominal LCOE	4.5 cents/kWh
Net present value	$5,500
Payback period	24.6 years

Detailed Photovoltaic	12 DC kW Nameplate	33.45, -111.98
Commercial	$5.94/W Installed Cost	UTC -7

Year 1 Monthly Generation and Load Summary

Electricity from System

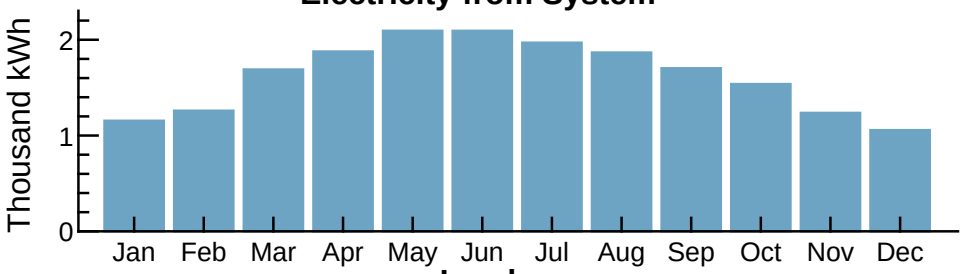

Load

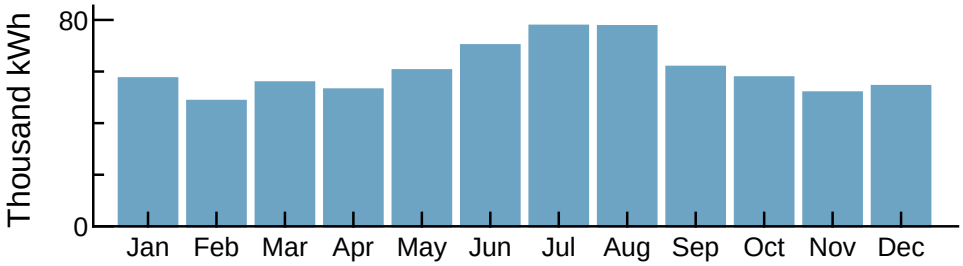

Year 1 Monthly Electric Bill and Savings ($)

Month	Without System	With System	Savings
Jan	4,921	4,885	36
Feb	3,842	3,802	39
Mar	4,051	3,913	137
Apr	4,219	4,072	146
May	4,543	4,377	166
Jun	7,844	7,614	229
Jul	9,041	8,832	209
Aug	8,642	8,427	214
Sep	7,297	7,107	190
Oct	4,284	4,167	116
Nov	3,720	3,631	88
Dec	4,164	4,130	33
Annual	66,573	64,963	1,609

NPV Approximation using Annuities

Annuities, Capital Recovery Factor (CRF) = 0.1023		
Investment	$0	Sum:
Expenses	$-4,600	$500
Savings	$3,800	NPV = Sum / CRF:
Energy value	$1,300	$5,000

Investment = Installed Cost - Debt Principal - IBI - CBI
Expenses = Operating Costs + Debt Payments
Savings = Tax Deductions + PBI
Energy value = Tax Adjusted Net Savings
Nominal discount rate = 9.06%

Payback Cash Flow (Payback Period = 24.6 years)

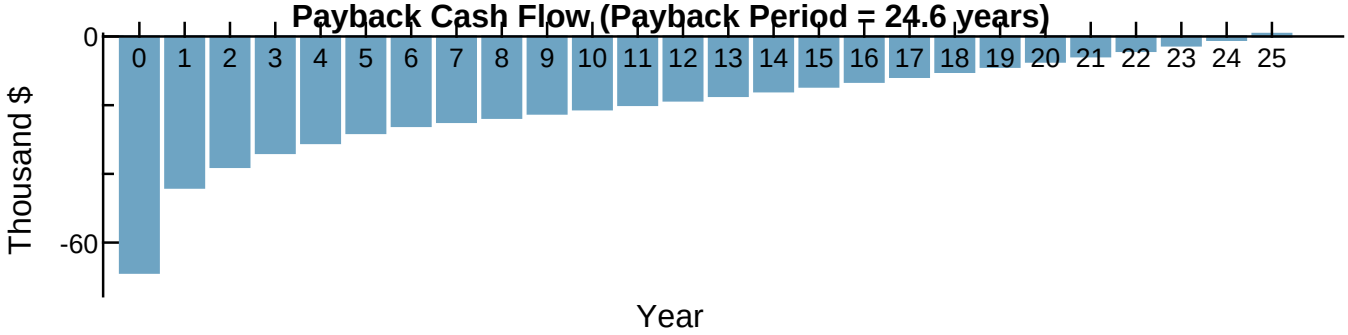

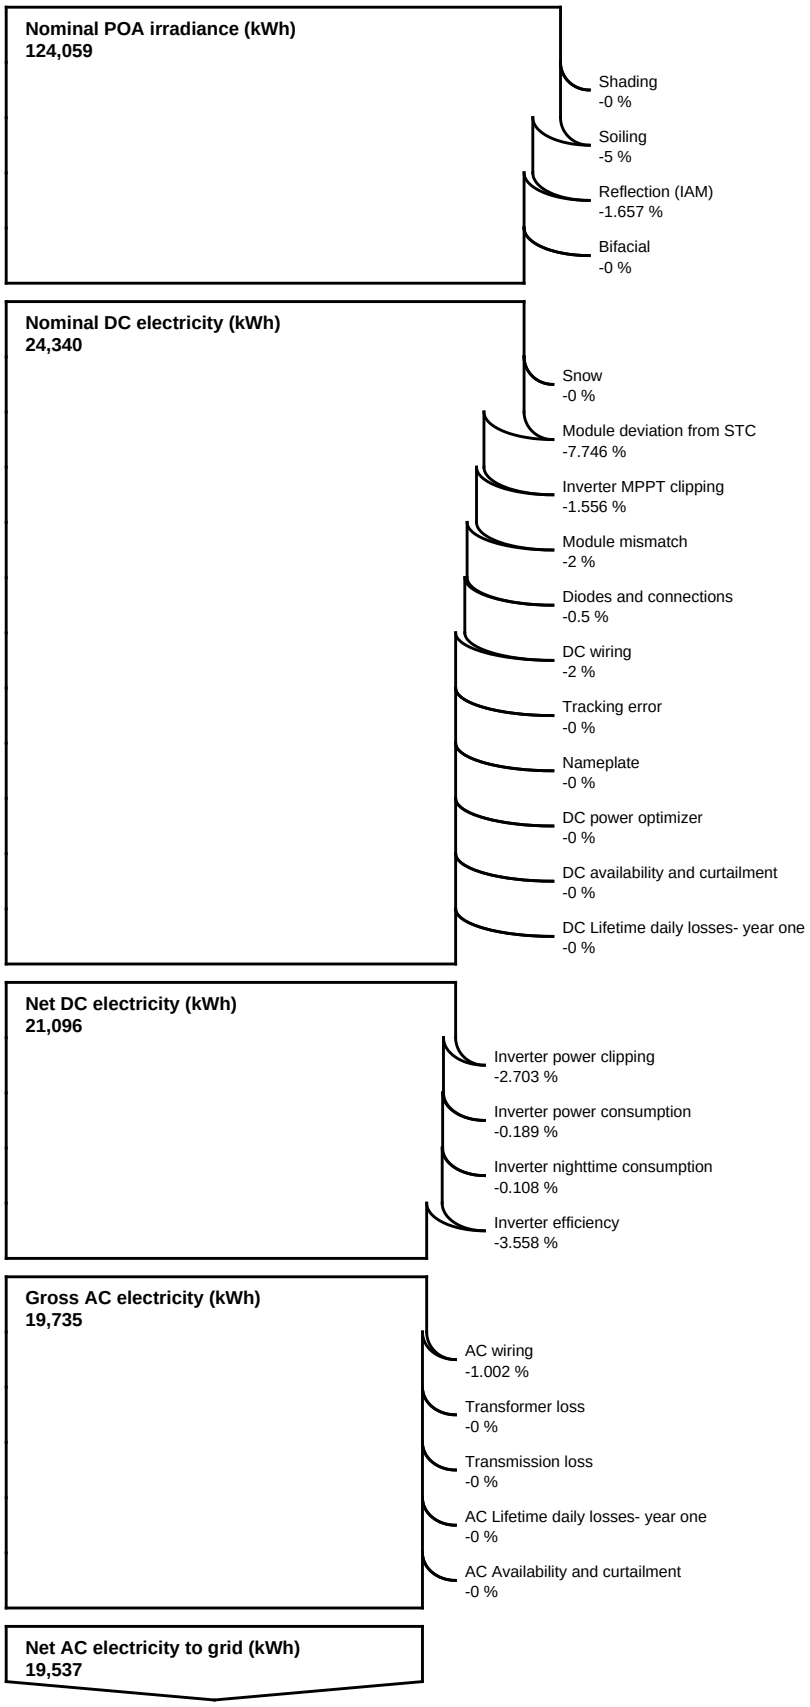
Nominal POA irradiance (kWh)
124,059
Shading
-0 %
Soiling
-5 %
Reflection (IAM)
-1.657 %
Bifacial
-0 %
Nominal DC electricity (kWh)
24,340
Snow
-0 %
Module deviation from STC
-7.746 %
Inverter MPPT clipping
-1.556 %
Module mismatch
-2 %
Diodes and connections
-0.5 %
DC wiring
-2 %
Tracking error
-0 %
Nameplate
-0 %
DC power optimizer
-0 %
DC availability and curtailment
-0 %
DC Lifetime daily losses- year one
-0 %
Net DC electricity (kWh)
21,096
Inverter power clipping
-2.703 %
Inverter power consumption
-0.189 %
Inverter nighttime consumption
-0.108 %
Inverter efficiency
-3.558 %
Gross AC electricity (kWh)
19,735
AC wiring
-1.002 %
Transformer loss
-0 %
Transmission loss
-0 %
AC Lifetime daily losses- year one
-0 %
AC Availability and curtailment
-0 %
Net AC electricity to grid (kWh)
19,537