



DEPARTMENT OF PUBLIC HEALTH & PREVENTIVE MEDICINE
SANITARY CERTIFICATE

APPENDIX – 3 (Chapter III Rule : 24)

(Issued under provisions of Public Health Act 1939 Under Sections (u/s 21, 63, 64, 67, 98 & 106)

Certified that M/s. VIVEGAA SCHOOL, S.F.NO.88/2A3,2A4, 2B, 3B, CHINNERIPALAYAM VILLAGE & PANCHAYAT, AVINASHI Taluk, TIRUPUR Dist - 641654 has been inspected on 07/05/25 and the building and premises are found satisfactory on the following aspects.

- ❖ The Class Rooms and surroundings are maintained **neat and clean**.
- ❖ The Sanitary arrangements provided are adequate and **satisfactory**.
- ❖ The drinking water arrangements provided is **satisfactory**.
- ❖ In all other necessary aspect the sanitation is **good**.


This Certificate is issued subject to the following conditions:

- On any account the garbage shall not be burnt or kept more than 24 hours in the premises and should be collected and disposed off then and there by appointing adequate sanitary staffs.
- Usage of one time use and throwaway plastics irrespective of thickness is prohibited as per GO. (Ms) No. 84 Environment and Forest Department Dated : 25.06.2018.
- Fire pre cautionary measures and First Aid Box should be provided.
- Overhead Tank and water sump shall be hermitically sealed and scientifically close and shall not be a breeding source of mosquitoes.
- Drinking water shall be chlorinated and shall have 0.5 ppm of residual Chlorine.
- Fly / Mosquitoes breeding shall not be permitted within the premises. .
- Display and exhibition of board : as per rule 3 of the Tamil Nadu Prohibition and Smoking and Spitting Rules 2003, Every person in charge of the place should display and exhibit board stating that this place is a “ **NO SMOKING AND SPITTING PLACE**” and that “ **SMOKING OR SPITTING HERE IS AN OFFENCE**”.
- This Certificate is liable to be cancelled at any time on infringement if any of above said conditions and for improper maintenance of Sanitation & Building and if any health nuisance is found as defined in Tamil Nadu Public Health Act, 1939.
- Sanitary Certificate valid for the period of one year only from the date of issue.

L. DIS. No.: 1761 /A4 /2025 Dated 07.05.2025

Counter Signed

DISTRICT HEALTH OFFICER
TIRUPPUR.

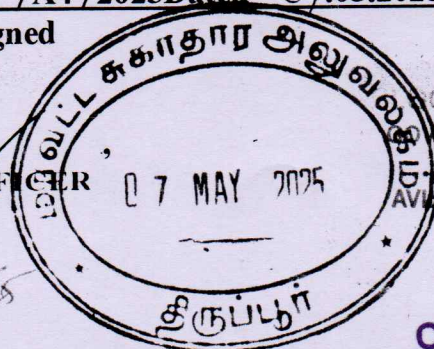

G. Kumar

PRINCIPAL

VIVEGAA SCHOOL
CHINNERIPALAYAM
AVINASHI - 641 654

SUPERVISOR
PUBLIC HEALTH CENTRE,
TIRUPUR-641 655,
AVINASHI BLOCK, TIRUPPUR (Dt).

E. S. S.
CORRESPONDENT
VIVEGAA SCHOOL
AVINASHI



TAMILNADU WATER SUPPLY AND DRAINAGE BOARD

DISTRICT WATER TESTING LABORATORY

No. 471 & 472, Bharathiyar Complex, Avinashi Road,

Tiruppur - 641602.

Phone: 0421 - 2245201

E-mail: labtpr@gmail.com



TC - 15221

TEST REPORT

Doc.No: DWTL/FORM/7.8/01

Sample / Lab No:	TR/2025/294	Report Issue Date :	30.06.2025
Invoice Details:	3157/Dt.26.06.2025/ Amt.Rs.1,652 /-		
ULR No:	TC1522125000000146F		

Client Name & Address : M/s.Vivegaa School,
Contact No / Email.ID : 88/2B, 3B, Chinneripalayam,
Avinashi, Tiruppur Dt.

Sample Name : Water- Drinking
Sample Description : RO Outlet Water
Sample Code No : 294
Sample Submitted by : Customer- Muthuras.S
Location & Date : At M/s.Vivegaa School & 26.06.2025.
Quantity of sample Received : 2 Litre
Sample Container : Plastic - Good condition.
Sample Condition on Receipt : Good
Sample Received On : 26.06.2025
Test Commenced on : 26.06.2025
Test Completed on : 27.06.2025
Environmental Condition : 23.0°C-27.0°C

S.No	Parameters	Test Method	Unit	Result	Specification as per IS 10500 : 2012	
					Acceptable Limit	Permissible Limit in the absence of alternate source
1	pH @ 25° C	IS 3025 Part 11-2022	--	6.82	6.5-8.5	6.5-8.5
2	Total Alkalinity as CaCO ₃	IS 3025 Part 23-2023	mg/L	88	200	600
3	Total Hardness as CaCO ₃	IS 3025 Part 21-2009 (RA:2023)	mg/L	54	200	600
4	Chloride as Cl	IS 3025-Part 32-1988 (RA:2019)	mg/L	15	250	1000
5	Sulphate as SO ₄	IS 3025-Part 24- Sec 1-2022	mg/L	6	200	400
6	Nitrate as NO ₃	IS 3025-Part 34- Sec 1-2023	mg/L	< 2	45	45
7	Fluoride as F	IS 3025-Part 60- Sec 1-2023	mg/L	< 0.2	1.0	1.5

Remarks : The Tested sample conformed IS:10500:2012 Drinking water specification with respect to above tested Parameters.

..... End of the Report.....

Reviewed & Authorised Signatory
B.George - Junior Engineer

Note:

1. The test results relate only to the items tested.
2. The test report shall not be reproduced anywhere except in full and in the same format without the permission of the laboratory.
3. Unless informed by customer, the test items will not be retained for more than 15 days from the date of issue of the test report.
4. The result applied to the sample as received basis.

Issue No./Date	01/01.07.2024	Amend. No/ Date	00/--	Page No	1 of 1.
----------------	---------------	-----------------	-------	---------	---------

PRINCIPAL
VIVEGAA SCHOOL
CHINNERIPALAYAM
AVINASHI - 641 654

E. George
CORRESPONDENT
VIVEGAA SCHOOL
AVINASHI



TAMILNADU WATER SUPPLY AND DRAINAGE BOARD

DISTRICT WATER TESTING LABORATORY

No. 471 & 472, Bharathiyar Complex, Avinashi Road,

Tiruppur - 641602.

Phone: 0421 - 2245201

E-mail: labtpr@gmail.com

TEST REPORT

Doc.No: DWTL/FORM/7.8/01

Sample / Lab No:	TR/2025/294	Report Issue Date :	30.06.2025
Invoice Details:	3157/Dt.26.06.2025/ Amt.Rs.1,652 /-		

S.No	Parameters	Test Method	Unit	Result	Specification as per IS 10500 : 2012	
					Acceptable Limit	Permissible Limit in the absence of alternate source
1	Appearance	Physical observation	--	Clear	-	-
2	Colour	IS 3025-Part 4	Hazen	< 2	5	25
3	Odour	IS 3025-Part 5	--	Agreeable	Agreeable	Agreeable
4	Turbidity	IS 3025-Part 10	NTU	< 0.5	1	5
5	Total Dissolved Solids	IS 3025-Part 16	mg/L	173	500	2000
6	Conductivity	IS 3025-Part 14	μ S/cm	247	-	-
7	P - Alkalinity as CaCO_3	IS 3025-Part 23-1983	mg/L	NIL	-	-
8	Calcium as Ca	IS 3025-Part 40	mg/L	12	75	200
9	Magnesium as Mg	IS 3025-Part 46	mg/L	6	30	100
10	Iron as Fe	IS 3025-Part 53	mg/L	< 0.1	0.3	1
11	Manganese as Mn	IS 3025-Part 59	mg/L	< 0.05	0.1	0.3
12	Ammonia as NH_3	IS 3025-Part 34	mg/L	< 0.1	0.5	0.5
13	Nitrite as NO_2	IS 3025-Part 34	mg/L	< 0.01	-	-
14	Total Phosphate as PO_4	IS 3025-Part 31	mg/L	< 0.1	-	-
15	Residual Chlorine	IS 3025-Part 26	mg/L	< 0.2	0.2	1.0
16	Fecal Coliform	IS 1622	CFU/100ml	0 / 100ml	0 / 100ml	0/100ml

Remarks : The Tested sample conformed IS:10500:2012 Drinking water specification with respect to above tested Parameters.

..... End of the Report.....

Reviewed & Authorised Signatory
B .George - Junior Engineer

Note:

1. The test results relate only to the items tested.
2. The test report shall not be reproduced anywhere except in full and in the same format without the permission of the laboratory.
3. Unless informed by customer, the test items will not be retained for more than 15 days from the date of issue of the test report.
4. The result applied to the sample as received basis.

Issue No./Date	01/01.07.2024	Amend. No/ Date	00/--	Page No	1 of 1.
----------------	---------------	-----------------	-------	---------	---------

PRINCIPAL
VIVEGAA SCHOOL
CHINNERIPALAYAM

CORRESPONDENT
VIVEGAA SCHOOL
AVINASHI