



DERs Phase-1 policy behavior on the same in-distribution episode (GB in-distribution profile row 609; x-axis aligned to clock 00:00)

— No control — Voltage droop — IPPO — IPPO-rs — IPPO-Lag — PV active (cf > 0.02)


Battery SOC (per-device mean)

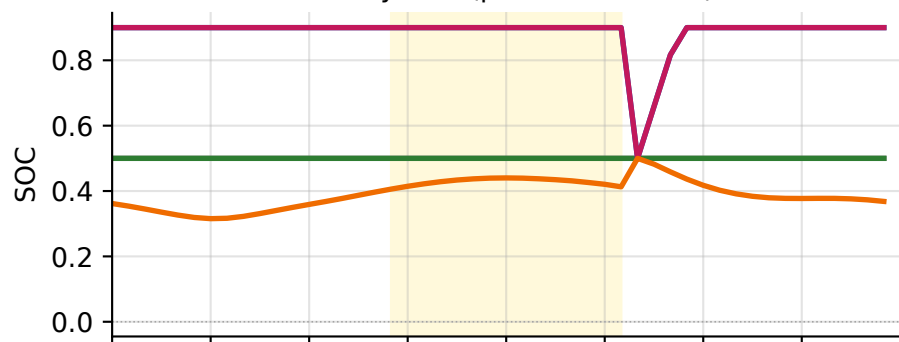


Battery Q realized (system total, MVar)

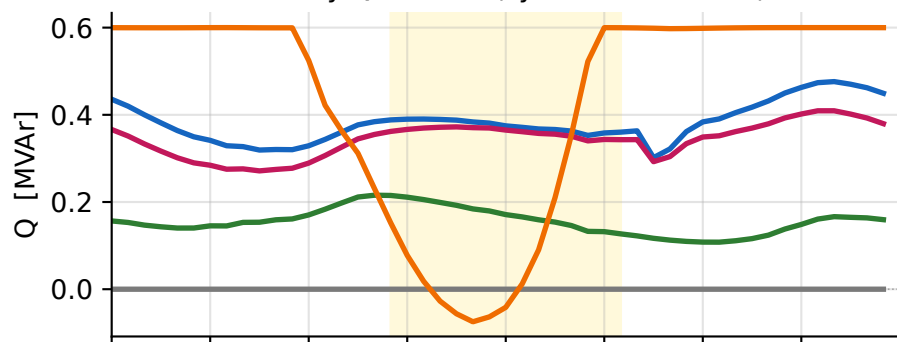


PV curtailment realized (system total, MW)

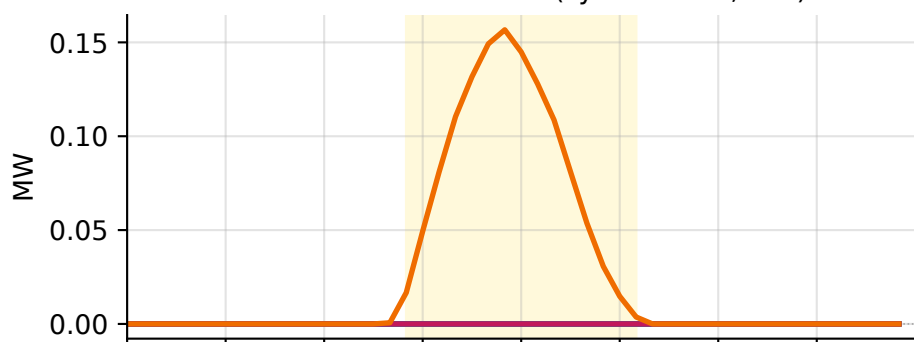

PV Q realized (system total, MVar)

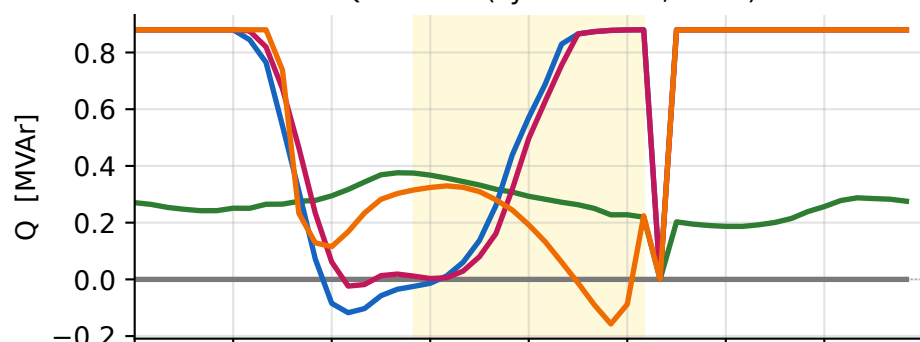

Flex net load relief = curtail + shift-out – shift-in (MW)

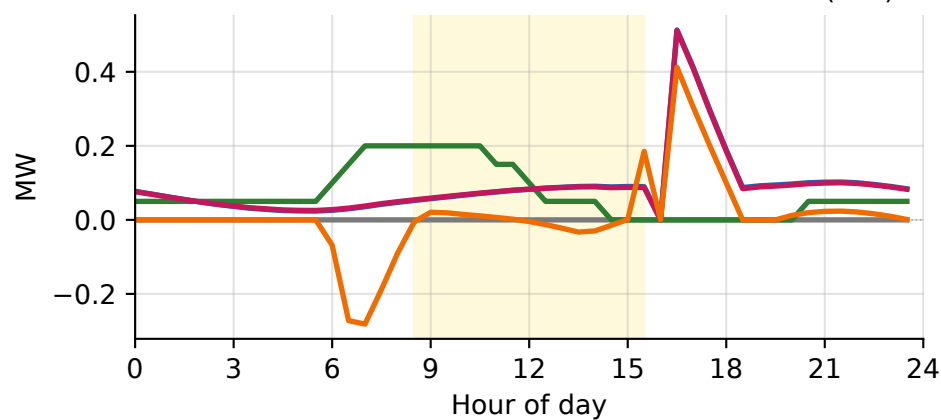

Active loss (system total, MW)

