


Ablation prediction errors

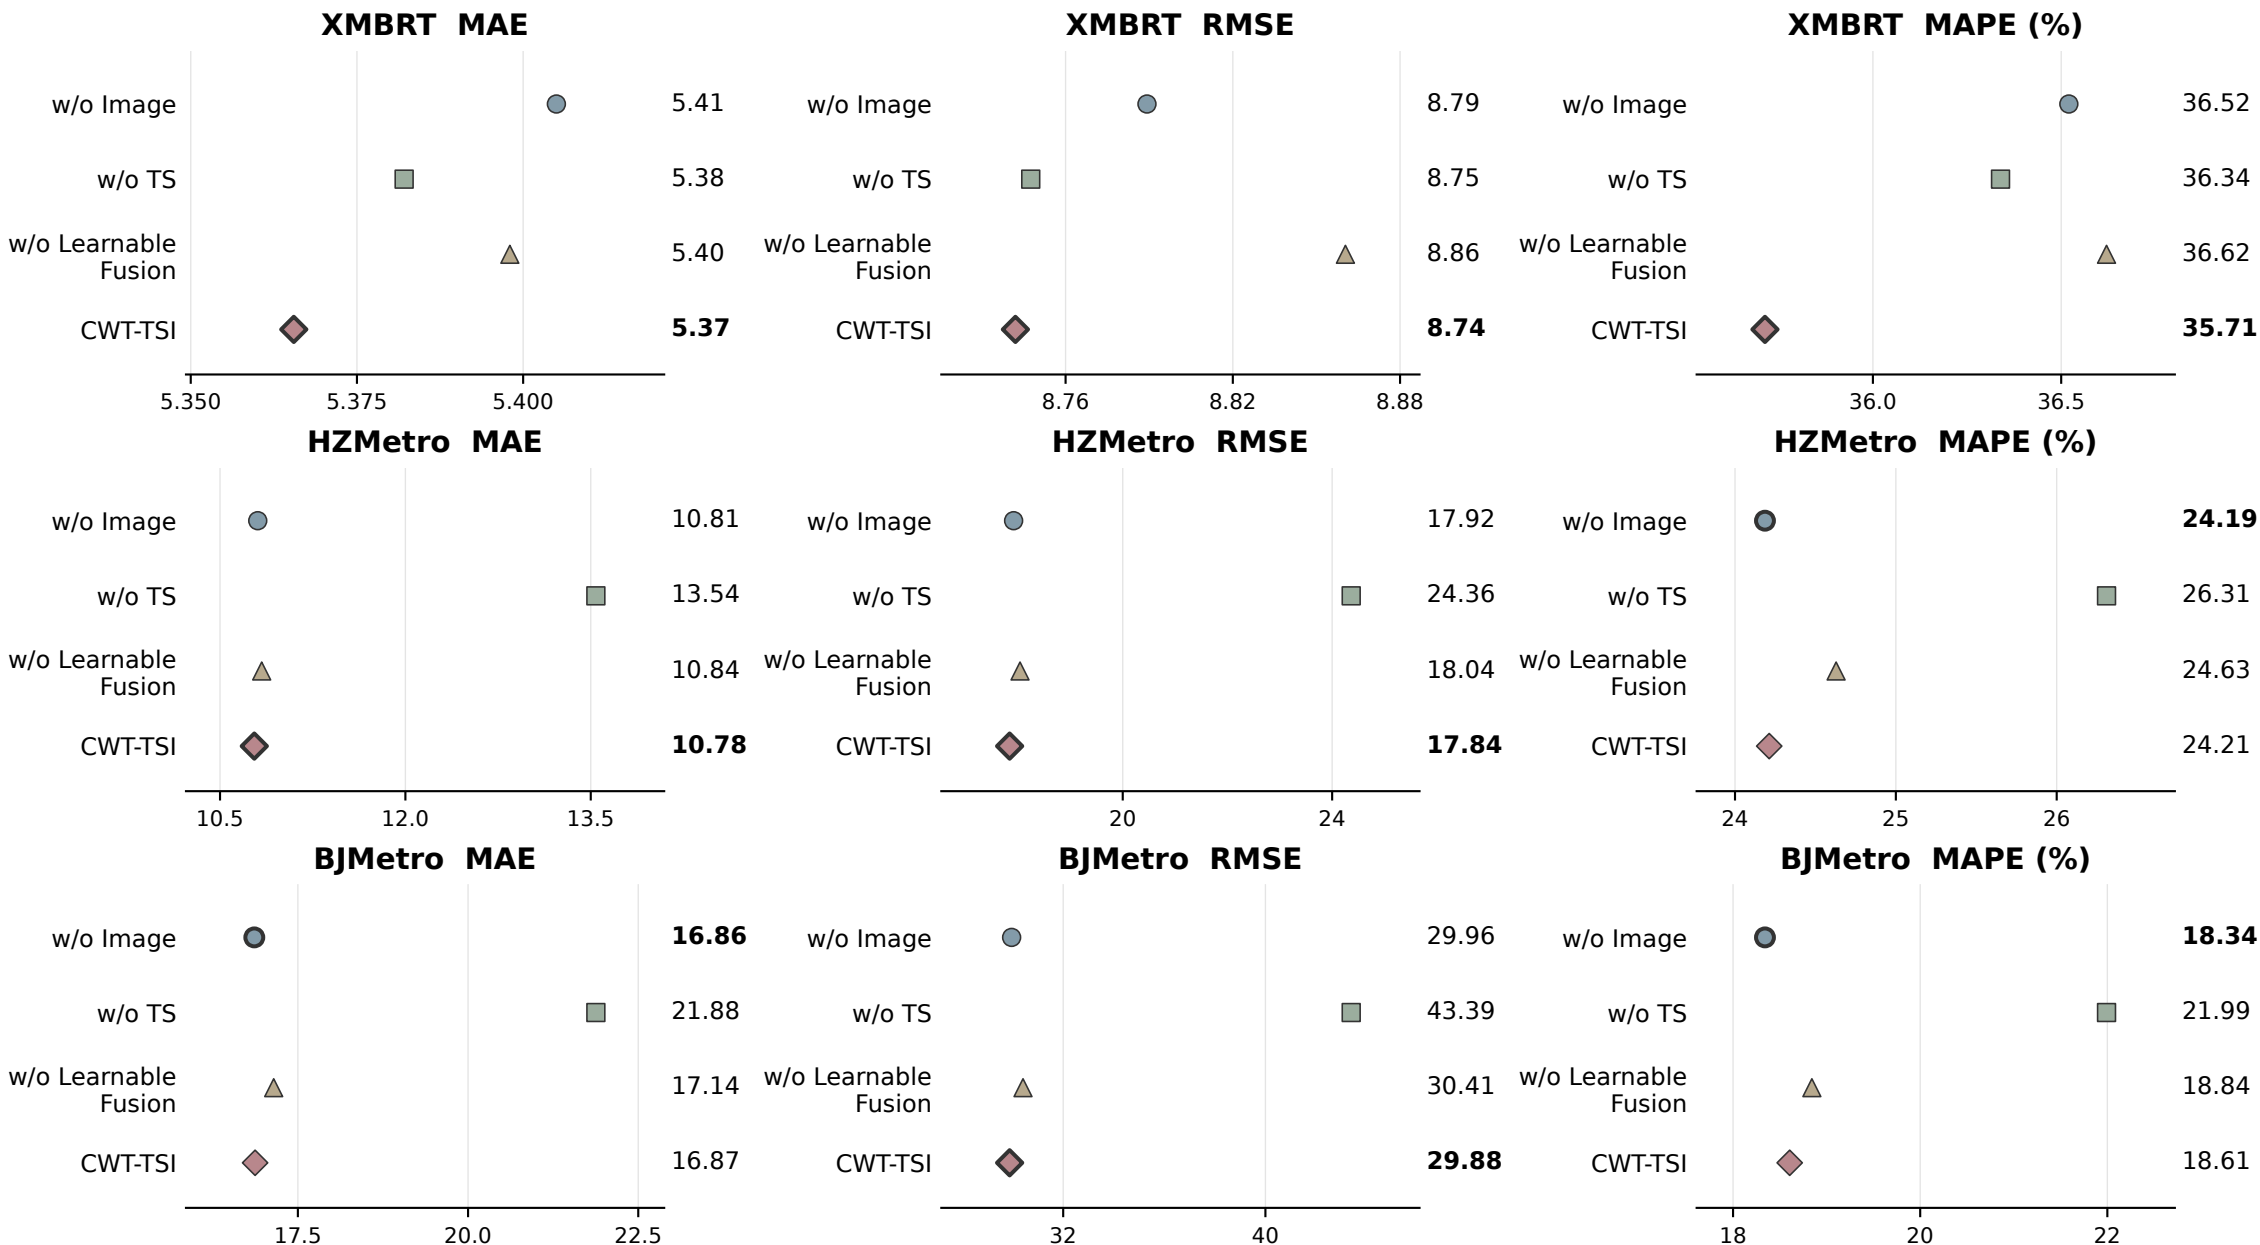

Lower is better; bold values mark the minimum. Panels use independent ranges.