


PathMNIST: Test Accuracy under Label Noise Corruption  
Vision Transformer (ViT-Tiny), 9-class histopathology

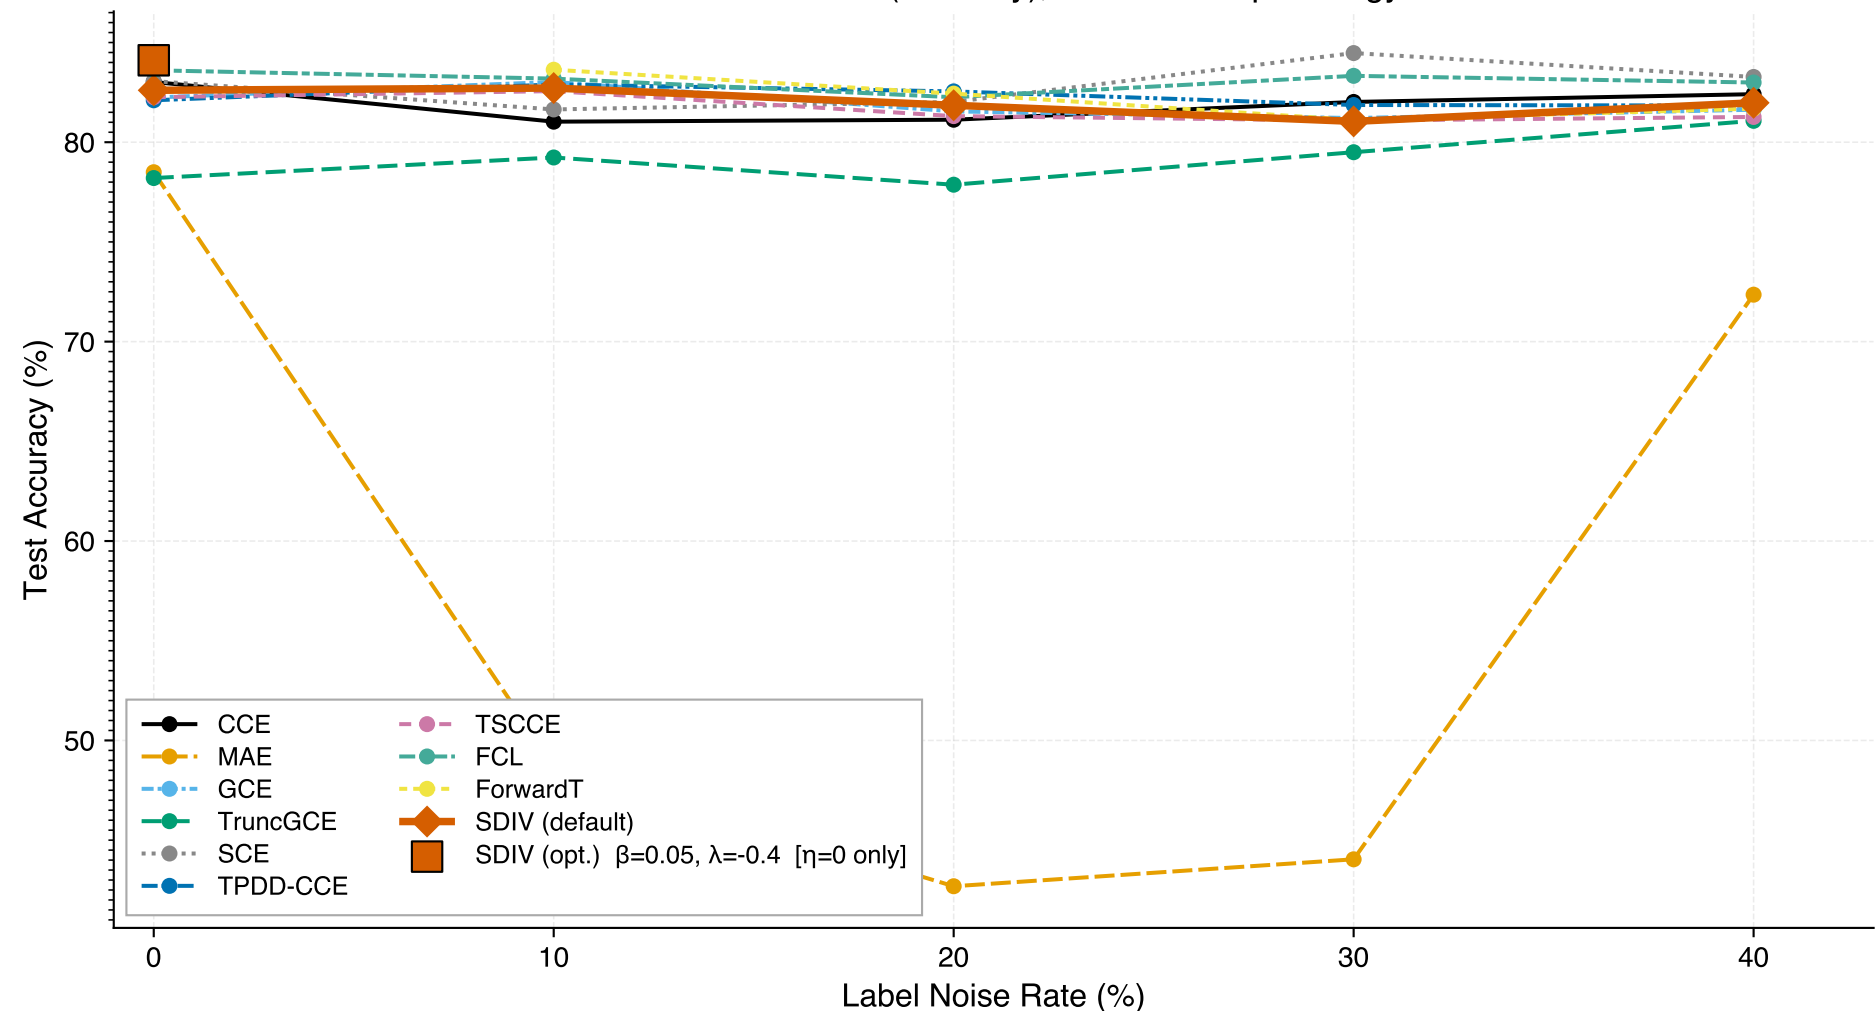

Results: seed=42, 30 training epochs. SDIV (opt.) from parameter grid sweep, evaluated at  $\eta=0$  only.