


DermaMNIST: Test Accuracy under Label Noise Corruption
Vision Transformer (ViT-Tiny), 7-class dermatoscopy

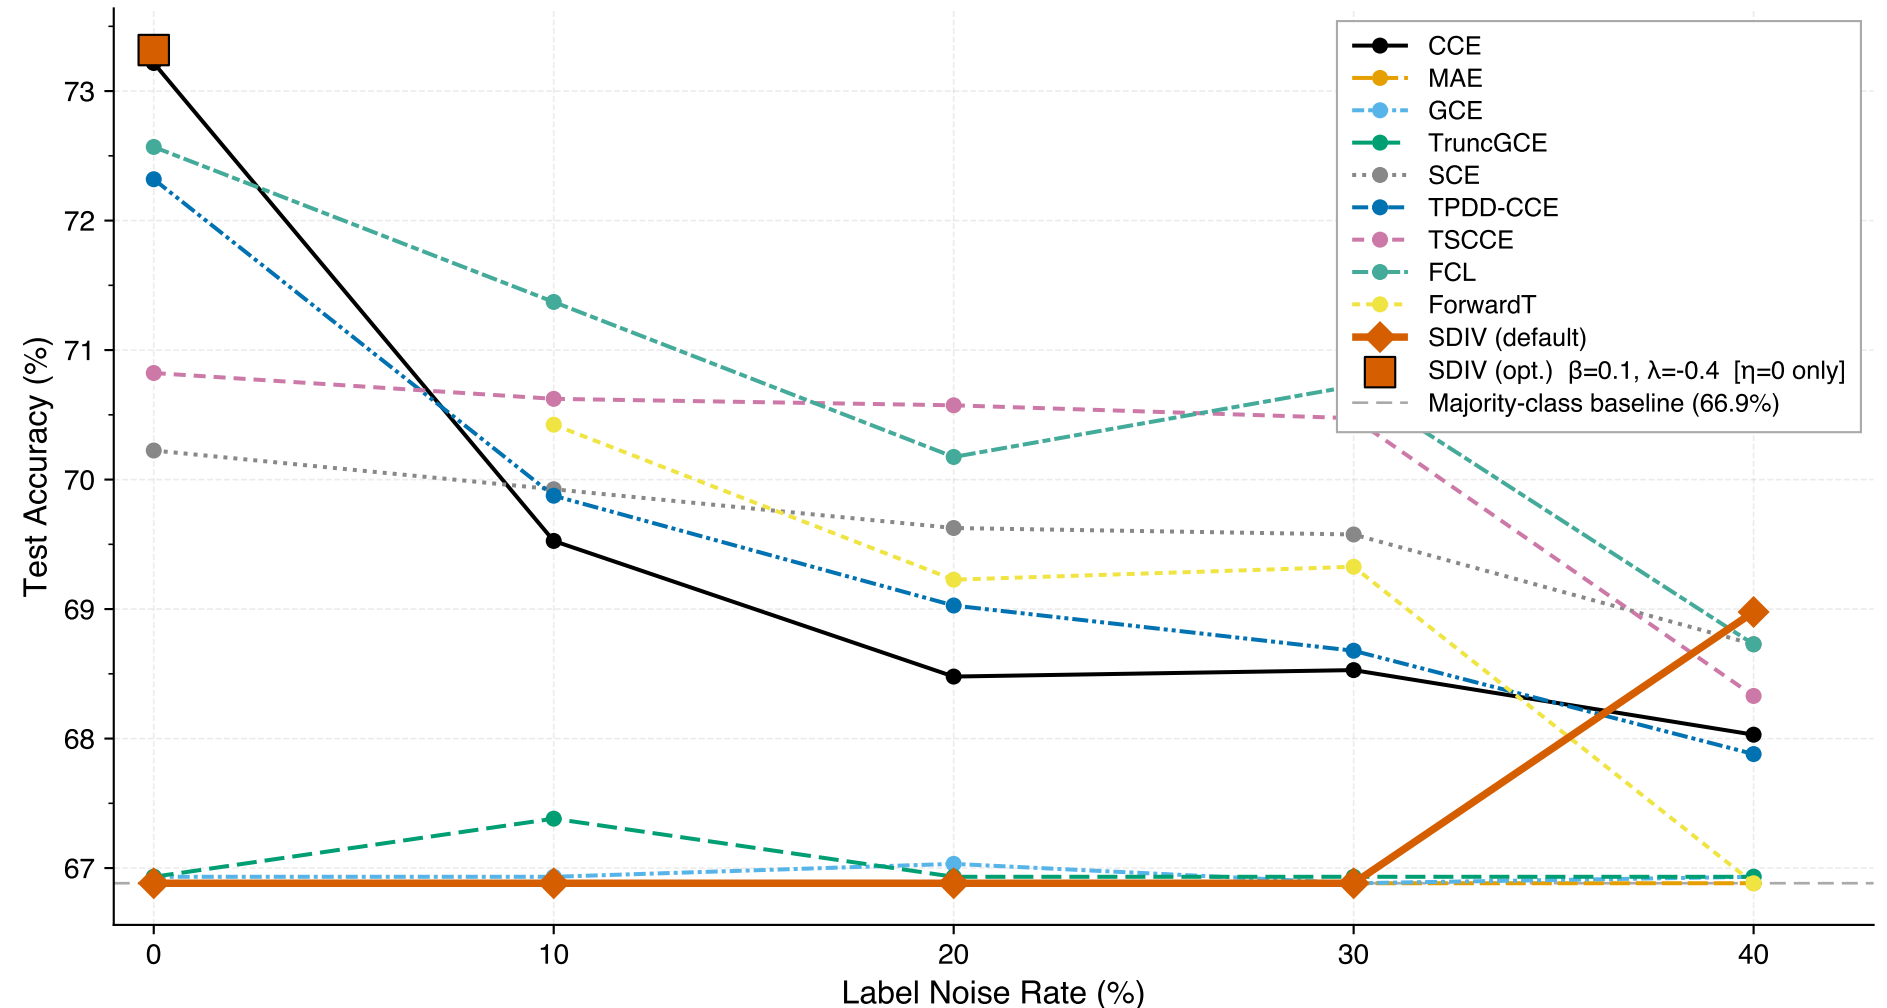

Results: seed=42, 30 training epochs. SDIV (opt.) evaluated at $\eta=0$ from parameter grid sweep.