


PathMNIST: Test Accuracy across Label Noise Rates
Vision Transformer (ViT-Tiny), 9-class histopathology | Losses ranked by AUNRC

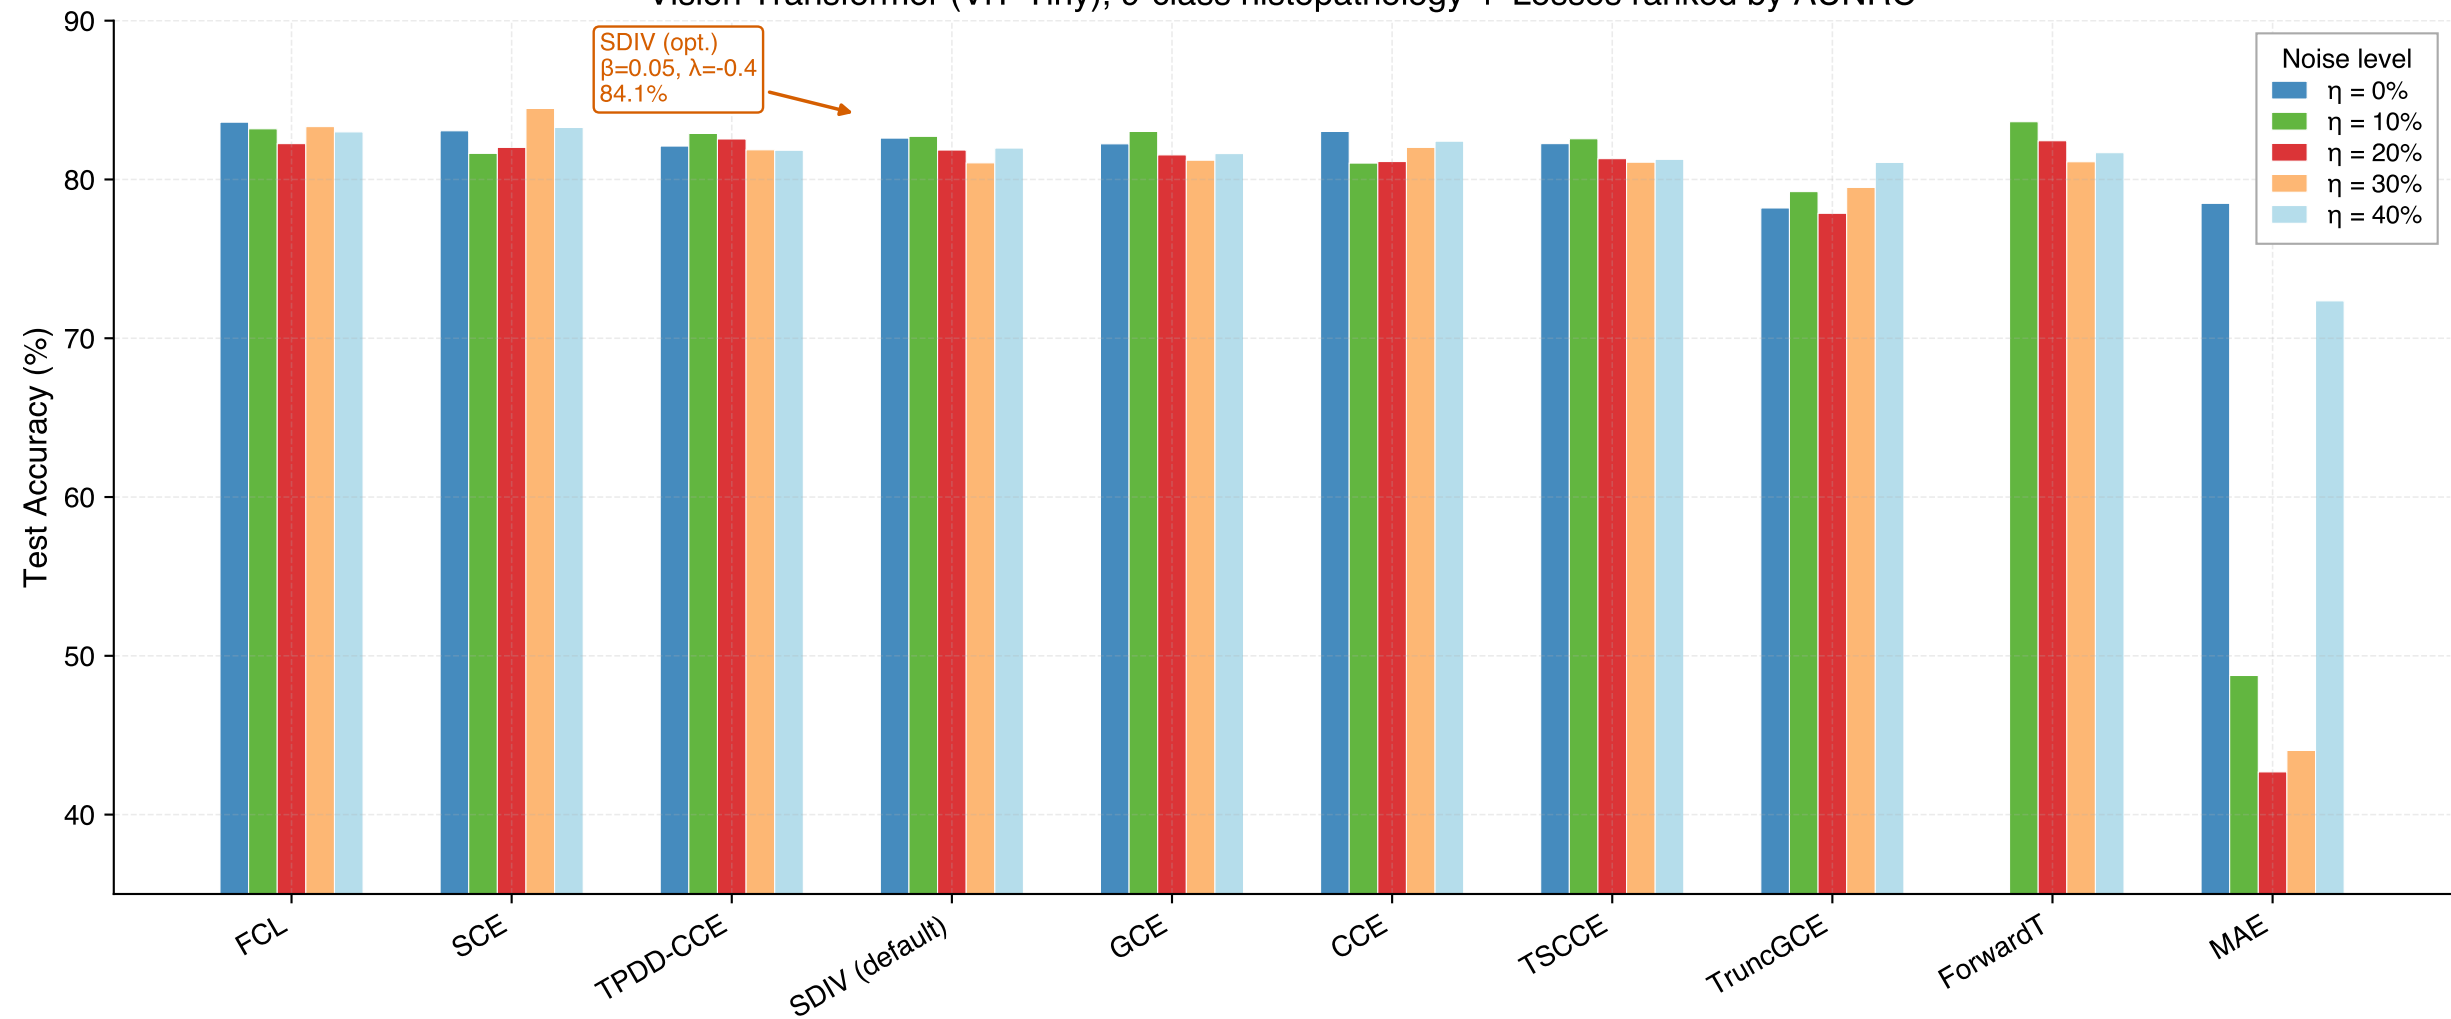

Results: seed=42, 30 training epochs. SDIV (opt.) from parameter grid sweep, evaluated at $\eta=0$ only.