

Monte Carlo Uncertainty Analysis (N=15,000)


(a) Power Output Distribution

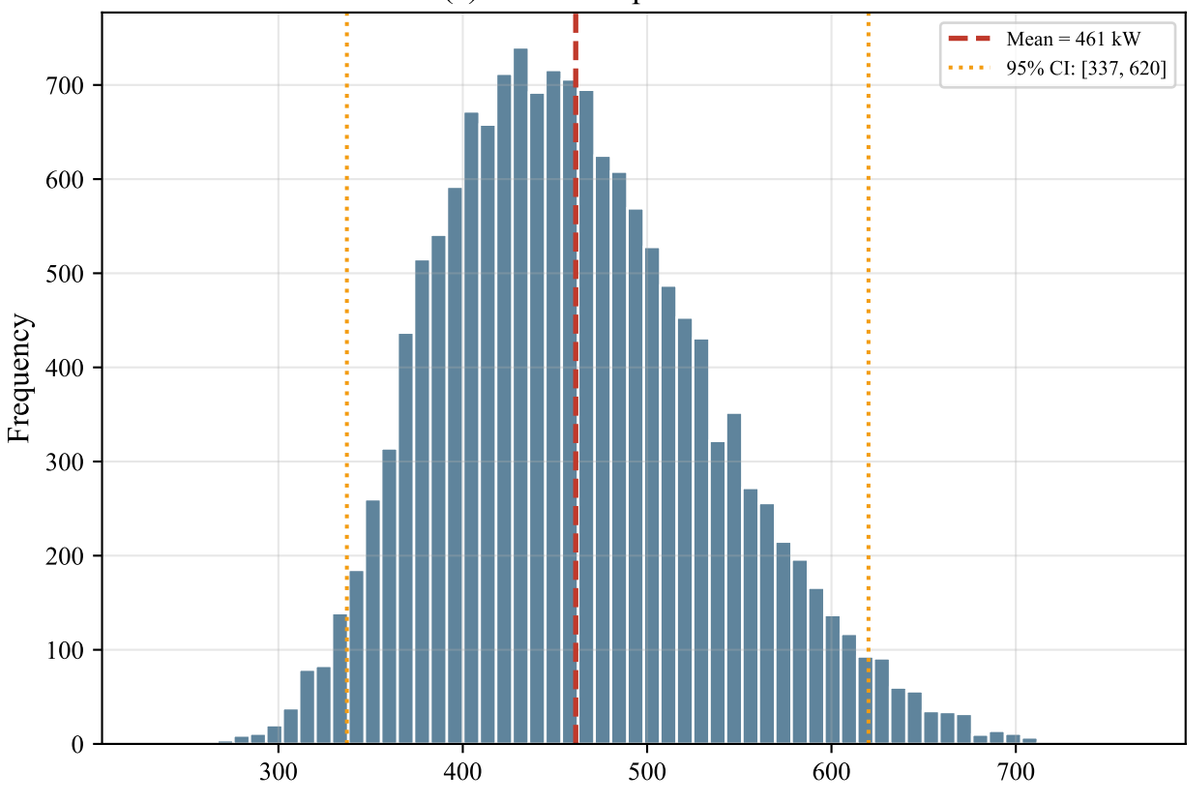

(b) NPV Distribution (100% positive)

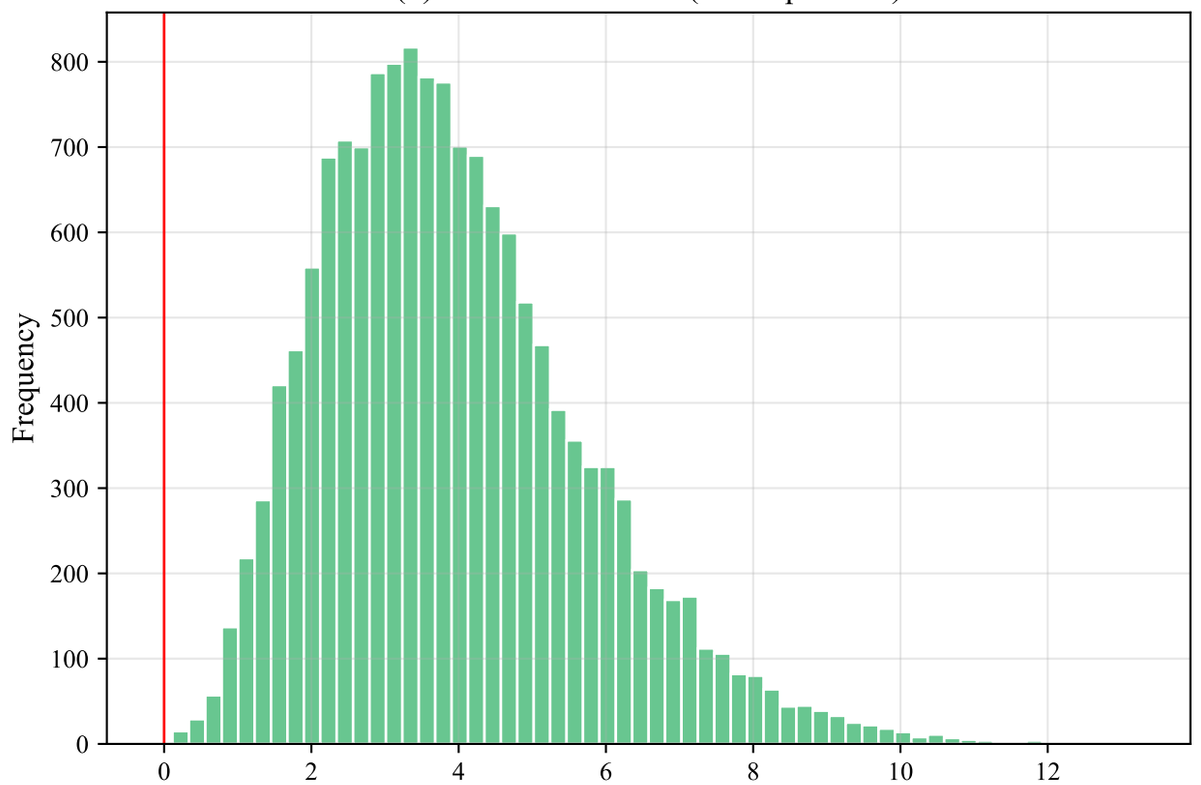

(c) Sensitivity Analysis (Tornado Chart)

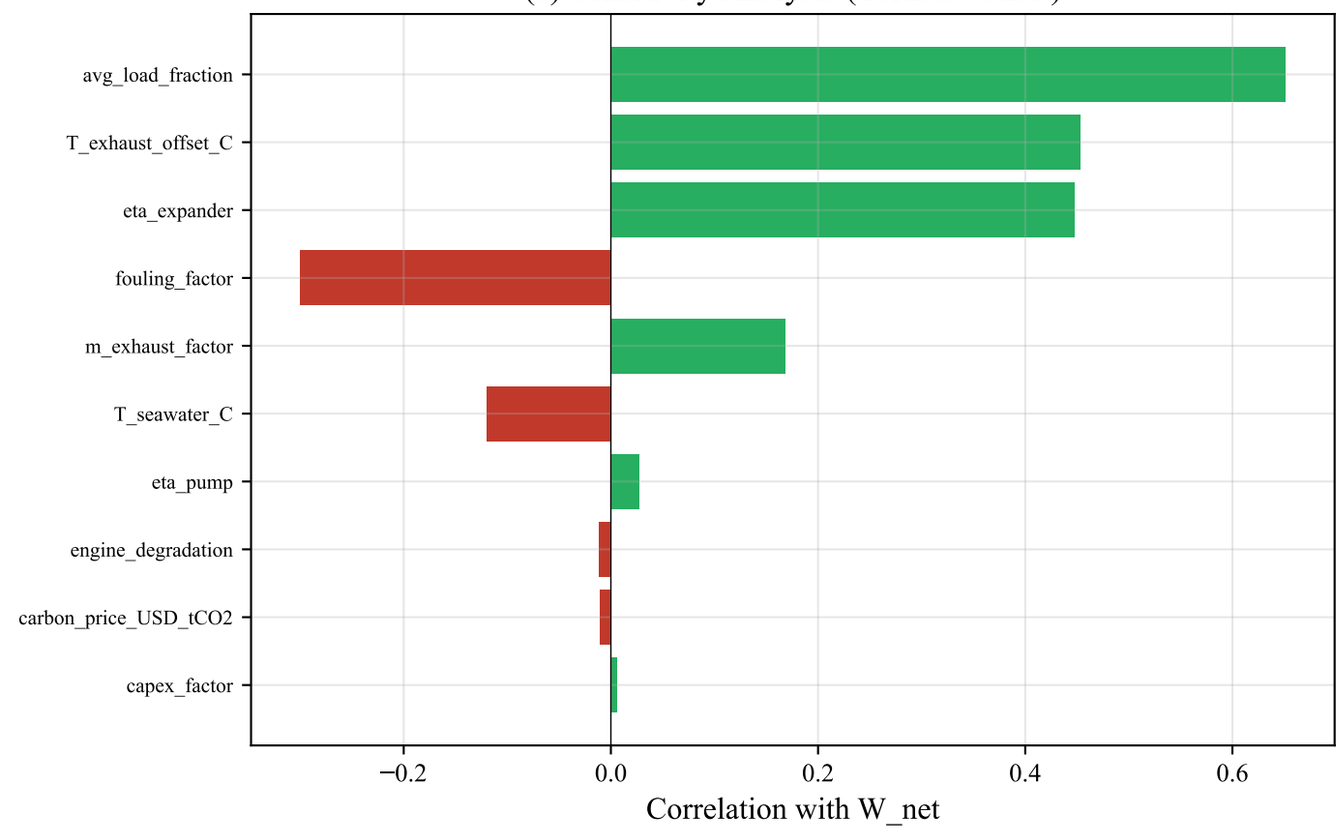

(d) Power vs CO_2 Savings

