



UNSW
SYDNEY

This is the title of the thesis

This is the subtitle of the thesis

Abhijith Prakash

A thesis in fulfilment of the requirements for the degree of
Doctor of Philosophy

School of Electrical Engineering and Telecommunications
Faculty of Engineering

Supervised by:
Professor Iain MacGill
Associate Professor Anna Bruce

UNSW Sydney, Australia

April 2023

I, AUTHORMNAME confirm that the work presented in this thesis is my own. Where information has been derived from other sources, I confirm that this has been indicated in the thesis.

Abstract

 Lorem ipsum dolor sit amet, consectetur adipiscing elit. Nam et turpis gravida, lacinia ante sit amet, sollicitudin erat. Aliquam efficitur vehicula leo sed condimentum. Phasellus lobortis eros vitae rutrum egestas. Vestibulum ante ipsum primis in faucibus orci luctus et ultrices posuere cubilia Curae; Donec at urna imperdiet, vulputate orci eu, sollicitudin leo. Donec nec dui sagittis, malesuada erat eget, vulputate tellus. Nam ullamcorper efficitur iaculis. Mauris eu vehicula nibh. In lectus turpis, tempor at felis a, egestas fermentum massa.

Acknowledgements

The authors would like to thank Andrew Corrigan and Max Zekulich for sharing their data and analysis on frequency response and FCAS markets. We greatly appreciate the thoughtful comments provided by the reviewers in response to our original submission. This research was supported by an Australian Government Research Training Program Scholarship and by the UNSW Digital Grid Futures Institute.

Table of Contents

Abstract	i
Acknowledgements	ii
Abbreviations and Nomenclature	
1 Introduction, with a citation	1
1.1 Background	1
1.2 The middle bit	2
1.2.1 Subsection of the middle bit	2
1.3 Summary of chapters	3
2 Literature review, with maths	4
2.1 Introduction	4
2.2 The middle	4
2.3 A complicated math equation	5
2.4 Conclusion	5
3 Frequency control arrangements: insights from the National Electricity Market	6
3.1 Link to thesis	6
3.2 Abstract	7

3.3	Introduction	8
3.4	Context	13
3.4.1	Conventional frequency control schemes	13
3.4.2	Procurement of frequency control services	14
3.4.3	North American markets	15
3.4.4	European markets	17
3.5	Designing frequency control arrangements	20
3.5.1	The influx of VRE and other IBR in power systems	21
3.5.2	Achieving economic efficiency	22
3.6	Frequency control arrangements in the Australian National Electricity Market	25
3.6.1	Overview of the NEM	25
3.6.2	FCAS markets	27
3.6.3	NEM operation and governance	32
3.6.4	Challenges to frequency control posed by VRE and IBR .	32
3.6.5	Features of NEM frequency control arrangements	34
3.6.5.1	Control mechanisms:	34
3.6.5.2	Market-based mechanisms:	35
3.6.5.3	Regulatory mechanisms:	36
3.7	Insights from the National Electricity Market	37
3.8	Declining tight-deadband primary frequency response	37
3.9	Performance and efficiency issues of regulation services	41
3.10	NEM assessment and outlook	45
3.10.1	Reactive regulatory requirements	49
3.11	Preference for market-based arrangements	51
3.12	Conclusion	55

4 Research containing a figure	58
4.1 Introduction	58
4.2 Method	58
4.2.1 Subsection 1	59
4.2.2 Subsection 2	59
4.3 Results	59
4.4 Discussion	59
4.5 Conclusion	61
5 Research containing a table	62
5.1 Introduction	62
5.2 Method	62
5.2.1 Subsection 1	63
5.2.2 Subsection 2	63
5.3 Results	63
5.4 Discussion	64
5.5 Conclusion	65
6 Final research study	66
6.1 Introduction	66
6.2 Method	66
6.2.1 Subsection 1	67
6.2.2 Subsection 2	67
6.3 Results	67
6.4 Discussion	67
6.5 Conclusion	68
7 Conclusion	69

7.1	Thesis summary	69
7.2	Future work	69
	Appendix 1: Some extra stuff	71
	Appendix 2: Some more extra stuff	72
	References	73

List of Figures

3.1	Regions/states and transmission in the NEM. Source: Australian Energy Market Commission (n.d.)	26
3.2	Entry (of IBR) and exit (of synchronous generation) capacity in the NEM between Australian financial years 2013/14 and 2019/20. Data source: Australian Energy Market Commission (2020a). . .	33
3.3	Active power output of QLD super-critical coal generators (top), SA solar PV farms (middle) and SA wind farms (bottom). The response of an individual generator is denoted by solid lines (obtained from 4-second AEMO SCADA data using NEMOSIS (Gorman et al., 2018)). None of these generators are enabled for FCAS. The red dashed line in each frame is the regional frequency as measured by high-speed (1-second) phasor measurement units. . .	40
3.4	Regional phasor measurement unit frequency data and AGC reference frequency data from AEMO's NSW control centre (obtained using NEMOSIS (Gorman et al., 2018)) during the power system event on the 25 th of August, 2018. Note that the AGC reference frequency deviates in the opposite direction to local frequency in QLD and SA.	43

3.5 Events and volume-weighted NEM-wide average quarterly prices for energy, raise regulation FCAS and raise contingency FCAS in the NEM. The entry of new albeit smaller FCAS providers in 2017 was preceded by the retirement of several large thermal generation. Q1 2020 FCAS prices were high due to local procurement in the SA region, which was islanded for approximately two weeks. Note that while average energy prices fell in Q2-Q4 in 2020 to levels previously seen in 2014-2015 (due to lower demand during COVID-19 lockdowns), FCAS prices remained relatively high. Five-minute price and volume data obtained using NEMO-SIS (Gorman et al., 2018).	46
3.6 Normalised distribution of mainland frequency within the NOFB in 2005 and 2018. Reproduced from (Australian Energy Market Operator, 2019d)	47
3.7 Standard deviation of mainland frequency grouped by each day, week, month or quarter from 2009 to 2021. Some initial PFR setting changes were made in late September 2020 and many generators moved to final settings in late October 2020. Source: Australian Energy Market Operator (2021f).	48
4.1 RV Calypso is a former British Royal Navy minesweeper converted into a research vessel for the oceanographic researcher Jacques-Yves Cousteau. It was equipped with a mobile laboratory for underwater field research.	60
4.2 This is not a boat	61

List of Tables

3.1 Frequency control ancillary services in the National Electricity Market. Sources: Thorncraft and Outhred (2007), Riesz et al. (2015), Australian Energy Market Operator (2017a), Australian Energy Market Operator (2010), Australian Energy Market Operator (2015a), Australian Energy Market Operator (2015b), Australian Energy Market Operator (2020c)	30
5.1 Important data for various land masses.	64

Abbreviations and Nomenclature

AC	Alternating Current
AEMC	Australian Energy Market Commission
AEMO	Australian Energy Market Operator
AER	Australian Energy Regulator
AGC	Automatic generation control
BESS	Battery energy storage systems
BRP	Balancing responsible party
BSP	Balancing service provider
DC	Direct current
DR	Demand response
ENSTO-E	European Network of Transmission System Operators for Electricity
ESB	Energy Security Board
IBR	Inverter-based resources
ISO/RTO	Independent System Operator/Regional Transmission Organisation
FCS	Frequency control services
FCAS	Frequency Control Ancillary Services
FERC	Federal Energy Regulatory Commission
FFR	Fast frequency response
Hz	Hertz

mHz	Millihertz
MW	Megawatts
NEM	National Electricity Market
NER	National Electricity Rules
NOFB	Normal operating frequency band
NSW	New South Wales
OFGS	Over-frequency generation shedding
PFR	Primary frequency response
PV	Photovoltaic
QLD	Queensland
RoCoF	Rate of change of frequency
SA	South Australia
SFR	Secondary frequency response
SO	System operator
TAS	Tasmania
TFR	Tertiary frequency response
TNSP	Transmission Network Service Provider
TSO	Transmission System Operator
UFLS	Under-frequency load shedding
UK	United Kingdom
US	United States
UFLS	Under-frequency load shedding
VIC	Victoria
VRE	Variable renewable energy

Chapter 1

Introduction, with a citation

1.1 Background

This is the introduction. Quisque finibus aliquet cursus. Integer in pellentesque tellus. Duis eu dignissim nulla, a porttitor enim. Quisque vehicula leo non ultrices finibus. Duis vehicula quis sem sit amet sollicitudin. Integer neque est, pharetra et auctor vel, iaculis interdum lectus.

To include a citation to the text, just add the citation key shown in the references.bib file. The style of the citation is determined by the ref_format.csl file. For example, in The Living Sea you can find pictures of the Calypso ([Cousteau1963?](#)).

In neque mauris, maximus at sapien a, iaculis dignissim justo. Aliquam erat volutpat. Praesent varius risus auctor est ultricies, sit amet consequat nisi laoreet. Suspendisse non est et mauris pharetra sagittis non porta justo. Praesent malesuada metus ut sapien sodales ornare.

1.2 The middle bit

This is the middle bit. Phasellus quis ex in ipsum pellentesque lobortis tincidunt sed massa. Nullam euismod sem quis dictum condimentum. Suspendisse risus metus, elementum eu congue quis, viverra ac metus. Donec non lectus at lectus euismod laoreet pharetra semper dui. Donec sed eleifend erat, vel ultrices nibh. Nam scelerisque turpis ac nunc mollis, et rutrum nisl luctus.

Duis faucibus vestibulum elit, sit amet lobortis libero. Class aptent taciti sociosqu ad litora torquent per conubia nostra, per inceptos himenaeos. Sed at cursus nibh. Sed accumsan imperdiet interdum. Proin id facilisis tortor. Proin posuere a neque nec iaculis. Suspendisse potenti. Nullam hendrerit ante mi, vitae iaculis dui laoreet eu.

Cras eleifend velit diam, eu viverra mi volutpat ut. Cum sociis natoque penatibus et magnis dis parturient montes, nascetur ridiculus mus. Donec finibus leo nec dui imperdiet, tincidunt ornare orci venenatis. Maecenas placerat efficitur est, eu blandit magna hendrerit eu.

1.2.1 SUBSECTION OF THE MIDDLE BIT

This is a subsection of the middle bit. Quisque sit amet tempus arcu, ac suscipit ante. Cras massa elit, pellentesque eget nisl ut, malesuada rutrum risus. Nunc in venenatis mi. Curabitur sit amet suscipit eros, non tincidunt nibh. Phasellus lorem lectus, iaculis non luctus eget, tempus non risus. Suspendisse ut felis mi.

1.3 Summary of chapters

This is a brief outline of what went into each chapter, and a section which shows how to reference headers (which are labelled automatically for you). This chapter, Chapter 1, shows how to use citations and how to reference section headers. Chapter 2 shows how use and reference equations. Chapter ?? shows how to use and reference code. Chapter 4 shows how to use, reference, and resize pdf and jpg figures. Chapter 5 shows how to use and reference tables. Chapter 6 is truly revolutionary (but shows nothing functional). **Appendix 1** shows how to add chapters which are not numbered, and has to be referenced manually, as does **Appendix 2**. See the base README .md for how References are handled - leave *_references .md alone, and provide it to pandoc last.

Proin faucibus nibh sit amet augue blandit varius¹.

¹The term *balancing services* is used in European systems, whereas the term *operating reserves* is widely used in North America.

Chapter 2

Literature review, with maths

2.1 Introduction

This is the introduction. Duis in neque felis. In hac habitasse platea dictumst. Cras eget rutrum elit. Pellentesque tristique venenatis pellentesque. Cras eu dignissim quam, vel sodales felis. Vestibulum efficitur justo a nibh cursus eleifend. Integer ultrices lorem at nunc efficitur lobortis.

2.2 The middle

This is the literature review. Nullam quam odio, volutpat ac ornare quis, vestibulum nec nulla. Aenean nec dapibus in mL/min⁻¹. Mathematical formula can be inserted using Latex and can be automatically numbered:

$$f(x) = ax^3 + bx^2 + cx + d \quad (2.1)$$

Nunc eleifend, ex a luctus porttitor, felis ex suscipit tellus, ut sollicitudin sapien purus in libero. Nulla blandit eget urna vel tempus. Praesent fringilla dui sapien, sit amet egestas leo sollicitudin at.

Later on in the text, you can reference Equation 2.1 and its mind-blowing ramifications. Pellentesque habitant morbi tristique senectus et netus et malesuada fames ac turpis egestas. Sed faucibus pulvinar volutpat. Ut semper fringilla erat non dapibus. Nunc vitae felis eget purus placerat finibus laoreet ut nibh.

2.3 A complicated math equation

The following raw text in markdown behind Equation 2.2 shows that you can fall back on \LaTeX if it is more convenient for you. Note that this will only be rendered in `thesis.pdf`

$$\hat{\theta}_g = \operatorname{argmin}_{\theta_g} \left\{ - \sum_{n=1}^N \left(1 - \mathbb{1}[f(\mathbf{x}^{(n)})] \right) \log f(\mathbf{x}^{(n)} + g(\mathbf{x}^{(n)}; \theta_g)) + \lambda |g(\mathbf{x}^{(n)}; \theta_g)|_2 \right\}, \quad (2.2)$$

2.4 Conclusion

This is the conclusion. Donec pulvinar molestie urna eu faucibus. In tristique ut neque vel eleifend. Morbi ut massa vitae diam gravida iaculis. Pellentesque habitant morbi tristique senectus et netus et malesuada fames ac turpis egestas.

Chapter 3

Frequency control arrangements: insights from the National Electricity Market

3.1 Link to thesis

This is the introduction. Nam mollis congue tortor, sit amet convallis tortor mollis eget. Fusce viverra ut magna eu sagittis. Vestibulum at ultrices sapien, at elementum urna. Nam a blandit leo, non lobortis quam. Aliquam feugiat turpis vitae tincidunt ultricies. Mauris ullamcorper pellentesque nisl, vel molestie lorem viverra at.

3.2 Abstract

For restructured electricity industries undergoing energy transition, designing effective and efficient frequency control arrangements is a complex and ongoing task that requires appropriate configuration of controllers, generator technical connection requirements, market arrangements and wider policy settings. In this paper, we provide an overview and assessment of these arrangements in Australia's National Electricity Market - a useful case study given its long-standing frequency control ancillary services markets, yet recent challenges in maintaining secure frequency control. We assess the performance of these evolving arrangements in delivering improved frequency control outcomes, with particular regard to growing renewable penetrations and evident tensions between mandatory requirements and market-based incentives. Based on this assessment, we draw out four key insights on designing frequency control arrangements as power system capabilities and needs change: 1) Understanding control action interactions, 2) Implementing efficient price formation and cost-allocation mechanisms, 3) Monitoring and assessing service provision to better align participant remuneration with service quality, and 4) Considering both regulatory and market mechanisms and their consequences and interactions. In particular, we discuss the trade-offs between effective and efficient outcomes, and provide arguments for more robust and forward-looking frequency control arrangements during energy transition.

3.3 Introduction

As a consequence of growing momentum to address global warming and continually declining technology costs, many power systems around the world are undergoing an energy transition in which significant capacity additions of variable renewable energy (VRE) and other inverter-based resources (IBR) are being accompanied by the progressive retirement of existing fossil fuel generation (International Energy Agency, 2021). Such power systems are currently experiencing or expected to soon experience high instantaneous penetrations of VRE (i.e. beyond 50% of grid demand being met by VRE at any given time), which can pose technical challenges to the stable and secure operation of a power system (Kenyon et al., 2020; Kroposki et al., 2017; Meegahapola et al., 2021). While several of these challenges have technological solutions of various maturities, configuring mechanisms in an effective and efficient manner across power system design layers, which span from how resources are controlled to how grid codes and markets are designed, remains an open and significant challenge.

In this article, we focus on one aspect of power system security: control of AC frequency. Maintaining frequency near the nominal value of a power system (either 50 or 60 Hz) is contingent on the ongoing balance of active power supply and demand within a synchronous area (Grainger, 1994). Power system frequency deviations are a consequence of instantaneous supply-demand imbalances, which typically occur as a result of system variability (predictable changes in supply or demand, such as fluctuations and ramps of generation or load) and uncertainty (unpredicted changes in supply or demand, such as forecast errors or unplanned outages) (Ela et al., 2011). System operators (SOs) achieve short-term active power balancing using reserve capacity. Whilst there are many names

for these reserves¹, this article will focus on a common subset that responds to and mitigates frequency deviations over short timeframes (milliseconds to minutes). We will refer to such reserves as *Frequency Control Services* (FCS). If FCS are insufficient or inadequate, the system frequency may deviate beyond acceptable system limits and lead to equipment damage, load shedding, generator trips and cascading failures that lead to blackouts (Kirby et al., 2002; Ulbig et al., 2014).

In electricity industries with competitive markets for energy and FCS, frequency control arrangements consist of control, regulatory and market-based mechanisms (Mancarella and Billimoria, 2021). Control mechanisms specify the technical requirements for FCS. Regulatory and market-based mechanisms are used by the SO to:

1. Mandate or incentivise participant behaviour in the energy market that facilitates system balancing. This includes enforcing dispatch compliance or penalising participant portfolio imbalances; and
2. Procure FCS from capable resources (i.e. generators, loads and network elements).

Regulatory FCS procurement mechanisms are often mandatory and include equipment standards, connection requirements and SO intervention, whereas market-based FCS procurement mechanisms are often voluntary and include remunerative schemes and contract or spot markets. Together, these mechanisms dictate the physical effectiveness and productive, dynamic, price formation and cost-allocation efficiencies of FCS provision and procurement. Well-designed arrangements should be effective and efficient, where *effectiveness*

¹The term *balancing services* is used in European systems, whereas the term *operating reserves* is widely used in North America.

entails sufficient and robust frequency response to meet physical power system requirements and *efficiency* relates to frequency response being provided at low cost, both now and into the future (Y. Rebours et al., 2007; van der Veen and Hakvoort, 2016).

As power systems transition towards higher instantaneous penetrations of VRE and IBR, SOs are likely to face the following challenges to short-term system balancing that may require existing frequency control arrangements to be revisited:

- VRE adds variability and uncertainty to a power system, particularly if similar technologies are situated within close proximity of one another (i.e. correlated production and/or forecast errors) (Australian Energy Market Operator, 2020a; Keeratimahat et al., 2021). Furthermore, unless an appropriate response is incorporated and enabled in their control systems, VRE and other IBR do not provide FCS. In jurisdictions that do not require, incentivise or allow VRE and IBR to provide FCS, the displacement of synchronous machines in dispatch has led to lower availabilities of resources that provide FCS (Australian Energy Market Operator, 2020b; Denholm et al., 2020; Milano et al., 2018) .
- In jurisdictions with competitive markets for energy and FCS, there is a tension between achieving economically efficient markets and the redundancy, certainty and control afforded to the SO. While the societal and economic costs of power system failure are often very large, it may be difficult for the SO to justify the cost of mitigation measures when they are ongoing or significant and when the joint probability of events or failures is low. The uncertainties associated with energy transition and the impacts

of global warming are likely to present additional challenges. Power system security measures may need to be implemented rapidly and be both robust to a range of futures and resilient in the face of shocks, such as severe weather events (Eggleson et al., 2021; Prakash et al., 2021).

In this paper, we provide insights and recommendations on designing more effective and efficient frequency control arrangements based on experience from the Australian National Electricity Market (NEM). The NEM is currently experiencing relatively high system-wide instantaneous VRE penetrations (just over 60% in 2021) and is expected to experience penetrations as high as 75-100% by 2025 (Australian Energy Market Operator, 2021a, 2021b). Though the NEM's frequency control arrangements were once arguably world-leading (Riesz et al., 2015; Thorncraft and Outhred, 2007), the speed at which system capabilities and needs are changing and the removal of mandatory requirements in 2001 as a part of a paradigm shift from obligation to remuneration for FCS have exposed design issues. In attempting to address these issues, the NEM's rule makers have placed FCS obligations on generators and transmission network operators and have undertaken reforms to the NEM's energy and FCS markets, including introducing a new market to procure emergency fast frequency response (FFR) from IBR. Whilst the NEM is an electrically-isolated power system with a relatively simple energy-only market, the insights and recommendations from this paper are likely to be relevant to other power systems and interconnections as their existing conventional generation retires and VRE deployment levels increase.

This paper offers three contributions to the literature. First, we provide a high-level overview and comparison of the key features of frequency control arrangements in North America and Central and Western Europe, and provide

a review of the most prominent challenges to designing effective and efficient frequency control arrangements and the potential solutions discussed in the literature. Second, we provide a comprehensive update to previous literature on frequency control in the NEM (Riesz et al., 2015; Thorncraft et al., 2008; Thorncraft and Outhred, 2007). Our analysis benefits from recent experience in the NEM that encompasses deteriorating frequency performance, the reintroduction of mandatory requirements and integrating higher shares of VRE. While several of these aspects have been discussed independently in the literature, this paper seeks to provide a structured and holistic analysis of developments in the NEM and their implications for frequency control arrangement design. Third, this article advocates for designers placing a greater emphasis on delivering forward-looking frequency control arrangements during energy transition through the implementation of more robust regulatory mechanisms and ensuring that market-based mechanisms are capable of supporting FCS investment. As highlighted in the following sections, these design features have received surprisingly little attention in the literature.

The rest of the chapter is structured as follows. In Section 3.4, we provide an overview of typical frequency control arrangements, with a focus on restructured electricity industries in North America and Europe, and the main challenges faced in their design. We describe the NEM, its frequency control arrangements and the specific challenges posed by increasing penetrations of VRE and other IBR in Section 3.6. In Section Chapter 3.7, we analyse the performance of the NEM’s frequency control arrangements in responding to the challenges explored in Section Chapter 3.4, with primary frequency response and regulation (secondary frequency response) services in the NEM as case studies. Based on our analysis, we conclude by offering four key insights to operators, regulators

and market-bodies that include understanding control action interactions; ensuring that arrangements are capable of supporting investment in FCS capability; monitoring, assessing and remunerating FCS performance; and considering both regulatory and market-based mechanisms in the design of effective and efficient frequency control arrangements.

3.4 Context

3.4.1 CONVENTIONAL FREQUENCY CONTROL SCHEMES

SOs employ hierarchical and sequential frequency control schemes. In most power systems, such schemes implicitly include inertial response and explicitly define FCS such as primary frequency response (PFR), secondary frequency response (SFR) and tertiary frequency response (TFR). In general, once frequency has deviated from the system nominal value, synchronous machines provide an inertial response that is inherent and immediate in slowing the rate of change of frequency (RoCoF). Within seconds, generators and/or loads provide autonomous and decentralised control action through PFR (Eto et al., 2018; Machowski et al., 2020). PFR arrests the frequency deviation to enable the slower and more centralised control actions of SFR and TFR to return the power system frequency to its nominal value (Ela et al., 2012b; Eto et al., 2010). Should system frequency continue to rise or fall beyond the system's allowable limits, emergency protection schemes such as under-frequency load shedding (UFLS) and over-frequency generation shedding (OFGS) relays may be triggered. In some systems, RoCoF relays are also used to prevent high RoCoFs from tripping or damaging equipment and to contain frequency nadirs and zeniths (Akram et

al., 2020; DGA Consulting, 2016; Miller et al., 2017a).

3.4.2 PROCUREMENT OF FREQUENCY CONTROL SERVICES

Except for inertial response from synchronous machines, the SO procures FCS capacity from capable resources within its control area and, in the case of SFR and TFR, activates FCS energy if necessary. In electricity industries where the SO owns most if not all the generation assets (i.e. a vertically-integrated utility), the SO is able to jointly schedule generation and FCS capacity with knowledge of the condition of the system and the status and cost structures of their plant. However, many electricity industries have undergone some degree of restructuring, which has created a greater role for competitively-oriented decentralised decision-making (van der Veen and Hakvoort, 2016). The diverse outcomes of restructuring processes and differences in technical characteristics (e.g. capabilities of resource mix and network topology) have led to a wide range of frequency control arrangements across power systems (Poplavskaya and de Vries, 2019; Y. Rebours et al., 2007), which have been reviewed and compared extensively within industry and academic literature (Banshwar et al., 2018; Brooks and Lesieurte, 2019; Ela and Hytowitz, 2019; Hewicker et al., 2020; Lopez et al., 2020; Ocker et al., 2016; Y. G. Rebours et al., 2007a, 2007b; Reishus Consulting LLC, 2017; Zhou et al., 2016).

In restructured electricity industries, the provision of more passive FCS (e.g. ride-through capabilities) is usually mandated by regulatory mechanisms such as connection agreements and grid codes, whereas FCS that require additional response capabilities or impose opportunity-costs on suppliers are procured and remunerated by the SO through market-based mechanisms.

In Sections 3.4.3 & 3.4.4, we provide an overview of typical features² and key developments in market-based mechanisms for procuring FCS in North America and Central and Western Europe, respectively. These regions best represent the two prevailing short-term wholesale electricity market models: central dispatch markets, in which the SO issues dispatch instructions, and decentralised or self-dispatch markets, in which resource dispatch is managed by market participants (Ahlqvist et al., 2018). Given that FCS and energy are partially substitutable goods, the characteristics of short-term wholesale electricity markets heavily influence the design of FCS arrangements and thus these regions provide an interesting contrast. However, despite their differences, the SO plays a central role in both of these regions as they determine the area demand for FCS capacity, activate FCS energy as required and are ultimately responsible for ensuring that the power system is balanced and securely operated.

3.4.3 NORTH AMERICAN MARKETS

In North America, central dispatch wholesale electricity markets are operated by an Independent System Operator (ISO) or Regional Transmission Organization (RTO) and are distributed across three synchronous areas. These markets consist of two short-term centralised platforms: a day-ahead market and a real-time market. In the day-ahead market, the SO solves a security-constrained unit commitment problem using supply offers (single or three-part) and demand bids (quantity or price-quantity) to produce day-ahead locational marginal prices and a financially-binding hourly schedule. In the real-time

²We note that there are numerous differences between jurisdictional arrangements and terminology in each of these regions. For a more general overview of potential procurement models, refer to Billimoria et al. (2020).

market, the SO solves a security-constrained economic dispatch problem (typically every five minutes) using generator price-quantity offers and a demand forecast to produce real-time locational marginal prices and a set of physically and financially binding dispatch instructions. Thus, each short-term market is cleared to maximise social welfare whilst respecting network and system security constraints (Chow et al., 2005; Cramton, 2017).

Except for Frequency Responsive Reserves (i.e. PFR), operating reserves (i.e. FCS capacity) are explicitly procured by placing an obligation on load-serving entities to self-provide or purchase their share from SO-run FCS markets (Ela et al., 2012b; Zhou et al., 2016). These FCS markets are usually integrated into day-ahead market and, in most jurisdictions, the real-time market. Standard products in North American markets include Regulation (i.e. SFR during normal operation), Spinning and Non-Spinning Reserves (i.e. TFR deployed following an event) (Ela and Hytowitz, 2019; Hewicker et al., 2020; Zhou et al., 2016). Participants can submit offers for FCS in addition to offer for energy. Unit commitment and economic dispatch permit co-optimisation of energy and FCS procurement. From the perspective of the SO, co-optimisation ensures that the total system cost of achieving an energy supply-demand balance is minimised alongside FCS requirements, subject to network and system security constraints. From the perspective of participants, co-optimisation leads to an FCS price that not only reflects the price offer of the marginal resource, but also any "profit" it forgoes in the energy market (assuming supplier offers reflect their short-run marginal costs) (Ela et al., 2012a; Isemonger, 2009). As such, ISO/RTO FCS markets can compensate opportunity-costs related to the day-ahead and/or real-time market but only allocate costs to load-serving entities through a procurement obligation.

Though North American FCS markets have predominantly procured and remunerated FCS capacity, ISO/RTOs (except Texas' ISO, ERCOT) were ordered to also remunerate Regulation providers for the quantity of energy provided whilst accurately following control signals by the Federal Energy Regulatory Commission's (FERC) Order 755 (Commission, 2011). As such, Regulation providers offer a quantity of capacity, a price for capacity and a price for "mileage", which is the energy delivered. Remuneration for Regulation takes performance (the ability of a resource to follow the ISO/RTO's control signals) into account, though how this is implemented varies between ISO/RTOs (Ela and Hytowitz, 2019; Fernández-Muñoz et al., 2020). A notable example is the PJM RTO, which uses both a standard SFR control signal (RegA) and faster SFR control signal (RegD) intended for battery energy storage systems (BESS). PJM determines how interchangeable a resource's RegD provision is with RegA provision (the marginal benefit factor) to clear the Regulation market and calculates a performance score for use in market clearing and settlement. However, according to the independent market monitor, the omission of the marginal benefit factor from market settlement has led to perverse market outcomes (Brooks and Lesieurte, 2019; Monitoring Analytics, 2021).

3.4.4 EUROPEAN MARKETS

Most of the electricity markets of Central and Western Europe are self-dispatch and consist of two short-term platforms: the day-ahead market and the intraday market, which can be continuous, composed of frequently-run discrete auctions or a combination of the two. Each of these platforms is coupled across the majority of market zones in Europe, with a single price coupling algorithm

used to simultaneously clear zonal day-ahead markets and a single order book compiled to match cross-zonal intraday orders (EPEX Spot, n.d.; NEMO Committee, n.d.). In contrast to North American electricity markets, the market operator is responsible for market operation and is distinct from the Transmission System Operator (TSO). Generation and load are managed by Balancing Responsible Parties (BRP), which must submit binding operational schedules to the TSO ahead of delivery (often by the day prior to delivery). As BRPs become aware of potential deviations closer to real time (e.g. improved forecasts), they are able to adjust their submitted schedules (i.e. remain "balanced") through trades on the intraday market (Lago et al., 2021; Müsgens et al., 2014). BRPs face financial repercussions if they are imbalanced via an imbalance price and, in some jurisdictions, are legally obliged to be balanced (ENTSO-E WGAS, 2021).

Following gate-closure of the intraday market, residual imbalances are primarily addressed by FCS (known as balancing services) procured by the TSO. Standard FCS in Europe include Frequency Containment Reserve (i.e. PFR), automatic Frequency Restoration Reserves (i.e. SFR), and manual Frequency Restoration Reserves and Replacement Reserves (i.e. both TFR), with minimum technical requirements for each specified by the European Network of Transmission System Operators for Electricity (ENTSO-E) (European Network of Transmission System Operators for Electricity, 2013). Depending on the FCS product and the jurisdiction, TSOs may distinguish between FCS capacity (balancing capacity) and the delivery of FCS energy (balancing energy). The provision of one or both is mandated in some cases, but where both are procured competitively, Balancing Service Providers (BSP) typically submit separate offers for FCS capacity and FCS energy (Abbasy, 2012). FCS capacity markets are often cleared days to months in advance of real-time whereas the FCS energy market, which effec-

tively constitutes merit-order or pro rata activation of capacity for FCS energy provision, is cleared within an hour or minutes of real-time (ENTSO-E WGAS, 2021; Ocker et al., 2016; Poplavskaya and de Vries, 2019). FCS capacity costs are typically allocated to power system users via a grid tariff. FCS energy costs are typically allocated to BRPs based on their schedule deviations and an imbalance price, which may differ from the FCS energy price paid to BSPs (Hirth and Ziegenhagen, 2015; Vandezande et al., 2010). As such, European FCS markets generally disincentivise causes of imbalance through the imbalance price, which may also recover or reflect the cost of FCS energy. However, since FCS capacity markets are typically decoupled from and cleared ahead of short-term energy markets, perceived opportunity-costs based on expected short-term energy market prices must be internalised within participants' FCS offers.

Given the relatively high degree of interconnection between transmission systems in Central and Western Europe, cross-TSO initiatives are in place and being expanded to address imbalances and share FCS across the Continental Europe synchronous area. When sufficient cross-TSO transmission capacity is available, initiatives currently in place enable participating TSOs to jointly procure Frequency Containment Reserve capacity, net imbalances (i.e. reduce the demand for SFR by aggregating individual control area imbalances) and jointly procure automatic Frequency Restoration Reserve capacity and energy (European Network of Transmission System Operators for Electricity, 2020). Further efficiency gains are expected following the implementation of integrated market platforms for imbalance netting and balancing energy for SFR and TFR. The implementation of these platforms is mandated by the European Commission's European Balancing Guideline and requires certain FCS product definitions and market features to be harmonised across the balancing energy markets of participating

TSOs (50hz, 2017; European Commission, 2017).

3.5 Designing frequency control arrangements

As with any policy problem, designing frequency control arrangements in restructured electricity industries requires design principles, variables and performance criteria to be established. The public good characteristics of frequency control have heavily influenced arrangement design principles across jurisdictions, such as the common preference for the SO to centrally coordinate FCS procurement and activation (Müsgens et al., 2014; Y. Rebours et al., 2007). In contrast, though some design variables are common, others may only apply to particular systems based on their resource mix, network topology and/or market design. Y. Rebours et al. (2007) discuss design variables for central dispatch markets related to the following arrangement features:

1. FCS procurement;
2. Price formation, which when efficient should lead to FCS prices not only reflecting the true cost of the service, but also its true value to the system; and
3. Allocation of the cost of FCS.

Similarly, Abbasy (2012) discusses the main design variables applicable to European self-dispatch markets. van der Veen and Hakvoort (2016) build upon this work to provide a more comprehensive treatment of design variables in self-dispatch markets. Y. Rebours et al. (2007), Abbasy (2012) and van der Veen

and Hakvoort (2016) all propose some variation of effectiveness and efficiency as performance criteria, with van der Veen and Hakvoort (2016) analysing the various trade-offs between and within each criterion.

Despite the well-defined nature of the design problem, there are several challenges to achieving effective and efficient arrangements. In Sections 3.5.1 and 3.5.2, we present the most prominent challenges and their treatment in the literature.

3.5.1 THE INFLUX OF VRE AND OTHER IBR IN POWER SYSTEMS

As discussed in Section 3.3, VRE adds variability and uncertainty to power systems which, at the very least, can lead to increased procurement and activation requirements for PFR and SFR during normal operating conditions (Ela et al., 2011). Three proposals to address this issue and thus reduce FCS requirements with growing penetrations of VRE have been discussed in the literature. The first is to shorten energy market trading/dispatch intervals (Ocker and Ehrhart, 2017; Riesz and Milligan, 2015) and the time between market gate closure and dispatch (Katz et al., 2019), thereby enabling scheduling based on up-to-date system conditions and forecasts. The second is to increase coordination between control areas within a synchronous area by netting imbalances (King et al., 2011), jointly procuring and dispatching FCS (Scherer et al., 2013) or aggregating them into a single market region (Milligan and Kirby, 2010; Riesz and Milligan, 2015). These two proposals alone have delivered significant system savings in Germany despite growing penetrations of VRE (Hirth and Ziegenhagen, 2015; Ocker and Ehrhart, 2017). The third is for the SO to determine the required quantity of FCS capacity (*dimensioning*) using

dynamic and probabilistic approaches (as opposed to static and deterministic) that adequately reflect current or expected power system conditions and an acceptable level of risk, such as a reliability standard (De Vos et al., 2019; Holttinen et al., 2013; Ortega-Vazquez et al., 2020).

In recent years, SOs have become increasingly concerned with growing penetrations of asynchronous IBR leading to higher RoCoFs and fewer resources offering conventional FCS (Denholm et al., 2020; DGA Consulting, 2016; Hartmann et al., 2019). However, VRE and other IBR are able to provide tunable conventional FCS, FFR and/or an inherent response that strongly resembles the inertial response of synchronous machines³ if this is facilitated by arrangement design (Fernández-Muñoz et al., 2020; Mancarella and Billimoria, 2021; Miller et al., 2017b). Following a contingency event in a low-inertia power system, rapid FCS from IBR can mitigate higher RoCoFs, which when unabated can lead to deeper frequency nadirs and zeniths and the subsequent activation of UFLS or OFGS (Australian Energy Market Operator, 2017a; NERC Inverter-Based Resource Performance Task Force, 2020; Tielens and Van Hertem, 2016).

3.5.2 ACHIEVING ECONOMIC EFFICIENCY

Achieving short-run efficiency entails supplier costs being reflected in their offers and adequately propagated to FCS prices, and the SO assigning at least some portion of FCS costs to system users that create a need for procure-

³The terms *virtual*, *emulated* and *synthetic* inertia have been used in the literature to refer to a proportional active power response to RoCoF. However, these terms do not distinguish whether the inverter control scheme provides an inherent response (i.e. from inverters operated as a voltage source which are commonly referred to as *grid-forming inverters* (Cherevatskiy et al., 2020; Lin et al., 2020)) or a controlled response following frequency measurement (Eriksson et al., 2018; Tielens and Van Hertem, 2016).

ment or activation. A widely used pricing approach in ISO/RTO co-optimised FCS markets is a marginal price which incorporates the marginal resource's short-term market opportunity-costs and their offer, which could reflect potential mileage or wear-and-tear costs (Frew et al., 2021; Zhou et al., 2016). Though improving cost-allocation has been repeatedly proposed in North American literature (Ela et al., 2012a; Isemonger, 2009; Milligan et al., 2011), FCS costs are predominantly socialised across loads based on demand or consumption. In Europe, however, much attention has been given to FCS market pricing, scoring (the order in which offers are selected) and cost-allocation. Specifically, literature on European FCS markets has explored whether pay-as-bid or uniform pricing better facilitates suppliers revealing their true costs (Hirth and Ziegenhagen, 2015; Müsgens et al., 2014; Ocker et al., 2018), the particular offers scoring should consider (Ehrhart and Ocker, 2021; Müsgens et al., 2014) and the design of imbalance prices to sufficiently incentivise short-term balancing (Hirth and Ziegenhagen, 2015; Papavasiliou, 2020; Vandezande et al., 2010). Regardless, both European and North American literature suggest that increased competition in FCS markets is a priority. This could be facilitated by enabling distributed and utility-scale VRE and IBR to qualify for FCS provision, reducing minimum offer quantities, separating raise and lower (positive and negative) products and increasing market clearing frequency and the time resolution of FCS products (Frew et al., 2021; Hirth and Ziegenhagen, 2015; Lago et al., 2021; Poplavskaya and de Vries, 2019). Despite the typically "shallow" nature of FCS markets (i.e. additional supply can significantly reduce prices (Riesz and Milligan, 2015)), dynamic efficiency has received considerably less attention. Notable exceptions include Papavasiliou (2020) and Frew et al. (2021), who briefly discuss the potential for FCS scarcity pricing to better reflect the true

value of system reliability and support investment in FCS.

An additional challenge in implementing efficient FCS markets involves the trade-offs that must be considered. As outlined in Section 3.3, some mechanisms that improve efficiency may come at the expense of visibility, control and redundancy afforded to the SO, which typically does not own any FCS-capable assets. The former is typically achieved using market-based mechanisms and the latter through regulatory mechanisms. Ela et al. (2012b), Billimoria et al. (2020), Mancarella and Billimoria (2021) and Lal et al. (2021) discuss several prerequisites for implementing market-based mechanisms and stress that balance between market-based and regulatory mechanisms may be required. However, achieving this balance can be challenging due to the asymmetry between the risk of an event and its consequences, and that between the benefits of market efficiency and the cost of resilient and robust mitigation measures (Lal et al., 2021; Mancarella and Billimoria, 2021). Another trade-off is the arbitrary definition of FCS products. Market-based mechanisms will work best when FCS are "discrete" commodities and fungible. However, this ignores the wide "spectrum" of resource technical capabilities. Favouring fungibility may obscure physical and control interdependencies between FCS and restrict or fail to incentivise higher quality provision, thereby leading to an inefficient overall outcome (Gimon, 2020; MacGill and Esplin, 2020).

3.6 Frequency control arrangements in the Australian National Electricity Market

3.6.1 OVERVIEW OF THE NEM

The NEM consists of five regions corresponding to the eastern and southern Australian states of New South Wales (NSW), Queensland (QLD), Victoria (VIC), South Australia (SA) and Tasmania (TAS) (Figure 3.1). In 2020, the NEM serviced a total electricity consumption of approximately 190 TWh/year and a peak demand of approximately 35 GW across a ‘stringy’ network over 5000 kilometres long with relatively weak interconnection between regions through inter-connectors (Australian Energy Regulator, 2021; MacGill and Esplin, 2020). As high voltage DC transmission connects the island of Tasmania to the mainland state of Victoria, the NEM consists of two synchronous areas operated at a nominal frequency of 50 Hz: the mainland states and Tasmania. Due to the large distances involved, the NEM is not electrically connected to other markets.

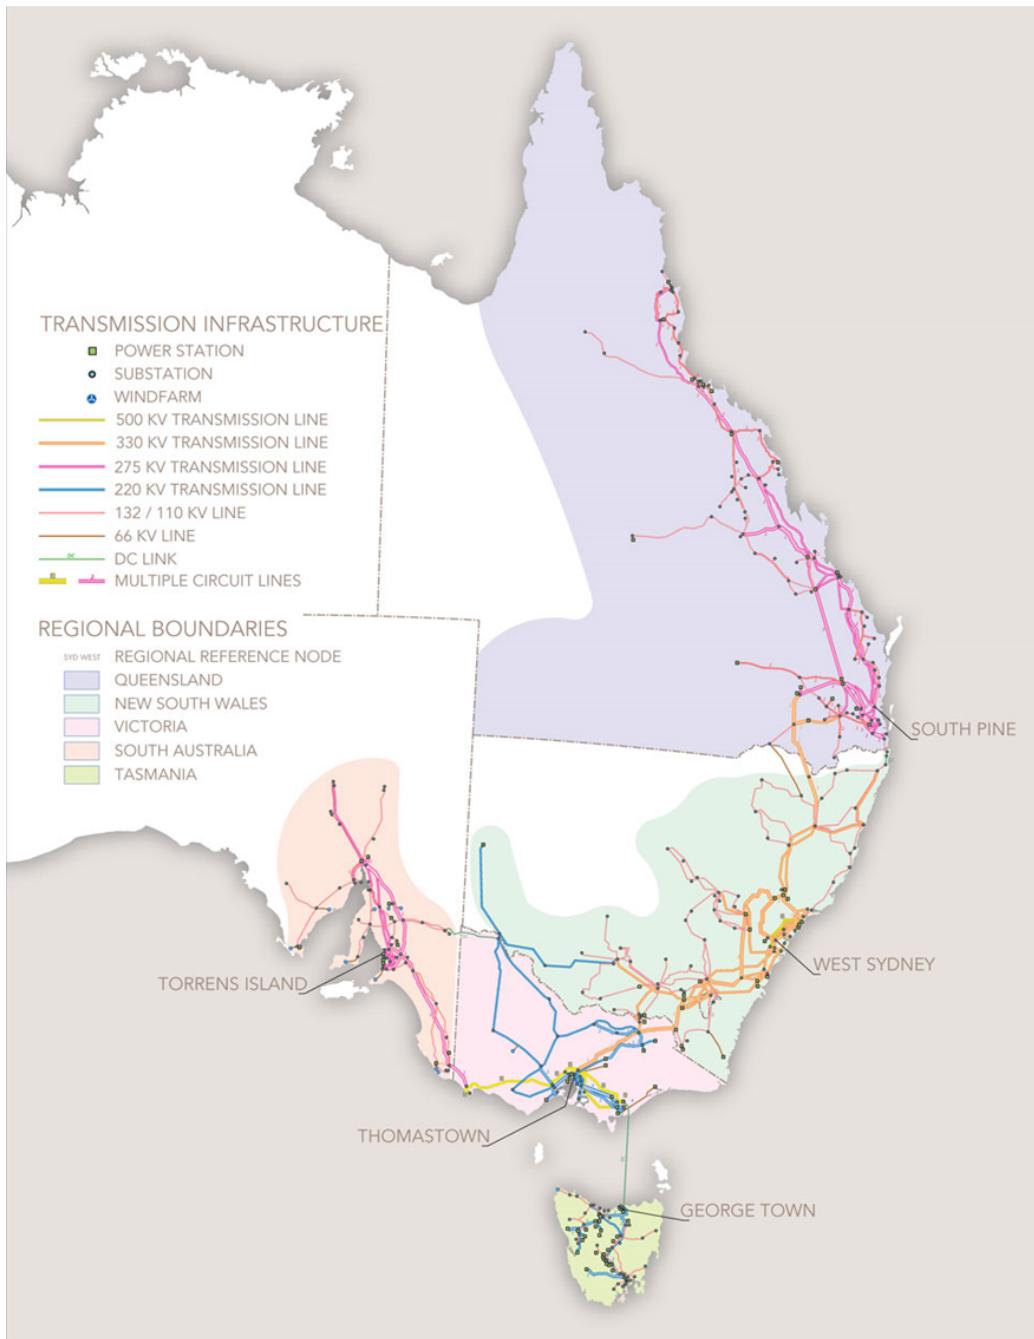


Figure 3.1: Regions/states and transmission in the NEM. Source: Australian Energy Market Commission (n.d.)

The NEM is a single platform (real-time) energy-only market with no explicit capacity mechanisms. Unit commitment is managed by market participants, who must submit resource-specific offers for energy and Frequency Con-

trol Ancillary Services (FCAS) capacity in price-quantity pairs the day before delivery. These offers are subsequently used in a pre-dispatch process, which provides forecasted market information (e.g. generation and demand, interconnector flows, prices, etc.) to market participants. While prices in submitted offers are fixed, participants may change the energy volumes in their offer up to a few minutes before the delivery dispatch interval commences. As the NEM is single-sided, security-constrained economic dispatch is run every five minute to meet forecast demand at least cost, subject to network and security constraints. Much like ISO/RTO markets, energy and FCAS markets are co-optimised with respect to technical feasibility and cost (Australian Energy Market Operator, 2021c, 2017b). Real-time dispatch produces zonal marginal prices for energy and FCAS, which form the basis for market settlement in each of the NEM's regions.

3.6.2 FCAS MARKETS

The NEM's competitive FCAS markets consist of eight separate raise and lower FCAS products that can be classed as regulation FCAS or contingency FCAS, with the former responsible for control when frequency is within the normal operating frequency band (NOFB) and the latter for when frequency deviates outside the NOFB after an event (see Table 3.1). This is similar to arrangements in many ISO/RTO markets, where FCS are divided into event and non-event reserves (Ela et al., 2011).

Security-constrained economic dispatch includes system-wide and regional FCAS requirement constraints. Regulation and contingency FCAS are typically procured for and from all regions of the NEM in the absence of binding local constraints. Local requirements for FCAS procurement apply to Tasmania

and to the other regions of the NEM if they experience network constraints, are at risk of separation or when islanded⁴ (Australian Energy Market Operator, 2015a, 2010). Prices are calculated for each region of the NEM based on the sum of the shadow prices of local and system-wide constraints and FCAS costs are allocated to market participants based on a "Causer Pays" principle, which bears similarities to imbalance penalties in European markets (Australian Energy Market Operator, 2015b). FCAS providers are paid for enablement (capacity provision) regardless of whether their capacity is activated (Australian Energy Market Operator, 2015b; Riesz et al., 2015; Thorncraft and Outhred, 2007).

For a resource to provide FCAS, it must meet pre-qualification criteria and undergo a registration process. Historically, FCAS was provided by thermal generation (predominantly coal and some gas), hydropower generation and some large loads, such as hydropower pumps and an aluminium smelter, as only resources associated with wholesale energy market participants were permitted to offer FCAS. In 2017, the first battery energy storage system (BESS) in the NEM began to offer FCAS and market reform enabled demand response (DR) aggregators to offer contingency FCAS without participating in the energy market (Aurecon, 2019; Australian Energy Market Commission, 2016). In recent years, new FCAS market entrants have included several DR aggregators, new BESS, distributed PV-battery virtual power plants and wind farms (the latter two through trials) (Aurecon, 2019; Australian Energy Market Operator, 2021d; Australian Energy Regulator, 2021). However, these new entrants tend to offer smaller vol-

⁴From 2015-2019, the Tasmanian and mainland contingency FCAS markets were separated on average for 40% of the time due to the technical limitations of the high voltage DC interconnector (GHD Advisory, 2019). However, if the interconnector flow is within the appropriate operating envelope, NEM-wide FCAS procurement is possible as the interconnector's frequency controller enables FCAS transfer between the mainland and Tasmania (Australian Energy Market Operator, 2017c).

umes and there are still relatively few FCAS providers in the NEM, with no single FCAS product having more than 30 providers across the system or 8 providers in any one region (Australian Energy Regulator, 2021).

Table 3.1: Frequency control ancillary services in the National Electricity Market. Sources: Thorncraft and Outhred (2007), Riesz et al. (2015), Australian Energy Market Operator (2017a), Australian Energy Market Operator (2010), Australian Energy Market Operator (2015a), Australian Energy Market Operator (2015b), Australian Energy Market Operator (2020c).

Product	Control action	Procurement	Timeframe
Regulation (raise & lower)	Centralised control through AEMO Automatic Generation Control (AGC), which adjusts unit set points	Minimum capacity enablement with dynamic additional reserve setting based on time error for every dispatch interval	Unit set points adjusted by AGC every 4-s over dispatch interval
6-s contingency (fast raise & lower)	Decentralised control response to locally-measured frequency, typically delivered through droop settings in governors or inverters or frequency-responsive loads (raise only)	Capacity enablement based on size of largest generator (raise) or load block (lower), minus assumed load relief for every dispatch interval	Full response delivered by 6-s after frequency has left NOFB and orderly transition to 60-s service
60-s contingency (slow raise & lower)			Full response delivered by 60-s after frequency has left NOFB and orderly transition to 5-min service

Product	Control action	Procurement	Timeframe
5-min contingency (delayed raise & lower)	Response pre-configured by AEMO but triggered in response to locally-measured frequency. Typically consists of unit control systems increasing or decreasing set points with sustained frequency deviations	Capacity enablement based on size of largest generator (raise) or load block (lower), minus assumed load relief and corresponding Regulation FCAS procurement for every dispatch interval	Full response delivered by 5-min after frequency has left NOFB and sustained until frequency returns to NOFB or 10-min has elapsed

3.6.3 NEM OPERATION AND GOVERNANCE

The Australian Energy Market Operator (AEMO) is responsible for the operation of the market and power system in the NEM in accordance with the National Electricity Rules (NER). They act as a single buyer of dynamically-determined volumes of FCS. The Australian Energy Market Commission (AEMC) is responsible for making or amending rules for the NEM. Both AEMO and the AEMC provide operational and strategic advice to the Energy Security Board (ESB), which is responsible for coordinating market oversight and longer-term reform such as the ongoing post-2025 NEM market design framework. As the market regulator, the Australian Energy Regulator (AER) monitors compliance with and enforces the NER.

3.6.4 CHALLENGES TO FREQUENCY CONTROL POSED BY VRE AND IBR

The rapid pace at which IBR have entered the NEM was preceded by the exit of FCAS-capable synchronous generation (Figure 3.2). Many of these IBR do not currently offer FCAS or any meaningful frequency response to deviations other than the most extreme. Furthermore, though updated equipment standards require distributed IBR to ride-through and/or respond to certain frequency deviations, some inverter models have been found to be non-compliant and there is still a significant number of legacy systems in the NEM (Australian Energy Market Operator, 2021e; Stringer et al., 2020).

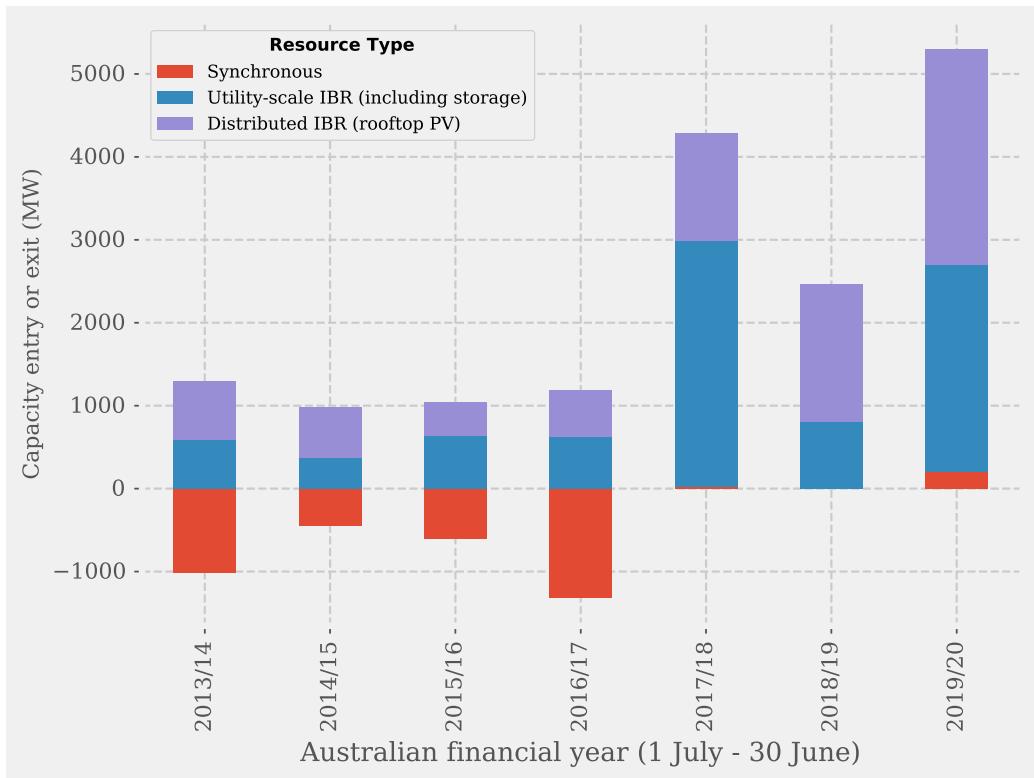


Figure 3.2: Entry (of IBR) and exit (of synchronous generation) capacity in the NEM between Australian financial years 2013/14 and 2019/20. Data source: Australian Energy Market Commission (2020a).

The challenges that VRE and other IBR pose to frequency control have been exacerbated by the NEM's network topology. Limited interconnection between regions reduces the NEM's cross-regional balancing capabilities and increases the likelihood of synchronous area separation following power system events, a consequence of which is that local requirements for FCAS may apply (Australian Energy Market Operator, 2019a). Furthermore, correlated variability and uncertainty can arise from intensive development of similar utility-scale VRE in areas with good wind or solar resources (as might occur in the Renewable Energy Zones identified by AEMO's least-regrets transmission planning study (Australian Energy Market Operator, 2020d)). This is also an issue at the distribution level given the significant installed capacities of rooftop solar PV located

within proximity of one another in suburban areas (Australian Energy Market Operator, 2021f).

3.6.5 FEATURES OF NEM FREQUENCY CONTROL ARRANGEMENTS

Below, we highlight some noteworthy features of the NEM's frequency control arrangements that complement or contrast previous analyses in Thorncraft and Outhred (2007), Riesz et al. (2015) and Thorncraft et al. (2008).

3.6.5.1 Control mechanisms:

- There is no explicit TFR FCS in the NEM. Security-constrained economic dispatch is run every five minutes and is expected to relieve PFR and SFR and address supply-demand imbalances (Australian Energy Market Operator, 2020c).
- PFR from contingency FCAS is only required to respond to frequency deviations outside the NOFB (50 ± 0.15 Hz). When FCAS markets were implemented in the NEM in 2001, mandatory PFR around a tight deadband of ± 50 mHz was removed from the NER (Australian Energy Market Operator, 2019b). Since then and prior to 2020, there was no explicit procurement or requirement for tight-deadband PFR provision within the NOFB. The decline in the provision of tight-deadband PFR in the NEM is discussed further in Section 3.8.
- The mainland synchronous area is controlled as one balancing area by AEMO's AGC (i.e. no tie-line biased SFR) despite limited interconnection between adjacent regions (Australian Energy Market Operator, 2018a).

AGC control performance is discussed further in Section 3.9.

3.6.5.2 Market-based mechanisms:

- There are relatively few limits imposed on FCAS participation. FCAS can be provided by any technology through variable, switched or hybrid controllers (Australian Energy Market Operator, 2020e). Furthermore, regulation and contingency FCAS products are unbundled into raise and lower services, and contingency FCAS products are unbundled based on response time. All of these features improve the potential for participation and competition in FCAS markets, though market participants can and often are enabled to provide multiple FCAS.
- FCAS unbundling has enabled a ‘Causer Pays’ cost allocation framework. Raise contingency FCAS costs, which are incurred as insurance for the failure of a generator, are distributed amongst generators in proportion to their generation in the trading interval. Similarly, lower contingency FCAS costs are distributed amongst loads based on their consumption in a trading interval. A complex methodology is used to calculate monthly, portfolio-wide Causer Pays contribution factors (outlined in Australian Energy Market Operator (2018b) and summarised in Riesz et al. (2015)) that determine how regulation FCAS costs are allocated to market participants. We discuss the issues associated with this methodology in Section Chapter 3.9.
- The NEM co-optimises FCAS that respond within similar timeframes. In the absence of constraints, the volume of 5-minute delayed contingency FCAS procured is reduced by the volume of regulation FCAS enabled

(Australian Energy Market Operator, 2010).

3.6.5.3 Regulatory mechanisms:

- Connecting utility-scale generators negotiate the frequency response capability of their plant between a minimum access standard and an automatic access standard, the latter guaranteeing network access to the applicant. A suite of generator standards for frequency response were added to the NER in October 2018 and apply to any newly-connecting generation. These standards include minimum frequency disturbance ride-through times, automatic generation output reduction following extreme over-frequency events and the capability to operate in a frequency response mode with a proportional response⁵ (Australian Energy Market Commission, 2018a).
- Transmission Network Service Providers (TNSPs) are required to address any inertia shortfalls identified by AEMO within the NEM region in which they build, maintain, plan and operate the transmission network. AEMO's assessment considers whether an islanded region can be securely operated following a contingency event. Shortfalls can be reduced by special protection schemes (e.g. disconnection of load following interconnector trip) and the provision of FFR, but they must ultimately be met by providers of inertial response (Australian Energy Market Operator, 2020g, 2018c).

⁵In addition to these standards, newly-connected generation may install a synchronous condenser under the ‘do no harm’ requirements outlined in the NER if they are determined to have an adverse impact on system strength. Particularly when fitted with a rotating mass or flywheel, these synchronous condensers can also provide inertial response (Australian Energy Market Operator, 2020f).

3.7 Insights from the National Electricity Market

In light of existing challenges and those posed by energy transition, effective and efficient frequency control arrangements should enable sufficient FCS to be procured across timeframes and strike the appropriate balance between efficiency and robustness. In the following sections, we review issues associated with two core elements of the NEM’s frequency control hierarchy (i.e. PFR and SFR), assess their physical and economic performance and outline reform underway. Drawing on developments in the NEM and our review of arrangements in North America and Europe, we then discuss the merits and flaws of regulatory and market-based mechanisms with respect to sufficiency and efficiency. We conclude by offering insights that could serve as design principles for jurisdictions revisiting their frequency control arrangements during energy transition.

3.8 Declining tight-deadband primary frequency response

When FCAS markets were implemented in 2001, mandatory tight-deadband PFR was superseded by two types of PFR: voluntary PFR within the NOFB and competitive procurement for PFR outside the NOFB in the form of contingency FCAS (Australian Energy Market Operator, 2019b).

As such, the NEM’s frequency control scheme deviated from what has been argued to be international best practice as it only explicitly specified and procured wide-deadband PFR (i.e. deadband of ± 150 mHz) (Australian Energy Market Operator, 2019b). In contrast, ENTSO-E specifies that PFR providers

have a deadband no greater than \pm 10-15 mHz depending on the control area (European Network of Transmission System Operators for Electricity, 2013) and FERC Order 842 mandates all newly-connecting generation in US interconnections to operate frequency-responsive control equipment with maximum deadbands of \pm 36 mHz (Federal Energy Regulatory Commission, 2018).


In recent years in the NEM, the lack of an incentive or requirement for tight-deadband PFR and perceived disincentives to its provision (through Causers Pays contribution factors discussed further in Section 3.9) has led to many synchronous generators that once provided tight-deadband PFR to widen deadbands or install control systems that block or dampen PFR from the speed governor within the NOFB (Australian Energy Market Commission, 2020b). Furthermore, many VRE generators were deployed in the NEM and connected with inverter control systems that were unresponsive to any frequency deviations other than the most serious.

The extent to which tight-deadband PFR provision had declined in the NEM and the consequences of this became clear to AEMO following a major power system incident on the 25th of August 2018 (Australian Energy Market Operator, 2019c). Prior to the event, the QLD region was exporting \sim 900 MW to the rest of the NEM. Around 13:11:41, lightning strikes at the QLD-NSW interconnector resulted in the QLD region being separated from the rest of the NEM with excess supply. The SA region was exporting \sim 200 MW prior to the event and following QLD's separation, this increased by more than 200 MW in response to under-frequency. The sudden increase in active power flow triggered an emergency scheme that disconnected SA from the NSW-VIC synchronous area, resulting in local over-frequency.

There were diverse responses from various generators following the double separation event. While many synchronous generators provided some form of PFR though not enabled for FCAS, their response was withdrawn by their load controllers in several cases so that the unit could return to its dispatch target (e.g. green and pink lines in top frame of Figure 3.3). Wind and solar farms were either unresponsive, tripped due to protection settings in their inverters, or reduced their active power output in line with performance standards negotiated in their connection agreements (middle and bottom frames in Figure 3.3). AEMO attributed slow frequency recovery and under-frequency load shedding in NSW and VIC to insufficient PFR from generators and a lack of appropriate contingency FCAS within the islanded regions. Over 50% of fast and slow raise contingency FCAS needed in NSW-VIC was enabled in SA and QLD, whilst QLD had no lower FCAS enabled to respond to over-frequency⁶ (Australian Energy Market Operator, 2019c).

⁶AEMO is currently investigating appropriate regional requirements for FCAS, particularly for contingency FCAS in the terminal regions of QLD and SA (Australian Energy Market Operator, 2020h, 2019d).

QLD Super-critical Coal Generators

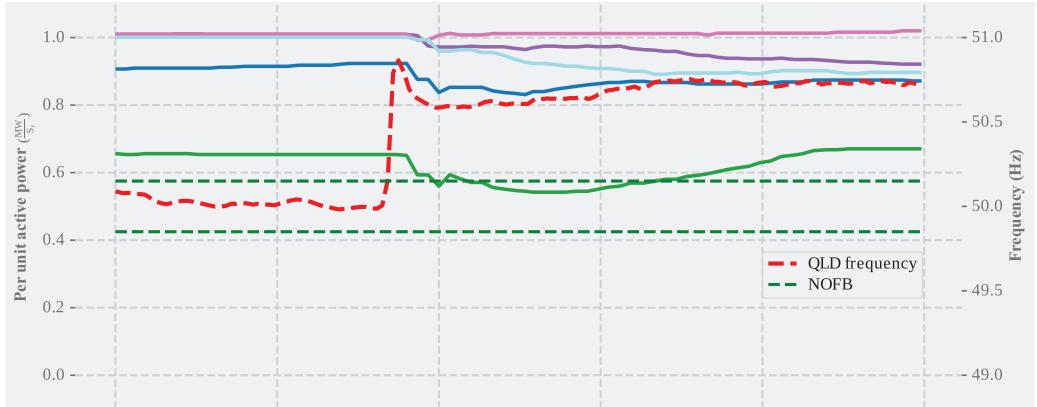

QLD Solar PV Farms



SA Wind Farms

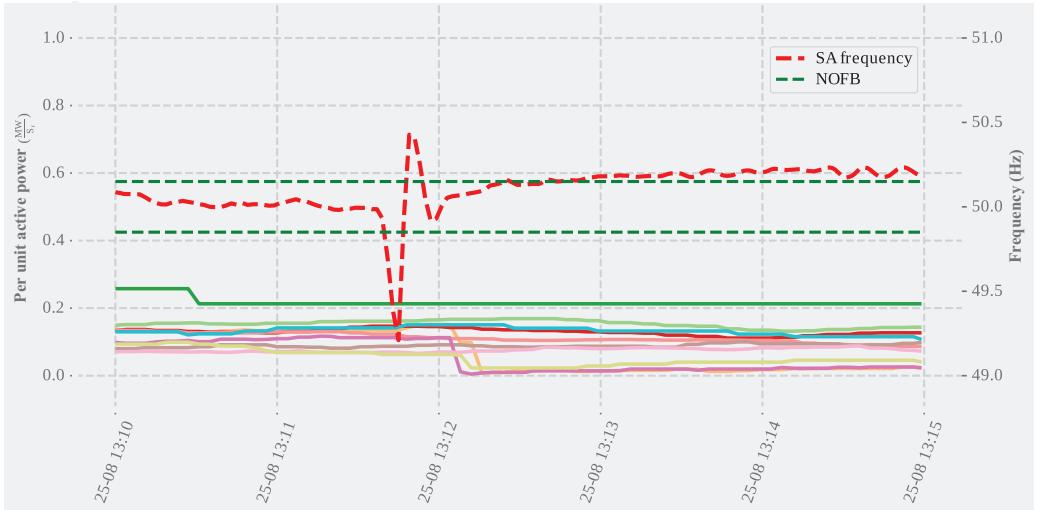


Figure 3.3: Active power output of QLD super-critical coal generators (top), SA solar PV farms (middle) and SA wind farms (bottom). The response of an individual generator is denoted by solid lines (obtained from 4-second AEMO SCADA data using NEMOSIS (Gorman et al., 2018)). None of these generators are enabled for FCAS. The red dashed line in each frame is the regional frequency as measured by high-speed (1-second) phasor measurement units.

Prior to this incident, deteriorating control of frequency within the NOFB was of concern to AEMO and the AEMC, and trials and investigations were recommended to inform the design of an incentive for tight-deadband PFR provision (Australian Energy Market Commission, 2018b). However, this separation event demonstrated the “urgent need for regulatory changes to arrest the ongoing decline in frequency performance in the NEM” and to enhance “the resilience of the NEM to similar major disturbances”, with AEMO submitting a rule change proposal for all capable generators in the NEM to provide mandatory PFR with a maximum deadband of ± 0.015 Hz (i.e. 10% of the NOFB) (Australian Energy Market Operator, 2019b).

This rule was initially incorporated into the NER in 2020 as a temporary arrangement through the addition of a “sunset” after three years to demonstrate the AEMC’s commitment to investigating incentives or market-based mechanisms for tight-deadband PFR (Australian Energy Market Commission, 2020b, 2020c). AEMO has specified PFR settings, including maximum droop and response time, but is unable to require generation to reserve headroom for PFR (Australian Energy Market Operator, 2020i).

3.9 Performance and efficiency issues of regulation services

For SFR provided by regulation FCAS within the NOFB to be effective, the dynamics of the system need to accommodate slower SFR control action and the centralised secondary controller (in the NEM, AEMO’s AGC) needs to be properly configured. Prior to the introduction of mandatory PFR in the NEM,

AEMO observed no significant improvement in NOFB frequency stability despite several increases in the minimum volumes procured for regulation FCAS in 2019 (Australian Energy Market Operator, 2019b). This is likely due to:

- A lack of fast and decentralised tight-deadband PFR supporting slower SFR;
- Inappropriate control signals being calculated within the AGC due to the use of rate limiters to account for ramping constraints, signal filtering and generator controller models that do not accurately reflect a unit's frequency response (DIgSILENT, 2017). The latter is the consequence of an absence of control coordination between market participants and AEMO; and
- Variable communication delays between individual unit controllers and AEMO's AGC system, and disparate response times from generators.

Furthermore, the control of all mainland regions as one balancing area can be problematic in the event of separation. AGC control of regulation FCAS enabled in islanded regions may exacerbate local frequency deviations when responding to the AGC frequency reference. This was the case during the double separation event on the 25th of August 2018, in which the AGC instructed raise regulation FCAS generators in QLD and SA to respond to under-frequency in the AGC frequency reference despite local over-frequency (Figure 3.4). Such incorrect control action can occur until AEMO is able to manually reconfigure the AGC to treat each island as a control area - a process which can take up to 15 minutes (Australian Energy Market Operator, 2019c) .

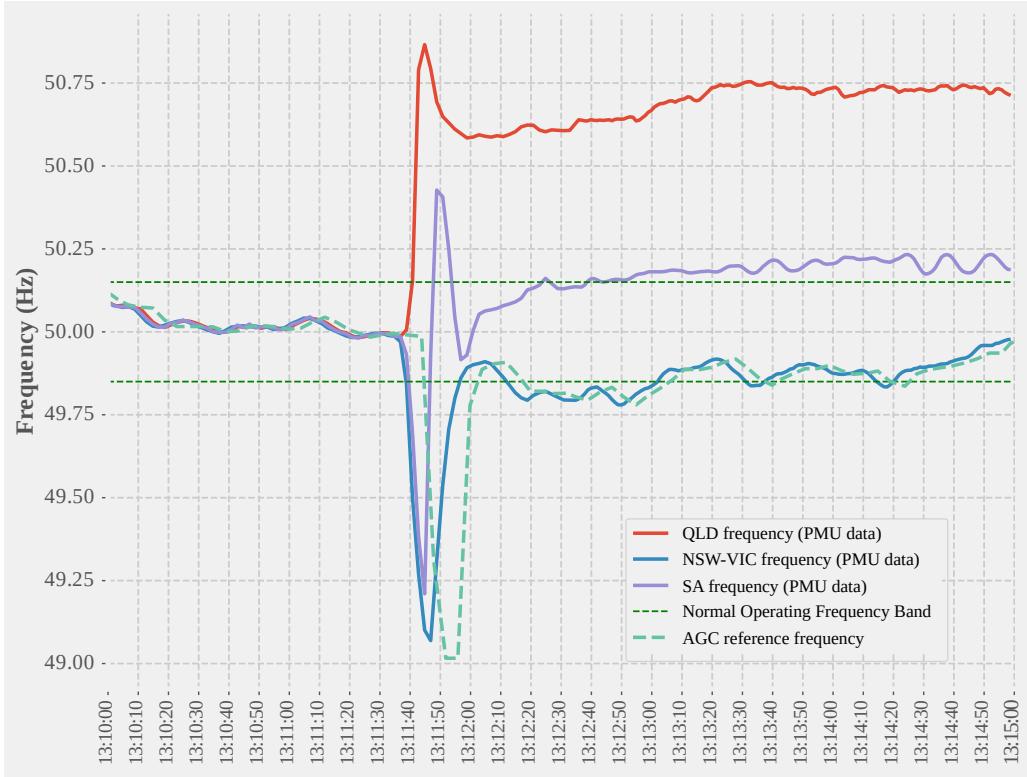


Figure 3.4: Regional phasor measurement unit frequency data and AGC reference frequency data from AEMO’s NSW control centre (obtained using NEMOSIS (Gorman et al., 2018)) during the power system event on the 25th of August, 2018. Note that the AGC reference frequency deviates in the opposite direction to local frequency in QLD and SA.

Over time, inefficiencies in regulation FCAS procurement and cost-allocation have also become apparent. Regulation FCAS procurement in the NEM is dynamic beyond a minimum volume, but the dynamic component is based on the system time error (Australian Energy Market Operator, 2015a). Time error control is largely unnecessary as modern clocks no longer rely on power system frequency to keep the time (Y. Rebours et al., 2007). Furthermore, whilst AEMO is required to control the NEM within certain time error limits, these have been relaxed in recent years (Australian Energy Market Commission Reliability Panel, 2017). Given that time error is no longer prioritised as a control objective, dynamic regulation FCAS procurement based on better measures of

sustained frequency deviation (e.g. mean absolute error as suggested by Riesz et al. (2015)) and/or a modelled distribution of potential intra-dispatch ramp uncertainty may be more suitable.

Regulation FCAS costs are allocated to market participants based on their contribution factor, a calculation which represents the extent to which the participant has contributed to the need for regulation FCAS through a deviation from a dispatch trajectory. Though the calculation methodology assigns weights to a generator or load's dispatch trajectory deviation based on the AGC regulation direction and mileage requirement every 4 seconds, the disincentive for dispatch deviation suffers from a disconnect to causation. This is because the contribution factors of a generator or load are averaged over a 5-minute dispatch interval, summed over a 28-day period and then within a market participant's portfolio (Australian Energy Market Commission, 2018b; Australian Energy Market Operator, 2018b; Australian Energy Regulator, 2020).

Much like portfolio-based balancing in Europe, the aggregation of contribution factors enables a market participant to offset antagonistic deviations with assisting deviations (from the provision of tight-deadband PFR) across its resources and time. However, the complexity and opacity of the methodology and cost-allocation process has contributed to the withdrawal of tight-deadband PFR in the NEM. Several generators disabled governor response in the NOFB in the belief that dispatch adherence alone will minimise Causer Pays liabilities (DIgSILENT, 2017).

3.10 NEM assessment and outlook

Though the introduction of competitive FCAS markets in 2001 initially resulted in significantly lower FCAS prices in the NEM (Riesz et al., 2015; Thorn-craft and Outhred, 2007), volume-weighted average FCAS prices, particularly those for raise regulation and contingency services, have increased relative to the volume-weighted average energy price since 2016 (Figure 3.5). Furthermore, the increases in minimum regulation FCAS volumes and reductions in assumed load relief in 2019 have raised the procured volumes of regulation and contingency FCAS, respectively. Together, these factors have contributed to higher NEM-wide FCAS costs (Australian Energy Market Operator, 2019e). While quarterly FCAS costs were less than 1% of quarterly total NEM costs in 2015, 50% of all quarters from 2017 to 2020 had FCAS costs that were between 1-2% of total NEM cost (Australian Energy Regulator, 2021).

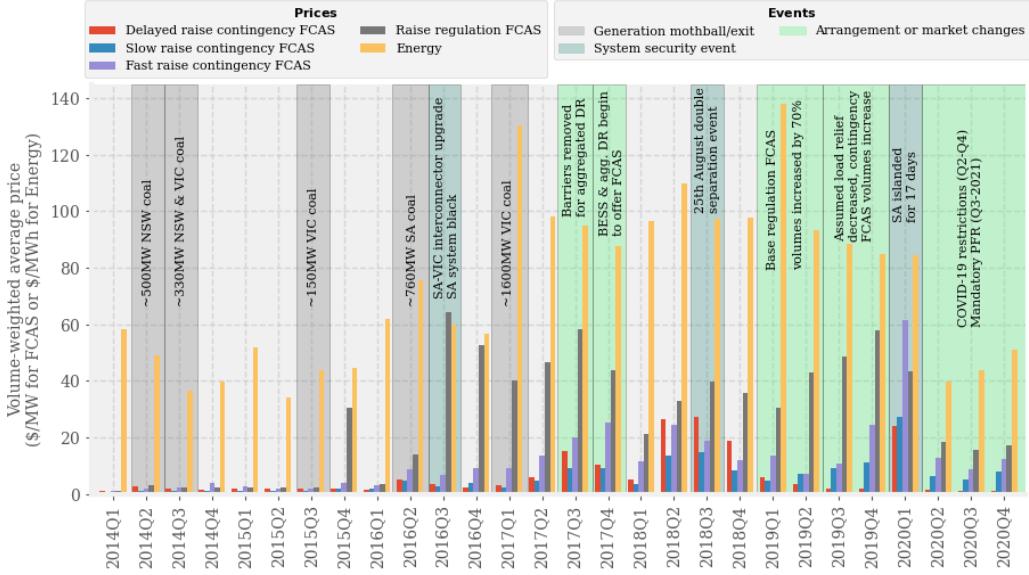


Figure 3.5: Events and volume-weighted NEM-wide average quarterly prices for energy, raise regulation FCAS and raise contingency FCAS in the NEM. The entry of new albeit smaller FCAS providers in 2017 was preceded by the retirement of several large thermal generation. Q1 2020 FCAS prices were high due to local procurement in the SA region, which was islanded for approximately two weeks. Note that while average energy prices fell in Q2-Q4 in 2020 to levels previously seen in 2014-2015 (due to lower demand during COVID-19 lockdowns), FCAS prices remained relatively high. Five-minute price and volume data obtained using NEMOSIS (Gorman et al., 2018).

Prior to the implementation of mandatory PFR, higher NEM FCAS costs were arguably not accompanied by an improvement in frequency control performance. Alongside deteriorating frequency control performance within the NOFB (Figure 3.6), AEMO has expressed a loss of confidence in the NEM's resilience to complex power system events, such as the double separation incident on the 25th of August 2018 (Australian Energy Market Operator, 2019b). These events are typically more severe than the 'credible' contingency events (i.e. N-1 contingency) that dictate the volume of contingency FCAS procured.

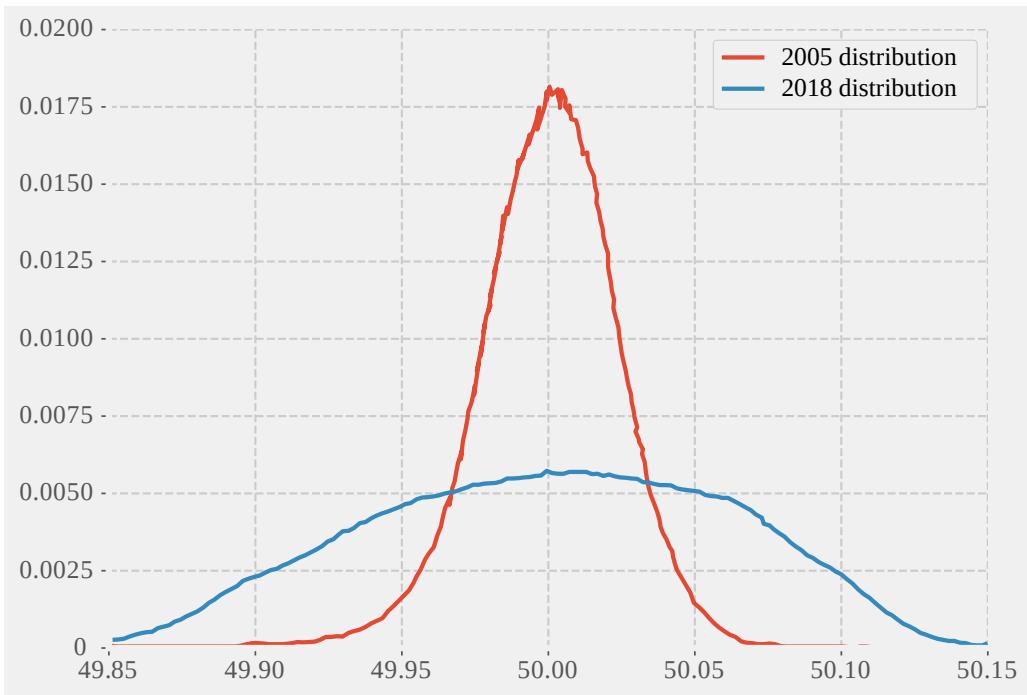


Figure 3.6: Normalised distribution of mainland frequency within the NOFB in 2005 and 2018. Reproduced from (Australian Energy Market Operator, 2019d)

Since the implementation of the mandatory PFR, settings specified by AEMO have been applied to a majority of large synchronous generators ($> 200\text{MW}$) and some smaller synchronous generators. Despite the absence of requirements for maintaining headroom and/or footroom, preliminary analysis by AEMO⁷ suggests that mandatory PFR has delivered better control of frequency within the NOFB (see Figure 3.7) and reduced excursions beyond the NOFB (Australian Energy Market Operator, 2021f). As a result of this initial success and further technical advice provided by AEMO, the AEMC has indicated that it intends to retain mandatory PFR at a tight-deadband following the “sunset” of the initial rule (Australian Energy Market Commission, 2021a).

⁷We note that AEMO has yet to complete mandatory PFR implementation. In particular, settings have yet to be changed for many VRE plant as inverter control system software changes are being trialled.

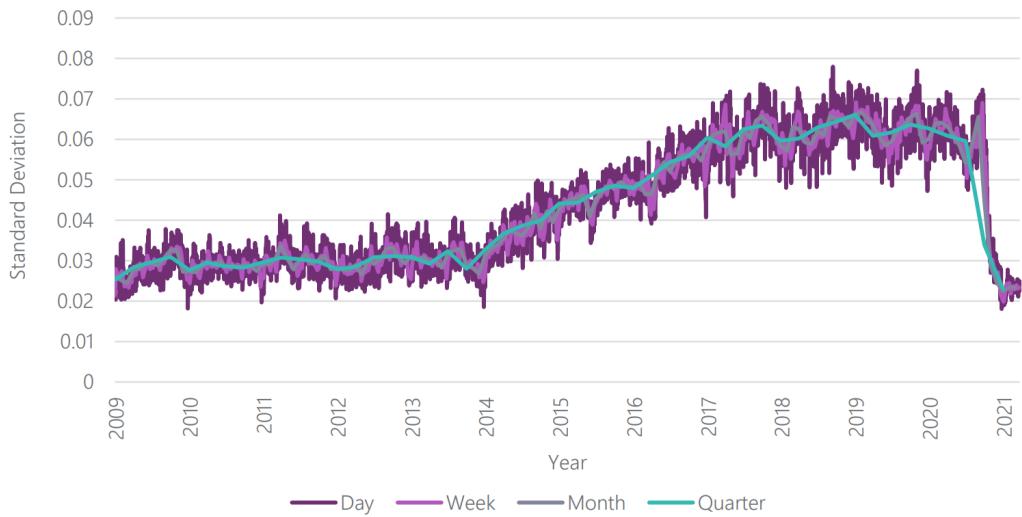


Figure 3.7: Standard deviation of mainland frequency grouped by each day, week, month or quarter from 2009 to 2021. Some initial PFR setting changes were made in late September 2020 and many generators moved to final settings in late October 2020. Source: Australian Energy Market Operator (2021f).

However, this initial success may be a result of the headroom maintained by these generators for risk management purposes (e.g. defending contract positions) and any headroom made available to the system through the displacement of more expensive synchronous capacity by VRE. Given that several large synchronous generators are expected to retire in the coming decades (Australian Energy Market Operator, 2020d), continuing to rely on this “free” headroom (and any available footroom) into the future may reduce the potential resilience benefits of widespread, tight-deadband PFR and place a greater burden on generators that do reserve headroom and hence respond. The AEMC is proposing to address this issue by paying resources that provide assisting tight-deadband PFR (“double-siding”) (Australian Energy Market Commission, 2021a).

Presently, several other operational and market changes are being considered or implemented with the goal of improving the effectiveness of arrangements in the NEM. AEMO is investigating the use of dispatch constraints to (Aus-

Australian Energy Market Operator, 2021g):

- Procure contingency FCAS volumes based on system inertia;
- Apply regional contingency and regulation FCAS requirements; and
- To limit the amount of switched contingency FCAS procured. Switched FCAS has a number of limitations compared to governor-like control (Australian Energy Market Operator, 2020b).

These additional constraints will likely improve the effectiveness of frequency control arrangements but may lead to higher FCAS costs. In addition to these procurement changes, the AEMC has made a rule to introduce raise and lower contingency markets for FFR by October 2023, each with a likely response time of 1 second (Australian Energy Market Commission, 2021b; Australian Energy Market Operator, 2021h). Whilst AEMO has highlighted that potential stability issues and interconnector maloperation will need to be managed (e.g. through delivery caps or provision constraints) (Australian Energy Market Operator, 2021i), these FFR markets, along with the ESB's proposals for short-term scheduling and/or procurement of inertial response (Energy Security Board, 2021), will likely improve AEMO's operational toolbox for managing a low-inertia NEM.

3.10.1 REACTIVE REGULATORY REQUIREMENTS

Despite a broad set of FCS markets, there is a high degree of reliance on regulatory mechanisms in the NEM. Performance standards and mandatory PFR enforced by connection requirements in the NEM have recently been aligned with international grid-codes (Roberts, 2018). As argued by TNSPs and AEMO dur-

ing the mandatory PFR rule change process, near-universal widespread provision of frequency control should lead to relatively low costs for individual participants and be outweighed by greater visibility and certainty for AEMO alongside the system-wide benefits of improved physical frequency control performance (Australian Energy Market Operator, 2019b; Dillon, 2019; Hopwood, 2019).

Regulatory mechanisms are ideal for mandating basic FCS capabilities as a condition for access, which may reduce the need to procure more specialised FCS, or where FCS faces significant barriers to efficient price formation or unbundled procurement. The latter reasons are particularly pertinent in the NEM. Current FCAS prices do not appear to be incentivising FCS provision from the vast majority of VRE generators, which have business models centred around energy provision (Australian Energy Market Commission, 2021c; Meegahapola et al., 2021). Furthermore, procuring inertial response is challenging due to its inseparability from system strength provision and unit commitment costs (Bilimoria et al., 2020). With respect to these challenges, regulatory mechanisms in the NEM have assisted in ensuring some level of frequency response from most power system resources (e.g. mandatory PFR) and improving the ability of AEMO and TNSPs to coordinate the procurement of essential but “lumpy” FCS (e.g. inertia shortfall mechanism).

While mechanisms such as mandatory PFR are likely to improve the robustness of frequency control arrangements, it may be difficult for other regulatory mechanisms to keep in step with changing physical performance requirements in systems rapidly facing higher penetrations of VRE and IBR. Regulatory mechanisms are often only updated after a number of years to reduce the burden placed on connecting resources. As such, they are slow to respond to changing

capabilities and requirements. This delay often makes new standards and requirements reactive rather than proactive. For example, AEMO can only review utility-scale generator technical performance standards every 5 years (Australian Energy Market Commission, 2018a), a timeframe in which the solar PV capacity installed in the NEM has more than quadrupled (2015-2020) (Australian PV Institute, n.d.).

Additional concerns with regulatory mechanisms include poor dynamic efficiency and opaque costs (Riesz et al., 2015). In the absence of remuneration or incentives, particularly those that are linked to the quality of frequency response, there is no incentive to innovate or invest in higher-quality frequency control capabilities (Meegahapola et al., 2021). Furthermore, cost opacity may lead to FCS provision costs being internalised within other prices (e.g. energy) by participants and prevent the implementation of imbalance or dispatch non-conformance disincentives through cost-allocation mechanisms.

3.11 Preference for market-based arrangements

Since the establishment of the NEM, a competition norm has been established, with markets being viewed as a key driver for delivering the National Electricity Objective of “efficient investment in, and efficient operation and use of electricity services” (Haines and McConnell, 2016; MacGill et al., 2020). This norm has pervaded all levels of participation and governance in the NEM. Generator owners opposed the mandatory nature of the mandatory PFR rule change on the basis that a lack of remuneration was against market principles and that it would lead to economically inefficient outcomes (Rolfe, 2019; Scott, 2019; Skin-

ner, 2019). AEMO did not include a headroom requirement in its proposal, making the mandatory PFR rule change more palatable to market bodies and participants. The AEMC, who have expressed a clear preference for market-based approaches (Australian Energy Market Commission, 2018b), included a “sunset” clause in their initial decision to implement mandatory PFR. Furthermore, a market for FFR will be implemented in 2023 and the ESB’s post-2025 market design process is considering new system services markets for inertial response and TFR (Energy Security Board, 2021, 2020).

If incentives or remuneration are designed correctly, markets can drive short-run efficiency. Where required, they can also support investment in FCS capability and assist a power system in achieving dynamically efficient frequency control arrangements. However, in some cases, simply introducing new FCS markets may serve as ‘patchwork’ solutions to existing control deficiencies and market failures. These deficiencies and failures could be partially addressed by improving FCS cost allocation processes, verifying FCS performance and linking incentives to higher quality provision.

As discussed in Section [-Chapter 3.4), efficient Causer Pays cost-allocation mechanisms in FCS markets could provide suitable disincentives for dispatch non-conformance or imbalances. In the NEM, the aggregation of regulation FCAS Causer Pays contribution factors over time and a portfolio has resulted in a blunt frequency performance market signal. The solution to this problem may not be as simple as strengthening disincentives (e.g. as proposed by Hirth and Ziegenhagen (2015) and Papavasiliou (2020)) for resource-based cost-allocation processes as potential exposure to high instantaneous FCS costs may lead to participants curtailing or decommitting flexible resources rather

than providing an assisting frequency response. This has been observed in the NEM when local constraints have resulted in regulation FCAS (Australian Energy Market Commission, 2018b) and contingency FCAS (Australian Energy Market Operator, 2020j) price spikes. The AEMC has proposed a compromise to this problem by shortening the settlement period for regulation FCAS Causer Pays to 5 minutes but only allocating the costs of regulation FCAS capacity that is activated by AEMO (i.e. the cost of any unactivated capacity is socialised across power system users) (Australian Energy Market Commission, 2021a).

An alternative to Causer Pays is to allocate costs based on needs ('User Pays'), such that connected equipment imposing RoCoF or frequency constraints pay for FCS. 'Users' of frequency control currently include synchronous machines and IBR that have not been configured to ride-through higher RoCoFs and greater frequency deviations. Following more extreme frequency deviations, the former may suffer equipment damage whereas both have the potential to trip (DGA Consulting, 2016; Miller et al., 2017a). A User Pays approach to cost-allocation could encourage resources to be more resilient to frequency deviations and thereby reduce system FCS costs (Lal et al., 2021), particularly if a significant proportion of connected equipment are IBR that can be configured to ride-through such disturbances.

Beyond choosing who costs should be allocated to and what an appropriate granularity for cost-allocation might be, market designers should ensure that the chosen methodology is transparent, can be understood by participants and that any calculations can be replicated using accessible data. If appropriate design choices are made, efficient cost-allocation could create counter-parties for financial instruments that hedge price risk (Skinner et al., 2020; Thorncraft

and Outhred, 2007). FCS derivatives may drive investment in FCS capabilities by supporting business models in which FCS is a major revenue stream (this is currently the case for utility-scale BESS, DR aggregators and virtual power plants in the NEM) and assist in FCS price formation (Billimoria et al., 2020; Pollitt and Anaya, 2019).

As in ISO/RTO Regulation markets, aligning FCS procurement and/or remuneration with performance essentially recognises that there is a spectrum of FCS capabilities. This recognition is lacking in the NEM, where battery energy storage systems are responding precisely and rapidly to AGC regulation signals but are being paid the same as thermal plant that provide lower quality regulation FCAS (Australian Energy Market Operator, 2018d). However, implementing performance-based design is contingent on the SO verifying FCS provision. While AEMO has outlined FCAS delivery measurement standards and verification principles (Australian Energy Market Operator, 2020e), delivery verification appears to be restricted to confirming contingency FCAS delivery following a power system event (to the authors' best knowledge). While a regular verification process does not appear to be in place for regulation FCAS, AEMO is proposing to specify minimum control requirements (e.g. response delay and ramp rate) and implement a regular testing cycle for resources registered for regulation FCAS (Australian Energy Market Operator, 2021j).

Market designers may also need to consider price formation in FCS markets to ensure that arrangements are at least capable of supporting investment during energy transition. As discussed by Hirth and Ziegenhagen (2015), VRE have low to no short-term energy market opportunity-costs when providing lower/negative FCS but can incur significant short-term energy

market opportunity-costs when providing raise/positive FCS. The raise/positive opportunity-cost may be even higher if the SO requires additional curtailment to better ensure that FCS capacity is firm, which AEMO has required, or if the resource has entered into an energy off-take agreement, which is common in the NEM (Australian Energy Market Operator, 2018e). While co-optimised FCS markets mean that such opportunity-costs can be accounted for, FCS prices can be suppressed if large conventional generators with low to no opportunity-costs offer large volumes of FCS. Low prices can limit the incentive for high capital, low operating cost IBR to provide and invest in FCS capabilities. This may lead to a dynamically inefficient outcome as additional conventional generators are retired and limited FCS capabilities are offered by VRE and other IBR (Ela et al., 2019; Meegahapola et al., 2021). As discussed in Section 3.5.2, one potential solution to this issue is to strengthen scarcity pricing in FCS markets. The AEMC and ESB have discussed implementing system demand curves with scarcity pricing for all existing and proposed FCAS (Australian Energy Market Commission, 2020c; Energy Security Board, 2020). However, the shape of these system demand curves and how they account for interdependent or interchangeable FCAS will ultimately dictate their success.

3.12 Conclusion

Whilst recent years have seen increasing participation from demand response and IBR, energy transition and a pervasive competition norm have exposed design issues in the NEM's frequency control arrangements. As such, considerable attention and effort have been devoted to reforming the NEM's arrangements in the past two years.

From our review of North American and European frequency control arrangements and our analysis of the NEM's, we share four key insights below that could serve as design principles for operators, regulators and market-bodies attempting to design effective and efficient frequency control arrangements in restructured electricity industries during energy transition:

1. Control deficiencies may not be addressable through introducing new FCS.

While this solution may address emerging needs (e.g. low-inertia operation), SOs and market bodies need to better understand the interdependency, interoperability and interchangeability between FCS and the interactions with other technical attributes of the power system (e.g. system strength) to ensure that frequency control is first and foremost effective. Once this has been achieved, the short-run efficiency of arrangements can be improved through mechanisms such as dynamic and probabilistic dimensioning and co-optimising the procurement of interchangeable FCS.

2. Given the pace and scale of energy transition, a dynamically efficient outcome in some power systems may require additional investments in FCS capability. FCS prices can be strengthened through scarcity pricing, which may better reflect the system's preference for security and reliability. Such pricing mechanisms are complementary to appropriate and efficient cost-allocation based on causation or needs. Both efficient price formation and cost-allocation will improve the potential for FCS derivatives, which may assist in providing price signals for investment.

3. SOs should systematically and frequently verify FCS delivery, where relevant, and withhold or penalise remuneration when delivery is deemed to be insufficient. If such monitoring is in place, FCS remuneration can

be performance-based to drive the provision of high quality FCS. Performance monitoring would also enable the SO to assess FCS arrangements and identify any deficiencies in control action or procurement.

4. During energy transition, a suitable set of frequency control arrangements will most likely involve a combination of market-based and regulatory mechanisms. Frequency control is a power system public good and achieving frequency stability requires a degree of coordination and cooperation between resources. These characteristics make it difficult to establish complete markets for FCS, and an emphasis on market solutions may obscure these characteristics to market participants and undermine effective control. In contrast, regulatory mechanisms may prove to be more robust and resilient in the face of uncertainties, particularly those that are exogenous to the power system (e.g. climate risk). Regardless of whether arrangements are skewed towards market-based mechanisms or regulatory mechanisms, designers should be more forward-looking and avoid assumptions regarding the provision of FCS capability over time, particularly when there is a pervasive competition norm and effective frequency control relies on sequential and hierarchical control actions.

Chapter 4

Research containing a figure

4.1 Introduction

This is the introduction. Sed vulputate tortor at nisl blandit interdum. Cras sagittis massa ex, quis eleifend purus condimentum congue. Maecenas tristique, justo vitae efficitur mollis, mi nulla varius elit, in consequat ligula nulla ut augue. Phasellus diam sapien, placerat sit amet tempor non, lobortis tempus ante.

4.2 Method

Donec imperdiet, lectus vestibulum sagittis tempus, turpis dolor euismod justo, vel tempus neque libero sit amet tortor. Nam cursus commodo tincidunt.

4.2.1 SUBSECTION 1

This is the first part of the methodology. Duis tempor sapien sed tellus ultrices blandit. Sed porta mauris tortor, eu vulputate arcu dapibus ac. Curabitur sodales at felis efficitur sollicitudin. Quisque at neque sollicitudin, mollis arcu vitae, faucibus tellus.

4.2.2 SUBSECTION 2

This is the second part of the methodology. Sed ut ipsum ultrices, interdum ipsum vel, lobortis diam. Curabitur sit amet massa quis tortor molestie dapibus a at libero. Mauris mollis magna quis ante vulputate consequat. Integer leo turpis, suscipit ac venenatis pellentesque, efficitur non sem. Pellentesque eget vulputate turpis. Etiam id nibh at elit fermentum interdum.

4.3 Results

These are the results. In vitae odio at libero elementum fermentum vel iaculis enim. Nullam finibus sapien in congue condimentum. Curabitur et ligula et ipsum mollis fringilla.

4.4 Discussion

Figure 4.1 shows how to add a figure. Donec ut lacinia nibh. Nam tincidunt augue et tristique cursus. Vestibulum sagittis odio nisl, a malesuada turpis blandit quis. Cras ultrices metus tempor laoreet sodales. Nam molestie

ipsum ac imperdiet laoreet. Pellentesque habitant morbi tristique senectus et netus et malesuada fames ac turpis egestas.



Figure 4.1: RV Calypso is a former British Royal Navy minesweeper converted into a research vessel for the oceanographic researcher Jacques-Yves Cousteau. It was equipped with a mobile laboratory for underwater field research.

4.5 Conclusion

This is the conclusion to the chapter. Quisque nec purus a quam consectetur volutpat. Cum sociis natoque penatibus et magnis dis parturient montes, nascetur ridiculus mus. In lorem justo, convallis quis lacinia eget, laoreet eu metus. Fusce blandit tellus tellus. Curabitur nec cursus odio. Quisque tristique eros nulla, vitae finibus lorem aliquam quis. Interdum et malesuada fames ac ante ipsum primis in faucibus.



Figure 4.2: This is not a boat

Chapter 5

Research containing a table

5.1 Introduction

This is the introduction. Phasellus non purus id mauris aliquam rutrum vitae quis tellus. Maecenas rhoncus ligula nulla, fringilla placerat mi consectetur eu. Aenean nec metus ac est ornare posuere. Nunc ipsum lacus, gravida commodo turpis quis, rutrum eleifend erat. Pellentesque id lorem eget ante porta tincidunt nec nec tellus.

5.2 Method

Vivamus consectetur, velit in congue lobortis, massa massa lacinia urna, sollicitudin semper ipsum augue quis tortor. Donec quis nisl at arcu volutpat ultrices. Maecenas ex nibh, consequat ac blandit sit amet, molestie in odio. Morbi finibus libero et nisl dignissim, at ultricies ligula pulvinar.

5.2.1 SUBSECTION 1

This is the first part of the methodology. Integer leo erat, commodo in lacus vel, egestas varius elit. Nulla eget magna quam. Nullam sollicitudin dolor ut ipsum varius tincidunt. Duis dignissim massa in ipsum accumsan imperdiet. Maecenas suscipit sapien sed dui pharetra blandit. Morbi fermentum est vel quam pretium maximus.

5.2.2 SUBSECTION 2

This is the second part of the methodology. Nullam accumsan condimentum eros eu volutpat. Maecenas quis ligula tempor, interdum ante sit amet, aliquet sem. Fusce tellus massa, blandit id tempus at, cursus in tortor. Nunc nec volutpat ante. Phasellus dignissim ut lectus quis porta. Lorem ipsum dolor sit amet, consectetur adipiscing elit.

5.3 Results

Table 5.1 shows us how to add a table. Integer tincidunt sed nisl eget pellentesque. Mauris eleifend, nisl non lobortis fringilla, sapien eros aliquet orci, vitae pretium massa neque eu turpis. Pellentesque tincidunt aliquet volutpat. Ut ornare dui id ex sodales laoreet.

Table 5.1: Important data for various land masses.

Landmass	% stuff	Number of Owls	Dolphins per Capita	How Many Foos	How Many Bars	Forbidden Float
North America	94%	20,028	17,465	12,084	20,659	1.71
Central America	91%	6564	6350	8,189	12,012	1.52
South America	86%	3902	4127	5,205	6,565	1.28
Africa	84%	2892	3175	3,862	4,248	1.1
Europe	92%	20,964	17,465	15,303	24,203	1.58
Asia	87%	6852	6350	8,255	11,688	1.47
Oceania	87%	4044	4127	5,540	6,972	1.28
Antarctica	83%	2964	3175	4,402	4,941	1.13

5.4 Discussion

This is the discussion. As we saw in Table Table 5.1, many things are true, and other things are not. Etiam sit amet mi eros. Donec vel nisi sed purus gravida fermentum at quis odio. Vestibulum quis nisl sit amet justo maximus molestie. Maecenas vitae arcu erat. Nulla facilisi. Nam pretium mauris eu enim porttitor, a mattis velit dictum. Nulla sit amet ligula non mauris volutpat fermentum quis vitae sapien.

5.5 Conclusion

This is the conclusion to the chapter. Nullam porta tortor id vehicula interdum. Quisque pharetra, neque ut accumsan suscipit, orci orci commodo tortor, ac finibus est turpis eget justo. Cras sodales nibh nec mauris laoreet iaculis. Morbi volutpat orci felis, id condimentum nulla suscipit eu. Fusce in turpis quis ligula tempus scelerisque eget quis odio. Vestibulum et dolor id erat lobortis ullamcorper quis at sem.

Chapter 6

Final research study

6.1 Introduction

This is the introduction. Nunc lorem odio, laoreet eu turpis at, condimentum sagittis diam. Phasellus metus ligula, auctor ac nunc vel, molestie mattis libero. Praesent id posuere ex, vel efficitur nibh. Quisque vestibulum accumsan lacus vitae mattis.

6.2 Method

In tincidunt viverra dolor, ac pharetra tellus faucibus eget. Pellentesque tempor a enim nec venenatis. Morbi blandit magna imperdiet posuere auctor. Maecenas in maximus est.

6.2.1 SUBSECTION 1

This is the first part of the methodology. Praesent mollis sem diam, sit amet tristique lacus vulputate quis. Vivamus rhoncus est rhoncus tellus lacinia, a interdum sem egestas. Curabitur quis urna vel quam blandit semper vitae a leo. Nam vel lectus lectus.

6.2.2 SUBSECTION 2

This is the second part of the methodology. Aenean vel pretium tortor. Aliquam erat volutpat. Quisque quis lobortis mi. Nulla turpis leo, ultrices nec nulla non, ullamcorper laoreet risus.

6.3 Results

These are the results. Curabitur vulputate nisl non ante tincidunt tempor. Aenean porta nisi quam, sed ornare urna congue sed. Curabitur in sapien justo. Quisque pulvinar ullamcorper metus, eu varius mauris pellentesque et. In hac habitasse platea dictumst. Pellentesque nec porttitor libero. Duis et magna a massa lacinia cursus.

6.4 Discussion

This is the discussion. Curabitur gravida nisl id gravida congue. Duis est nisi, sagittis eget accumsan ullamcorper, semper quis turpis. Mauris ultricies diam metus, sollicitudin ultricies turpis lobortis vitae. Ut egestas vehicula enim,

porta molestie neque consectetur placerat. Integer iaculis sapien dolor, non porta nibh condimentum ut.

6.5 Conclusion

This is the conclusion to the chapter. Nulla sed condimentum lectus. Duis sed tempor erat, at cursus lacus. Nam vitae tempus arcu, id vestibulum sapien. Cum sociis natoque penatibus et magnis dis parturient montes, nascetur ridiculus mus.

Chapter 7

Conclusion

7.1 Thesis summary

In summary, pellentesque habitant morbi tristique senectus et netus et malesuada fames ac turpis egestas. Nunc eleifend, ex a luctus porttitor, felis ex suscipit tellus, ut sollicitudin sapien purus in libero. Nulla blandit eget urna vel tempus. Praesent fringilla dui sapien, sit amet egestas leo sollicitudin at.

7.2 Future work

There are several potential directions for extending this thesis. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Aliquam gravida ipsum at tempor tincidunt. Aliquam ligula nisl, blandit et dui eu, eleifend tempus nibh. Nullam eleifend sapien eget ante hendrerit commodo. Pellentesque pharetra erat sit amet dapibus scelerisque.

Vestibulum suscipit tellus risus, faucibus vulputate orci lobortis eget. Nunc varius sem nisi. Nunc tempor magna sapien, euismod blandit elit pharetra sed. In dapibus magna convallis lectus sodales, a consequat sem euismod. Curabitur in interdum purus. Integer ultrices laoreet aliquet. Nulla vel dapibus urna. Nunc efficitur erat ac nisi auctor sodales.

Appendix 1: Some extra stuff

Add appendix 1 here. Vivamus hendrerit rhoncus interdum. Sed ullamcorper et augue at porta. Suspendisse facilisis imperdiet urna, eu pellentesque purus suscipit in. Integer dignissim mattis ex aliquam blandit. Curabitur lobortis quam varius turpis ultrices egestas.

Appendix 2: Some more extra stuff

Add appendix 2 here. Aliquam rhoncus mauris ac neque imperdiet, in mattis eros aliquam. Etiam sed massa et risus posuere rutrum vel et mauris. Integer id mauris sed arcu venenatis finibus. Etiam nec hendrerit purus, sed cursus nunc. Pellentesque ac luctus magna. Aenean non posuere enim, nec hendrerit lacus. Etiam lacinia facilisis tempor. Aenean dictum nunc id felis rhoncus aliquam.

References

- 50hz, A., Amprion, 2017. Consultation on the design of the platform for automatic Frequency Restoration Reserve (aFRR) of PICASSO region (No. November).
- Abbasy, A., 2012. National Design and Multinational Integration of Balancing Services Markets (PhD thesis). TU Delft.
- Ahlqvist, V., Holmberg, P., Tangerås, T., 2018. Central- versus Self-Dispatch in Electricity Markets. SSRN Electronic Journal. <https://doi.org/10.2139/ssrn.3302569>
- Akram, U., Mithulananthan, N., Shah, R., Basit, S.A., 2020. Energy Storage for Short-Term Frequency Stability Enhancement in Low-Inertia Power Systems. 2020 Australasian Universities Power Engineering Conference (AUPEC).
- Aurecon, 2019. Large-Scale Battery Storage Knowledge Sharing Report. ARENA.
- Australian Energy Market Commission, n.d. National Electricity Market.
- Australian Energy Market Commission, 2021b. Fast frequency response market ancillary service, Final report.
- Australian Energy Market Commission, 2021a. Primary frequency response incentive arrangements, Draft rule determination.
- Australian Energy Market Commission, 2021c. Reserve services in the National Electricity Market, Directions Paper.
- Australian Energy Market Commission, 2020a. Annual Market Performance Review 2020.
- Australian Energy Market Commission, 2020c. Frequency control rule changes.
- Australian Energy Market Commission, 2020b. Mandatory primary frequency response, Rule determination.
- Australian Energy Market Commission, 2018b. Frequency Control Frameworks Review.
- Australian Energy Market Commission, 2018a. Generator technical performance standards, Rule determination.
- Australian Energy Market Commission, 2016. National Electricity Amendment (Demand Response Mechanism and Ancillary Services Unbundling) Rule 2016 - Final rule determination.
- Australian Energy Market Commission Reliability Panel, 2017. Stage One Final Determination: Review of the Frequency Operating Standard (No. November).

- Australian Energy Market Operator, 2021d. AEMO Virtual Power Plant Demonstrations, Knowledge Sharing Report #3.
- Australian Energy Market Operator, 2021j. Amendment of the Market Ancillary Service Specification - DER and General Consultation, Draft report and determination.
- Australian Energy Market Operator, 2021e. Behaviour of distributed resources during power system disturbances Overview of key findings.
- Australian Energy Market Operator, 2021c. Dispatch Standard Operating Procedure.
- Australian Energy Market Operator, 2021f. Enduring primary frequency response requirements for the NEM.
- Australian Energy Market Operator, 2021h. Fast Frequency Response Implementation Options.
- Australian Energy Market Operator, 2021g. Frequency Control Work Plan.
- Australian Energy Market Operator, 2021i. Implementation of the National Electricity Amendment (Mandatory Primary Frequency Response) Rule 2020: Status as at 20 Jan 2021.
- Australian Energy Market Operator, 2021a. NEM Engineering Framework.
- Australian Energy Market Operator, 2021b. Quarterly Energy Dynamics Q3 2021.
- Australian Energy Market Operator, 2020d. 2020 Integrated System Plan (No. December), Clean Energy Council.
- Australian Energy Market Operator, 2020i. Interim Primary Frequency Response Requirements.
- Australian Energy Market Operator, 2020e. Market ancillary service specification.
- Australian Energy Market Operator, 2020g. Notice of South Australia Inertia Requirements and Shortfall.
- Australian Energy Market Operator, 2020c. Power System Requirements.
- Australian Energy Market Operator, 2020j. Quarterly Energy Dynamics Q1 2020.
- Australian Energy Market Operator, 2020a. Renewable Integration Study Appendix C : Managing variability and uncertainty.
- Australian Energy Market Operator, 2020h. Renewable Integration Study : Stage 1 report.
- Australian Energy Market Operator, 2020b. Renewable Integration Study Appendix B : Frequency control.
- Australian Energy Market Operator, 2020f. System strength in the NEM explained.
- Australian Energy Market Operator, 2019b. Electricity Rule Change Proposal - Mandatory Primary Frequency Response.
- Australian Energy Market Operator, 2019d. Electricity Rule Change Proposal - Removal of disincentives to the provision of primary frequency response under normal operating conditions.
- Australian Energy Market Operator, 2019c. Final Report – Queensland and South Australia system separation on 25 August 2018.

- Australian Energy Market Operator, 2019a. Maintaining Power System Security with High Penetrations of Wind and Solar Generation: International Insights.
- Australian Energy Market Operator, 2019e. Review of NEM load relief.
- Australian Energy Market Operator, 2018a. AEMC Frequency Control Frameworks Review - AEMO Advice.
- Australian Energy Market Operator, 2018e. Hornsdale Wind Farm 2 FCAS trial.
- Australian Energy Market Operator, 2018c. Inertia requirements methodology: Inertia requirements & shortfalls.
- Australian Energy Market Operator, 2018d. Initial operation of the Hornsdale Power Reserve Battery Energy Storage System.
- Australian Energy Market Operator, 2018b. Regulation FCAS Contribution Factor Procedure.
- Australian Energy Market Operator, 2017a. Fast Frequency Response in the NEM.
- Australian Energy Market Operator, 2017b. FCAS Model in NEMDE.
- Australian Energy Market Operator, 2017c. Interconnector Capabilities for the National Electricity Market.
- Australian Energy Market Operator, 2015a. Constraint Implementation Guidelines.
- Australian Energy Market Operator, 2015b. Guide To Ancillary Services in the National Electricity Market.
- Australian Energy Market Operator, 2010. Constraint Formulation Guidelines.
- Australian Energy Regulator, 2021. State of the Energy Market 2021.
- Australian Energy Regulator, 2020. Issues paper - Semi scheduled generator rule change(s).
- Australian PV Institute, n.d. Installed PV generation capacity by State/Territory.
- Banshwar, A., Sharma, N.K., Sood, Y.R., Shrivastava, R., 2018. An international experience of technical and economic aspects of ancillary services in deregulated power industry: Lessons for emerging BRIC electricity markets. *Renewable and Sustainable Energy Reviews* 90, 774–801. <https://doi.org/10.1016/j.rser.2018.03.085>
- Billimoria, F., Mancarella, P., Poudineh, R., 2020. Market design for system security in low-carbon electricity grids: From the physics to the economics. Oxford Institute for Energy Studies. <https://doi.org/10.26889/9781784671600>
- Brooks, A.E., Lesieutre, B.C., 2019. A review of frequency regulation markets in three U.S. ISO/RTOs. *Electricity Journal* 32, 106668. <https://doi.org/10.1016/j.tej.2019.106668>
- Cherevatskiy, S., Sproul, S., Zabihi, S., Korte, R., Klingenberg, H., Buchholz, B., Oudalov, A., 2020. Grid Forming Energy Storage System addresses challenges of grids with high penetration of renewables (A case study), in: 48th CIGRE Session 2020, Paris.
- Chow, J.H., De Mello, R.W., Cheung, K.W., 2005. Electricity market design: An integrated approach to reliability assurance. *Proceedings of the IEEE* 93, 1956–1968. <https://doi.org/10.1109/jproc.2005.857493>

- Commission, F.E.R., 2011. Order No. 755: Frequency Regulation Compensation in the Organized Wholesale Power Markets.
- Cramton, P., 2017. Electricity market design. *Oxford Review of Economic Policy* 33, 589–612. <https://doi.org/10.1093/oxrep/grx041>
- De Vos, K., Stevens, N., Devolder, O., Papavasiliou, A., Hebb, B., Matthys-Donnadieu, J., 2019. Dynamic dimensioning approach for operating reserves: Proof of concept in Belgium. *Energy Policy* 124, 272–285. <https://doi.org/10.1016/j.enpol.2018.09.031>
- Denholm, P., Mai, T., Kenyon, R.W., Kroposki, B., Malley, M.O., 2020. Inertia and the Power Grid : A Guide Without the Spin (No. May). NREL.
- DGA Consulting, 2016. International Review of Frequency Control Adaptation.
- DIgSILENT, 2017. Review of Frequency Control Performance in the NEM under Normal Operating Conditions Final Report. DIgSILENT Pacific.
- Dillon, A., 2019. Mandatory primary frequency response consultation paper submission - Energy Networks Australia.
- Eggleston, J., Zuur, C., Mancarella, P., 2021. From security to resilience: Technical and regulatory options to manage extreme events in low-carbon grids. *IEEE Power and Energy Magazine* 19, 67–75. <https://doi.org/10.1109/MPE.2021.3088958>
- Ehrhart, K.M., Ocker, F., 2021. Design and regulation of balancing power auctions: An integrated market model approach. *Journal of Regulatory Economics* 60, 55–73. <https://doi.org/10.1007/s11149-021-09430-7>
- Ela, E., Hytowitz, R.B., 2019. Ancillary Services in the United States: Technical Requirements, Market Designs and Price Trends. Electric Power Research Institute.
- Ela, E., Kirby, B., Navid, N., Smith, J.C., 2012a. Effective ancillary services market designs on high wind power penetration systems. *IEEE Power and Energy Society General Meeting* 1–8. <https://doi.org/10.1109/pesgm.2012.6345361>
- Ela, E., Milligan, M., Kirby, B., 2011. Operating Reserves and Variable Generation. NREL. <https://doi.org/10.2172/1023095>
- Ela, E., Sotkiewicz, P., Billimoria, F., Ragsdale, K., Moorty, S., OSullivan, J., Gramlich, R., Rothleider, M., Rew, B., Supponen, M., 2019. Future Electricity Markets: Designing for Massive Amounts of Zero-Variable-Cost Renewable Resources. *IEEE Power and Energy Magazine* 17, 58–66. <https://doi.org/10.1109/mpe.2019.2933281>
- Ela, E., Tuohy, A., Milligan, M., Kirby, B., Brooks, D., 2012b. Alternative Approaches for Incentivizing the Frequency Responsive Reserve Ancillary Service. *Electricity Journal* 25, 88–102. <https://doi.org/10.1016/j.tej.2012.04.015>
- Energy Security Board, 2021. Post 2025 Market Design Options – A paper for consultation: Part B.
- Energy Security Board, 2020. Post 2025 Market Design Consultation Paper. COAG Energy Council.
- ENTSO-E WGAS, 2021. Survey on Ancillary Services Procurement, Balancing Market Design 2020.

- EPEX Spot, n.d. European Market Coupling.
- Eriksson, R., Modig, N., Elkington, K., 2018. Synthetic inertia versus fast frequency response: A definition. *IET Renewable Power Generation* 12, 507–514. <https://doi.org/10.1049/iet-rpg.2017.0370>
- Eto, J.H., Undrill, J., Roberts, C., Mackin, P., Ellis, J., 2018. Frequency Control Requirements for Reliable Interconnection Frequency Response. Lawrence Berkeley National Laboratory.
- Eto, J., Undrill, J., Mackin, P., Daschmans, R., Williams, B., Haney, B., Hunt, R., Ellis, J., Illian, H., Martinez, C., OMalley, M., Coughlin, K., Hamachi-LaCommare, K., 2010. Use of Frequency Response Metrics to Assess the Planning and Operating Requirements for Reliable Integration of Variable Renewable Generation. Lawrence Berkley National Laboratory.
- European Commission, 2017. Commission Regulation (EU) 2017/2195 of 23 November 2017 establishing a guideline on electricity balancing. Official Journal of the European Union.
- European Network of Transmission System Operators for Electricity, 2020. ENTSO-E Balancing Report.
- European Network of Transmission System Operators for Electricity, 2013. Network Code on Load-Frequency Control and Reserves.
- Federal Energy Regulatory Commission, 2018. Order No. 842: Essential Reliability Services and the Evolving Bulk-Power System—Primary Frequency Response.
- Fernández-Muñoz, D., Pérez-Díaz, J.I., Guisández, I., Chazarra, M., Fernández-Espina, Á., 2020. Fast frequency control ancillary services: An international review. *Renewable and Sustainable Energy Reviews* 120. <https://doi.org/10.1016/j.rser.2019.109662>
- Frew, B., Brinkman, G., Denholm, P., Narwade, V., Stephen, G., Bloom, A., Lau, J., 2021. Impact of operating reserve rules on electricity prices with high penetrations of renewable energy. *Energy Policy* 156, 112443. <https://doi.org/10.1016/j.enpol.2021.112443>
- GHD Advisory, 2019. GHD Report for TasNetworks - Ancillary Service Benefits for Marinus Link.
- Gimon, E., 2020. Grid Physics and Markets: A Non-Engineer's Perspective.
- Gorman, N., Haghdadi, N., Bruce, A., MacGill, I., 2018. NEMOSIS – NEM Open Source Information Service; open-source access to Australian National Electricity Market Data. Asia-Pacific Solar Research Conference.
- Grainger, J.J., 1994. Power system analysis. McGraw-Hill, New York.
- Haines, F., McConnell, D., 2016. Environmental norms and electricity supply: An analysis of normative change and household solar PV in Australia. *Environmental Sociology* 2, 155–165. <https://doi.org/10.1080/23251042.2016.1155690>
- Hartmann, B., Vokony, I., Táczki, I., 2019. Effects of decreasing synchronous inertia on power system dynamics—Overview of recent experiences and marketisation of services. *International Transactions on Electrical Energy Systems* 29. <https://doi.org/10.1002/2050-7038.12128>
- Hewicker, C., Kumar, A., Arappil, M., 2020. Dimensioning of Control Reserves in Southern Region Grid States. Deutsche Gesellschaft für Internationale Zusammenarbeit GmbH.

- Hirth, L., Ziegenhagen, I., 2015. Balancing power and variable renewables: Three links. *Renewable and Sustainable Energy Reviews* 50, 1035–1051. <https://doi.org/10.1016/j.rser.2015.04.180>
- Holttinen, H., Milligan, M., Ela, E., Menemenlis, N., Dobschinski, J., Rawn, B., Bessa, R.J., Flynn, D., Gomez Lazaro, E., Detlefsen, N., 2013. Methodologies to determine operating reserves due to increased wind power. *IEEE Power and Energy Society General Meeting* 3, 713–723. <https://doi.org/10.1109/pesmg.2013.6673067>
- Hopwood, C., 2019. Mandatory primary frequency response consultation paper submission - TasNetworks.
- International Energy Agency, 2021. Net Zero by 2050 - A Roadmap for the Global Energy Sector.
- Isemonger, A.G., 2009. The evolving design of RTO ancillary service markets. *Energy Policy* 37, 150–157. <https://doi.org/10.1016/j.enpol.2008.06.033>
- Katz, J., Pawan Kumar, K.V.N., Cochran, J., Saxena, S.C., Soonee, S.K., Narasimhan, S.R., Baba, K.V.S., 2019. Opening Markets, Designing Windows, and Closing Gates. NREL, USAID, Indian Ministry of Power.
- Keeratimahat, K., Bruce, A., MacGill, I., 2021. Analysis of short-term operational forecast deviations and controllability of utility-scale photovoltaic plants. *Renewable Energy* 167, 343–358. <https://doi.org/10.1016/j.renene.2020.11.090>
- Kenyon, R.W., Bossart, M., Marković, M., Doubleday, K., Matsuda-Dunn, R., Mitova, S., Julien, S.A., Hale, E.T., Hodge, B.M., 2020. Stability and control of power systems with high penetrations of inverter-based resources: An accessible review of current knowledge and open questions. *Solar Energy* 210, 149–168. <https://doi.org/10.1016/j.solener.2020.05.053>
- King, J., Kirby, B., Milligan, M., Beuning, S., 2011. Flexibility Reserve Reductions from an Energy Imbalance Market with High Levels of Wind Energy in the Western Interconnection.
- Kirby, B.J., Dyer, J., Martinez, C., Shoureshi, R.A., Guttrromson, R., Dagle, J., 2002. Frequency Control Concerns In The North American Electric Power System. Oak Ridge National Laboratory.
- Kroposki, B., Johnson, B., Zhang, Y., Gevorgian, V., Denholm, P., Hodge, B., Hannegan, B., 2017. Achieving a 100% Renewable Grid: Operating Electric Power Systems with Extremely High Levels of Variable Renewable Energy. *IEEE Power and Energy Magazine* 15, 61–73. <https://doi.org/10.1109/mpe.2016.2637122>
- Lago, J., Poplavskaya, K., Suryanarayana, G., De Schutter, B., 2021. A market framework for grid balancing support through imbalances trading. *Renewable and Sustainable Energy Reviews* 137, 110467. <https://doi.org/10.1016/j.rser.2020.110467>
- Lal, N., Price, T., Kwek, L., Wilson, C., Billimoria, F., Morrow, T., Garbutt, M., Sharafi, D., 2021. Essential system services reform: Australian market design for renewable-dominated grids. *IEEE Power and Energy Magazine* 19, 29–45. <https://doi.org/10.1109/mpe.2021.3088959>
- Lin, Y., Eto, J., Johnson, B., Flicker, J., Lasseter, R., Pico, H., Seo, G., Pierre, B., Ellis, A., Krishnaswami, H., Miller, J., Yuan, G., 2020. Research Roadmap on Grid-Forming Inverters.
- Lopez, A., Ogayar, B., Hernández, J.C., Sutil, F.S., 2020. Survey and assessment of technical and economic features for the provision of frequency control services by household-prosumers.

Energy Policy 146. <https://doi.org/10.1016/j.enpol.2020.111739>

- MacGill, I., Bruce, A., Zekulich, M., 2020. Electricity market norms vs power system norms: The example of Primary Frequency Response in the Australian National Electricity Market, in: 2020 IEEE Power & Energy Society General Meeting (PESGM). IEEE, pp. 1–5. <https://doi.org/10.1109/pesgm41954.2020.9282169>
- MacGill, I., Esplin, R., 2020. End-to-end electricity market design - some lessons from the Australian National Electricity Market. Electricity Journal 33, 106831. <https://doi.org/10.1016/j.tej.2020.106831>
- Machowski, J., Lubosny, Z., Bialek, J.W., R., B.J., 2020. Power System Dynamics: Stability and Control. John Wiley & Sons, Ltd.
- Mancarella, P., Billimoria, F., 2021. The Fragile Grid: The Physics and Economics of Security Services in Low-Carbon Power Systems. IEEE Power and Energy Magazine 19, 79–88. <https://doi.org/10.1109/mpe.2020.3043570>
- Meegahapola, L., Mancarella, P., Flynn, D., Moreno, R., 2021. Power system stability in the transition to a low carbon grid: A techno-economic perspective on challenges and opportunities. WIREs Energy and Environment 1–27. <https://doi.org/10.1002/wene.399>
- Milano, F., Dorfler, F., Hug, G., Hill, D.J., Verbic, G., 2018. Foundations and Challenges of Low-Inertia Systems (Invited Paper), in: 2018 Power Systems Computation Conference (PSCC). IEEE, pp. 1–25. <https://doi.org/10.23919/pssc.2018.8450880>
- Miller, N., Lew, D., Barnes, S., Ren, W., Reichard, M., Alexander, M., Freeman, L., Achilles, S., Adamiak, M., 2017a. Advisory on Equipment Limits associated with High RoCoF. GE Energy Consulting.
- Miller, N., Lew, D., Piwko, R., 2017b. Technology Capabilities for Fast Frequency Response, GE Energy Consulting. GE Energy Consulting.
- Milligan, M., Ela, E., Hodge, B.M., Kirby, B., Lew, D., Clark, C., DeCesaro, J., Lynn, K., 2011. Integration of Variable Generation, Cost-Causation, and Integration Costs. Electricity Journal 24, 51–63. <https://doi.org/10.1016/j.tej.2011.10.011>
- Milligan, M., Kirby, B., 2010. Market characteristics for efficient integration of variable generation in the Western Interconnection. National Renewable Energy Laboratory (NREL), Golden, CO.
- Monitoring Analytics, 2021. 2021 Quarterly State of the Market Report for PJM: January through June - Section 10: Ancillary Services.
- Müsgens, F., Ockenfels, A., Peek, M., 2014. Economics and design of balancing power markets in Germany. International Journal of Electrical Power and Energy Systems 55, 392–401. <https://doi.org/10.1016/j.ijepes.2013.09.020>
- NEMO Committee, n.d. Single Intraday Coupling (SIDC).
- NERC Inverter-Based Resource Performance Task Force, 2020. Fast Frequency Response Concepts and Bulk Power System Reliability Needs. North American Electric Reliability Corporation.
- Ocker, F., Braun, S., Will, C., 2016. Design of European balancing power markets, in: 2016 13th International Conference on the European Energy Market (EEM). IEEE, pp. 1–6. <https://doi.org/10.1109/eem.2016.7521193>

- Ocker, F., Ehrhart, K.M., 2017. The “German Paradox” in the balancing power markets. *Renewable and Sustainable Energy Reviews* 67, 892–898. <https://doi.org/10.1016/j.rser.2016.09.040>
- Ocker, F., Ehrhart, K.M., Belica, M., 2018. Harmonization of the European balancing power auction: A game-theoretical and empirical investigation. *Energy Economics* 73, 194–211. <https://doi.org/10.1016/j.eneco.2018.05.003>
- Ortega-Vazquez, M.A., Costilla-Enriquez, N., Ela, E., Tuohy, A., 2020. Risk-Based Reserve Procurement. *2020 International Conference on Probabilistic Methods Applied to Power Systems, PMAPS 2020 - Proceedings*. <https://doi.org/10.1109/pmaps47429.2020.9183585>
- Papavasiliou, A., 2020. Scarcity pricing and the missing European market for real-time reserve capacity. *Electricity Journal* 33, 106863. <https://doi.org/10.1016/j.tej.2020.106863>
- Pollitt, M.G., Anaya, K.L., 2019. Competition in Markets for Ancillary Services? The implications of rising distributed generation. University of Cambridge Energy Policy Research Group.
- Poplavskaya, K., de Vries, L., 2019. Distributed energy resources and the organized balancing market: A symbiosis yet? Case of three European balancing markets. *Energy Policy* 126, 264–276. <https://doi.org/10.1016/j.enpol.2018.11.009>
- Prakash, A., Macgill, I., Bruce, A., 2021. Response to Frequency control rule changes directions paper. <https://doi.org/10.13140/RG.2.2.11620.50560>
- Rebours, Y.G., Kirschen, D.S., Trotignon, M., Rossignol, S., 2007b. A Survey of Frequency and Voltage Control Ancillary Services - Part II: Economic Features. *IEEE Transactions on Power Systems* 22, 358–366. <https://doi.org/10.1109/tpwrs.2006.888965>
- Rebours, Y.G., Kirschen, D.S., Trotignon, M., Rossignol, S., 2007a. A Survey of Frequency and Voltage Control Ancillary Services - Part I: Technical Features. *IEEE Transactions on Power Systems* 22, 350–357. <https://doi.org/10.1109/tpwrs.2006.888963>
- Rebours, Y., Kirschen, D., Trotignon, M., 2007. Fundamental Design Issues in Markets for Ancillary Services. *Electricity Journal* 20, 26–34. <https://doi.org/10.1016/j.tej.2007.06.003>
- Reishus Consulting LLC, 2017. Electricity Ancillary Services Primer.
- Riesz, J., Gilmore, J., MacGill, I., 2015. Frequency Control Ancillary Service Market Design: Insights from the Australian National Electricity Market. *Electricity Journal* 28, 86–99. <https://doi.org/10.1016/j.tej.2015.03.006>
- Riesz, J., Milligan, M., 2015. Designing electricity markets for a high penetration of variable renewables. *Wiley Interdisciplinary Reviews: Energy and Environment* 4, 279–289. <https://doi.org/10.1002/wene.137>
- Roberts, C., 2018. Review of International Grid Codes.
- Rolfe, R., 2019. Mandatory primary frequency response consultation paper submission - Infigen.
- Scherer, M., Zima, M., Andersson, G., 2013. An integrated pan-European ancillary services market for frequency control. *Energy Policy* 62, 292–300. <https://doi.org/10.1016/j.enpol.2013.07.030>
- Scott, T., 2019. Mandatory primary frequency response consultation paper submission - CS Energy.

- Skinner, B., 2019. Mandatory primary frequency response consultation paper submission - Australian Energy Council.
- Skinner, B., Mancarella, P., Vrakopoulou, M., Hiskens, I., 2020. Incorporating new power system security paradigms into low-carbon electricity markets. *The Electricity Journal* 33, 106837. <https://doi.org/10.1016/j.tej.2020.106837>
- Stringer, N., Bruce, A., MacGill, I., Haghdi, N., Kilby, P., Mills, J., Veijalainen, T., Armitage, M., Wilmot, N., 2020. Consumer-Led Transition: Australia's World-Leading Distributed Energy Resource Integration Efforts. *IEEE Power and Energy Magazine* 18, 20–36. <https://doi.org/10.1109/mpe.2020.3014720>
- Thorncraft, S.R., Outhred, H.R., 2007. Experience with market-based ancillary services in the Australian National Electricity Market. 2007 IEEE Power Engineering Society General Meeting, PES. <https://doi.org/10.1109/pes.2007.385855>
- Thorncraft, S.R., Outhred, H.R., Clements, D.J., Barker, F.K., 2008. Market-based ancillary services in the Australian National Electricity Market for increased levels of wind integration. *Wind Engineering* 32, 1–12. <https://doi.org/10.1260/030952408784305868>
- Tielens, P., Van Hertem, D., 2016. The relevance of inertia in power systems. *Renewable and Sustainable Energy Reviews* 55, 999–1009. <https://doi.org/10.1016/j.rser.2015.11.016>
- Ulbig, A., Borsche, T.S., Andersson, G., 2014. Impact of low rotational inertia on power system stability and operation, in: Proceedings of the 19th IFAC World Congress. IFAC, pp. 7290–7297. <https://doi.org/10.3182/20140824-6-za-1003.02615>
- van der Veen, R.A.C., Hakvoort, R.A., 2016. The electricity balancing market: Exploring the design challenge. *Utilities Policy* 43, 186–194. <https://doi.org/10.1016/j.jup.2016.10.008>
- Vandezande, L., Meeus, L., Belmans, R., Saguan, M., Glachant, J.M., 2010. Well-functioning balancing markets: A prerequisite for wind power integration. *Energy Policy* 38, 3146–3154. <https://doi.org/10.1016/j.enpol.2009.07.034>
- Zhou, Z., Levin, T., Conzelmann, G., 2016. Survey of U.S. Ancillary Services Markets. Argonne National Laboratory.