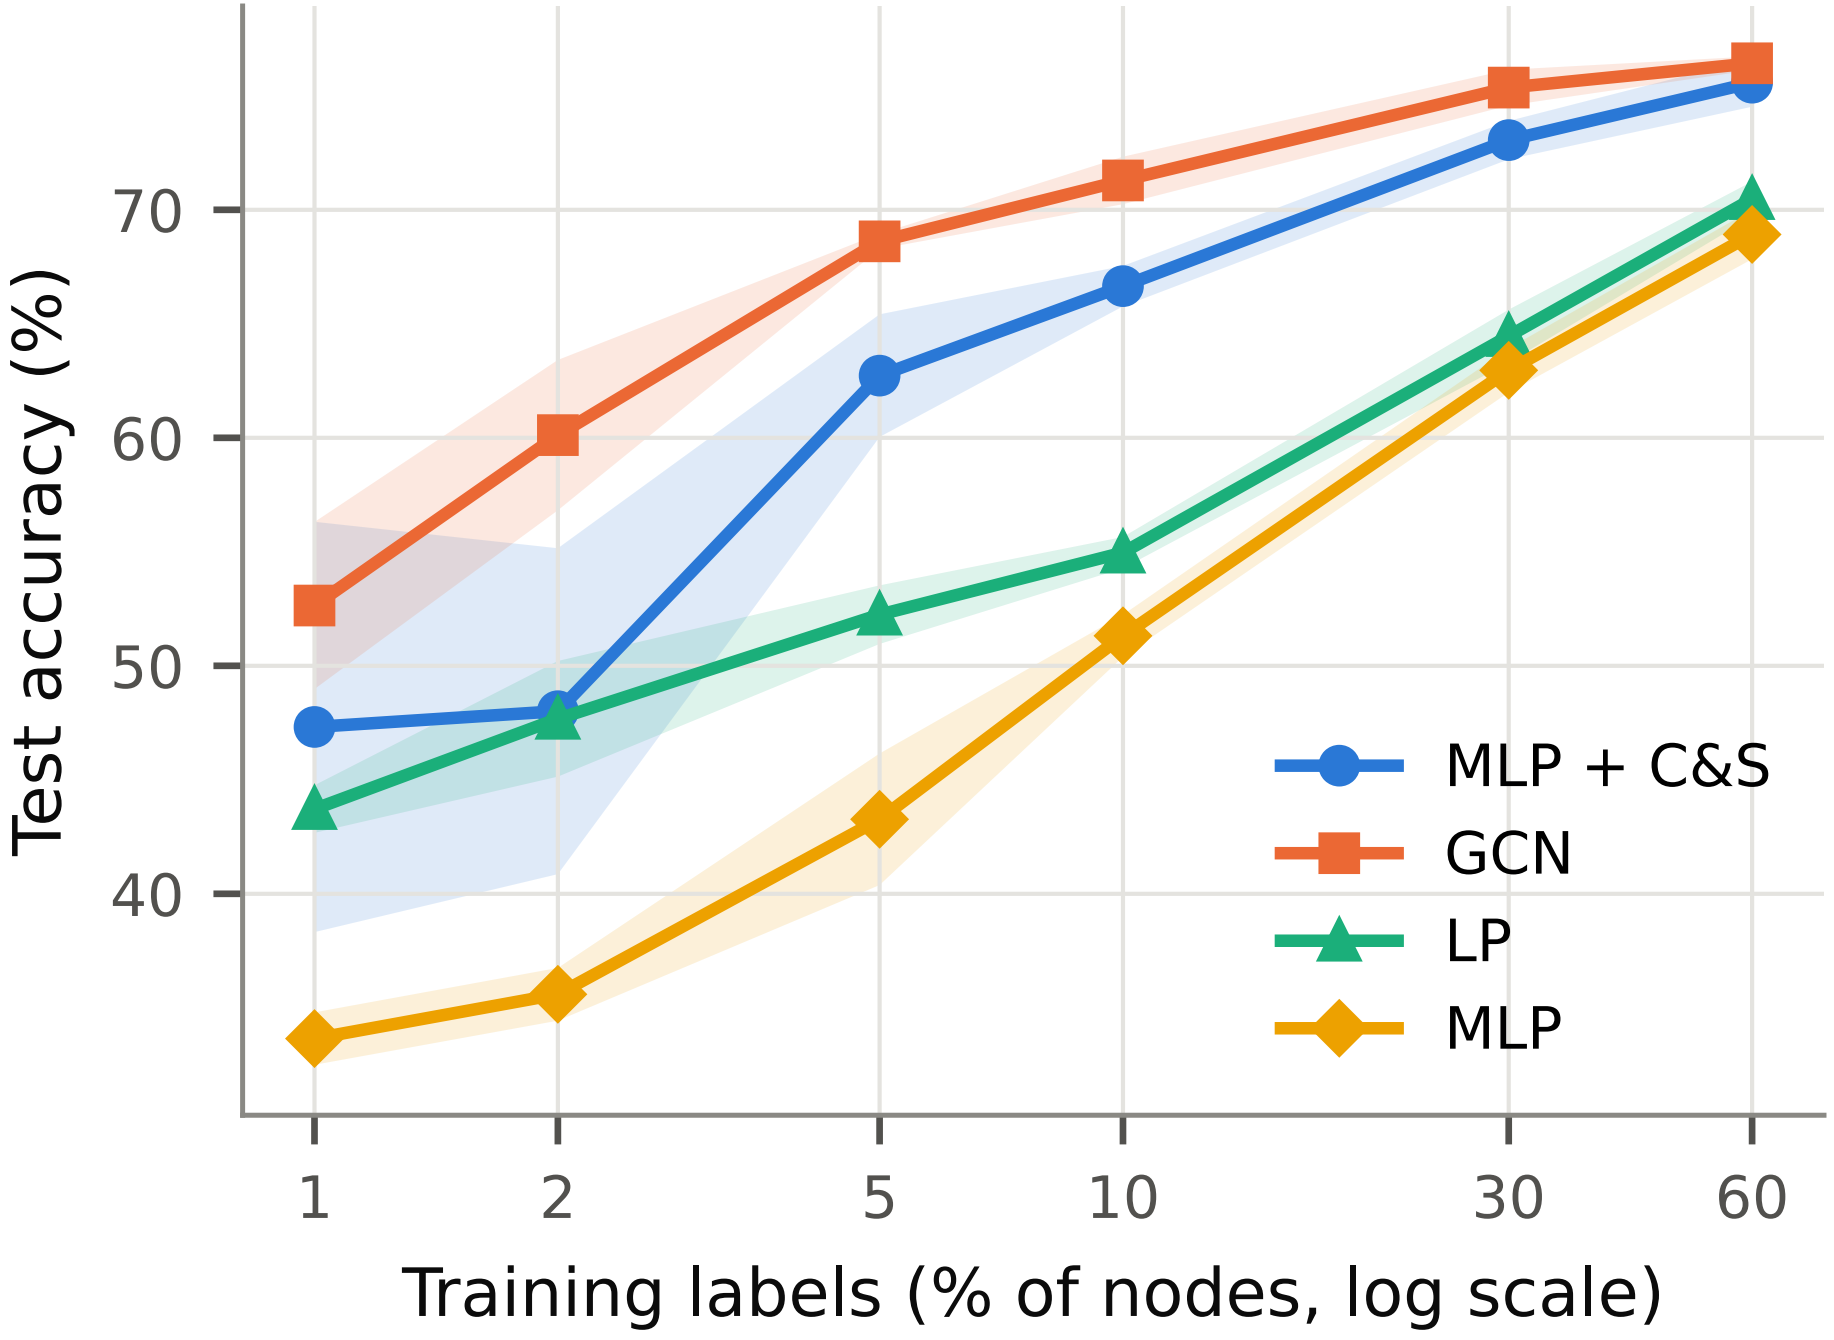
Test accuracy (%)
70
60
50
40
1
2
5
10
30
60
Training labels (% of nodes, log scale)
MLP + C&S
GCN
LP
MLP