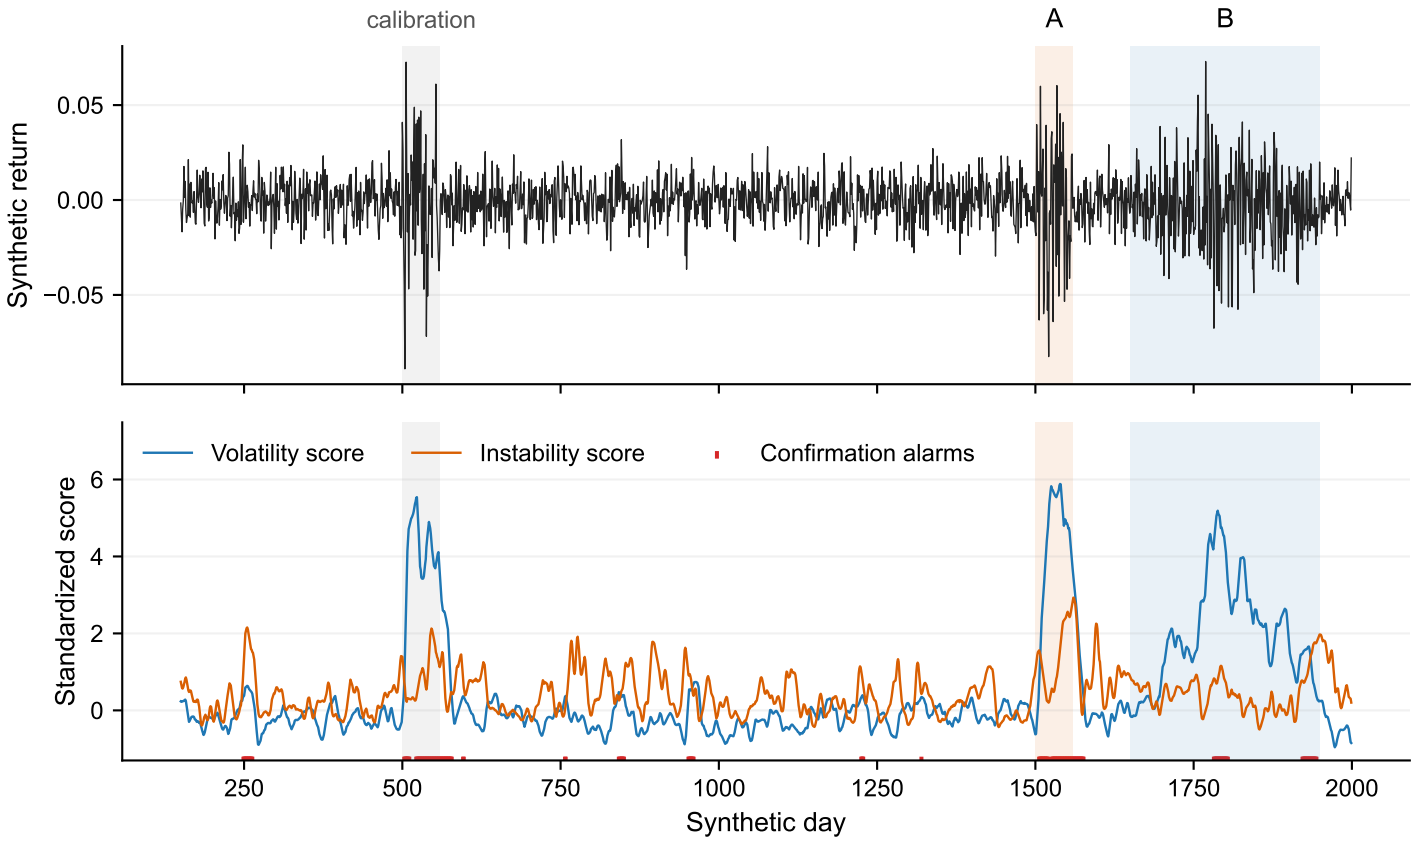
calibration
A
B
Synthetic return
0.05
0.00
−0.05
Volatility score
Instability score
Confirmation alarms
Standardized score
6
4
2
0
250
500
750
1000
1250
1500
1750
2000
Synthetic day