



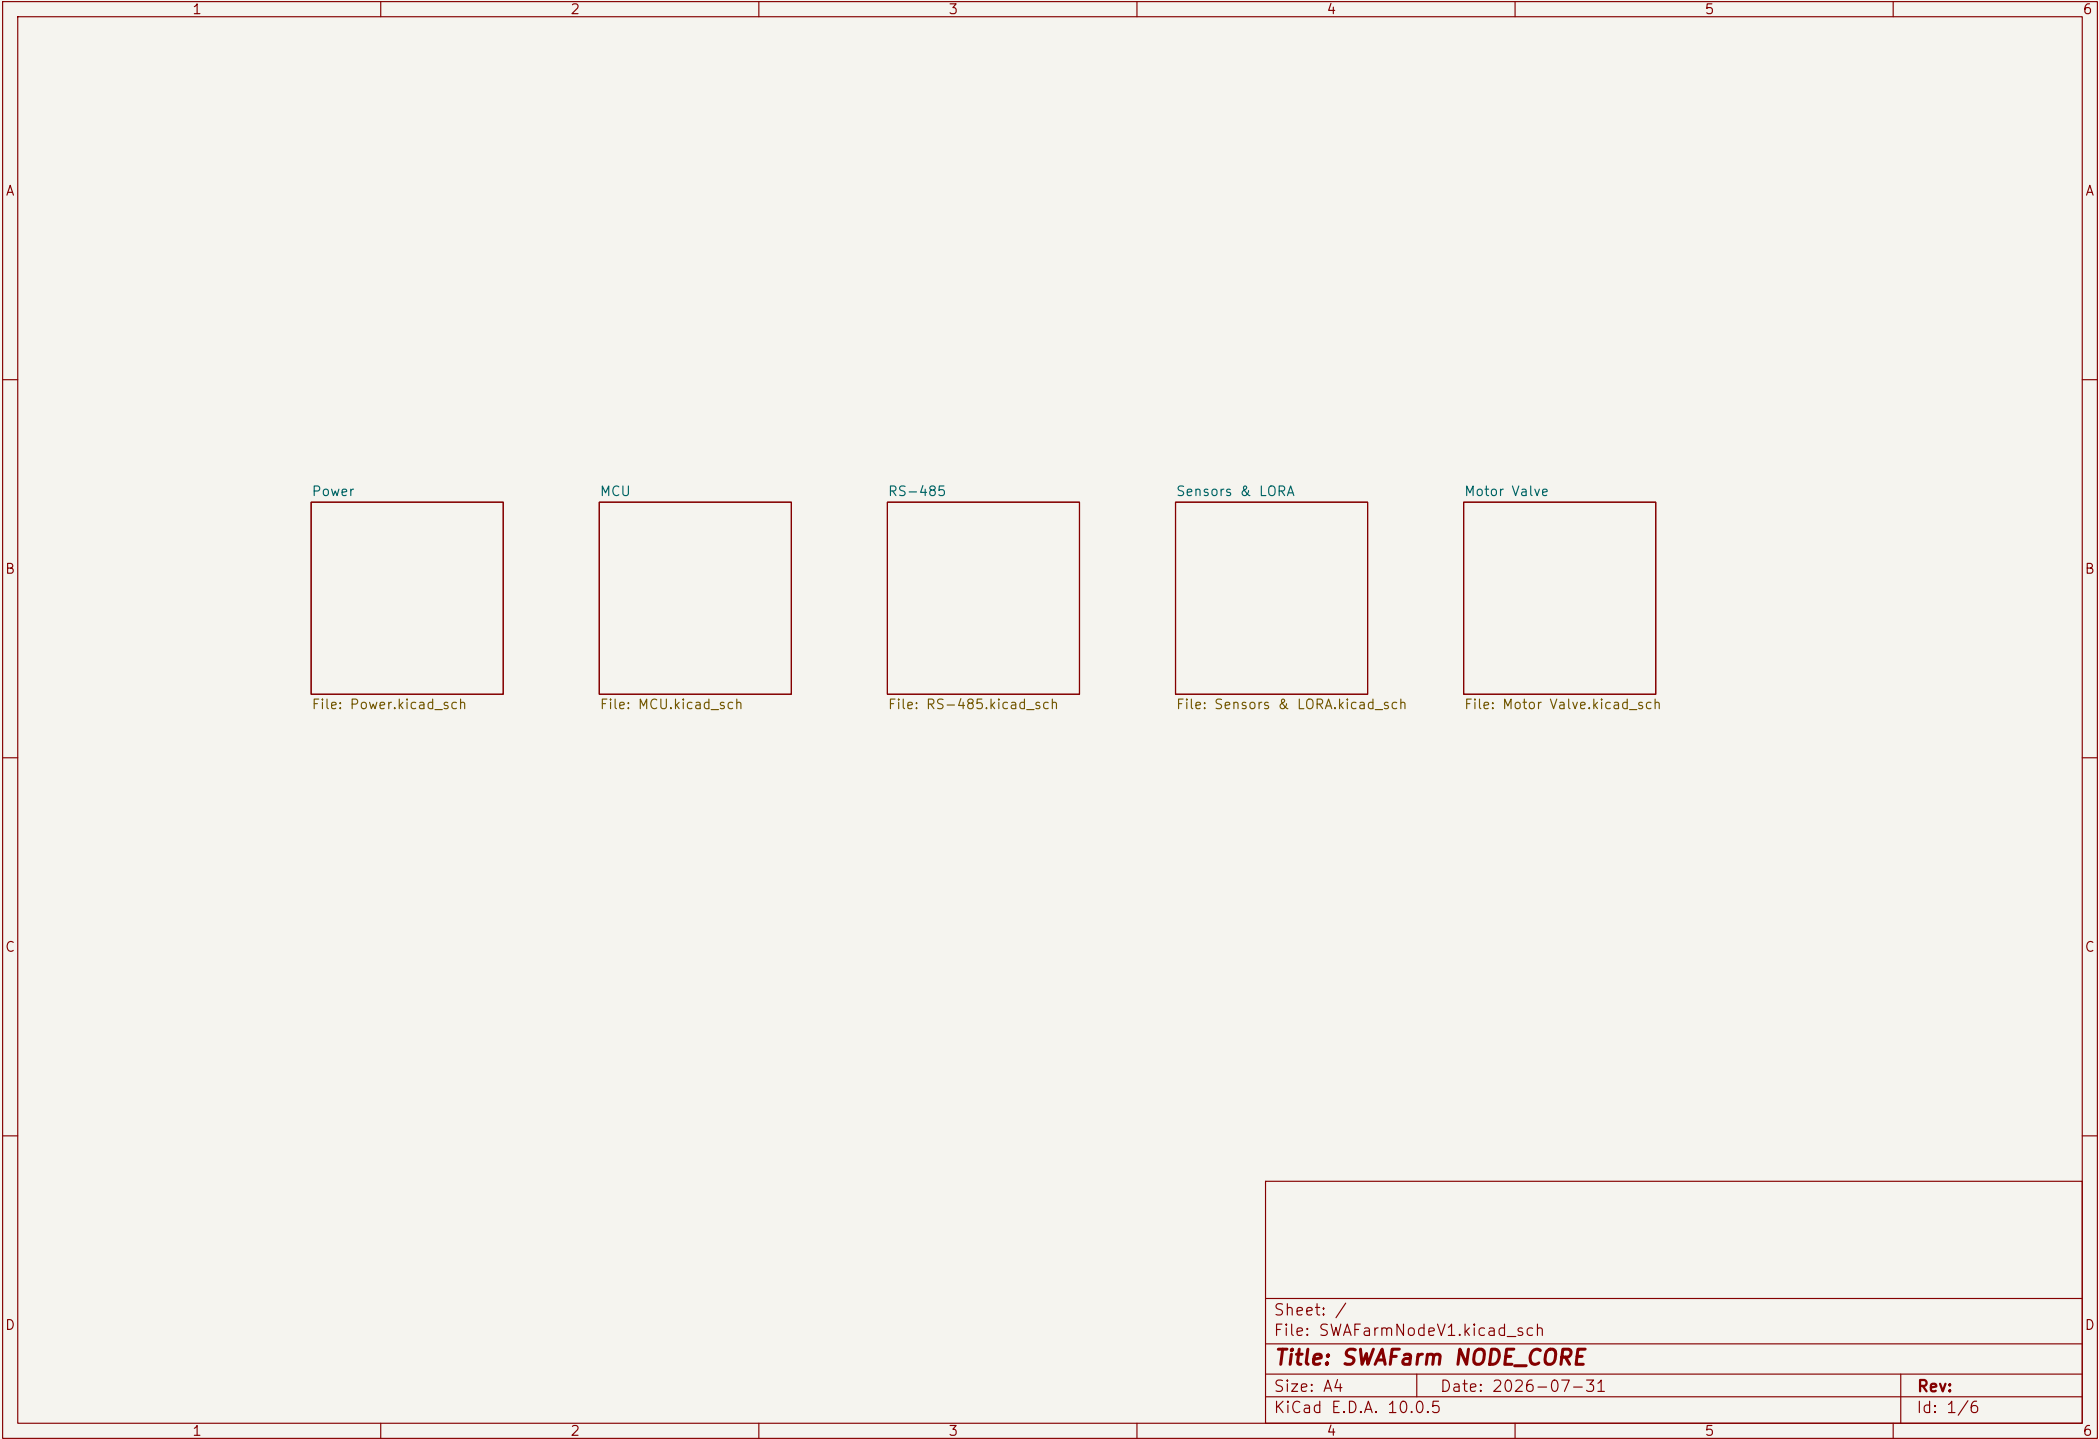

Sheet: /		
File: SWAFarmNodeV1.kicad_sch		
Title: SWAFarm NODE_CORE		
Size: A4	Date: 2026-07-31	Rev:
KiCad E.D.A. 10.0.5	Id: 1/6	

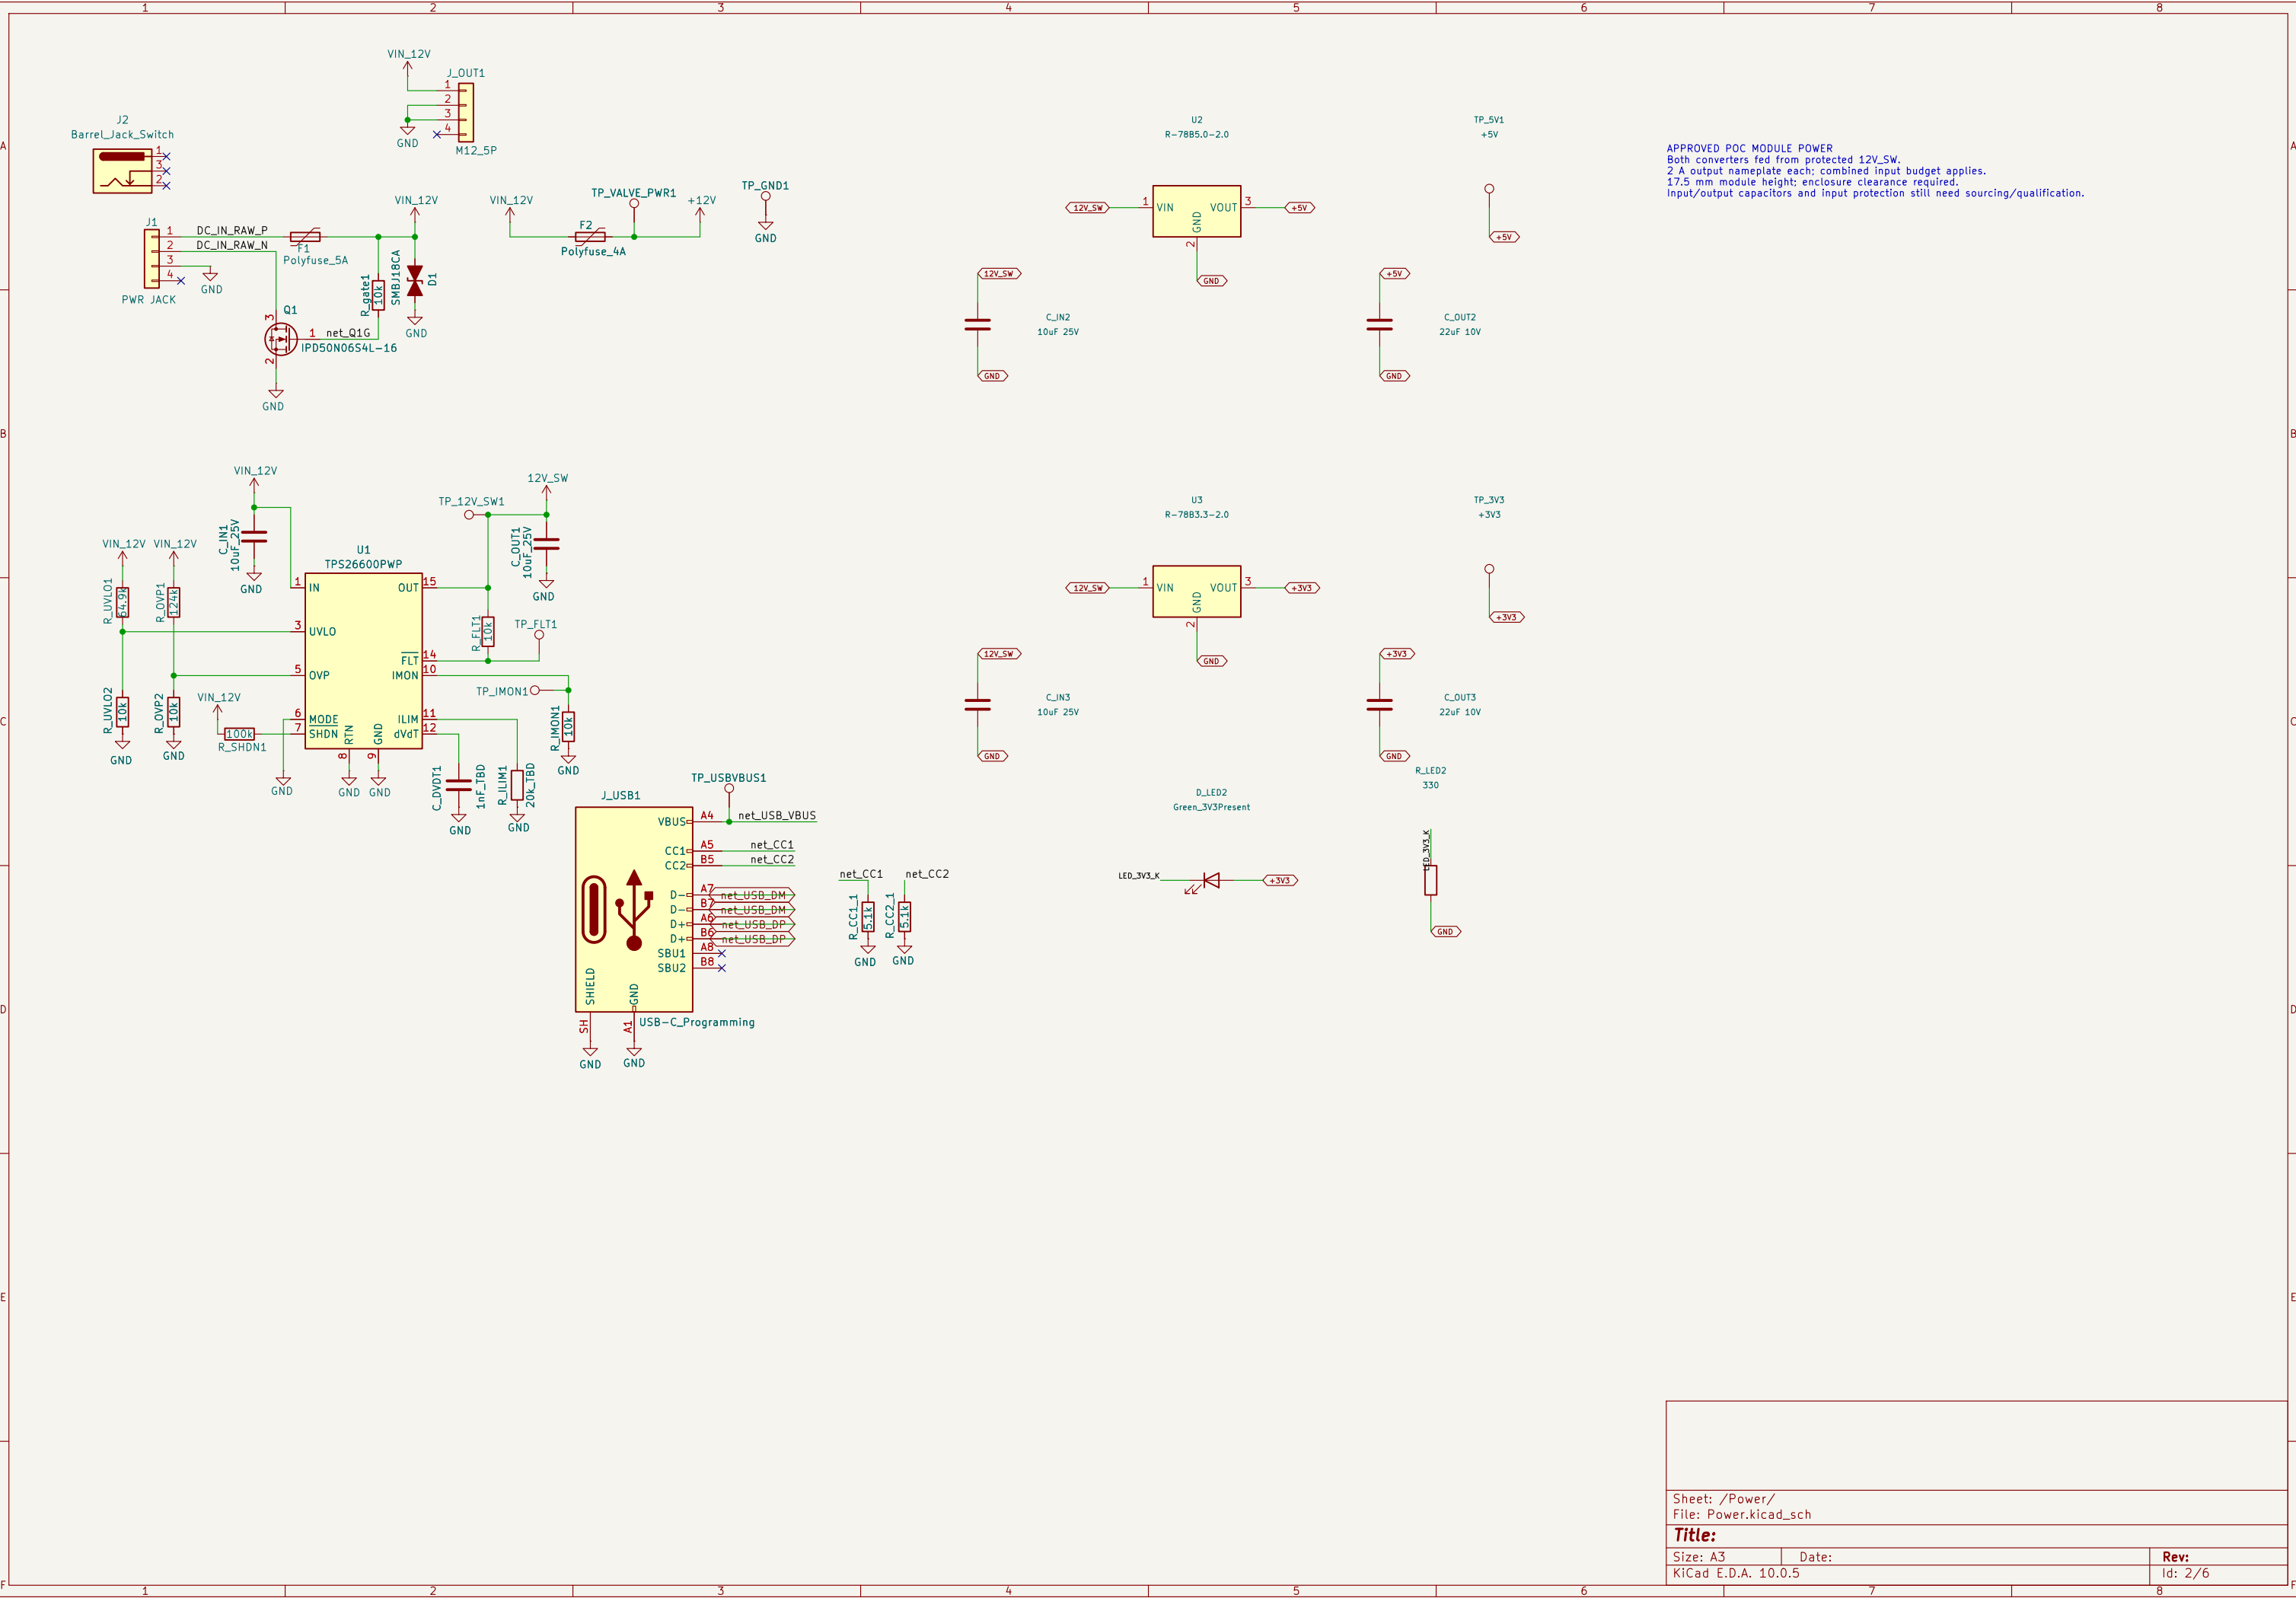

Sheet: /Power/
File: Power.kicad_sch

Title:

Size: A3


Date:

Rev:

KiCad E.D.A. 10.0.5

Id: 2/6



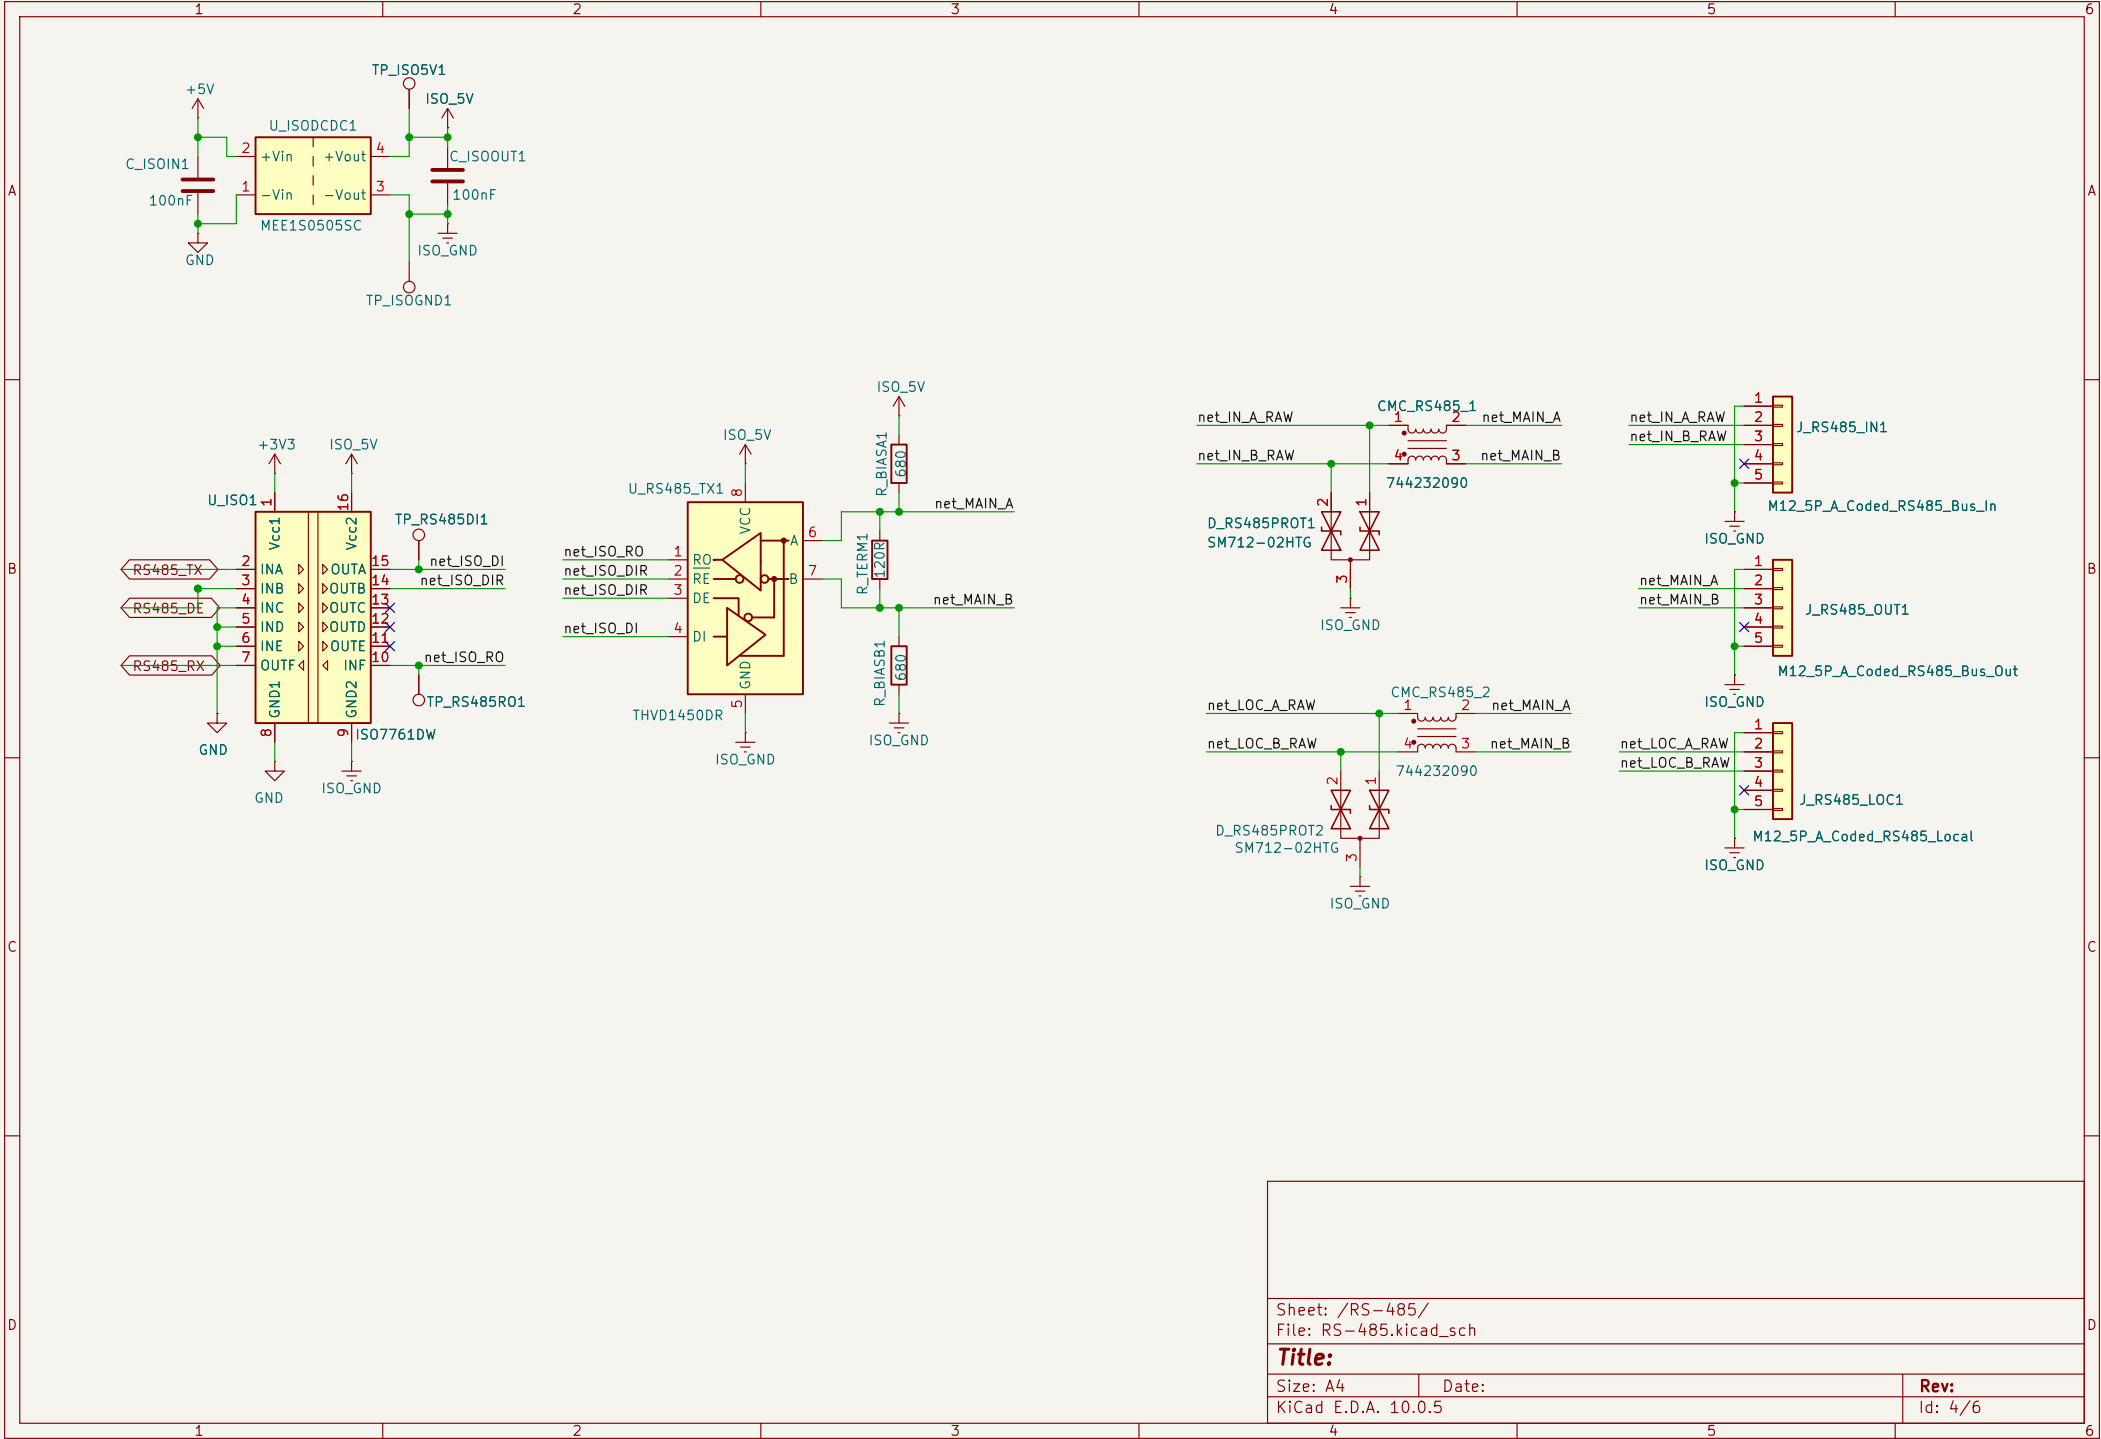

Sheet: /RS-485/
File: RS-485.kicad_sch


Title:

Size: A4
KiCad E.D.A. 10.0.5

Date:

Rev:

Id: 4/6

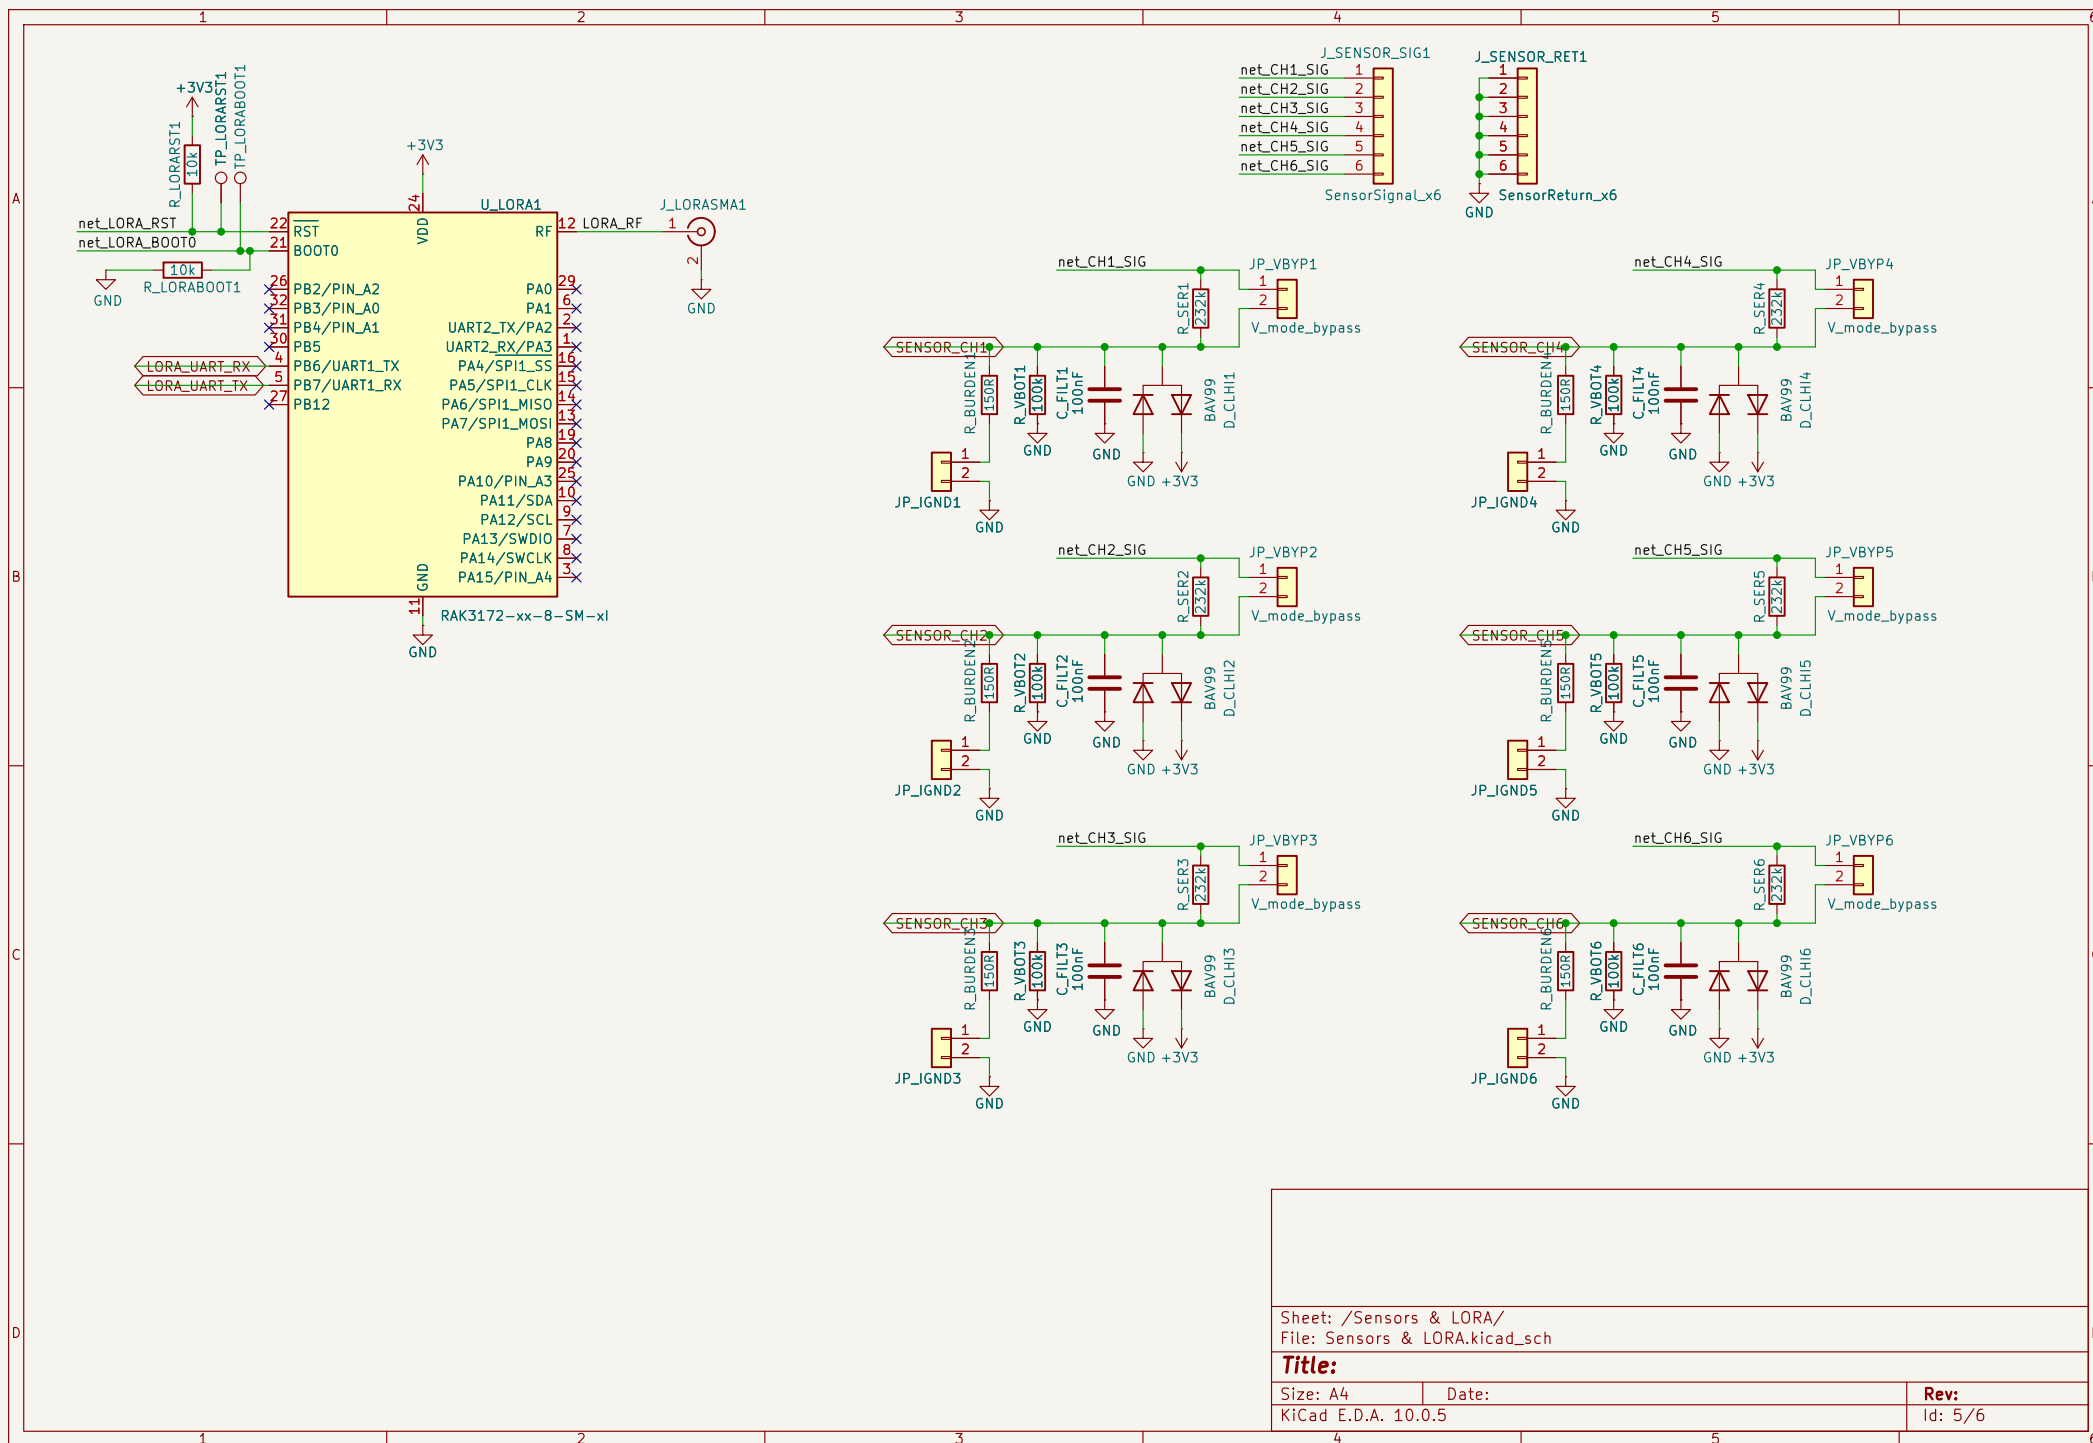

[illegible]

12 V controller supply powers relay coils only. External isolated 24 VAC valve supply is NOT connected to controller rails.
Wire each valve using COM and NO. Provide external branch fusing and AC-compatible coil suppression.
POC target: Hunter PGV-101-G-B, eight simultaneous valves for qualification. Contact/load life testing required.

