



COPPER CLADDED ALUMINUM

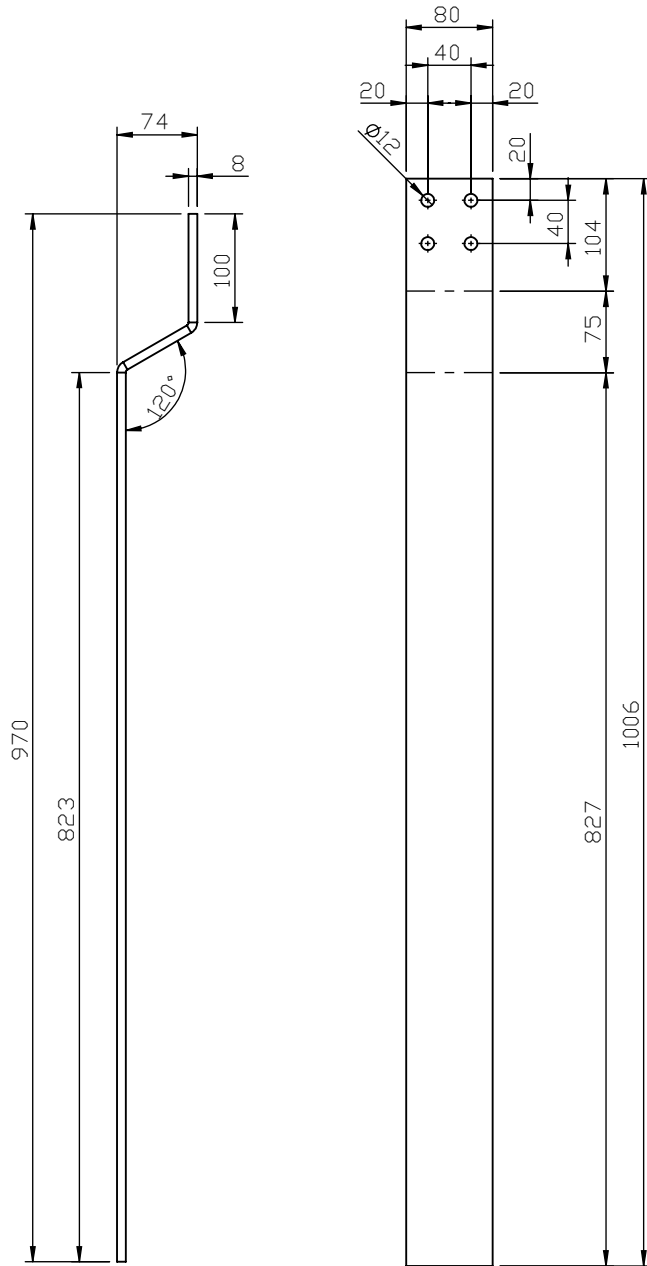


OUTSIDE LEAD
80x8mm/3NOS.

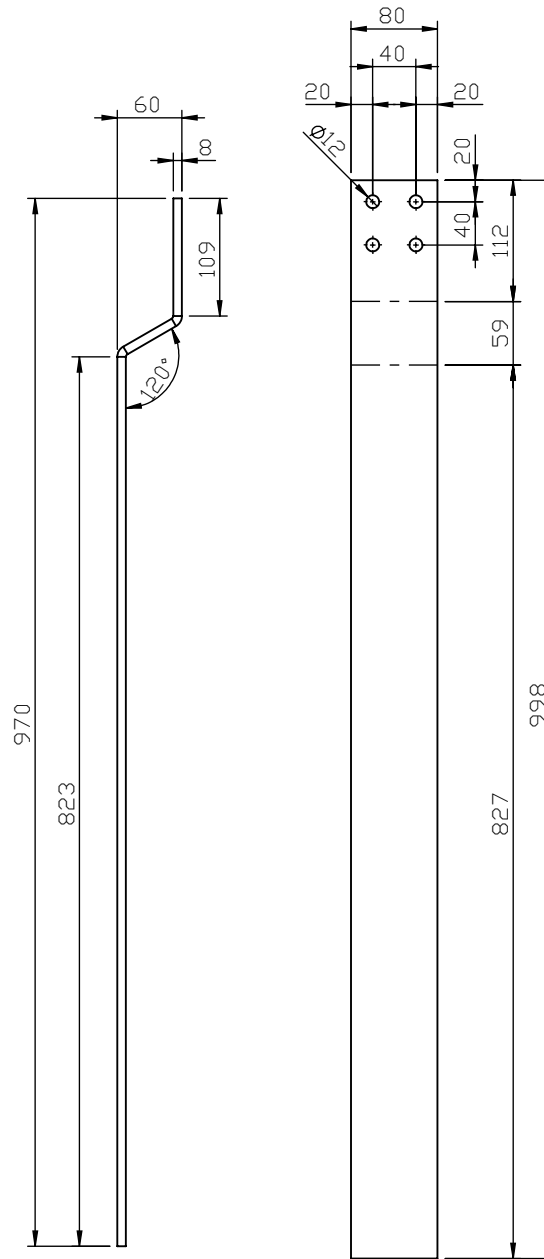

INSIDE LEAD
80x8mm/3NOS.

GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 1

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: APS TANZANIA LIMITED				
TITLE : LV LEADS 800kVA 11V/400V AL TRANSFORMER				
DESIGNED BY:	SCALE: 1:6	UNITS: mm	SIZE: A4	
REVIEWED BY:	DRAWN BY: PRASHANTH	DESIGN NO: CT-2314		
APPROVED BY:	DRAWING NO: DRW/CT-2314/1-1	DATE: 2023-07-06	REV:00	