




FRONT VIEW

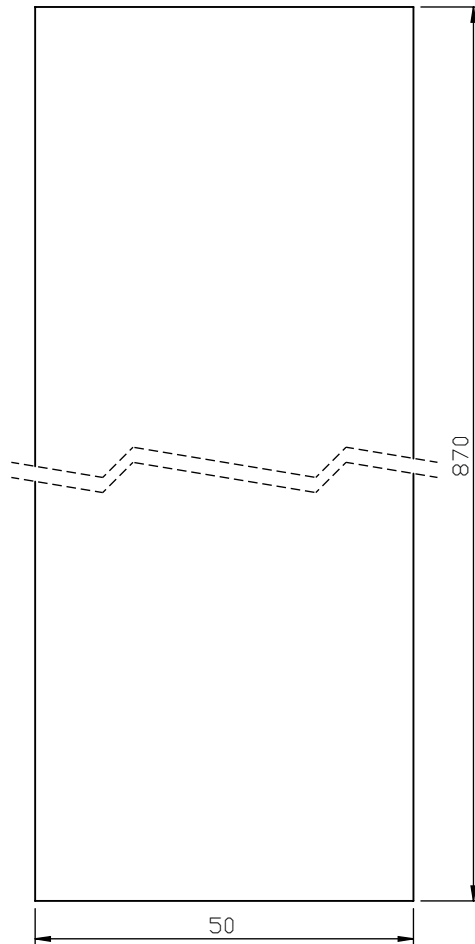

TOP VIEW  
STRAPPING DUCT  
PRESS BOARD/6NOS.

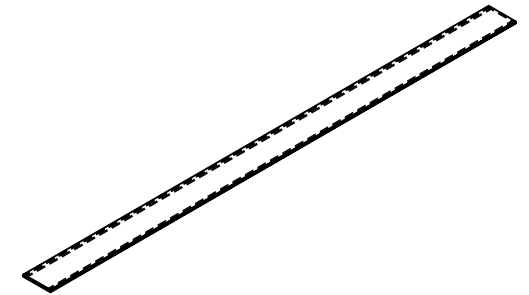

GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED  
HOLE SIZE  $\pm 0.05$  / HOLE C-C  $\pm 0.05$  / OTHER LINIER DIMENSIONS  $\pm 1$

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
	LTL Transformers (Pvt) Ltd			
	154/11, Railway Station Road, Angulana, Moratuwa, Sri lanka			
PROJECT: APS TANZANIA LIMITED				
TITLE : STRAPPING DUCT				
800kVA 11V/400V AL TRANSFORMER				
DESIGNED BY:	SCALE: 1:1	UNITS: mm	SIZE: A4	
DRAWN BY:	PRASHANTH	DESIGN NO: CT-2314		
REVIEWED BY:	DRAWING NO: DRW/CT-2314/8-2			
APPROVED BY:	DATE: 2023-07-06	REV:00		