

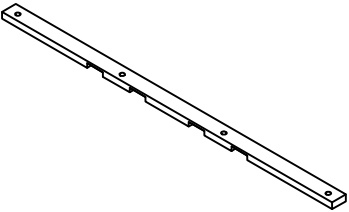







STEPPED WOODEN SUPPORT-HV	STEPPED WOODEN SUPPORT-LV
	
QTY-7	QTY-7
DRW/CT-2237/8-1	

WOODEN SUPPORT - HV & LV BOTTOM	WOODEN SUP. FOR WINDING
	
QTY-2	QTY-2
DRW/CT-2237/8-3	

Issued for Production
27 JAN 2023
QA DEPT

CONTROLLED
IF GREEN


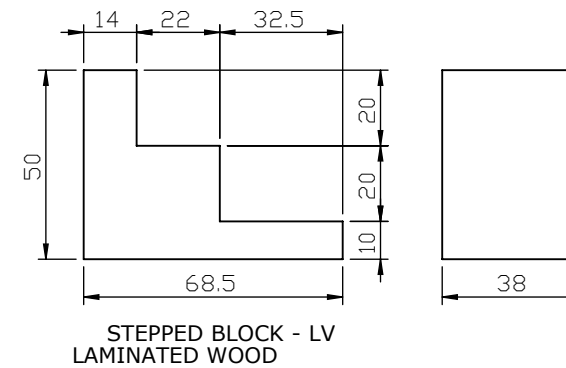
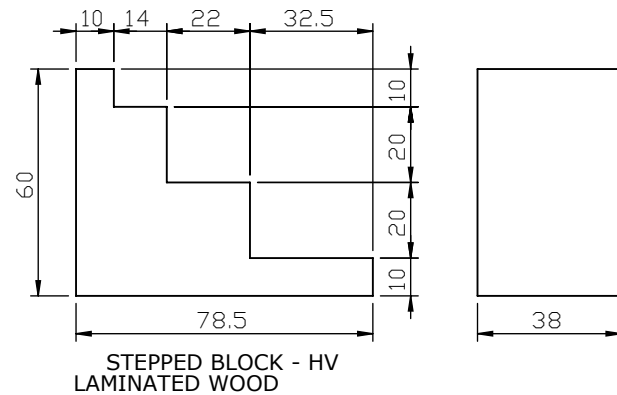
GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 1

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
	<div>LTL Transformers (Pvt) Ltd</div> <div>154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka</div>			
PROJECT: INSEE SIAM CITY CEMENT				
TITLE : CORE BUILDING TIMBER				
2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: NTS	UNITS: mm	SIZE: A4	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO:		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/80-6			
DATE: 2023/01/23	REV: 00			






NOTE: ABOVE GIVEN QUANTITIES ARE REQUIRED FOR SINGLE TRANSFORMER (3xWINDINGS).

Issued for Production
27 JAN 2023
QA DEPT

CONTROLLED
IF GREEN


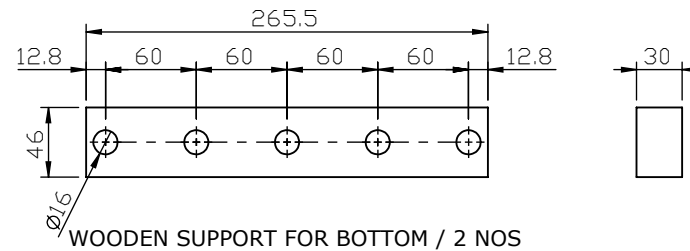
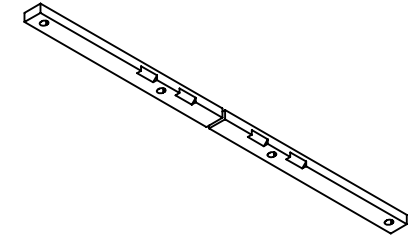
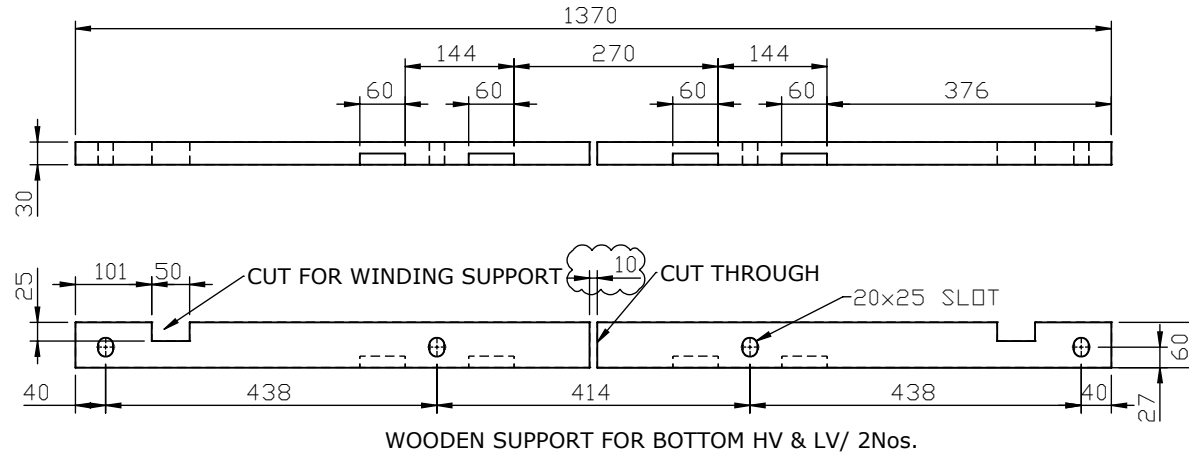


GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 0.2





REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
		<div>LTL Transformers (Pvt) Ltd</div> <div>154/11, Railway Station Road, Angulana, Moratuwa, Sri lanka</div>		
PROJECT: SIAM CITY CEMENT				
<div>TITLE :</div> <div>WOODEN STEPPED BLOCK</div> <div>2000kVA 3.3kV/440V TRANSFORMER</div>				
DESIGNED BY: 	SCALE: 1:2	UNITS: mm	SIZE: A4	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/8-1			
APPROVED BY: 	DATE: 27/01/2023	REV:00		

Issued for Production
01 MAR 2023
QA DEPT

CONTROLLED
IF GREEN



GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 1

01	2023/03/01	THARINDU	CUT ADDED	EE-1
REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
<div></div> <div>LTL Transformers (Pvt) Ltd</div> <div>154/11, Railway Station Road, Angulana, Moratuwa, Sri lanka</div>				
PROJECT: SIAM CITY CEMENT				
TITLE : WOODEN SUPPORT - BOTTOM HV & LV 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: 1:9		UNITS: mm	SIZE: A4
REVIEWED BY: 	DRAWN BY: PRASHANTH		DESIGN NO: 20003.3440	
APPROVED BY: 	DRAWING NO: DRW/CT-2237/8-3			
	DATE: 1/03/2023		REV:01	