
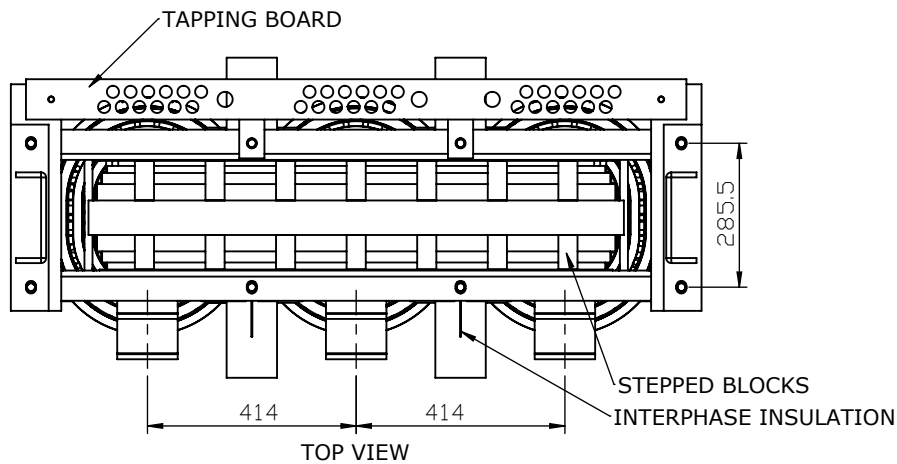


SIDE VIEW

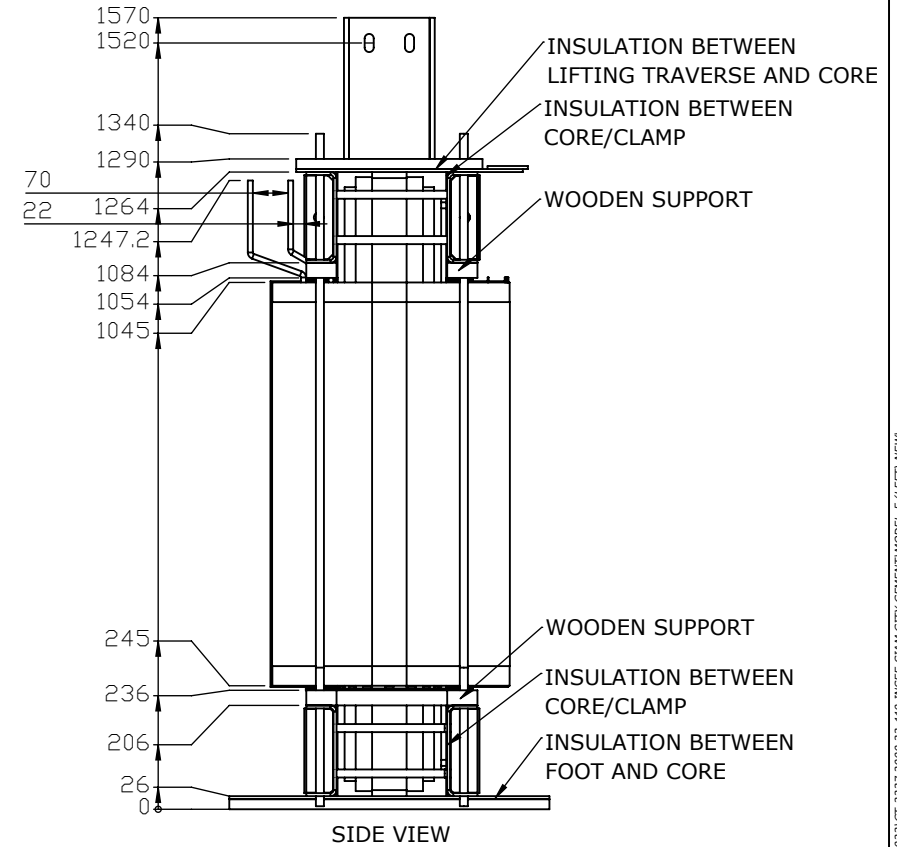





TOP VIEW

Issued for Production  
27 JAN 2023  
QA DEPT  
CONTROLLED  
IF GREEN



SIDE VIEW

GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED  
HOLE SIZE  $\pm 0.05$  / HOLE C-C  $\pm 0.05$  / OTHER LINIER DIMENSIONS  $\pm 1$

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
 <b>LTL Transformers (Pvt) Ltd</b> 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE : <b>ACTIVE PART ARRANGEMENT</b> 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: 1:50	UNITS: mm	SIZE: A4	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/21-1	DATE: 27/01/2023	REV:00	