


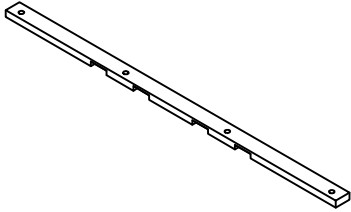
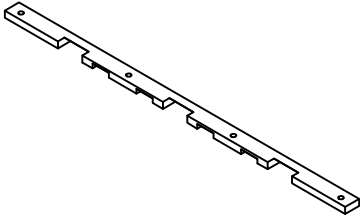
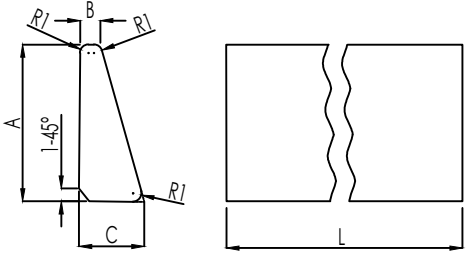



WOODEN STEPPED BLOCK - HV	WOODEN STEPPED BLOCK - LV
	
QTY-7	QTY-7
DRW/CT-2237/8-1	

WOODEN SUPPORT - HV TOP	WOODEN SUPPORT - LV TOP
	
QTY-1	QTY-1
DRW/CT-2237/8-2	DRW/CT-2237/8-2

CORE CORNER STICK				
				
A	B	C	L	QTY
30	3	4	798	12





WOODEN ROUND STICKS		
		
ROD DIA.	LENGTH	QTY
8	800	24
10	800	0
12	800	0

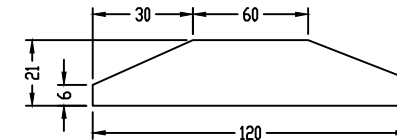

HV SIDE WOODEN FILLING
LENGTH=798 / QTY=3




Issued for Production
27 JAN 2023
QA DEPT
CONTROLLED
IF GREEN

NOTE: ABOVE GIVEN QUANTITIES ARE REQUIRED FOR SINGLE TRANSFORMER (3xWINDINGS).





GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED				
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 1				
REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: INSEE SIAM CITY CEMENT				
TITLE : ASSEMBLY STAGE TIMBER 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: NTS	UNITS: mm	SIZE: A4	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO:		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/80-5			
	DATE: 2023/01/26	REV: 00		

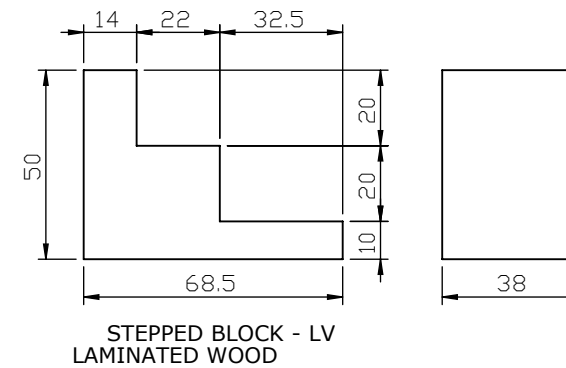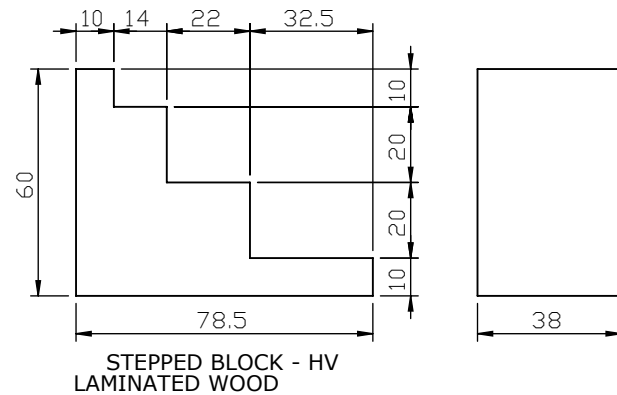Issued for Production
27 JAN 2023
QA DEPT





CONTROLLED
IF GREEN







GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 0.2

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE : WOODEN STEPPED BLOCK 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: 1:2	UNITS: mm	SIZE: A4	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/8-1	DATE: 27/01/2023	REV:00	

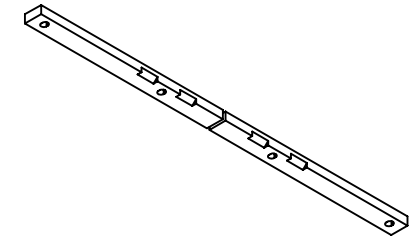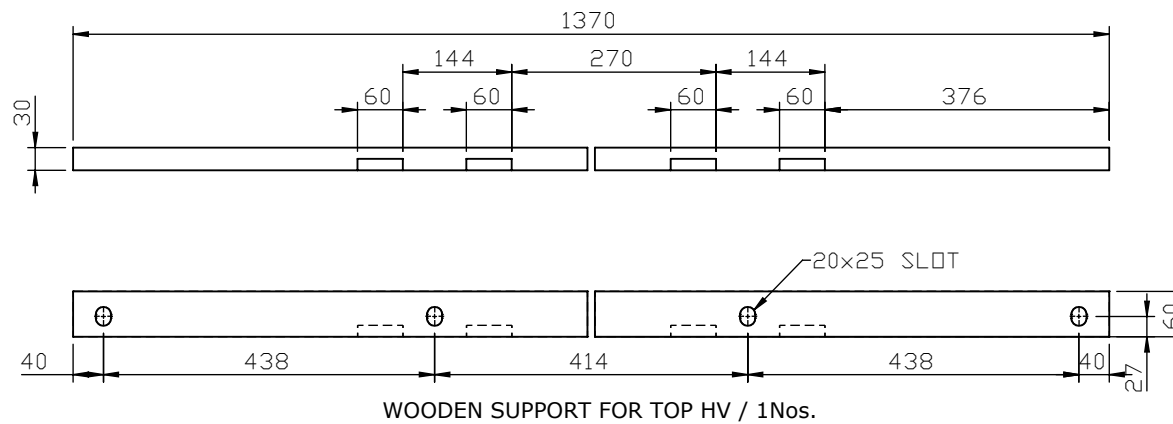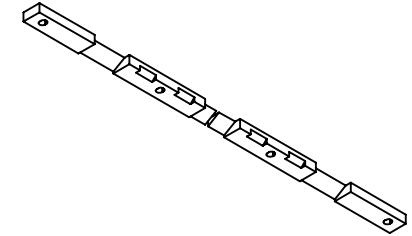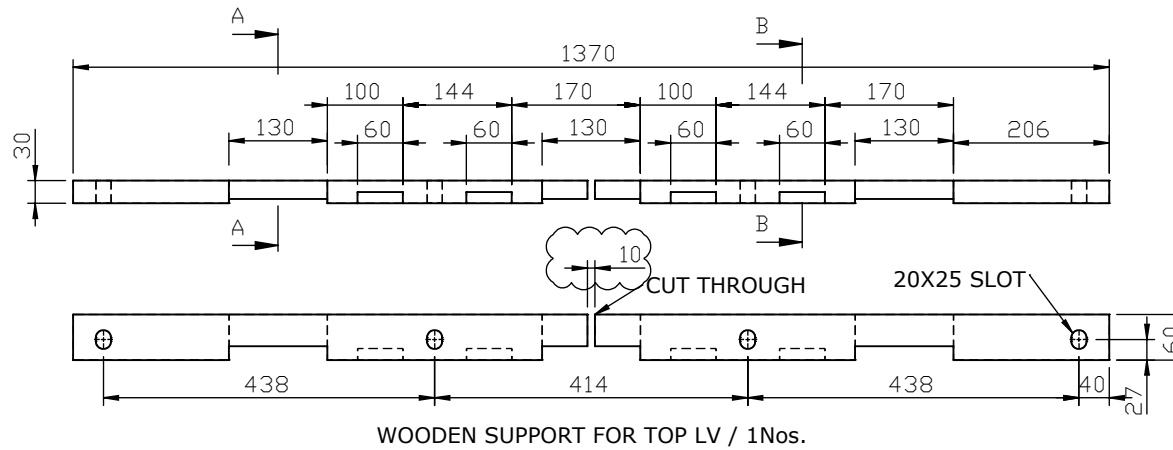Issued for Production
01 MAR 2023
QA DEPT
CONTROLLED
IF GREEN



GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 1

01	2023/03/01	THARINDU	CUT ADDED	EE-1
REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
<div> LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri lanka</div>				
PROJECT: SIAM CITY CEMENT				
TITLE : WOODEN SUPPORT - TOP HV & LV 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: 1:9		UNITS: mm	SIZE: A4
REVIEWED BY: 	DRAWN BY: PRASHANTH		DESIGN NO: 20003.3440	
APPROVED BY: 	DRAWING NO: DRW/CT-2237/8-2			
	DATE: 1/03/2023		REV:01	

