



COPPER NEUTRAL BUSBAR

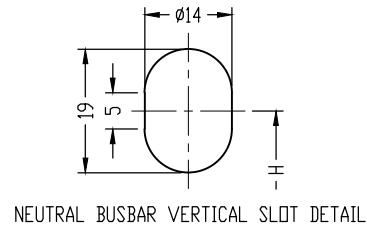


NEUTRAL BUSBAR VERTICAL SLOT DETAIL

Issued for Production
27 JAN 2023
QA DEPT
CONTROLLED
IF GREEN

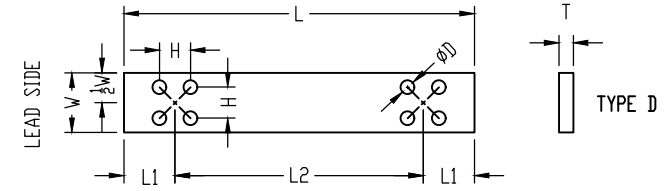

COPPER BUSBAR EXTENSION

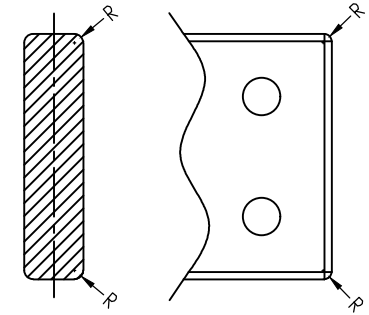


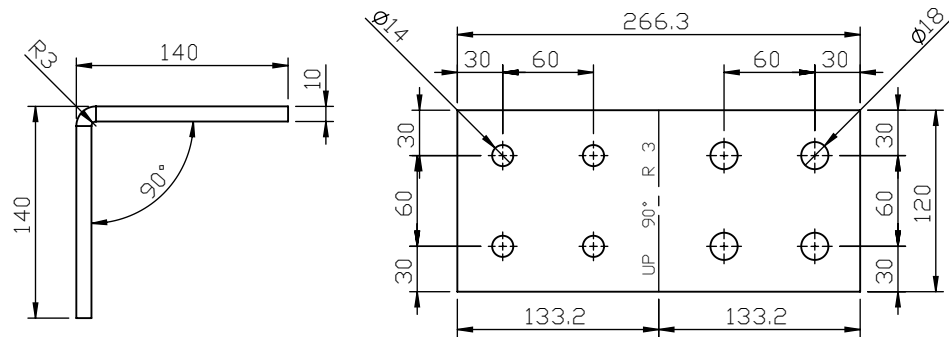
NEUTRAL & EXTENSION
EDGE PREPARATION DETAILS

kVA/kV	TYPE	L	W	T	L1	L2	D	H	QTY
2000/3.3/440	B	948	120	10	60	414	SLOT 14x19	60	1
kVA/kV	TYPE	L	W	T	L1	L2	D	H	QTY
2000/3.3/440	D	327	120	10	60	207	14	60	2


Nominal thickness [mm]		Corner radius, R [mm]	Tolerance on corner radius, R [mm]
over	Up to and including		
1	3	0.5	-
3	6	0.8	±0.20
6	10	1.0	±0.30
10	30	1.6	±0.40

GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ±0.05 / HOLE C-C ±0.05 / OTHER LINIER DIMENSIONS ±1

REV:	DATE	DRAWN:	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE : NEUTRAL BUSBAR & EXTENSIONS				
2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY:	SCALE: N/A	SIZE: A4	UNITS: mm	
REVIEWED BY:	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY:	DRAWING NO: DRW/CT-2057/21-3			
	DATE: 2021/07/06			REV: 00




ADAPTER
CU/ 120X10 / 4 NOS

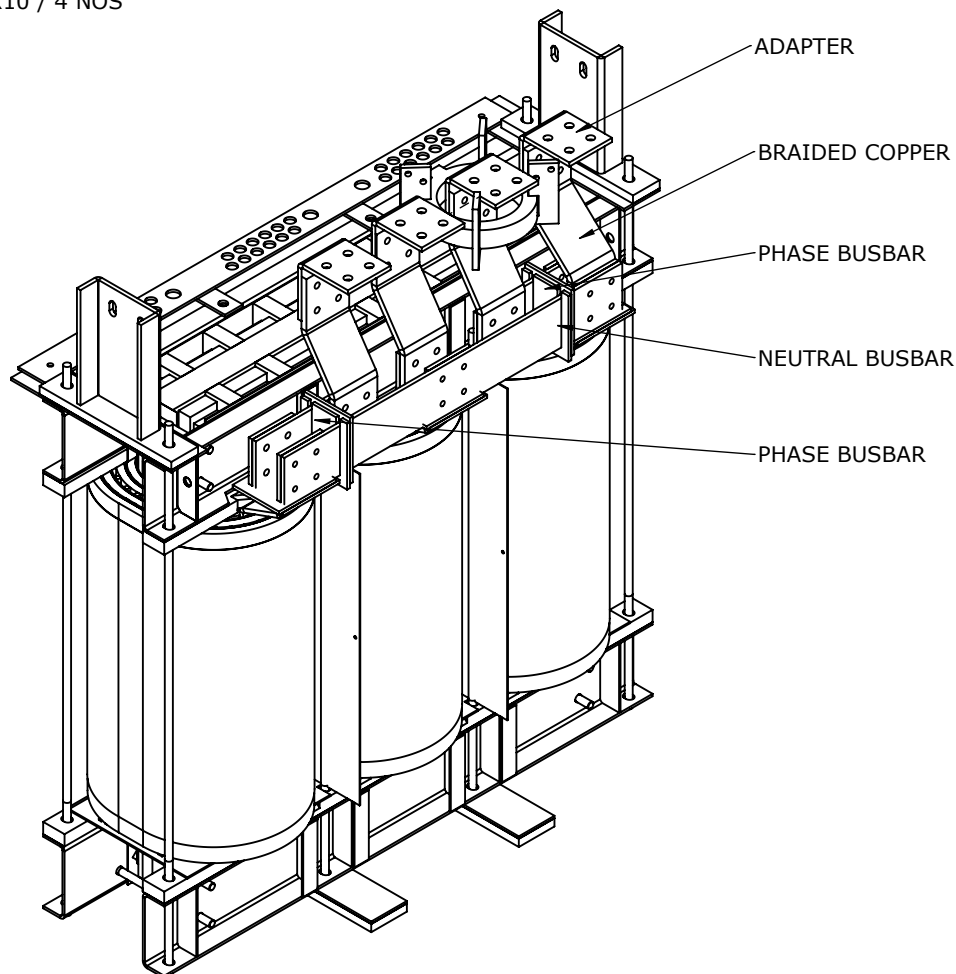



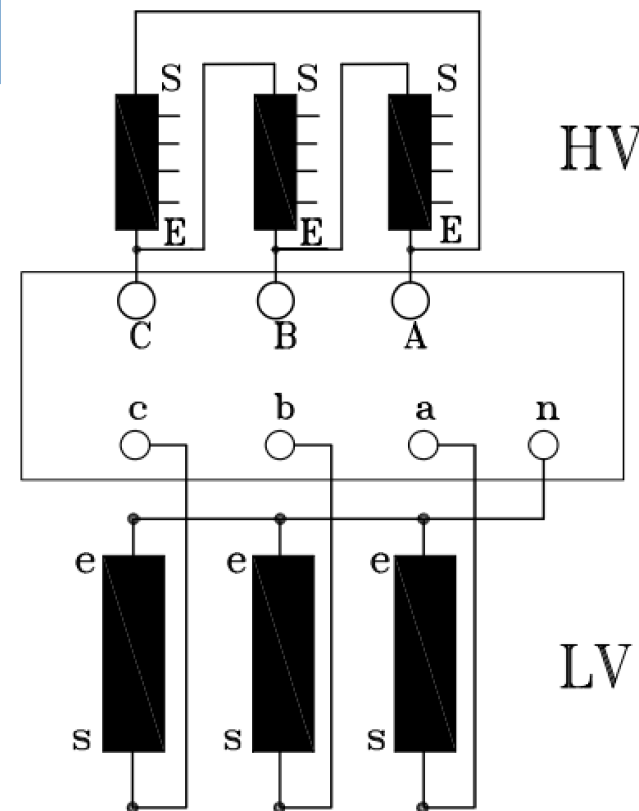

Issued for Production
27 JAN 2023
QA DEPT
CONTROLLED
IF GREEN

(NOTE - CONNECTION AS PER DYN5)



GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED
HOLE SIZE ± 0.05 / HOLE C-C ± 0.05 / OTHER LINIER DIMENSIONS ± 1

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE : ASSEMBLY STAGE COPPER 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: 1:20	UNITS: mm SIZE: A4		
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/21-2	DATE: 27/01/2023 REV:00		