

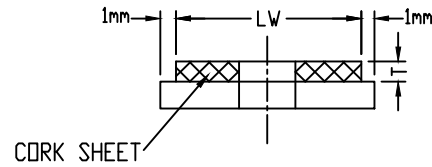
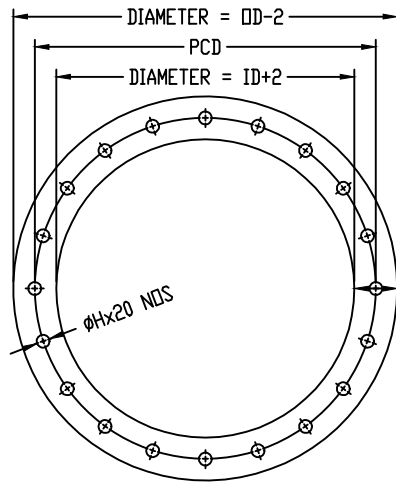


Issued for Production
27 JAN 2023
QA DEPT
CONTROLLED
IF GREEN

CAPACITY	L	LH	B	W	WH	D	LW	H	T	QTY	MATERIAL
2000/3.3/440	1540	1474	67	805	737	67	75	14	8	1	CORK SHEET TD 1120




REV:	DATE	DRAWN:	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE : GASKET DETAILS				
2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY:	SCALE: N/A	SIZE: A4	UNITS: mm	
REVIEWED BY:	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY:	DRAWING NO: DRW/CT-2237/81-1			
	DATE: 2020-11-10			REV: 00

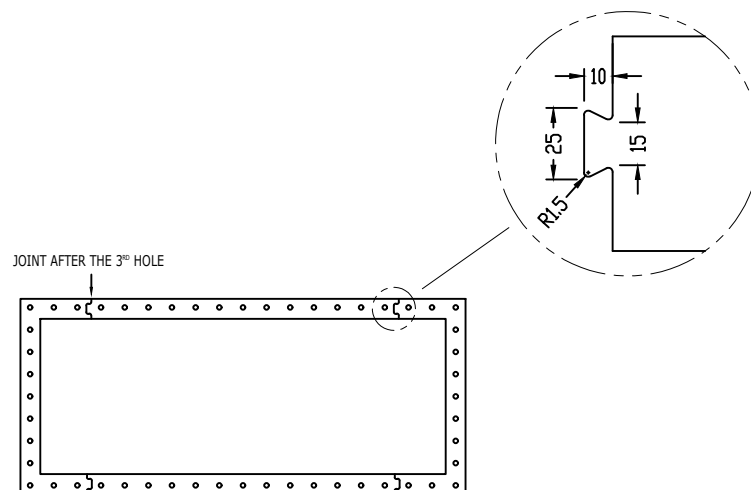


SHEET WIDTH = LW-2

ITEM	OD	ID	PCD	T	H	LW	QTY	MATERIAL
CONSERVATOR COVERS	572	472	522	8	14	50	1	CORK SHEET

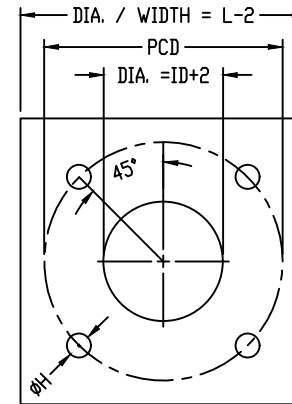


TYPE-A

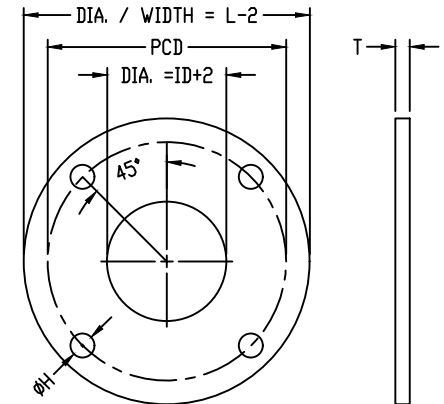


TYPE-B

ITEM	TYPE	L	ID	PCD	T	H	QTY	MATERIAL
CONSERVATOR SUPPORT FLANGE-I	A	75	26	72	8	12	3	CORK SHEET
CONSERVATOR SUPPORT FLANGE-II	B	115	25	85	8	14	2	
TANK FILTER FLANGE	B	115	25	85	8	14	1	
BREATHER EXTENSION FLANGE-III	B	105	28	75	8	14	1	
TANK SAMPLING FLANGE	B	80	15	55	8	12	1	

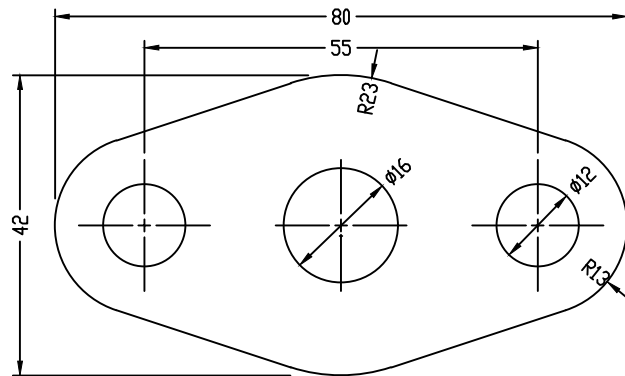





BREATHER CONNECTION GASKET
8mm / CORK SHEET (TD1120) / 1 NO.
(BREATHER DIN 42567)



CONSERVATOR FILLING CAP GASKET
4mm / CORK SHEET (TD1120) / 1 NO.

Issued for Production
30 JAN 2023
QA DEPT

CONTROLLED
IF GREEN

01	2023/01/30	THARINDU	FILTER VALVE CHANGED	EE-1
REV:	DATE	DRAWN:	DESCRIPTION	APPROVED BY
 LTL Transformers (Pvt) Ltd 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE: GASKET DETAILS 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: N/A	SIZE: A4	UNITS: mm	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/81-2	DATE: 2023-1-30	REV: 01	