


CONNECTION





Dyn5

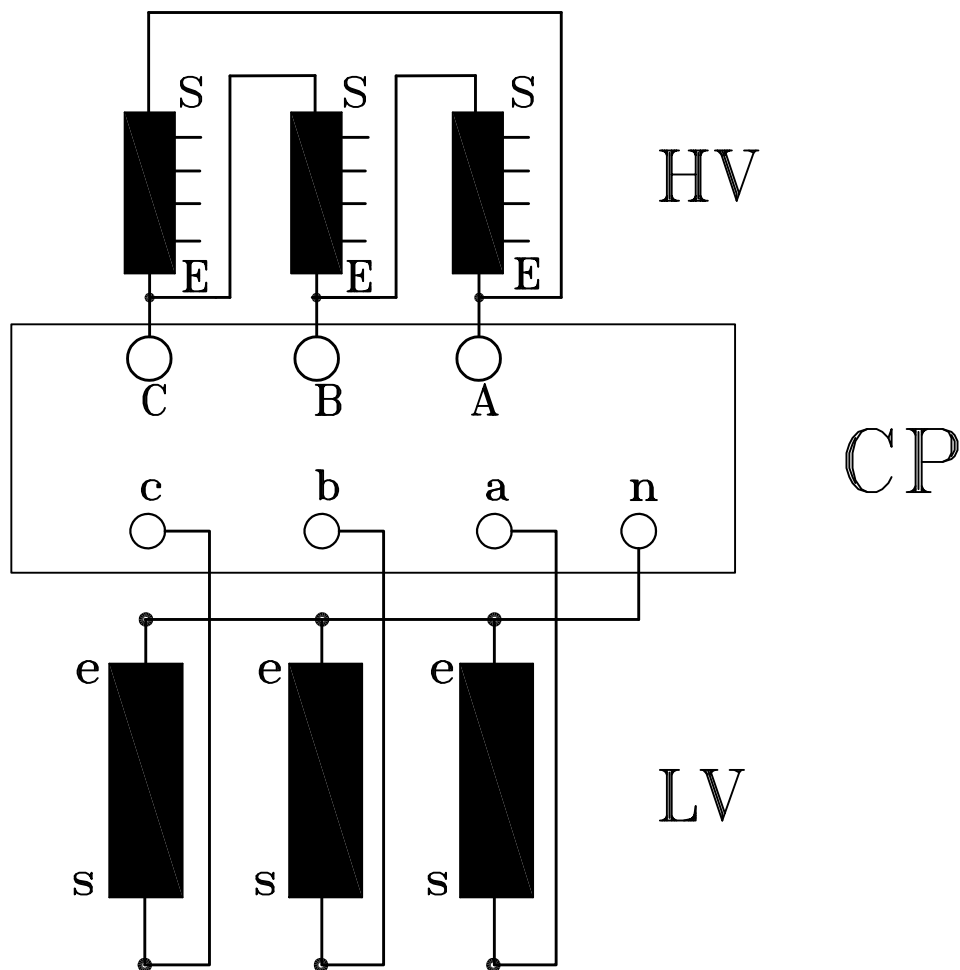

TAP POSITION	LOWER MARGIN	VALUE	UPPER MARGIN
1	13.57	13.64	13.71
2	13.25	13.32	13.38
3	12.93	12.99	13.06
4	12.60	12.67	12.73
5	12.28	12.34	12.40

Issued for Production
27 JAN 2023
QA DEPT

CONTROLLED
IF GREEN

REV	DATE	DRAWN	DESCRIPTION	APPROVED BY
	<div>LTL Transformers (Pvt) Ltd</div> <div>154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka</div>			
PROJECT: INSEE SIAM CITY CEMENT				
TITLE: TRANSFORMER CONNECTION & RATIO DIAGRAM				
2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE	N T S	SIZE: A4	UNITS: mm
REVIEWED BY: 	DRAWN BY	PRASHANTH		DESIGN NO:
APPROVED BY: 	DRAWING NO	DRW/CT-2237/7-1		
	DATE	2023/01/24		REV: 00