

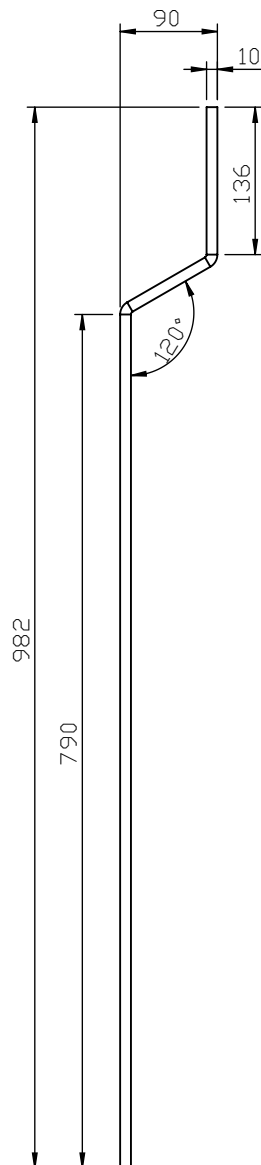


INSIDE LEAD  
120x10mm COPPER  
1NO .

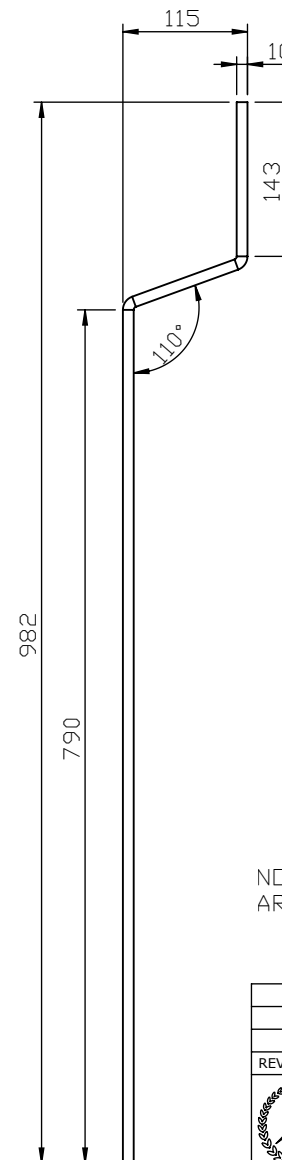


OUTSIDE LEAD  
120x10mm COPPER  
1NO .

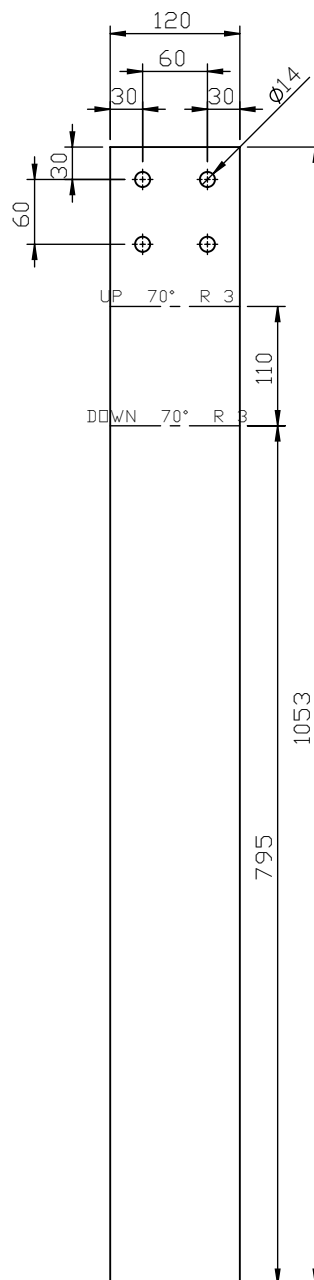

**ATTN: SUPDT. OF ASSEMBLE**  
USE M10x50 FOR NEUTRAL CONNECTION  
USE M10x40 OTHER CONNECTIONS



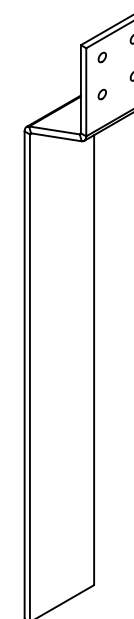

Issued for Production  
27 JAN 2023  
QA DEPT

CONTROLLED  
IF GREEN



NOTE: BELOW GIVEN QUANTITIES  
ARE REQUIRED FOR SINGLE WINDING

**GENERAL TOLERANCES UNLESS OTHERWISE SPECIFIED**  
HOLE SIZE  $\pm 0.05$  / HOLE C-C  $\pm 0.05$  / OTHER LINIER DIMENSIONS  $\pm 1$

REVISION NO.	DATE	DRAWN	DESCRIPTION	APPROVED BY
 <b>LTL Transformers (Pvt) Ltd</b> 154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka				
PROJECT: SIAM CITY CEMENT				
TITLE : <b>LV LEADS</b> 2000kVA 3.3kV/440V TRANSFORMER				
DESIGNED BY: 	SCALE: 1:6	UNITS: mm	SIZE: A4	
REVIEWED BY: 	DRAWN BY: PRASHANTH	DESIGN NO: 20003.3440		
APPROVED BY: 	DRAWING NO: DRW/CT-2237/1-1			
	DATE: 27/01/2023	REV:00		