



CONNECTION Dyn11

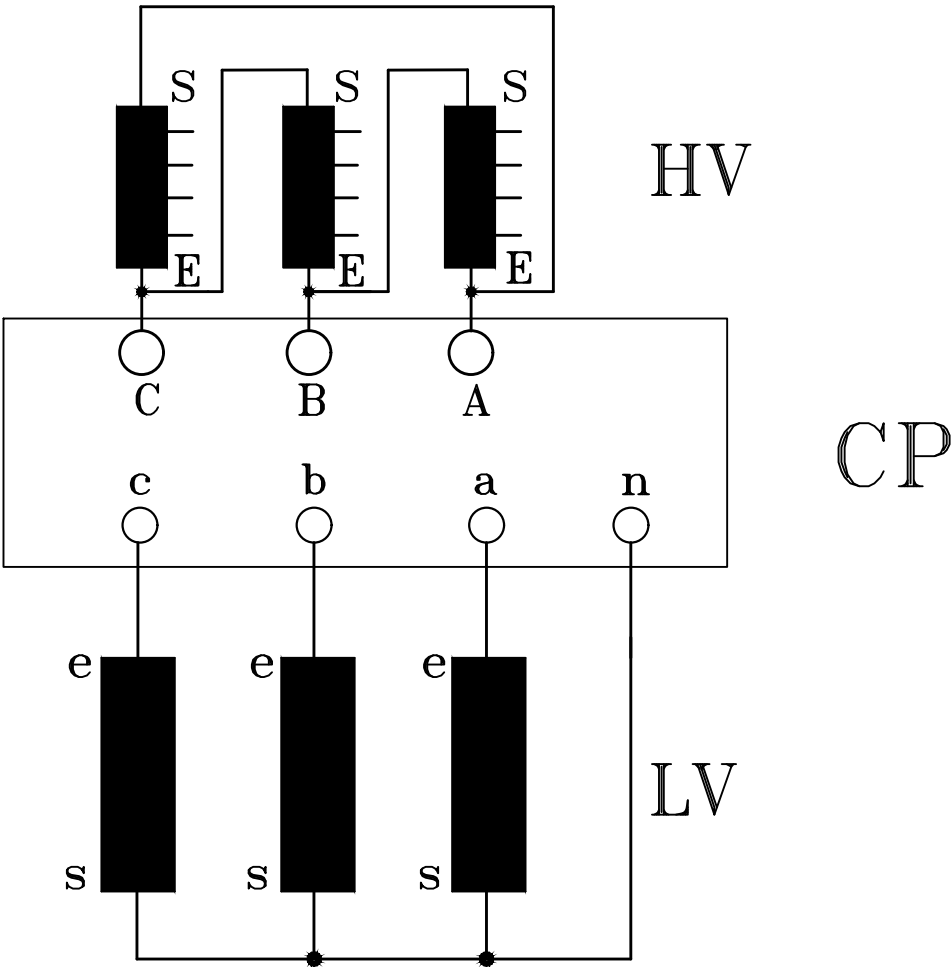

TAP POSITION	LOWER MARGIN	VALUE	UPPER MARGIN
1	49.76	50.01	50.26
2	48.58	48.82	49.07
3	47.39	47.63	47.87
4	46.21	46.44	46.67
5	45.02	45.25	45.48

REV	DATE	DRAWN	DESCRIPTION	APPROVED BY
<div><div></div><div><div>LTL Transformers (Pvt) Ltd</div><div>154/11, Railway Station Road, Angulana, Moratuwa, Sri Lanka</div></div></div>				
PROJECT: APS TANZANIA LIMITED				
TITLE: TRANSFORMER CONNECTION & RATIO DIAGRAM				
800kVA 11kV/400V TRANSFORMER				
DESIGNED BY:	SCALE	N T S	SIZE:A4	UNITS:mm
REVIEWED BY:	DRAWN BY	PRASHANTH	DESIGN NO:	
APPROVED BY:	DATE	2023/07/06	REV: 00	