


PowerWorld Simulator - Simulation Results


One-Line Diagram

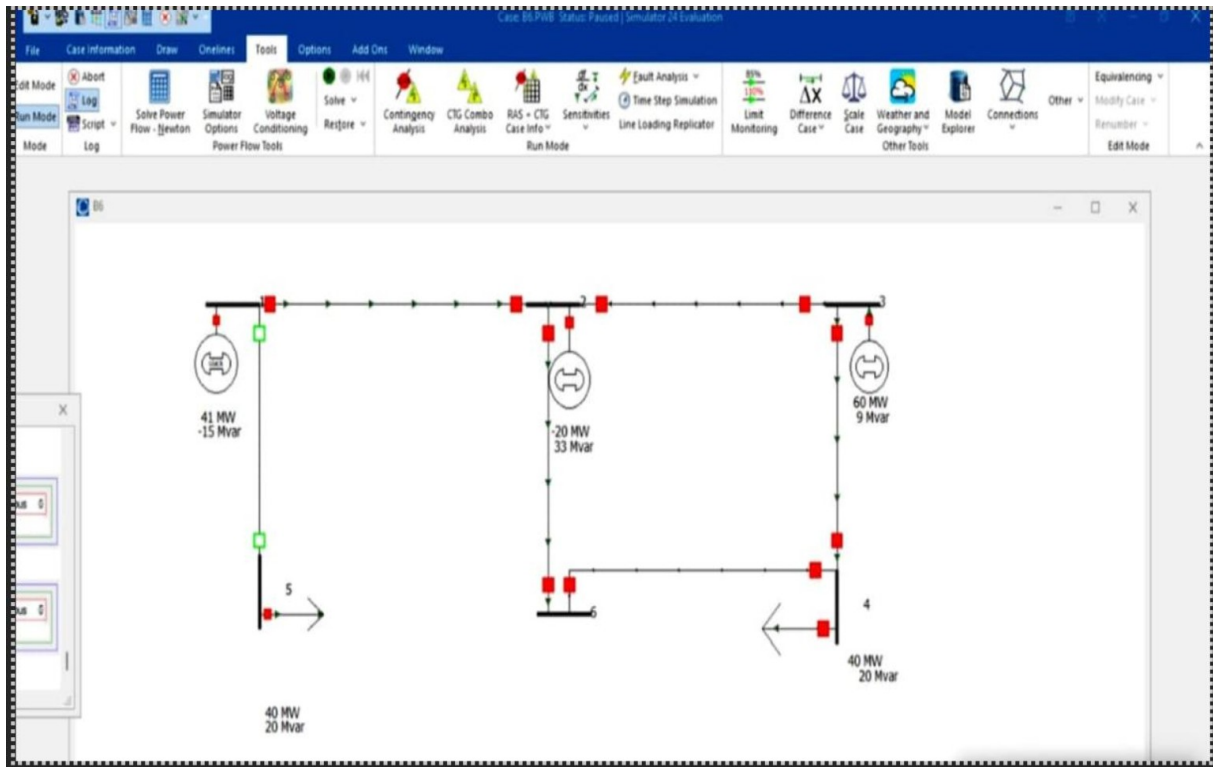


Voltage/Angle Results

Bus	Phase A (p.u.)	Phase B (p.u.)	Phase C (p.u.)	Angle A (°)	Angle B (°)	Angle C (°)
1	0.00000	1.10599	0.97977	170.54	-121.60	126.26
2	0.11876	1.09019	0.95411	-11.14	-120.13	124.20
3	0.16682	1.08458	0.94553	-4.62	-118.62	124.43
4	0.12789	1.08127	0.93747	-9.63	-120.37	124.15
5	0.04550	1.09269	0.95442	-18.24	-121.87	125.11
6	0.09686	1.08911	0.94982	-11.61	-120.83	124.49


Bus 1

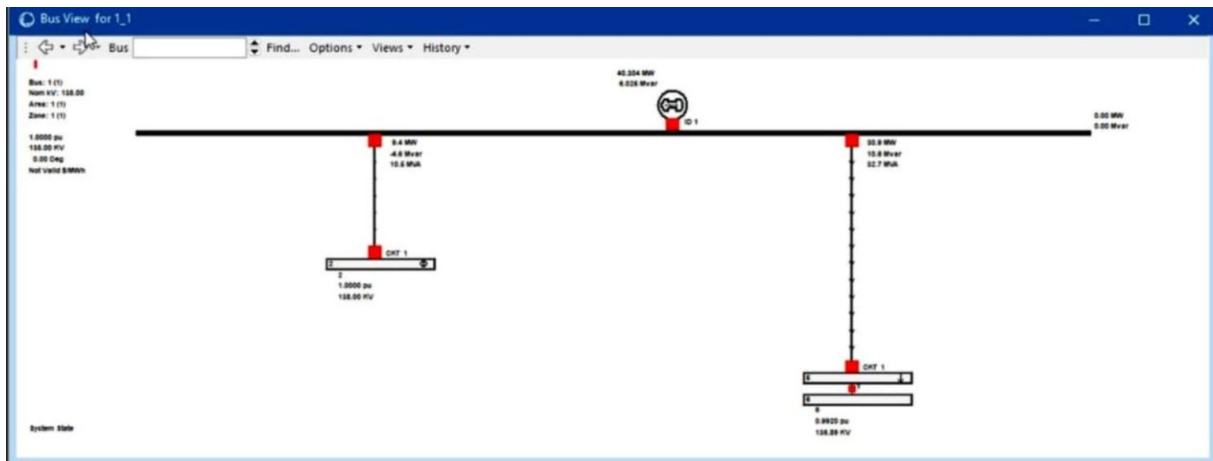


Bus 3

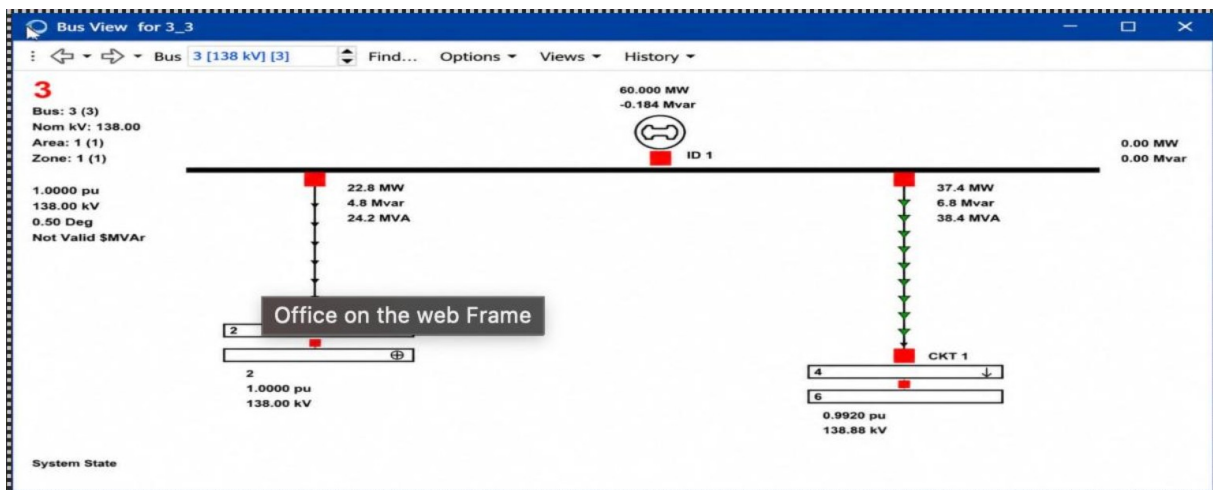


Bus 2

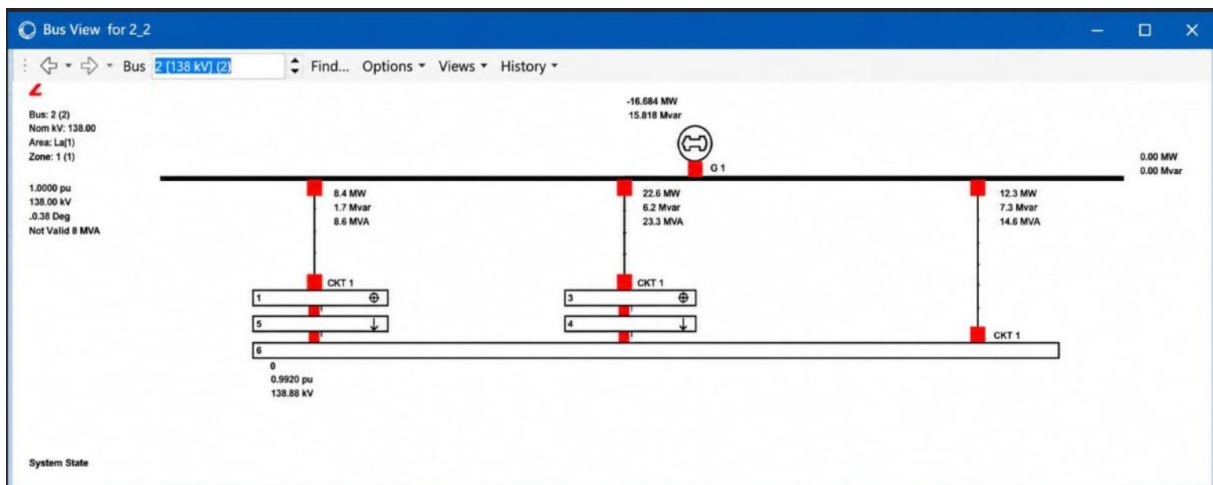


Bus 4

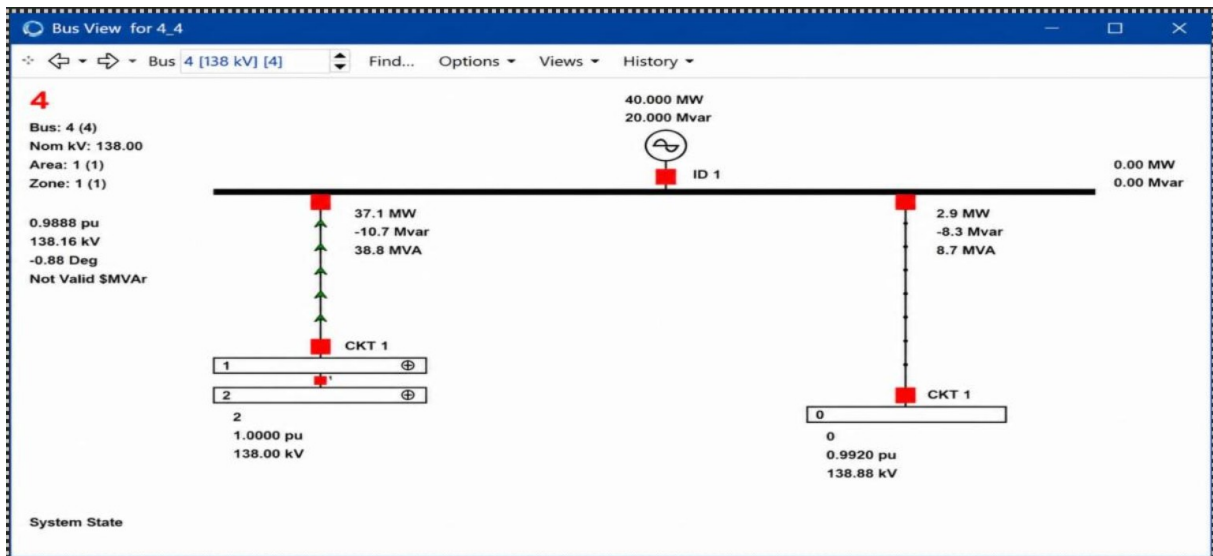

Bus 5

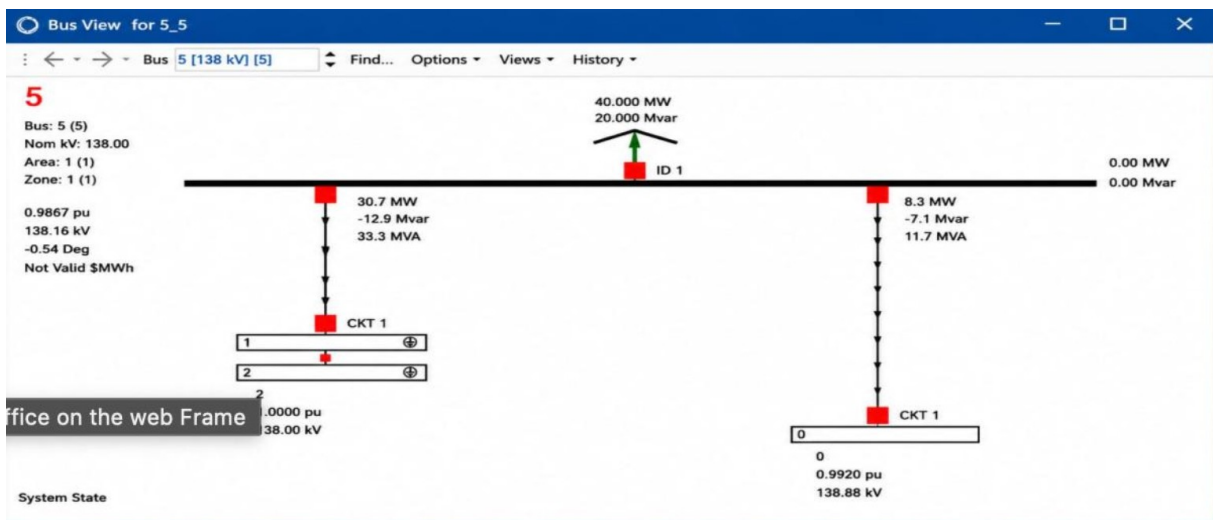

Bus 6

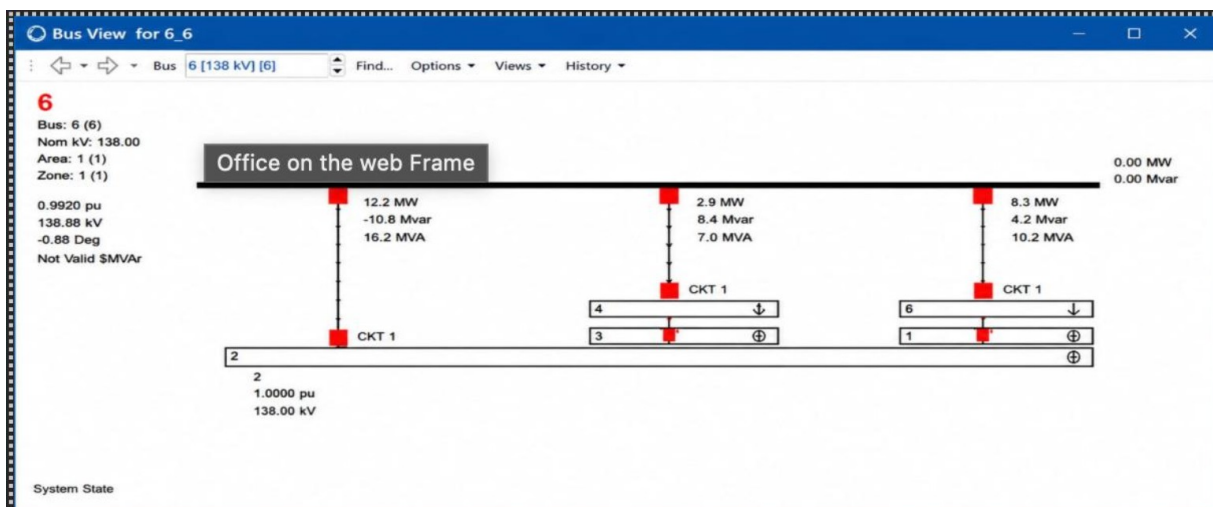

Bus Summary

Explore

Recent

Network

Branches By Type

Branches Input

Branches State

Buses

DC Transmission Line

Generators

Impedance Correction

Line D-FACIS Devices

Line Shunts

Loads

Mismatches

Multi-Terminal DC

Switched Shunts

Three-Winding Band

Transformer Controls

Voltage Control Grp

Voltage Droop Contr

VSC DC Transmission

Aggregations

Other Aggregations

Areas

Case Summary

Injection Groups

Interfaces

Islands

Multi-Section Lines

MW Transactions

Owners

Substations

Super Areas

Transfer Directions

Zones

Case Information and An

Open New Explorer

Buses

Filter Advanced

Bus

Find...

Remove

Quick Filter

Number	Name	Area Name	Nom kV	PV Volt	Volt (kV)	Angle (Deg)	Gen MW	Gen Mvar	Load MW	Load Mvar	Dist MW	Dist Mvar	Switched Shunts Mvar	Act G Shunt MW	Act S Shunt Mvar	Area Num
1	1 1	1	138.00	1.00000	138.000	0.00	40.30	6.02						0.00	0.00	1
2	2 2	1	138.00	1.00000	138.000	-0.36	-19.56	15.62						0.00	0.00	1
3	3 3	1	138.00	1.00000	138.000	-0.50	60.00	-0.19						0.00	0.00	1
4	4 4	1	138.00	0.98664	136.156	-0.63			40.00	20.00	0.00	0.00		0.00	0.00	1
5	5 5	1	138.00	0.98668	136.161	-0.94			40.00	20.00	0.00	0.00		0.00	0.00	1
6	6 6	1	138.00	0.99199	136.895	-0.68								0.00	0.00	1

Office on the web Frame

Search Search Now Options

Sum of the load MW at the bus