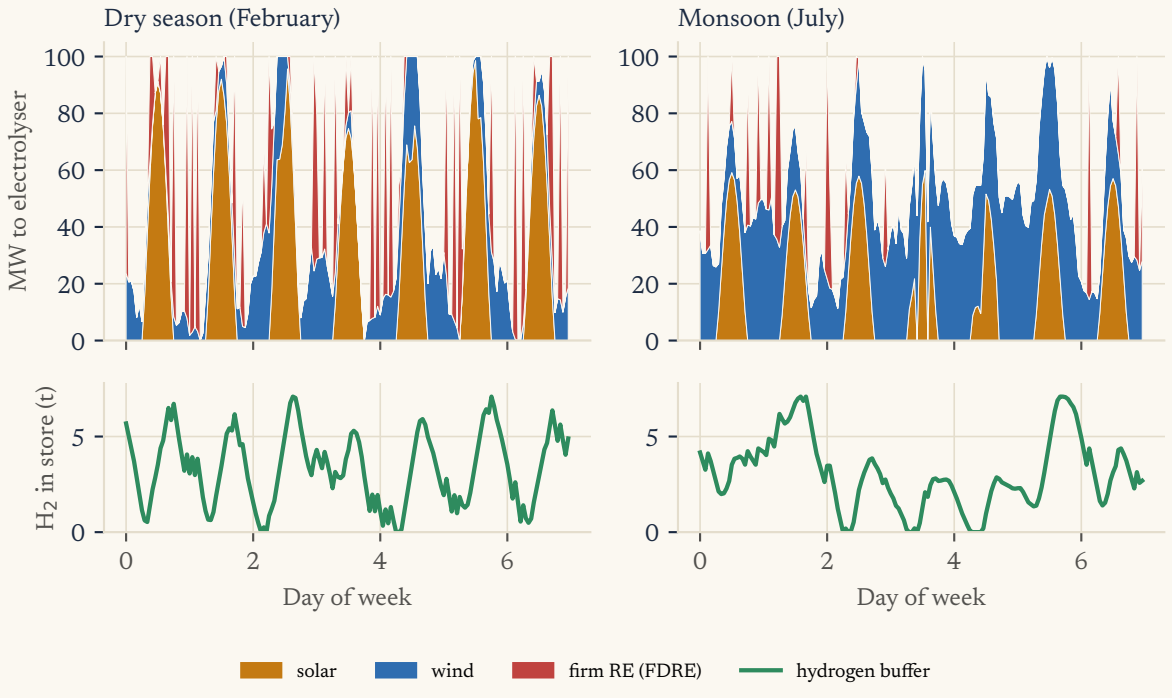
Dry season (February)
Monsoon (July)
MW to electrolyser
100
80
60
40
20
0
H_2 in store (t)
5
0
0
2
4
6
Day of week
solar
wind
firm RE (FDRE)
hydrogen buffer