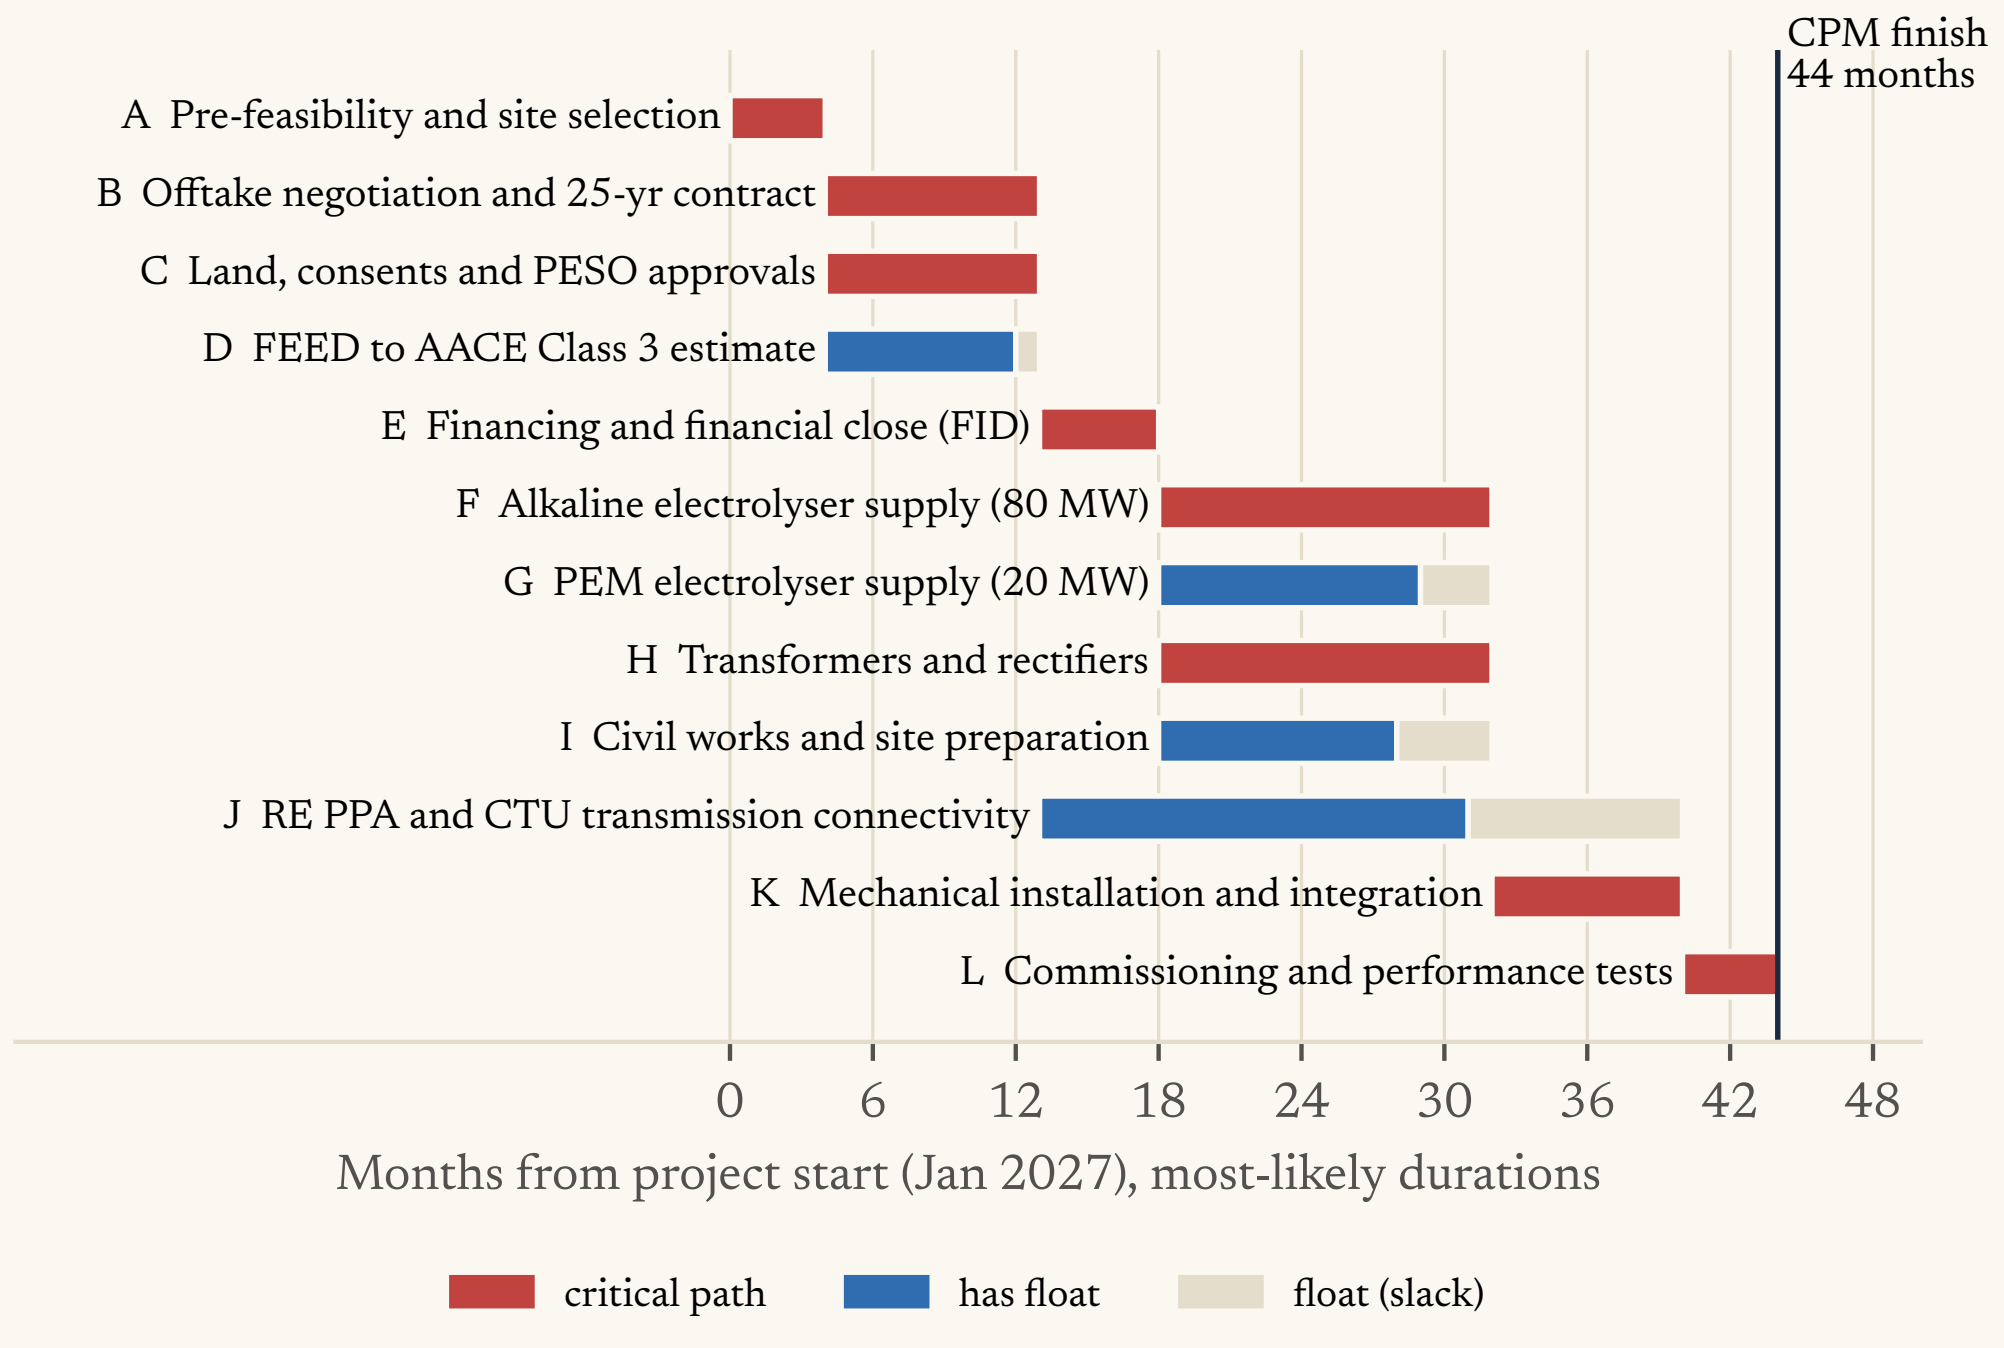
CPM finish
44 months
A Pre-feasibility and site selection
B Offtake negotiation and 25-yr contract
C Land, consents and PESO approvals
D FEED to AACE Class 3 estimate
E Financing and financial close (FID)
F Alkaline electrolyser supply (80 MW)
G PEM electrolyser supply (20 MW)
H Transformers and rectifiers
I Civil works and site preparation
J RE PPA and CTU transmission connectivity
K Mechanical installation and integration
L Commissioning and performance tests
0
6
12
18
24
30
36
42
48
Months from project start (Jan 2027), most-likely durations
critical path
has float
float (slack)