






CONT. ON DWG. JNE# 484000-04-2510

- NOTES:
1. REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
 2. REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
 3. REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS
 4. REFER TO EQUIPMENT LAYOUT DRAWINGS + MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION DETAIL.

 JNE CONSULTING LTD. <i>Professional Engineers</i> An ISO 9001:2000 Registered Company 175 Shaw Street, Hamilton, Ontario, Canada L8L 9P7 Tel: (905-528-9122, Fax: (905-528-9774, www.jne.ca		 ThyssenKrupp Steel USA Calvert, Alabama HDGL 1 - 4																																																															
Additional Information MAX. TOLERANCES <table border="1"> <tr> <td>42</td> <td>PT SPUNDED HOLE</td> <td>APR. 27/00</td> <td>G.S.</td> <td>Proprietary APPENDIX</td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>41</td> <td>PT SPUNDED HOLE</td> <td>AUG. 13/00</td> <td>G.S.</td> <td>Approved with</td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>40</td> <td>HOLES FOR CONSTRUCTION</td> <td>MAY 14/00</td> <td>G.S.</td> <td>Approved with</td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>30</td> <td>RE-ORDER FOR FINAL</td> <td>APR. 26/00</td> <td>G.S.</td> <td>RE-APP.</td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>20</td> <td>ORDER FOR FINAL</td> <td>OCT 09/99</td> <td>G.S.</td> <td></td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>12</td> <td>ORDER FOR MATH REVIEW</td> <td>OCT 21/99</td> <td>G.S.</td> <td></td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>10</td> <td>ORDER FOR MATH REVIEW</td> <td>APR. 26/99</td> <td>G.S.</td> <td></td> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> </table>		42	PT SPUNDED HOLE	APR. 27/00	G.S.	Proprietary APPENDIX	DATE	NAME	STATUS	41	PT SPUNDED HOLE	AUG. 13/00	G.S.	Approved with	DATE	NAME	STATUS	40	HOLES FOR CONSTRUCTION	MAY 14/00	G.S.	Approved with	DATE	NAME	STATUS	30	RE-ORDER FOR FINAL	APR. 26/00	G.S.	RE-APP.	DATE	NAME	STATUS	20	ORDER FOR FINAL	OCT 09/99	G.S.		DATE	NAME	STATUS	12	ORDER FOR MATH REVIEW	OCT 21/99	G.S.		DATE	NAME	STATUS	10	ORDER FOR MATH REVIEW	APR. 26/99	G.S.		DATE	NAME	STATUS	 <table border="1"> <tr> <td>DATE</td> <td>NAME</td> <td>STATUS</td> </tr> <tr> <td>APR 27/00</td> <td>G.S.</td> <td></td> </tr> </table>		DATE	NAME	STATUS	APR 27/00	G.S.	
42	PT SPUNDED HOLE	APR. 27/00	G.S.	Proprietary APPENDIX	DATE	NAME	STATUS																																																										
41	PT SPUNDED HOLE	AUG. 13/00	G.S.	Approved with	DATE	NAME	STATUS																																																										
40	HOLES FOR CONSTRUCTION	MAY 14/00	G.S.	Approved with	DATE	NAME	STATUS																																																										
30	RE-ORDER FOR FINAL	APR. 26/00	G.S.	RE-APP.	DATE	NAME	STATUS																																																										
20	ORDER FOR FINAL	OCT 09/99	G.S.		DATE	NAME	STATUS																																																										
12	ORDER FOR MATH REVIEW	OCT 21/99	G.S.		DATE	NAME	STATUS																																																										
10	ORDER FOR MATH REVIEW	APR. 26/99	G.S.		DATE	NAME	STATUS																																																										
DATE	NAME	STATUS																																																															
APR 27/00	G.S.																																																																
PROJECT NO. 03-48-4000-00		DRAWING NO. 484000-04-2509																																																															
CONVEYTEAM		CONVEYTEAM GmbH																																																															
427017.4944.KWP-3.42		427017.4944.KWP-3.42																																																															

ELECTRICAL ROOM PCR4 (E15S01P00)

CONT. ON DWG. JNE# 484000-04-2509

CONT. ON DWG. JNE# 484000-04-2513

CONT. ON DWG. JNE# 484000-04-2512

LEGEND


- 01 EMBEDDED CONDUIT NO.
- CMXXXX EMBEDDED CONDUIT SIZE (INCHES)
- PXXXXX JNE CABLE NUMBER
(SEE CABLE AND CONDUIT SCHEDULE FOR CMT CABLE ID REFERENCE)
- ALL CABLES SHALL HAVE CMT CABLE ID AT BOTH END

NOTES:

- REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
- REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
- REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS
- REFER TO EQUIPMENT LAYOUT DRAWINGS & MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION-DETAIL.

JNE CONSULTING LTD.
Professional Engineers
170 Glen Street, Hamilton, Ontario, Canada L8L 9T7
Tel: 905-528-6122, Fax: 905-528-6174, www.jne.ca

PROJECT No. 03-48-4800-00 DRAWING No. 484000-04-2511



ThyssenKrupp Steel USA

Calvert, Alabama
HDCI 1-4

Revised	By	Date	Revised	By	Date
42	NO UPDATED	2014/07/01	43	NO UPDATED	2014/07/01
41	NO UPDATED	2014/07/01	40	NO UPDATED	2014/07/01
39	NO UPDATED	2014/07/01	38	NO UPDATED	2014/07/01
37	NO UPDATED	2014/07/01	36	NO UPDATED	2014/07/01
35	NO UPDATED	2014/07/01	34	NO UPDATED	2014/07/01
33	NO UPDATED	2014/07/01	32	NO UPDATED	2014/07/01
31	NO UPDATED	2014/07/01	30	NO UPDATED	2014/07/01
29	NO UPDATED	2014/07/01	28	NO UPDATED	2014/07/01
27	NO UPDATED	2014/07/01	26	NO UPDATED	2014/07/01
25	NO UPDATED	2014/07/01	24	NO UPDATED	2014/07/01
23	NO UPDATED	2014/07/01	22	NO UPDATED	2014/07/01
21	NO UPDATED	2014/07/01	20	NO UPDATED	2014/07/01
19	NO UPDATED	2014/07/01	18	NO UPDATED	2014/07/01
17	NO UPDATED	2014/07/01	16	NO UPDATED	2014/07/01
15	NO UPDATED	2014/07/01	14	NO UPDATED	2014/07/01
13	NO UPDATED	2014/07/01	12	NO UPDATED	2014/07/01
11	NO UPDATED	2014/07/01	10	NO UPDATED	2014/07/01
9	NO UPDATED	2014/07/01	8	NO UPDATED	2014/07/01
7	NO UPDATED	2014/07/01	6	NO UPDATED	2014/07/01
5	NO UPDATED	2014/07/01	4	NO UPDATED	2014/07/01
3	NO UPDATED	2014/07/01	2	NO UPDATED	2014/07/01
1	NO UPDATED	2014/07/01	0	NO UPDATED	2014/07/01


NTS
HOT-DIP GALVANIZING LINE
HDGL 4

POWER CABLES
BLOCK-DIAGRAM
PCR4

CONVERTEAM 427017:4944.KWP-3.42

CONVERTEAM GmbH

CONT. ON DWG. JNE# 484000-04-2512

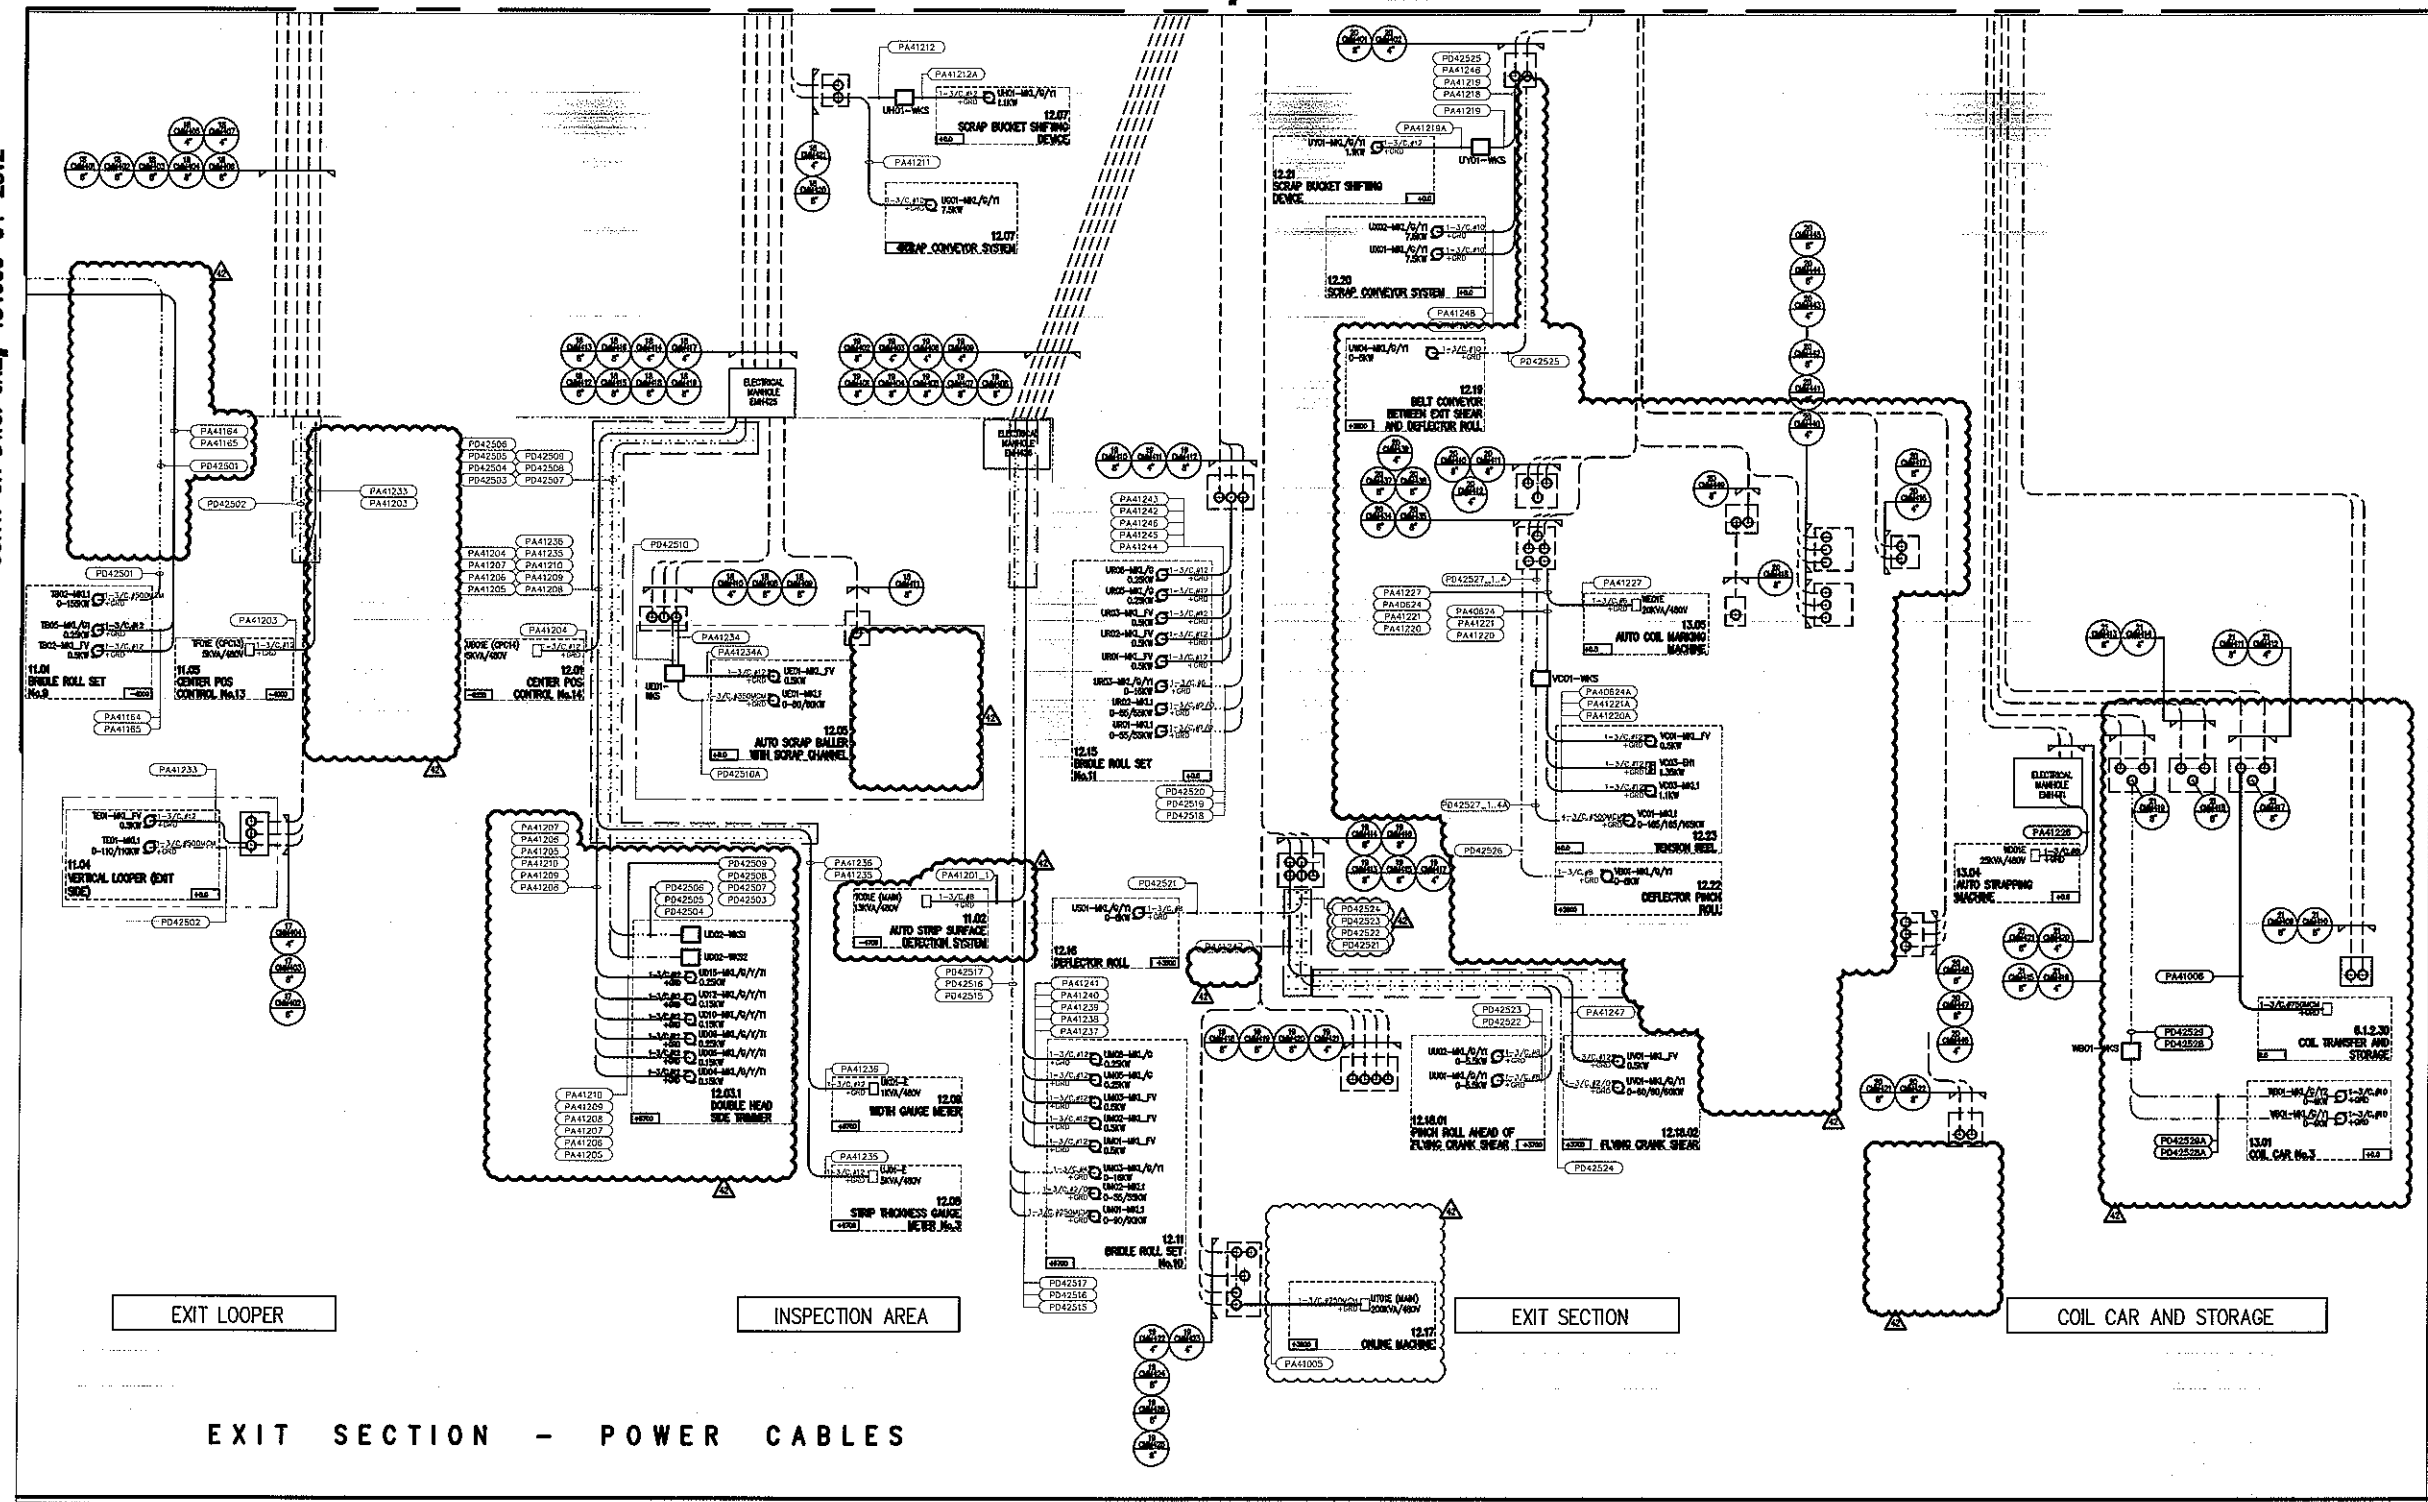


EXIT SECTION - POWER CABLES

LEGEND

- 01 EMBEDDED CONDUIT NO.
- XXXXXX EMBEDDED CONDUIT SIZE (INCHES)
- PXXXXX JNE CABLE NUMBER
(SEE CABLE AND CONDUIT SCHEDULE FOR CABLE ID REFERENCE)
- ALL CABLES SHALL HAVE CABLE ID AT BOTH END

NOTES:

1. REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
2. REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
3. REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS.
4. REFER TO EQUIPMENT LAYOUT DRAWINGS + MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION DETAIL.



ThyssenKrupp Steel USA

Calvert, Alabama
HDGL 1 - 4

JNE CONSULTING LTD.
Professional Engineers

178 Silver Street, Hamilton, Ontario, Canada L8L 9T7
TEL: 905-523-4122, Fax: 905-523-4174, www.jne.ca

PROJECT NO. 03-48-4000-00 DRAWING NO. 484000-04-2514

Revised	By	Date	Description	Revised	By	Date	Description
42	PC	07/03	PC UPDATED	43	PC	07/03	PC UPDATED
41	PC	07/03	PC UPDATED	42	PC	07/03	PC UPDATED
40	PC	07/03	PC UPDATED	41	PC	07/03	PC UPDATED
39	PC	07/03	PC UPDATED	40	PC	07/03	PC UPDATED
38	PC	07/03	PC UPDATED	39	PC	07/03	PC UPDATED
37	PC	07/03	PC UPDATED	38	PC	07/03	PC UPDATED
36	PC	07/03	PC UPDATED	37	PC	07/03	PC UPDATED
35	PC	07/03	PC UPDATED	36	PC	07/03	PC UPDATED
34	PC	07/03	PC UPDATED	35	PC	07/03	PC UPDATED
33	PC	07/03	PC UPDATED	34	PC	07/03	PC UPDATED
32	PC	07/03	PC UPDATED	33	PC	07/03	PC UPDATED
31	PC	07/03	PC UPDATED	32	PC	07/03	PC UPDATED
30	PC	07/03	PC UPDATED	31	PC	07/03	PC UPDATED
29	PC	07/03	PC UPDATED	30	PC	07/03	PC UPDATED
28	PC	07/03	PC UPDATED	29	PC	07/03	PC UPDATED
27	PC	07/03	PC UPDATED	28	PC	07/03	PC UPDATED
26	PC	07/03	PC UPDATED	27	PC	07/03	PC UPDATED
25	PC	07/03	PC UPDATED	26	PC	07/03	PC UPDATED
24	PC	07/03	PC UPDATED	25	PC	07/03	PC UPDATED
23	PC	07/03	PC UPDATED	24	PC	07/03	PC UPDATED
22	PC	07/03	PC UPDATED	23	PC	07/03	PC UPDATED
21	PC	07/03	PC UPDATED	22	PC	07/03	PC UPDATED
20	PC	07/03	PC UPDATED	21	PC	07/03	PC UPDATED
19	PC	07/03	PC UPDATED	20	PC	07/03	PC UPDATED
18	PC	07/03	PC UPDATED	19	PC	07/03	PC UPDATED
17	PC	07/03	PC UPDATED	18	PC	07/03	PC UPDATED
16	PC	07/03	PC UPDATED	17	PC	07/03	PC UPDATED
15	PC	07/03	PC UPDATED	16	PC	07/03	PC UPDATED
14	PC	07/03	PC UPDATED	15	PC	07/03	PC UPDATED
13	PC	07/03	PC UPDATED	14	PC	07/03	PC UPDATED
12	PC	07/03	PC UPDATED	13	PC	07/03	PC UPDATED
11	PC	07/03	PC UPDATED	12	PC	07/03	PC UPDATED
10	PC	07/03	PC UPDATED	11	PC	07/03	PC UPDATED
9	PC	07/03	PC UPDATED	10	PC	07/03	PC UPDATED
8	PC	07/03	PC UPDATED	9	PC	07/03	PC UPDATED
7	PC	07/03	PC UPDATED	8	PC	07/03	PC UPDATED
6	PC	07/03	PC UPDATED	7	PC	07/03	PC UPDATED
5	PC	07/03	PC UPDATED	6	PC	07/03	PC UPDATED
4	PC	07/03	PC UPDATED	5	PC	07/03	PC UPDATED
3	PC	07/03	PC UPDATED	4	PC	07/03	PC UPDATED
2	PC	07/03	PC UPDATED	3	PC	07/03	PC UPDATED
1	PC	07/03	PC UPDATED	2	PC	07/03	PC UPDATED

ELECTRICAL ROOM PCR3 (E11S01P00)

CONT. ON DWG. JNE# 484000-04-2527

CONT. ON DWG. JNE# 484000-04-2531

CONT. ON DWG. JNE# 484000-04-2528

CONT. ON DWG. JNE# 484000-04-2530

LEGEND

- OF CMMXXXX" EMBEDDED CONDUIT NO.
- XXXXXX EMBEDDED CONDUIT SIZE (INCHES)
- PXXXXXX JNE CABLE NUMBER
- (SEE CABLE AND CONDUIT SCHEDULE FOR CMT CABLE ID REFERENCE)
- ALL CABLES SHALL HAVE CMT CABLE ID AT BOTH ENDS

NOTES

- REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
- REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
- REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS
- REFER TO EQUIPMENT LAYOUT DRAWINGS + MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION DETAIL.

JNE CONSULTING LTD.
Professional Engineers
178 Shaw Street, Hamilton, Ontario, Canada L8L 9P7
Tel: 905-625-9122, Fax: 905-625-9124, www.jne.ca

PROJECT NO. 03-48-4000-00
DRAWING NO. 484000-04-2529

ThyssenKrupp Steel USA
Calvert, Alabama
HDGL 1 - 4

Revised	By	Date	Description
43	PC	07/20/03	PC UPDATED ISSUE
42	PC	07/20/03	PC UPDATED ISSUE
40	PC	07/20/03	PC UPDATED ISSUE
30	PC	07/20/03	PC UPDATED ISSUE
20	PC	07/20/03	PC UPDATED ISSUE
10	PC	07/20/03	PC UPDATED ISSUE
01	PC	07/20/03	PC UPDATED ISSUE


NTS
HOT DIP GALVANIZING LINE
HDGL 4
DRIVE CONTROL CABLES
BLOCK DIAGRAM
PCR3
427017.4944.KWP-3.42

CONVERTEAM
427017.4944.KWP-3.42

ELECTRICAL ROOM PCR4 (E15S01P00)

CONT. ON DWG. JNE# 484000-04-2529

CONT. ON DWG. JNE# 484000-04-2533

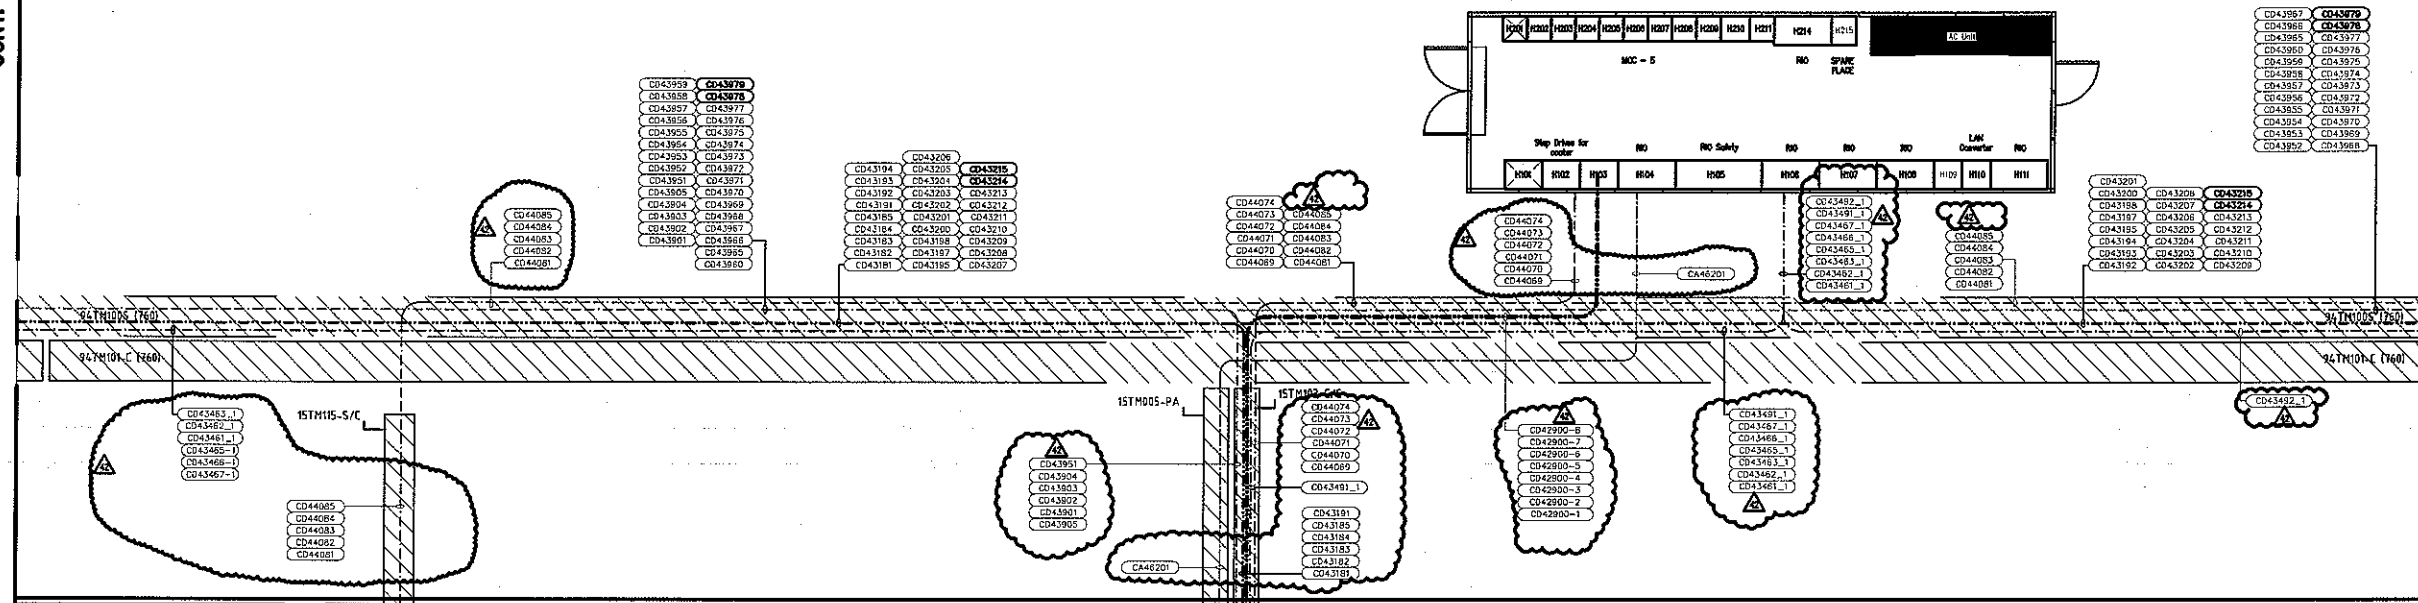

CONT. ON DWG. JNE# 484000-04-2532

LEGEND

- 01 EMBEDDED CONDUIT NO.
- EMBEDDED CONDUIT SIZE (INCHES)
- JNE CABLE NUMBER
(SEE CABLE AND CONDUIT SCHEDULE FOR CABLE ID REFERENCE)
- ALL CABLES SHALL HAVE CABLE ID AT BOTH END

NOTES:

- REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
- REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
- REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS.
- REFER TO EQUIPMENT LAYOUT DRAWINGS + MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION DETAIL.

JNE CONSULTING LTD.
Professional Engineers
170 River Street, Hamilton, Ontario, Canada L8L 3P7
Tel: 905-528-6122, Fax: 905-528-6174, www.jne.ca

PROJECT NO. 03-48-4000-00 DRAWING NO. 484000-04-2531



ThyssenKrupp Steel USA

Colvert, Alabama
HDGL 1 - 4

Material	Quantity	Unit	Notes
42	10	FT	PC UPWARD BULK
41	10	FT	PC UPWARD BULK
40	10	FT	PC UPWARD BULK
39	10	FT	PC UPWARD BULK
38	10	FT	PC UPWARD BULK
37	10	FT	PC UPWARD BULK
36	10	FT	PC UPWARD BULK
35	10	FT	PC UPWARD BULK
34	10	FT	PC UPWARD BULK
33	10	FT	PC UPWARD BULK
32	10	FT	PC UPWARD BULK
31	10	FT	PC UPWARD BULK
30	10	FT	PC UPWARD BULK
29	10	FT	PC UPWARD BULK
28	10	FT	PC UPWARD BULK
27	10	FT	PC UPWARD BULK
26	10	FT	PC UPWARD BULK
25	10	FT	PC UPWARD BULK
24	10	FT	PC UPWARD BULK
23	10	FT	PC UPWARD BULK
22	10	FT	PC UPWARD BULK
21	10	FT	PC UPWARD BULK
20	10	FT	PC UPWARD BULK
19	10	FT	PC UPWARD BULK
18	10	FT	PC UPWARD BULK
17	10	FT	PC UPWARD BULK
16	10	FT	PC UPWARD BULK
15	10	FT	PC UPWARD BULK
14	10	FT	PC UPWARD BULK
13	10	FT	PC UPWARD BULK
12	10	FT	PC UPWARD BULK
11	10	FT	PC UPWARD BULK
10	10	FT	PC UPWARD BULK
9	10	FT	PC UPWARD BULK
8	10	FT	PC UPWARD BULK
7	10	FT	PC UPWARD BULK
6	10	FT	PC UPWARD BULK
5	10	FT	PC UPWARD BULK
4	10	FT	PC UPWARD BULK
3	10	FT	PC UPWARD BULK
2	10	FT	PC UPWARD BULK
1	10	FT	PC UPWARD BULK

CONT. ON DWG. NE# 48400-04-2531



EMBEDDED CONDUIT NO.

EMBEDDED CONDUIT SIZE (INCHES)

JNE CABLE NUMBER _____
(SEE CABLE AND CONDUIT SCHEDULE FOR CVT CABLE ID REFERENCE)
ALL CABLES SHALL HAVE CVT CABLE ID AT BOTH END

1. REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
2. REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
3. REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS
4. REFER TO EQUIPMENT LAYOUT DRAWINGS + MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION DETAIL

ThyssenKrupp Steel USA
Calvert, Alabama
HDG-1 - 4


[illegible]

JNE CONSULTING LTD.
Professional Engineers
 Attn: 905-523-9122 Registered Company
 178 Shaw Street, Hamilton, Ontario, Canada L8L 2P7
 Tel: 905-523-9122, Fax: 905-523-9174, www.jne.ca

PROJECT No.	DRAWING No.
03-48-4000-00	484000-04-25

CONT. ON DWG. JNE# 484000-04-2533

CONT. ON DWG. JNE# 484000-04-2532

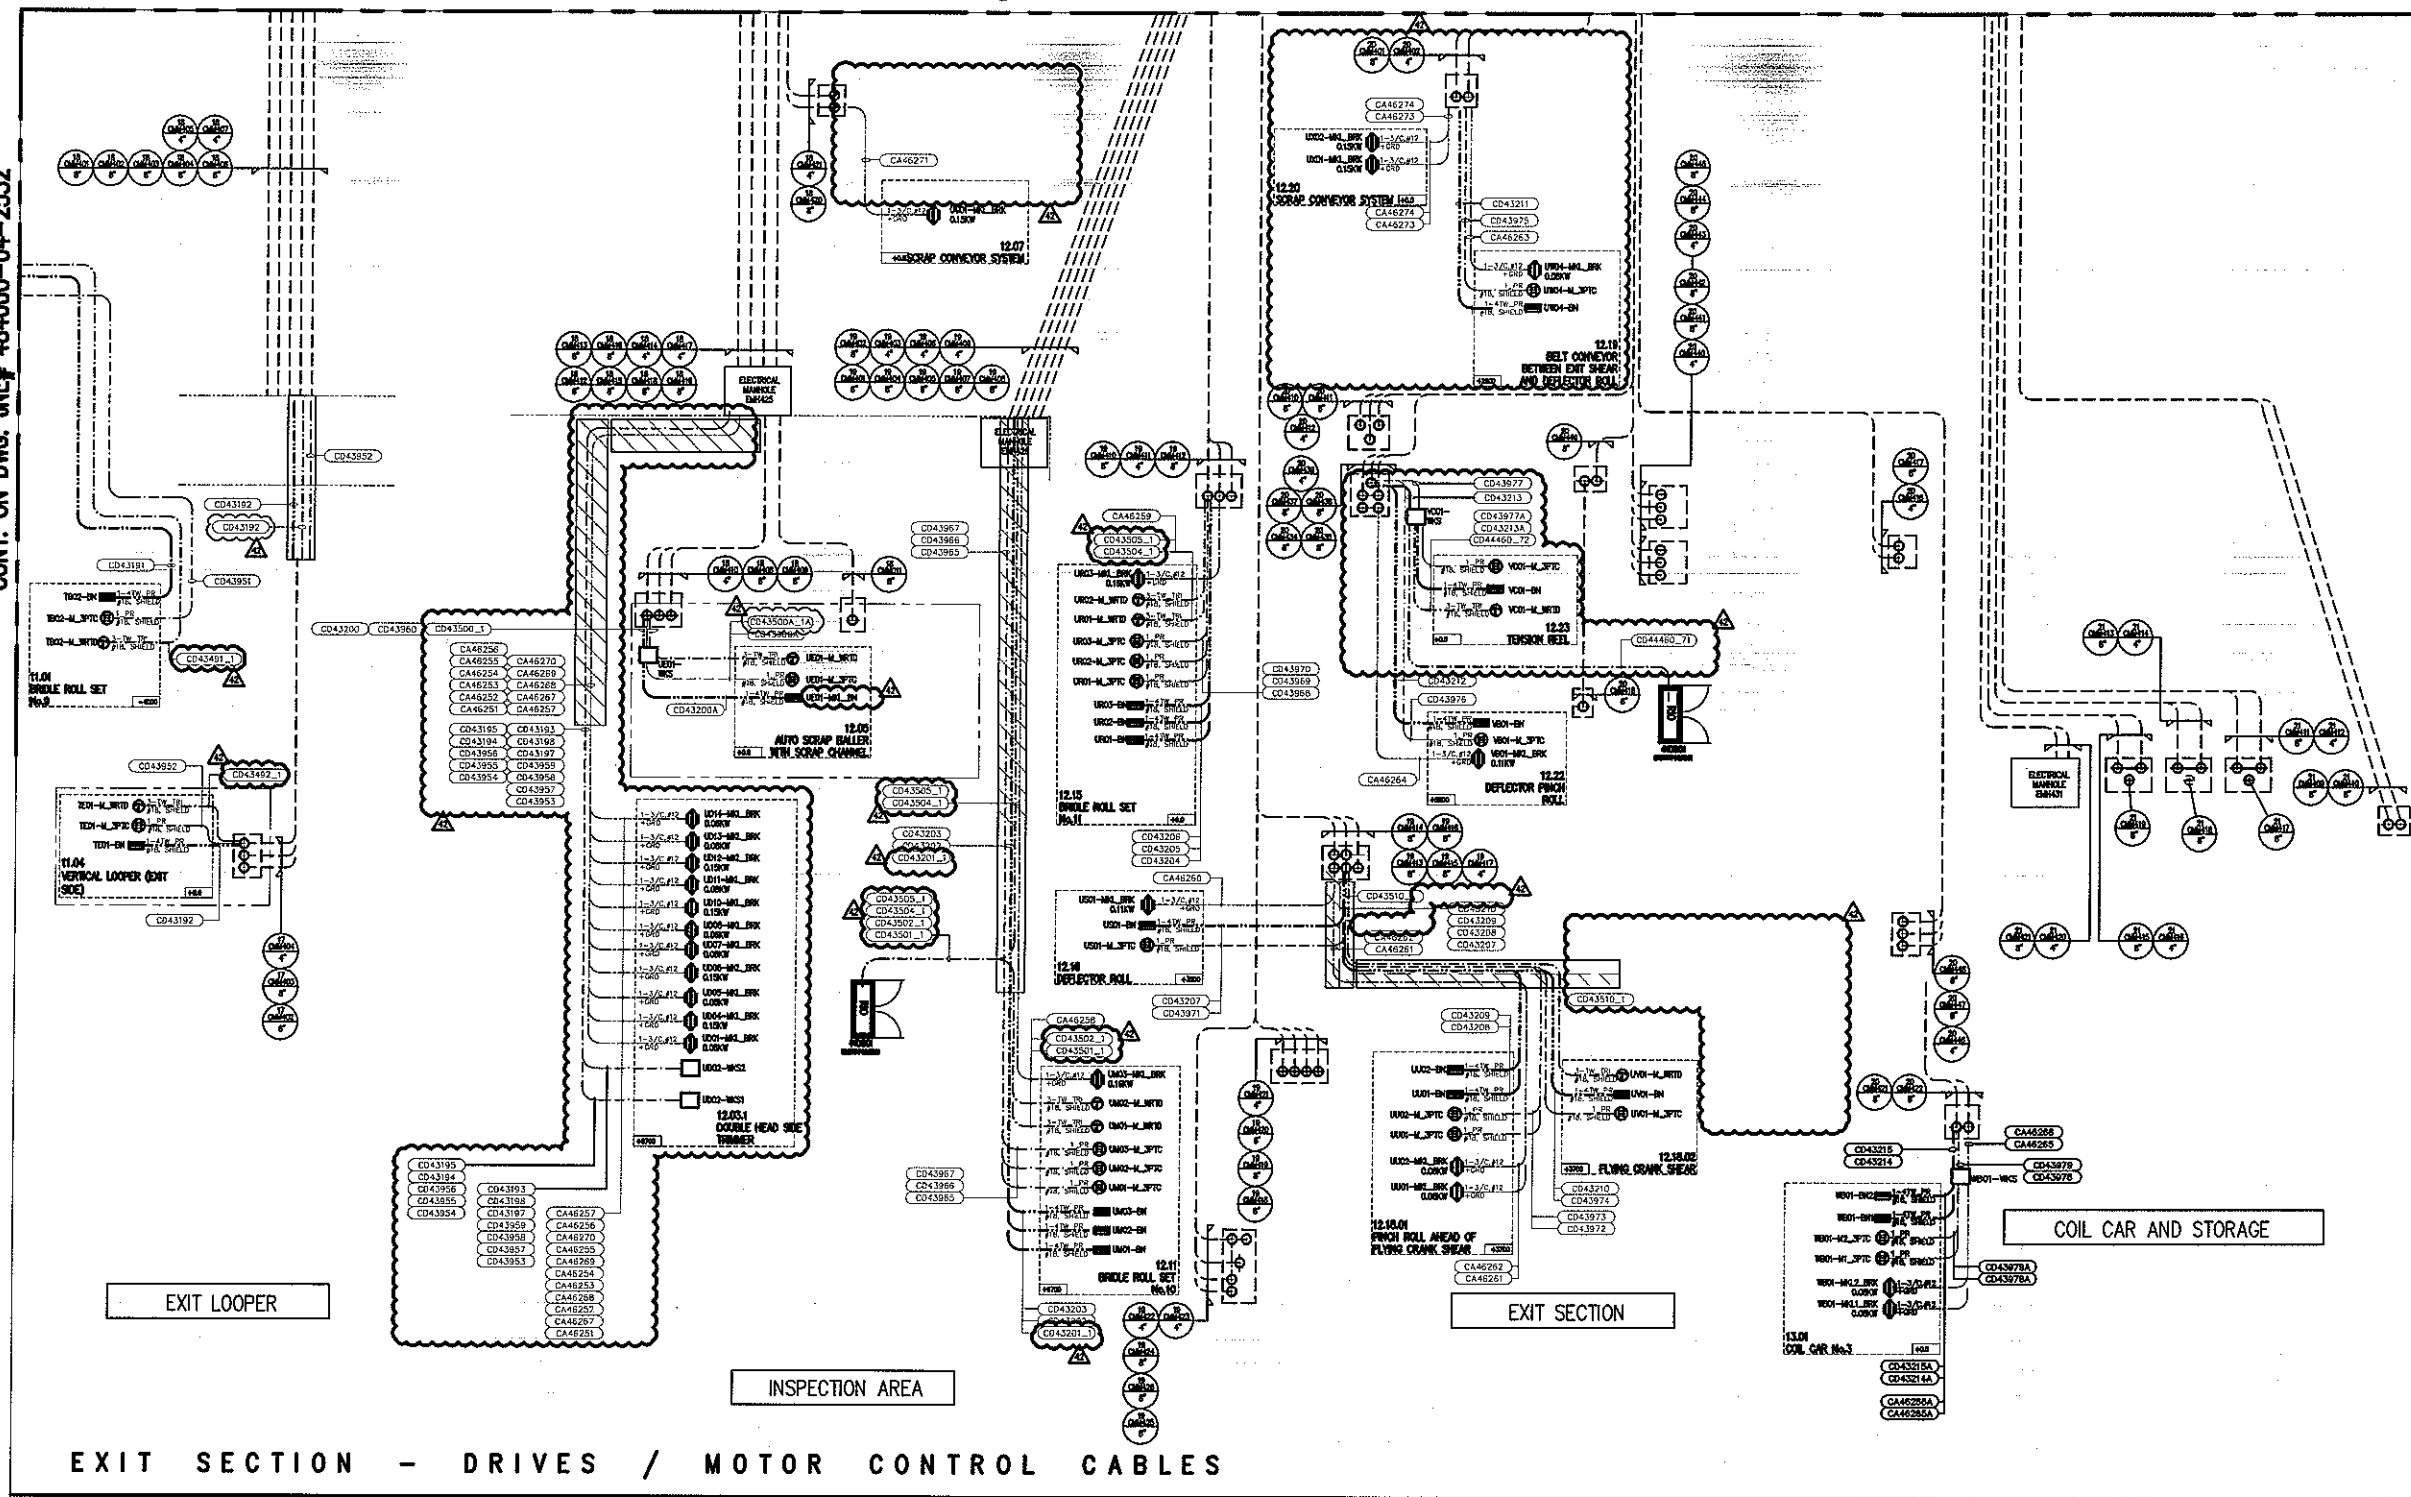

LEGEND

- 01 EMBEDDED CONDUIT NO.
- CMXXXXX EMBEDDED CONDUIT SIZE (INCHES)
- PXXXXXX JNE CABLE NUMBER

(SEE CABLE AND CONDUIT SCHEDULE FOR CMT CABLE ID REFERENCE)
ALL CABLES SHALL HAVE CMT CABLE ID AT BOTH END

NOTES:

1. REFER TO CABLE TRAY LAYOUT DRAWINGS FOR EXACT DETAIL TRAY LOCATION.
2. REFER TO EMBEDDED CONDUIT LAYOUT DRAWINGS FOR EXACT DETAIL CONDUITS LOCATION.
3. REFER TO CABLE AND CONDUIT SCHEDULES FOR CABLE TYPE AND SPECIFICATION DETAILS.
4. REFER TO EQUIPMENT LAYOUT DRAWINGS + MECHANICAL LAYOUT DRAWINGS FOR EXACT EQUIPMENT LOCATION DETAIL.



ThyssenKrupp Steel USA

Calvert, Alabama
HDGL 1 - 4

JNE CONSULTING LTD.
Professional Engineers
170 Shaw Street, Hamilton, Ontario, Canada L8L 3P7
Tel: 905-528-0122, Fax: 905-528-2074, www.jne.ca

PROJECT NO. 03-48-4000-00 DRAWING NO. 484000-04-2534

NO.	DESCRIPTION	DATE	BY	CHKD	APP'D
1	ISSUED FOR PERMITS	APR 27/00	SA		
2	REVISED FOR PERMITS	MAY 14/00	SA		
3	REVISED FOR PERMITS	MAY 14/00	SA		
4	REVISED FOR PERMITS	MAY 14/00	SA		
5	REVISED FOR PERMITS	MAY 14/00	SA		
6	REVISED FOR PERMITS	MAY 14/00	SA		
7	REVISED FOR PERMITS	MAY 14/00	SA		
8	REVISED FOR PERMITS	MAY 14/00	SA		
9	REVISED FOR PERMITS	MAY 14/00	SA		
10	REVISED FOR PERMITS	MAY 14/00	SA		
11	REVISED FOR PERMITS	MAY 14/00	SA		
12	REVISED FOR PERMITS	MAY 14/00	SA		
13	REVISED FOR PERMITS	MAY 14/00	SA		
14	REVISED FOR PERMITS	MAY 14/00	SA		
15	REVISED FOR PERMITS	MAY 14/00	SA		
16	REVISED FOR PERMITS	MAY 14/00	SA		
17	REVISED FOR PERMITS	MAY 14/00	SA		
18	REVISED FOR PERMITS	MAY 14/00	SA		
19	REVISED FOR PERMITS	MAY 14/00	SA		
20	REVISED FOR PERMITS	MAY 14/00	SA		
21	REVISED FOR PERMITS	MAY 14/00	SA		
22	REVISED FOR PERMITS	MAY 14/00	SA		
23	REVISED FOR PERMITS	MAY 14/00	SA		
24	REVISED FOR PERMITS	MAY 14/00	SA		
25	REVISED FOR PERMITS	MAY 14/00	SA		
26	REVISED FOR PERMITS	MAY 14/00	SA		
27	REVISED FOR PERMITS	MAY 14/00	SA		
28	REVISED FOR PERMITS	MAY 14/00	SA		
29	REVISED FOR PERMITS	MAY 14/00	SA		
30	REVISED FOR PERMITS	MAY 14/00	SA		
31	REVISED FOR PERMITS	MAY 14/00	SA		
32	REVISED FOR PERMITS	MAY 14/00	SA		
33	REVISED FOR PERMITS	MAY 14/00	SA		
34	REVISED FOR PERMITS	MAY 14/00	SA		
35	REVISED FOR PERMITS	MAY 14/00	SA		
36	REVISED FOR PERMITS	MAY 14/00	SA		
37	REVISED FOR PERMITS	MAY 14/00	SA		
38	REVISED FOR PERMITS	MAY 14/00	SA		
39	REVISED FOR PERMITS	MAY 14/00	SA		
40	REVISED FOR PERMITS	MAY 14/00	SA		
41	REVISED FOR PERMITS	MAY 14/00	SA		
42	REVISED FOR PERMITS	MAY 14/00	SA		
43	REVISED FOR PERMITS	MAY 14/00	SA		
44	REVISED FOR PERMITS	MAY 14/00	SA		
45	REVISED FOR PERMITS	MAY 14/00	SA		
46	REVISED FOR PERMITS	MAY 14/00	SA		
47	REVISED FOR PERMITS	MAY 14/00	SA		
48	REVISED FOR PERMITS	MAY 14/00	SA		
49	REVISED FOR PERMITS	MAY 14/00	SA		
50	REVISED FOR PERMITS	MAY 14/00	SA		
51	REVISED FOR PERMITS	MAY 14/00	SA		
52	REVISED FOR PERMITS	MAY 14/00	SA		
53	REVISED FOR PERMITS	MAY 14/00	SA		
54	REVISED FOR PERMITS	MAY 14/00	SA		
55	REVISED FOR PERMITS	MAY 14/00	SA		
56	REVISED FOR PERMITS	MAY 14/00	SA		
57	REVISED FOR PERMITS	MAY 14/00	SA		
58	REVISED FOR PERMITS	MAY 14/00	SA		
59	REVISED FOR PERMITS	MAY 14/00	SA		
60	REVISED FOR PERMITS	MAY 14/00	SA		
61	REVISED FOR PERMITS	MAY 14/00	SA		
62	REVISED FOR PERMITS	MAY 14/00	SA		
63	REVISED FOR PERMITS	MAY 14/00	SA		
64	REVISED FOR PERMITS	MAY 14/00	SA		
65	REVISED FOR PERMITS	MAY 14/00	SA		
66	REVISED FOR PERMITS	MAY 14/00	SA		
67	REVISED FOR PERMITS	MAY 14/00	SA		
68	REVISED FOR PERMITS	MAY 14/00	SA		
69	REVISED FOR PERMITS	MAY 14/00	SA		
70	REVISED FOR PERMITS	MAY 14/00	SA		
71	REVISED FOR PERMITS	MAY 14/00	SA		
72	REVISED FOR PERMITS	MAY 14/00	SA		
73	REVISED FOR PERMITS	MAY 14/00	SA		
74	REVISED FOR PERMITS	MAY 14/00	SA		
75	REVISED FOR PERMITS	MAY 14/00	SA		
76	REVISED FOR PERMITS	MAY 14/00	SA		
77	REVISED FOR PERMITS	MAY 14/00	SA		
78	REVISED FOR PERMITS	MAY 14/00	SA		
79	REVISED FOR PERMITS	MAY 14/00	SA		
80	REVISED FOR PERMITS	MAY 14/00	SA		
81	REVISED FOR PERMITS	MAY 14/00	SA		
82	REVISED FOR PERMITS	MAY 14/00	SA		
83	REVISED FOR PERMITS	MAY 14/00	SA		
84	REVISED FOR PERMITS	MAY 14/00	SA		
85	REVISED FOR PERMITS	MAY 14/00	SA		
86	REVISED FOR PERMITS	MAY 14/00	SA		
87	REVISED FOR PERMITS	MAY 14/00	SA		
88	REVISED FOR PERMITS	MAY 14/00	SA		
89	REVISED FOR PERMITS	MAY 14/00	SA		
90	REVISED FOR PERMITS	MAY 14/00	SA		
91	REVISED FOR PERMITS	MAY 14/00	SA		
92	REVISED FOR PERMITS	MAY 14/00	SA		
93	REVISED FOR PERMITS	MAY 14/00	SA		
94	REVISED FOR PERMITS	MAY 14/00	SA		
95	REVISED FOR PERMITS	MAY 14/00	SA		
96	REVISED FOR PERMITS	MAY 14/00	SA		
97	REVISED FOR PERMITS	MAY 14/00	SA		
98	REVISED FOR PERMITS	MAY 14/00	SA		
99	REVISED FOR PERMITS	MAY 14/00	SA		
100	REVISED FOR PERMITS	MAY 14/00	SA		

HOT DIP GALVANIZING LINE
HDGL 4
DRIVE CONTROL CABLES
BLOCK DIAGRAM
EXIT SECTION

CONVERTEAM 427017.4944.KWP-3.42

CONVERTEAM GmbH