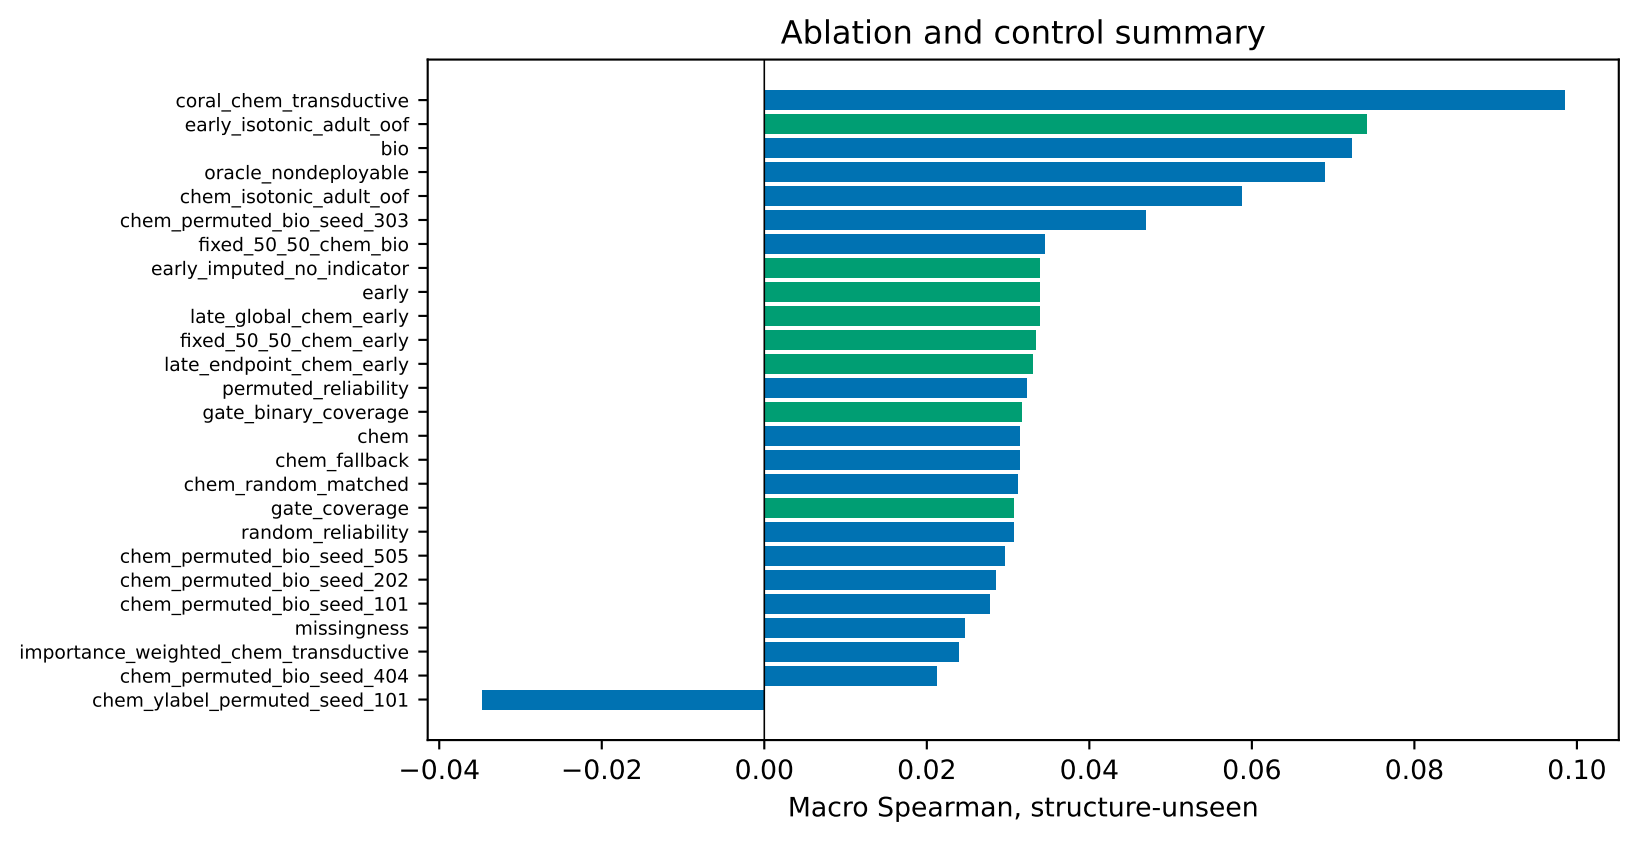
Ablation and control summary
coral_chem_transductive
early_isotonic_adult_oof
bio
oracle_nondeployable
chem_isotonic_adult_oof
chem_permuted_bio_seed_303
fixed_50_50_chem_bio
early_imputed_no_indicator
early
late_global_chem_early
fixed_50_50_chem_early
late_endpoint_chem_early
permuted_reliability
gate_binary_coverage
chem
chem_fallback
chem_random_matched
gate_coverage
random_reliability
chem_permuted_bio_seed_505
chem_permuted_bio_seed_202
chem_permuted_bio_seed_101
missingness
importance_weighted_chem_transductive
chem_permuted_bio_seed_404
chem_ylabel_permuted_seed_101
−0.04
−0.02
0.00
0.02
0.04
0.06
0.08
0.10
Macro Spearman, structure-unseen